



# 2022 Annual Groundwater Monitoring and Corrective Action Report - Former Emery Pond

**Southern Illinois Power Cooperative Marion Power Plant**

Prepared Pursuant to 40 CFR §257.90(e)

Submitted to:

**Southern Illinois Power Cooperative**

11543 Lake of Egypt Road  
Marion, Illinois 62959

Submitted by:

**WSP USA Inc.**

10 Al Paul Lane, Suite 103  
Merrimack, NH 03054

GL21467997.001

January 31, 2023

# Table of Contents

<b>1.0 INTRODUCTION .....</b>	<b>1</b>
1.1 Key Actions Completed - 2022.....	1
<b>2.0 STATUS OF PERMIT APPLICATIONS.....</b>	<b>2</b>
<b>3.0 SITE INFORMATION .....</b>	<b>2</b>
3.1 Monitoring Well Network .....	2
3.2 Geology and Hydrogeology.....	2
3.2.1 Geology.....	2
3.2.2 Site Hydrogeology.....	3
3.2.3 Groundwater Flow.....	3
<b>4.0 FIELD ACTIVITIES .....</b>	<b>5</b>
4.1 Problems Encountered and Follow-Up Corrective Actions .....	5
<b>5.0 GROUNDWATER MONITORING PROGRAM RESULTS.....</b>	<b>5</b>
5.1 Background Monitoring .....	5
5.2 Corrective Action .....	7
<b>6.0 STATISTICAL EVALUATION.....</b>	<b>7</b>
6.1 Third Corrective Action Monitoring Event Statistical Analysis .....	8
6.2 Fourth Corrective Action Monitoring Event Statistical Analysis .....	9
6.3 Fifth Corrective Action Monitoring Event Statistical Analysis.....	9
6.4 Sixth Corrective Action Monitoring Event Statistical Analysis.....	9
6.5 Seventh Corrective Action Monitoring Event Statistical Evaluation .....	10
<b>7.0 KEY ACTIVITIES PROJECTED FOR 2023 .....</b>	<b>10</b>
<b>8.0 REFERENCES .....</b>	<b>10</b>

## TABLES

Table 1	Monitoring Well Construction Details
Table 2	2022 Groundwater Water Levels
Table 3	Analytical Data
Table 4	Summary of Groundwater Protection Standards

**FIGURES**

- Figure 1 Site Location Map  
Figure 2 Monitoring Well Location Map  
Figure 3 January 2022, Groundwater Surface Elevation Contour Map  
Figure 4 February 2022, Groundwater Elevation Contour Map  
Figure 5 March 2022, Groundwater Elevation Contour Map  
Figure 6 April 2022, Groundwater Surface Elevation Contour Map  
Figure 7 May 2022, Groundwater Surface Elevation Contour Map  
Figure 8 June 2022, Groundwater Surface Elevation Contour Map  
Figure 9 July 2022, Groundwater Surface Elevation Contour Map  
Figure 10 August 2022, Groundwater Surface Elevation Contour Map  
Figure 11 September 2022, Groundwater Surface Elevation Contour Map  
Figure 12 October 2022, Groundwater Surface Elevation Contour Map  
Figure 13 November 2022, Groundwater Surface Elevation Contour Map  
Figure 14 December 2022, Groundwater Surface Elevation Contour Map

**APPENDICES**

- Appendix A Boring Logs  
Appendix B 2022 Groundwater Analytical Reports  
Appendix C 2022 Data Usability Assessment Report  
Appendix D 2022 Statistical Evaluation

## EXECUTIVE SUMMARY

This 2022 CCR Annual Groundwater Monitoring and Corrective Action Report (2022 Annual Report) was prepared on behalf of Southern Illinois Power Cooperative (SIPC) for the Marion Power Plant former Emery Pond located in Marion, Illinois (Site). The former Emery Pond is subject to Title 40 Code of Federal Regulations (CFR) Part 257.50 et seq. [Disposal of Coal Combustion Residuals (CCR) from Electric Utilities (CCR Rule; Federal Register Vol. 80, No. 74, 21302-21501 on April 17, 2015, as amended)]. Pursuant to the CCR Rule, SIPC is required to complete an annual groundwater monitoring and corrective action report by January 31<sup>st</sup> annually.

This 2022 Annual Report documents the status of the CCR groundwater monitoring program for the former Emery Pond, summarizes key actions completed, describes issues encountered, actions taken to resolve identified concerns, and proposes key activities for calendar year 2023. More specifically, this 2022 Annual Report describes the results of the CCR Rule Assessment Monitoring Program and Corrective Action Monitoring Program activities and discusses the progression of future sampling activities pursuant to the CCR Rule and the former Emery Pond Groundwater Monitoring Plan Addendum #1 (GMP, Golder, 2021).

In 2017, following the installation of a groundwater monitoring system, groundwater monitoring at the Site was completed to evaluate background water quality consistent with 40 CFR §257.90. In March 2018, the first round of Detection Monitoring was completed pursuant to the requirements of 40 CFR §257.94. The results of Detection Monitoring required the transition to Assessment Monitoring. The first Assessment Monitoring sampling event was completed in August 2018. The results of Assessment Monitoring initiated an Assessment of Corrective Measures which was completed in March 2019 and revised in March 2021. The Selection of Remedy Report was completed in June 2019 and revised in March 2021. The selected remedy, closure by removal, was completed in April 2021. The former Emery Pond is currently in quarterly post-closure monitoring of groundwater or Corrective Action Monitoring (CAM).

In accordance with 40 CFR §257.90(e)(6), the following information provides an overview of groundwater monitoring and corrective action status for the Unit:

- The Assessment Monitoring Program was initiated on August 8, 2018.
- The Assessment of Corrective Measures (ACM) was initiated in January 2019 and completed in March 2019 (Hanson, Revised March 30, 2021).
- Prior to the Selection of Remedy for Emery Pond, a public meeting was held on May 23, 2019 at the Marion Public Library in Marion, Illinois to discuss the results of the ACM in accordance with 40 CFR §257.96(e).
- The remedy was selected for Emery Pond on June 19, 2019 (SIPC, 2019) as required by 40 CFR §257.97.
- The selected remedy included closure by removal of all CCR from Emery Pond, installation of a perimeter drain, and ongoing groundwater monitoring. Closure by removal of CCR was completed on April 5, 2021 and final inspection by a licensed professional engineer was complete as of May 28, 2021 (SIPC, 2021). Upon completion of these closure by removal actions, all references to and reports for the former CCR unit transitioned to the current nomenclature, former Emery Pond.
- Throughout calendar year 2022, CAM was performed at former Emery Pond in accordance with 40 CFR §257.98.

- The following constituents were detected at statistically significant levels (SSLs) above groundwater protection standards (GPS) in 2022: cobalt at EP-3, EP-4, and EP-7.

In 2023, SIPC will continue CAM as described in the Site's GMP Addendum #1 (Golder, 2021a).

## 1.0 INTRODUCTION

On behalf of Southern Illinois Power Cooperative (SIPC), WSP USA Inc. (WSP), formerly known as Golder Associates USA Inc. (Golder), prepared this *2022 CCR Annual Groundwater Monitoring and Corrective Action Report* (2022 Annual Report) for the Marion Power Plant's (i.e., Facility's) former Emery Pond, 10825 Lake of Egypt Road, Marion, Williamson County, Illinois (Site, see Figure 1). The former Emery Pond was an on-site settling pond, approximately one (1) acre in size, closed via removal by April 5, 2021. The former Emery Pond is subject to the groundwater monitoring requirements of Title 40 Code of Federal Regulations (CFR) Part 257.50 et seq. [Disposal of Coal Combustion Residuals (CCR) from Electric Utilities (CCR Rule: Federal Register Vol. 80, No. 74, 21302-21501 on April 17, 2015, as amended)]. Pursuant to the CCR Rule, the Facility is required to complete an annual groundwater monitoring and corrective action report by January 31<sup>st</sup> annually.

This 2022 Annual Report provides the monitoring data and presents the relevant data evaluations from the Corrective Action Monitoring (CAM) events that were performed in December 2021, March 2022, May 2022, and September 2022. An additional CAM event was performed in December 2022; the results from this sampling event will be provided in the 2023 Annual Groundwater Monitoring and Corrective Action Report (2023 Annual Report).

In conformance with the applicable requirements of 40 CFR §257.90(e)(1) through (5), the 2022 Annual Report:

- Documents the status of the groundwater monitoring and corrective action activities
- Provides figures showing the former Emery Pond, monitoring well locations, and groundwater flow direction(s)
- Summarizes key CCR Rule groundwater activities completed during calendar year 2022
- Includes CCR Rule groundwater monitoring data obtained in calendar year 2022
- Describes any problems encountered during the monitoring activities
- Discusses actions taken to resolve the problems, if applicable
- Projects key activities for the upcoming year

### 1.1 Key Actions Completed - 2022

SIPC completed the following key actions relative to 40 CFR Part 257 CCR Rule groundwater monitoring and corrective action regulations at the Site in 2022:

- Preparation of the 2021 Groundwater Monitoring and Corrective Action Annual Report in January 2022 (2021 Annual Report) in accordance with 40 CFR §257.90(e).
- Notification that constituents in 40 CFR Part 257 Appendix IV were detected above Groundwater Protection Standards (GPS) from the second CAM event in January 2022 (40 CFR §257.98)
- Performance of the fourth CAM event in March 2022 (40 CFR §257.98)
- Evaluation and notification of detections above GPS from the third CAM event in April 2022 (40 CFR §257.98)
- Performance of the fifth CAM event in May 2022 (40 CFR §257.98)

- Evaluation and notification of detections above GPS from the fourth CAM event in June 2022 (40 CFR §257.98)
- Performance of the sixth CAM event in September 2022 (40 CFR § 257.98)
- Evaluation and notification of detections above GPS from the fifth CAM event in October 2022 (40 CFR §257.98)
- Performance of the seventh CAM event in December 2022 (40 CFR §257.98)

## 2.0 SITE INFORMATION

The following section summarizes Site information including the current monitoring well network and a description of the Site's Geology and Hydrogeology.

### 2.1 Monitoring Well Network

The groundwater monitoring system was installed in 2017 (AECOM, 2017). One background monitoring well (EBG) is located approximately 800 feet (ft) upgradient of the former Emery Pond and four downgradient monitoring wells (EP-1, EP-2, EP-3, and EP-4) are located along the southern, eastern, and northeastern boundaries of the former Emery Pond. Three additional wells (EP-5, EP-6, and EP-7) were installed in October 2021 between the former Emery Pond and the Lake of Egypt to evaluate groundwater at the limits of the groundwater management zone (GMZ, Figure 2). The monitoring wells are screened at the unlithified/bedrock unit interface which occurs at the Site at 10 – 20 feet below ground surface (ft bgs) dependent on location. Table 1 provides a summary of the well rationale/purpose and date of installation and monitoring well construction details.

### 2.2 Geology and Hydrogeology

The following section describes the geology and hydrogeology of the Site as it pertains to potential contaminant transport and fate at the Site.

#### 2.2.1 Geology

The Site is underlain by glacially-derived deposits of the Illinoian Stage overlying the Pennsylvanian Age Bedrock. (Hanson, revised March 24, 2021). WSP's interpretation of the Site's geology is based on soil borings (Appendix A) and bedrock geology maps and includes:

- Fill Materials: Where present, the fill materials generally consist of light gray to yellowish brown gravel with some silt and clay, and trace amounts of sand and asphalt from the ground surface to as deep as 14 ft bgs.
- Silt (upper discontinuous silt layer): Yellowish brown silt with little clay and trace very fine-grained sand from the ground surface to as deep as 8 ft bgs.
- Clay: Yellowish brown to black clay with some silt, little sand, and trace gravel from ground surface to approximately 20 ft bgs.
- Silt (lower discontinuous silt layer): Black to yellowish brown silt with little clay and trace very fine-grained sand from approximately 14 ft bgs to 20 ft bgs.
- Bedrock: Yellowish brown, weathered, sandstone and shale. The upper bedrock layer is at least 190 feet thick. The depth to bedrock is approximately 20 ft bgs.

The uppermost water bearing zone monitored by the groundwater monitoring system extends from the clay layer to the shallowest 11 feet of bedrock.

## 2.2.2 Site Hydrogeology

The uppermost water bearing zone is a shallow, hydraulically “perched” zone comprised of fill and residuum (silts and clays) from the weathering of underlying bedrock and is not considered a usable water source. No confining layer was identified. The fill and residuum unit has only 3 to 5 feet of saturated thickness. Because the former Emery Pond was constructed directly on top of the bedrock, groundwater monitoring wells are screened at the unlithified/bedrock unit interface. This zone has a low hydraulic conductivity (<1E-04 centimeters per second [cm/s]) and only a few feet of saturated thickness (5-10 ft; Hanson, 2019b).

## 2.2.3 Groundwater Flow

The 2022 static water levels are summarized in Table 2. Consistent with the requirements of the CCR Rule, the rate and direction of groundwater flow within the uppermost aquifer was determined after each sampling event. The potentiometric surface maps, Figures 3 through 14, were prepared using static water level data obtained monthly in 2022. Groundwater in the vicinity of the former Emery Pond generally flows east/northeast toward the Lake of Egypt. The average groundwater elevation varies between approximately 500 to 518 feet above mean sea level (ft amsl) with an average depth to groundwater of less than ten feet.

WSP calculated the horizontal hydraulic gradient ( $i$ ) for the unconfined aquifer in the vicinity of the former Emery Pond at 0.0302 as shown below using average groundwater elevation data for EP-5 and EP-7 from 2022.

$$i = h_L/L$$

Where:  $i$  = hydraulic gradient (unitless)

$h_L$  = head loss (elevation difference in feet)

$L$  = length (horizontal distance in feet)

As presented in the following table, the groundwater flow rate between EP-5 and EP-7 was calculated at approximately 7.8-8.7 feet per year using the following formula:

$$V = ki/\theta$$

Where:  $V$  = Groundwater Velocity (ft/min)

$k$  = Hydraulic conductivity (ft/min)

$i$  = Hydraulic gradient (unitless)

$\theta$  = Assumed effective porosity (unitless)

The hydraulic conductivity used to calculate the groundwater flow rate was the geometric mean of the hydraulic conductivities estimated through analysis of slug test data from wells EP-5 and EP-7 (Hanson, 2019b).

Date	Head Loss ( $h_L$ , feet)	Flow Length (feet)	Hydraulic Gradient ( $i$ )	Effective Porosity ( $\emptyset$ )	Hydraulic Conductivity ( $k$ , feet/min)	Estimated Groundwater Velocity	
						(feet/min)	(feet/year)
January 2022	14.2	470	3.02E-02	0.2	1.04E-04	1.57E-05	8.3
February 2022	14.8	470	3.15E-02	0.2	1.04E-04	1.64E-05	8.6
March 2022	14.2	470	3.02E-02	0.2	1.04E-04	1.57E-05	8.3
April 2022	14.8	470	3.15E-02	0.2	1.04E-04	1.64E-05	8.6
May 2022	15.0	470	3.19E-02	0.2	1.04E-04	1.66E-05	8.7
June 2022	14.2	470	3.02E-02	0.2	1.04E-04	1.57E-05	8.3
July 2022	13.6	470	2.89E-02	0.2	1.04E-04	1.51E-05	7.9
August 2022	13.4	470	2.85E-02	0.2	1.04E-04	1.48E-05	7.8
September 2022	13.8	470	2.94E-02	0.2	1.04E-04	1.53E-05	8.0
October 2022	14.0	470	2.98E-02	0.2	1.04E-04	1.55E-05	8.1
November 2022	14.0	470	2.98E-02	0.2	1.04E-04	1.55E-05	8.1
December 2022	14.1	470	3.00E-02	0.2	1.04E-04	1.56E-05	8.2

Notes: feet/min = feet per minute

$h_L$  = Head loss in feet

$i$  = hydraulic gradient

$k$  = hydraulic conductivity

$\emptyset$  = estimated value based on soil and bedrock properties

### **3.0 FIELD ACTIVITIES**

Pursuant to the requirements in 40 CFR §257.95(d)(1), four quarterly monitoring events were completed for the former Emery Pond in 2022. A summary of the sampling events is presented below.

Monitoring Event	Sample Parameters	Sample Dates
4 <sup>th</sup> Corrective Action Monitoring Event	Appendix III and Appendix IV	March 7-8, 2022
5 <sup>th</sup> Corrective Action Monitoring Event	Appendix III and Appendix IV	May 24-25, 2022
6 <sup>th</sup> Corrective Action Monitoring Event	Appendix III and Appendix IV	September 6-7, 2022
7 <sup>th</sup> Corrective Action Monitoring Event	Appendix III and Appendix IV	December 19-20, 2022

During each of the sampling events, the monitoring wells were sampled in accordance with the procedures presented in the Groundwater Monitoring Plan (GMP; Hanson, revised March 24, 2021) and the GMP Addendum #1 (Golder, 2021a). Samples were collected by Teklab, Inc. (Teklab) and delivered to the Teklab laboratory in Collinsville, Illinois in secured coolers under chain-of-custody control. Radium samples were then shipped to Summit Environmental Technologies, Inc. in Cuyahoga Falls, Ohio for analysis.

### **3.1 Problems Encountered and Follow-Up Corrective Actions**

During the third CAM event (December 2021), groundwater was sampled from monitoring wells EBG, EP-1, EP-4, and EP-6 at turbidity levels of 12.52, 12.68, 10.32, and 7.52 nephelometric turbidity units (NTUs), respectively. During the fourth CAM event (March 2022), groundwater was sampled from monitoring wells EBG and EP-7 at turbidity levels of 15.8 and 14.48, respectively. During the fifth CAM event (May 2022), groundwater was sampled from monitoring well EBG at turbidity levels of 14.98. According to the GMP Addendum #1 (Golder, 2021a), groundwater samples are to be collected once a well has achieved a turbidity level below 5 NTUs or when wells were purged for a minimum of two hours and sampled when turbidity appeared to stabilize (e.g., no downward or upward trend over three consecutive readings five minutes apart). This did not occur during the fourth or fifth CAM events due to field oversight. Moving forward, wells will be purged in accordance with the specifications of GMP Addendum #1.

### **4.0 GROUNDWATER MONITORING PROGRAM RESULTS**

This section includes a description of the CCR Rule monitoring program history and status, a discussion of the groundwater data collection and evaluation, and a summary of the Corrective Actions completed.

#### **4.1 Background Monitoring**

Per the requirements of 40 CFR §257.94, eight independent background groundwater samples were collected from each background and downgradient well between March 2017 and August 2017 on behalf of SIPC. SIPC submitted the samples to a contract laboratory, in accordance with chain of custody and quality assurance/quality control procedures, for analysis of 40 CFR Part 257 Appendix III and Appendix IV constituents. In addition, field water quality parameters were measured including specific conductance, temperature, dissolved oxygen, turbidity, oxidation-reduction potential, and pH. On behalf of SIPC, Hanson Professional Services Inc. (Hanson) used the

results of the background monitoring phase to develop appropriate, statistically valid background values for each constituent/monitoring well. The sampling dates, number of groundwater samples collected from each background and downgradient well, purpose of sampling, and analytical results are presented in Table 3.

## 4.2 Detection Monitoring

The first Detection Monitoring event was completed in March 2018. Pursuant to the requirements of 40 CFR §257.94, a groundwater sample was collected from each background and downgradient well for analysis of Appendix III constituents. Hanson evaluated the results of the first Detection Monitoring sampling event to compare to facility background concentrations. The results of Detection Monitoring indicated statistically significant increases (SSIs) and triggered Assessment Monitoring in 2018 (Hanson, 2019a). The sampling dates, number of groundwater samples collected from each background and downgradient well, purpose of sampling, and analytical results are presented in Table 3. The identified SSIs are summarized in the table below.

Parameter	EP-1	EP-2	EP-3	EP-4
Boron	X	X		X
Calcium	X	X		X
Chloride				X
Fluoride				
pH			X	X
Sulfate	X	X	X	X
Total Dissolved Solids	X	X	X	X

"X" Indicates an SSI

## 4.3 Assessment Monitoring

The first Assessment Monitoring sampling event was completed in August 2018, followed by a statistical evaluation and data analysis in January 2019. In August 2018, groundwater samples were collected from each background and downgradient well for analysis of Appendix III and Appendix IV constituents per 40 CFR §257.95. Following receipt of laboratory results, Hanson evaluated the Appendix IV constituents results relative to the Unit-specific GPS. In January 2019, Hanson determined that statistically significant levels (SSLs) existed for cobalt and thallium and, as a result, initiated the Assessment of Corrective Measures (ACM). Subsequent Assessment Monitoring sampling events confirmed these SSLs. A summary of the SSLs identified by Hanson between 2018-2020 and WSP in 2021 are provided in the Table below.

Assessment Monitoring Event	Identified Statistically Significant Levels
Assessment Monitoring Event #1 (August 2018)	Cobalt: EP-3 and EP-4 Thallium: EP-4
Assessment Monitoring Event #2 (January 2019)	Cobalt: EP-3 and EP-4 Thallium: EP-4
Assessment Monitoring Event #3 (June 2019)	Arsenic: EP-4 Cobalt: EP-3 and EP-4
Assessment Monitoring Event #4 (January 2020)	Arsenic: EP-4 Cobalt: EP-3 and EP-4

Assessment Monitoring Event	Identified Statistically Significant Levels
Assessment Monitoring Event #5 (June 2020)	Arsenic: EP-4 Cobalt: EP-3 and EP-4 Lead: EP-4
Assessment Monitoring Event #6 (January 2021)	Cobalt: EP-3 and EP-4

## 4.4 Corrective Action

The ACM was completed in March 2019 and a public meeting was held on May 23, 2019 at the Marion Public Library in Marion, Illinois to discuss the results of the ACM. The "Corrective Action and Selected Remedy Plan" (Hanson, revised March 30, 2021), outlines the selected remedy including:

- Closure of the then-operating Emery Pond and adjacent FGD storage area by removal of all CCR
- Construction of a composite liner system compliant with 40 CFR Part 257 in the footprint of the former Emery Pond to continue storm water management functions
- Construction of a perimeter drain at the toe of the liner system to protect the liner from external hydrostatic pressure and recover contaminated groundwater
- Installation of three new monitoring wells, continuing to monitor groundwater for changes resulting from the natural attenuation of contaminants, source removal and the perimeter drain collection of impacted groundwater, and the establishment of a GMZ.

Emery Pond ceased receipt of CCR materials in the fall of 2020. Closure construction activities began in late 2020. Emery Pond, and the adjacent flue-gas desulfurization (FGD) storage area, were dewatered and excavated. The removal and decontamination of Emery Pond was completed April 5, 2021, and the final inspection was completed May 28, 2021, in accordance with the Site's Closure Plan (Hanson, revised April 15, 2021).

## 4.5 Corrective Action Monitoring

The former Emery Pond is currently in CAM. In accordance with the Site's Closure Plan (Hanson, revised April 15, 2021) and the GMP Addendum #1 (Golder, 2021a), CAM is completed on a quarterly basis. The CAM program was initiated in May 2021, and the results from the first and second CAM events were discussed in the 2021 Annual Report (Golder, 2021).

The fourth through seventh CAM sampling events were completed in March, May, September, and December 2022. The results from the December 2021 and the March, May and September 2022 sampling events are discussed in Sections 5.1 through 5.5, respectively, and presented in Table 3. The corresponding analytical laboratory reports are provided in Appendix B. The 2022 Data Usability Summary Report is provided in Appendix C. The results from the December 2022 sampling event will be included in the 2023 Annual Report.

## 5.0 STATISTICAL EVALUATION

The former Emery Pond is currently in CAM. After four quarterly CAM groundwater sampling events have been completed, the groundwater sampling results were statistically evaluated to determine whether statistically significant decreases (SSDs) have occurred after closure through removal of the former Emery Pond as described in the Site's GMP Addendum #1 (Golder, 2021a).

In accordance with the procedures identified in GMP Addendum #1 (Golder, 2021a), WSP updated the GPS by recalculating the facility background concentration, including all data collected from the background monitoring well (EBG) prior to the former Emery Pond closure, for each analyte using a tolerance/prediction limit procedure in accordance with 40 CFR §257.95. The updated GPS are the higher value of the Maximum Contaminant Levels (MCL) provided in 40 CFR §257.95(h)(2), 40 CFR §141.62 or 40 CFR §141.66, and the facility background concentration. The GPS for the Site are summarized in Table 4. The results from the statistical analysis from the fourth through sixth CAM events are provided in Appendix D.

### 5.1 Third Corrective Action Monitoring Event Statistical Analysis

The December 2021 sampling was the third CAM event since closure activities were completed in April 2021. The December 2021 data were compared to facility background concentrations and GPS established by WSP in 2021. Concentrations identified above background for the third CAM event based on a value-to-standard evaluation are summarized in the table below. Due to their construction in December 2021, monitoring wells EP-5, EP-6, and EP-7 were not evaluated because the four requisite quarterly monitoring events for these locations were not completed until the sixth CAM event.

Constituent	Facility Background Concentration	Federal CCR Groundwater Protection Standard	Monitoring Well	December 2021 Concentration
Boron (mg/L)	0.14		EP-1	1.07
			EP-2	0.33
			EP-4	11.6
Calcium (mg/L)	63		EP-1	506
			EP-2	299
			EP-4	161
Chloride (mg/L)	86		EP-3	183
			EP-4	477
Sulfate (mg/L)	101		EP-1	1480
			EP-2	1250
			EP-3	178
			EP-4	567

Constituent	Facility Background Concentration	Federal CCR Groundwater Protection Standard	Monitoring Well	December 2021 Concentration
Total Dissolved Solids (mg/L)	591		EP-1	2510
			EP-2	2090
			EP-3	812
			EP-4	1450
Cobalt (mg/L)	0.018	0.018	EP-3	0.0472
			EP-4	0.298

mg/L = milligram per liter

QL = quantitation limit

The former Emery Pond has completed closure by removal of all CCR material and is in Corrective Action Monitoring, therefore, no actions beyond reporting these exceedances in this Annual Report are required.

## 5.2 Fourth Corrective Action Monitoring Event Statistical Analysis

The fourth CAM event (March 2022) data were compared to GPS established by WSP in 2021. Statistical analysis was completed according to the GMP Addendum #1 (Golder, 2021a). The results confirmed the SSLs identified in Assessment Monitoring for cobalt in monitoring wells EP-3 and EP-4.

The fourth CAM event data was also evaluated for SSDs by identifying constituents where SSLs were identified in the pre-closure (March 2017- January 2021) data but not identified in post-closure (May 2021-present) data. No SSDs were identified. The former Emery Pond has completed closure by removal of all CCR material and is in Corrective Action Monitoring, therefore, no actions beyond reporting these exceedances in this Annual Report are required.

## 5.3 Fifth Corrective Action Monitoring Event Statistical Analysis

The fifth CAM event (May 2022) data were compared to GPS established by WSP in 2021. The results confirmed the SSLs for cobalt in monitoring wells EP-3 and EP-4. No SSDs were identified.

The former Emery Pond has completed closure by removal of all CCR material and is in Corrective Action Monitoring, therefore, no actions beyond reporting these exceedances in this Annual Report are required.

## 5.4 Sixth Corrective Action Monitoring Event Statistical Analysis

The sixth CAM event (September 2022) data were compared to GPS established by WSP in 2021. The sixth CAM event is the fourth sample round for monitoring well EP-5, EP-6, and EP-7 and therefore was the first statistical evaluation of SSLs at these monitoring wells. The results confirmed the cobalt SSLs in monitoring wells EP-3 and EP-4 and identified an SSL for cobalt in monitoring well EP-7. No SSDs were identified.

The former Emery Pond has completed closure by removal of all CCR material and is in Corrective Action Monitoring, therefore, no actions beyond reporting these exceedances in this Annual Report are required.

## 5.5 Seventh Corrective Action Monitoring Event Statistical Evaluation

The seventh CAM event was completed in December 2022. The laboratory results were not received during calendar year 2022. The data for the seventh CAM event will be evaluated in accordance with the CCR Rule timeframes and reported in the 2023 Annual Report.

## 6.0 KEY ACTIVITIES PROJECTED FOR 2023

During calendar year 2023, SIPC anticipates conducting the following key CCR Rule groundwater monitoring activities for the former Emery Pond:

- Prepare and submit the appropriate notifications according to the CCR Rule
- Continue quarterly CAM per CCR Rule requirements
- Inspect and maintain the monitoring system including wells, pumps, and equipment.

## 7.0 REFERENCES

AECOM (2017). "Draft Monitoring Well Installation Report Col Combustion Residuals (CCR) Rule, Marion Power Plant", September 28, 2017.

AECOM (2018), "2017 Annual Groundwater Monitoring and Corrective Action Report Coal Combustion Residuals (CCR) Rule", January 30, 2018.

Golder Associates (2021a), "Groundwater Monitoring Plan Addendum #1, Marion Power Plant, Former Emery Pond, Southern Illinois Power Cooperative", October 28, 2021.

Golder Associates (2021b), "Southern Illinois Power Cooperative Initial Operating Permit Application, Former Emery Pond", October 30, 2021.

Golder Associates (2022), "2021 Annual Groundwater Monitoring and Corrective Action Report, Marion Power Plant – Emery Pond, Southern Illinois Power Cooperative", January 31, 2022.

Hanson (2019a), "2018 Annual Groundwater Monitoring and Corrective Action Report, Marion Power Plant – Emery Pond, Southern Illinois Power Cooperative", January 25, 2019.

Hanson Professional Services Inc. (2019b), "Emery Pond- Hydrogeologic Investigation Report," March 29, 2019.

Hanson (2021a), "2020 Annual Groundwater Monitoring and Corrective Action Report, Marion Power Plant – Emery Pond, Southern Illinois Power Cooperative", January 28, 2021.

Hanson Professional Services Inc. (revised March 24 2021), "Groundwater Monitoring Plan, Marion Power Plant", March 29, 2019 revised March 24, 2021

Hanson (revised April 15 2021) "Closure Plan, Emery Pond, Marion Power Plant, Southern Illinois Power Cooperative", March, 29 2019 revised April 15, 2021.

Hanson (Revised March 30, 2021) "Corrective Action and Selected Remedy Plan Including GMZ Petition", March 29, 2019 revised March 30, 2021.

Illinois Environmental Protection Agency (IEPA, 2008), "South Fork Saline – Lake of Egypt Watershed TMDL Report", June 2008.

Illinois State Geological Survey and the Prairie Research Institute (ISGS, 2021), "Illinois Water and Related Wells"  
<https://isgs.illinois.edu/ilwater>, Accessed July 6, 2021.

Southern Illinois Power Cooperative (SIPC, 2019), "Selection of Remedy (per 40 CFR 257.97)", June 19, 2019.

Southern Illinois Power Cooperative (SIPC, 2021), "Closure and Decontamination Report for Emery Pond at Marion Power Station", August 2, 2021.

## TABLES

**Table 1: Monitoring Well Construction Details****Former Emery Pond****Southern Illinois Power Cooperative Marion Power Plant****Marion, Illinois**

CCR Unit	Monitoring Well Type	Monitoring Well ID	Installation Date	Ground Surface Elevation (ft-msl)	Total Borehole Depth (ft)	Top of Casing Elevation (ft-msl)	Sounded Well Depth (ft-btoc)	Well Material	Screen Length (ft)	Screen Depth		Screen Elevation		
										Top (ft-btoc)	Bottom (ft-btoc)	Top (ft-btoc)	Middle (ft-msl)	Bottom (ft-msl)
Emery Pond	Background	EBG	2/8/2017	521.74	25.00	524.87	28.13	2" Sch 40 PVC	10	18.13	28.13	506.74	501.74	496.74
	Downgradient	EP-1	2/7/2017	517.07	31.00	519.72	33.65	2" Sch 40 PVC	10	23.65	33.65	496.07	491.07	486.07
	Downgradient	EP-2	2/7/2017	511.15	15.00	513.79	17.64	2" Sch 40 PVC	10	7.64	17.64	506.15	501.15	496.15
	Downgradient	EP-3	2/8/2017	516.24	26.50	518.95	29.21	2" Sch 40 PVC	10	19.21	29.21	499.74	494.74	489.74
	Downgradient	EP-4	2/8/2017	517.07	18.50	519.74	21.17	2" Sch 40 PVC	10	11.17	21.17	508.57	503.57	498.57
	GMZ Boundary	EP-5	10/5/2021	524.64	16.32	527.59	16.32	2" Sch 40 PVC	4.5	11.30	15.79	516.29	514.05	511.80
	GMZ Boundary	EP-6	10/4/2021	502.08	13.62	505.11	13.62	2" Sch 40 PVC	4.5	8.59	13.12	496.52	494.26	491.99
	GMZ Boundary	EP-7	10/4/2021	512.49	18.50	515.44	18.50	2" Sch 40 PVC	9.6	9.36	18.00	506.08	501.26	497.44

**Notes:**

ft-msl = Feet above mean sea level

ft-btoc = Feet below top of casing

2" Sch 40 PVC = Two-inch diameter well, constructed of schedule 40 polyvinyl chloride materials

AECOM, 2018, 2017 Annual Groundwater Monitoring and Corrective Action Report, January 31, 2018.

GMZ = Groundwater Management Zone

Prepared by: DPJ

Checked by: SLG

Reviewed by: MAH

**Table 2: 2022 Groundwater Water Levels**  
**Former Emery Pond**  
**Southern Illinois Power Cooperative Marion Power Plant**  
**Marion, Illinois**

Monitoring Well ID	Total Depth (feet)	Sounded Well Depth (feet)	Elevation of Top of Casing (feet msl)	1/12/2022		2/16/2022		3/16/2022		4/18/2022		5/16/2022		6/13/2022	
				DTW (feet)	Elevation (feet msl)										
EBG	25	28.13	524.87	8.10	516.77	6.8	518.1	7.2	517.67	7.7	517.2	7.1	517.77	7.9	517.0
EP-1	31	33.65	519.72	6.20	513.52	5.9	513.8	5.1	514.62	5.8	513.9	6.3	513.42	6.4	513.3
EP-2	15	17.64	513.79	4.20	509.59	4.8	509.0	4.7	509.09	5.2	508.6	4.9	508.89	5.1	508.7
EP-3	26.5	29.21	518.95	15.10	503.85	13.7	505.3	13.50	505.45	13.6	505.4	14.50	504.45	14.3	504.7
EP-4	18.5	21.17	519.74	11.60	508.14	12.4	507.3	11.8	507.94	12.2	507.5	12.4	507.34	12.1	507.6
EP-5	16.32	16.32	527.59	11.2	516.39	10.8	516.8	11.2	516.39	10.9	516.7	10.7	516.89	11.1	516.5
EP-6	13.62	13.62	505.11	2.5	502.61	2.55	502.6	2.65	502.46	2.62	502.5	2.45	502.66	2.62	502.5
EP-7	18.5	18.5	515.44	13.2	502.24	13.4	502.0	13.2	502.24	13.5	501.9	13.5	501.94	13.1	502.3

## Notes:

- 1.) MSL = mean sea level.
- 2.) NM = Not measured.
- 3.) DTW = Depth to Water

**Table 2: 2022 Groundwater Water Levels****Former Emery Pond****Southern Illinois Power Cooperative Marion Power  
Marion, Illinois**

Monitoring Well ID	Total Depth (feet)	Sounded Well Depth (feet)	Elevation of Top of Casing (feet msl)	7/11/2022		8/15/2022		9/12/2022		10/17/2022		11/14/2022		12/13/2022	
				DTW (feet)	Elevation (feet msl)										
EBG	25	28.13	524.87	8	516.9	8.4	516.47	8.1	516.8	8.6	516.3	8.5	516.4	8.1	516.77
EP-1	31	33.65	519.72	6.7	513.0	6.2	513.52	6.5	513.2	7.1	512.6	7.3	512.4	6.9	512.82
EP-2	15	17.64	513.79	5.4	508.4	5.0	508.79	5.4	508.4	5.6	508.2	5.6	508.2	5.5	508.29
EP-3	26.5	29.21	518.95	14.5	504.5	14.2	504.75	14.7	504.3	15.2	503.8	15.2	503.8	14.9	504.05
EP-4	18.5	21.17	519.74	12.5	507.2	11.9	507.84	12.2	507.5	12.5	507.2	12.6	507.1	12.50	507.24
EP-5	16.32	16.32	527.59	11.4	516.2	12.2	515.39	13.0	514.6	13.4	514.2	13.4	514.2	13.1	514.49
EP-6	13.62	13.62	505.11	2.5	502.6	3.7	501.41	4.5	500.6	5.1	500.0	5.2	499.9	5.10	500.01
EP-7	18.5	18.5	515.44	12.8	502.6	13.4	502.04	14.6	500.8	15.2	500.2	15.2	500.2	15	500.44

## Notes:

- 1.) MSL = mean sea level.
- 2.) NM = Not measured.
- 3.) DTW = Depth to Water

Created by: CCC

Checked by: GRD

Reviewed by: MAH

**Table 3: Analytical Data**

**Former Emery Pond**  
**Southern Illinois Power Cooperative Marion Power Plant**  
**Marion, Illinois**

Well ID	EBG	EBG																	
Sample Date	3/23/2017	4/3/2017	5/25/2017	6/22/2017	6/29/2017	7/24/2017	8/1/2017	8/31/2017	3/22/2018	8/27/2018	1/11/2019	6/27/2019	1/30/2020	6/22/2020	1/21/2021	5/31/2021	8/30/2021	12/21/2021	
Sample Purpose	Background	Corrective Action Monitoring	Corrective Action Monitoring	Corrective Action Monitoring															
<b>ANALYTE</b>	Unit																		
Boron	mg/L	0.12	0.079	0.1	0.071	0.073	0.079	0.074	0.056	0.033	0.035	0.041	<0.08	<0.5	0.022	<0.5	<0.009	0.010 J	0.013 J
Calcium	mg/L	23	10	30	23	32	37	35	35	14	15	13	15.2	12	13	15	13.3	12.1	11.6
Chloride	mg/L	55	11	84	68	79	27	86	82	12	16	12	18	7.2	12	13	22	17	12
Fluoride	mg/L	<0.029	<0.029	<0.029	<0.029	<0.029	0.64	<0.029	<0.029	0.53	0.55	0.5	<0.06	0.56	<0.5	0.46	0.6	0.58	0.67
pH	SU	6.5	6.8	6.41	6.45	6.53	6.59	6.66	6.26	6.35	6.57	6.85	6.21	6.54	6.5	6.57	6.61	6.58	6.95
Sulfate	mg/L	64	54	42	57	50	61	45	44	63	72	75	77	87	81	78	85	83	84
Total Dissolved Solids	mg/L	480	400	440	470	280	420	380	470	300	360	370	470	280	500	320	344	340	308
Antimony	mg/L	0.00057	0.00085 J	<0.0026	0.00069 J	0.0014 J	<0.0026	0.00022 J	<0.0026		<0.0016		<0.0016		<0.00052		<0.0010	<0.0010	<0.0200
Arsenic	mg/L	<0.0014	<0.0014	<0.0014	<0.0014	<0.0014	<0.0014	<0.0014	<0.0014	<0.0014	<0.002		<0.002		0.0011		<0.0010	<0.0010	<0.0200
Barium	mg/L	0.13	0.029	0.17	0.049	0.086	0.19	0.18	0.16		0.091		<0.00011		0.068		0.0505	0.0469	0.0475
Beryllium	mg/L	0.00033 J	<0.0002	<0.00055	<0.0002	<0.0002	<0.00055	<0.0002	<0.00055		<0.00015	0.00038 J	<0.00015		<0.00011		<0.0010	<0.0010	<0.0200
Cadmium	mg/L	<0.0001	<0.00075	<0.0015	<0.0015	<0.0015	<0.0015	<0.0015	<0.0015		<0.0015		<0.000018		<0.00002		<0.0010	<0.0010	<0.0200
Chromium	mg/L	0.0062	<0.0016	<0.0031	<0.0031	<0.0031	<0.0031	<0.0031	<0.0031		<0.0031	<0.0026	<0.00014		0.0042		<0.0015	0.0011 J	<0.0300
Cobalt	mg/L	0.008	0.00016 J	0.014	0.00015 J	0.0014 J	0.0093	0.0038 J	0.0073		<0.00063	0.0038	<0.00063		0.0017		<0.0001	0.0003 J	<0.0200
Lead	mg/L	<0.0008	<0.0013	<0.0026	<0.0026	<0.0026	<0.0026	<0.0026	<0.0026		<0.0026	<0.0042	<0.00016		<0.0033		<0.0010	<0.0010	<0.0200
Lithium	mg/L	0.046 J	0.0074 J	<0.0042	0.028 J	0.059 J	<0.0042	0.082 J	<0.0042		<0.0042		<0.04		<0.0042		0.0207	0.0164	<0.0600
Mercury	mg/L		<0.00019	<0.00019	<0.00019	<0.00019	<0.00019	<0.00019	<0.00019		<0.000093		<0.0001		<0.00019		<0.00020	<0.00020	<0.00020
Molybdenum	mg/L	0.0034 J	0.0043 J	<0.000095	0.0017 J	0.0016 J	<0.00095	0.0024 J	<0.00095		<0.00014		<0.00028		<0.000019		0.0145	0.0014 J	<0.0300
Radium 226	pCi/L	0.878	<0.223	0.805	<0.262	<0.245	0.43	0.28	0.77		0.933		0.703		0.468			<0.21	0.104 J
Radium 228	pCi/L	1.06	<0.496	0.555	<0.0695	<0.371	0.98	1.24	2.22		0.447		0.911		0.514			1.02	0.194
Radium, 226/228 Combined	pCi/L	1.938	<0.496	1.36	<0.262	<0.371	1.41	1.52	2.99		1.38		1.61		0.983			<1.23	0.297
Selenium	mg/L	0.0019 J	<0.0005	<0.0028	0.0036 J	0.0019 J	<0.0028	0.0028 J	0.007		<0.00033	0.00079 J	<0.00033		<0.00056		<0.0010	<0.0010	<0.0200
Thallium	mg/L	<0.0007	<0.004	<0.0081	<0.0081	<0.0081	<0.0081	<0.0081	<0.0081		<0.0081	<0.01	<0.00015		<0.004		<0.0020	0.0054	<0.0400
Turbidity	NTU																9.95	28.65	13

## Notes:

J = Indicates the result is estimated

&lt; = Analyte was not detected above the method detection limit, the method detection limit is provided

R = relative percent difference for the laboratory duplicate outside recovery limits

mg/L = milligrams per liter

pCi/L = picoCuries per liter

NTU = Nephelometric Turbidity Unit

**Table 3: Analytical Data**  
**Former Emery Pond**  
**Southern Illinois Power Cooperative Mari**  
**Marion, Illinois**

Well ID	EBG	EBG	EBG	EP-1															
Sample Date	3/7/2022	5/24/2022	9/6/2022	3/23/2017	4/3/2017	5/25/2017	6/22/2017	6/29/2017	7/24/2017	8/1/2017	8/31/2017	3/22/2018	8/27/2018	1/11/2019	6/27/2019	1/30/2020	6/22/2020	1/21/2021	
Sample Purpose	Corrective Action Monitoring	Corrective Action Monitoring	Corrective Action Monitoring	Background															
<b>ANALYTE</b>	Unit																		
Boron	mg/L	0.0225	0.019 J	0.012 J	0.13	0.21	0.28	0.26	0.32	0.21	0.23	0.17	0.38	0.92	0.75	1.12	1.1	0.92	1
Calcium	mg/L	11.9	13.1	10.9	220	280	310	310	310	270	250	240	330	410	410	444	540	470	460
Chloride	mg/L	15	18	10	54	54	48	50	50	51	48	48	60	63	70	55	52	34	39
Fluoride	mg/L	0.58	0.52	0.61	<0.029	<0.029	<0.029	<0.029	<0.029	<0.029	<0.029	<0.029	<0.25	<0.06	<0.06	<0.06	<0.5	<0.2	
pH	SU	6.78	6.55	6.6	6.94	6.89	6.55	6.52	6.64	6.57	6.82	6.79	6.25	6.36	6.33	6.2	7.39	6.15	6.29
Sulfate	mg/L	83	90	101	820	910	850	850	440	540	520	440	510	1000	1600	1500	1700	1400	1400
Total Dissolved Solids	mg/L	428	344	322	2000	2300	2300	2300	2200	2200	2100	2100	2400	2700	2800	550	2700	2700	2500
Antimony	mg/L	<0.0010	<0.0010	<0.0010	0.00043 J	<0.0002	<0.0026	0.00057 J	0.00095 J	<0.0026	<0.0002	<0.0026	<0.0016	<0.0016	<0.0016	<0.0016	<0.0026		
Arsenic	mg/L	<0.0010	0.0005 J	<0.0010	<0.0014	<0.0014	<0.0014	<0.0014	<0.0014	<0.0014	<0.0014	<0.0014	<0.0014	<0.002	<0.002	<0.002	<0.0014		
Barium	mg/L	0.054	0.0506	0.0491	0.045	0.04	0.041	0.032	0.033	0.029	0.028	0.026		0.023	<0.00011		0.019		
Beryllium	mg/L	<0.0010	<0.0010	<0.0010	<0.0002	<0.0002	<0.00055	<0.0002	<0.0002	<0.00055	<0.0002	<0.00055	<0.00015	<0.00055	<0.00015	<0.00055		<0.00055	
Cadmium	mg/L	<0.0010	<0.0010	<0.0010	<0.0001	0.006	<0.0015	<0.0015	<0.0015	<0.0015	<0.0015	<0.0015	<0.0015	<0.0015	<0.00015	<0.00018	<0.00002		
Chromium	mg/L	0.0009 J	0.0007 J	<0.0015	<0.0001	<0.0016	<0.0031	<0.0031	<0.0031	<0.0031	<0.0031	<0.0031	<0.0031	<0.0031	<0.0026	<0.00014	<0.0011		
Cobalt	mg/L	0.0005 J	0.0003 J	0.0002 J	0.0017 J	0.00079 J	<0.0018	0.00081 J	0.00057 J	<0.00018	0.00074 J	<0.00018	<0.00063	0.00056 J	<0.00063	<0.00018			
Lead	mg/L	<0.0010	<0.0010	<0.0010	<0.0008	<0.0013	<0.0026	<0.0026	<0.0026	<0.0026	<0.0026	<0.0026	<0.0026	<0.0042	<0.0042	<0.0033			
Lithium	mg/L	0.0162	0.0166	0.0141	0.024 J	0.028 J	<0.0042	0.032 J	0.029 J	<0.1	0.024 J	<0.0042	<0.0042	<0.04	<0.042				
Mercury	mg/L	<0.00020	<0.00020	<0.00020		<0.00019	<0.00019	<0.00019	<0.00019	<0.00019	<0.00019	<0.00019	<0.0002	<0.000093	<0.0001	<0.0001	<0.00019		
Molybdenum	mg/L	0.0014 J	0.0021	0.0012 J	0.0028 J	0.0016 J	<0.000095	0.00077 J	0.0018 J	<0.00095	0.0019 J	<0.00095	<0.00014	<0.00028		<0.000095			
Radium 226	pCi/L	0.215	0.0495	0.0129	0.603	0.341	0.37	0.313	<0.139	0.16	0.38	0.24		0.453	0.619	0.42			
Radium 228	pCi/L	1.18	2.63	0.315 J	<0.0552	0.55	<0.609	0.496	<0.0387	<0.27	1.04	1.15		0.992	0.0905	0.405			
Radium, 226/228 Combined	pCi/L	1.4	2.68	0.328	0.603	0.891	0.37	0.809	<0.139	0.16	1.42	1.39		1.445	0.71	0.825			
Selenium	mg/L	0.0007 J	0.0007 J	0.0006 J	0.0012 J	0.0014 J	<0.0028	0.005 J	0.0025 J	<0.0028	0.0011 J	<0.0028		<0.00033	<0.0028	<0.00033		<0.0028	
Thallium	mg/L	<0.0020	<0.0020	<0.0020	<0.0007	<0.004	<0.0081	<0.01	<0.010	<0.010	<0.010	<0.010		<0.0081	<0.01	<0.00015	<0.004		
Turbidity	NTU	16	15	3.5															

## Notes:

J = Indicates the result is estimated

&lt; = Analyte was not detected above the method detection limit

R = relative percent difference for the laboratory duplicate

mg/L = milligrams per liter

pCi/L = picoCuries per liter

NTU = Nephelometric Turbidity Unit

**Table 3: Analytical Data**  
**Former Emery Pond**  
**Southern Illinois Power Cooperative Mari**  
**Marion, Illinois**

Well ID	EP-1	EP-1	EP-1	EP-1	EP-1	EP-1	EP-2													
Sample Date	5/31/2021	8/30/2021	12/21/2021	3/7/2022	5/24/2022	9/6/2022	3/23/2017	4/3/2017	5/25/2017	6/22/2017	6/29/2017	7/24/2017	8/1/2017	8/31/2017	3/22/2018	8/27/2018	1/11/2019	6/27/2019		
Sample Purpose	Corrective Action Monitoring	Background																		
<b>ANALYTE</b>	Unit																			
Boron	mg/L	0.816	0.931	1.07	0.914	0.991	1.16	0.22	0.19	0.2	0.23	0.29	0.26	0.31	0.23	0.24	0.2	0.37	0.274	
Calcium	mg/L	478	483	506	474	508	476	190	170	200	200	470	200	190	180	230	190	280	236	
Chloride	mg/L	44	48	46	44	38	35	42	39	36	37	36	36	36	36	30	35	25	29	
Fluoride	mg/L	0.22	0.19	0.24	0.19	0.18	0.21	<0.029	<0.029	<0.029	<0.029	<0.029	<0.029	<0.029	<0.029	<0.029	<0.25	<0.06	<0.06	
pH	SU	6.18	6.12	6.37	6.19	6.2	6.21	6.18	6.39	6.31	6.1	5.75	5.86	5.88	6.33	6.27	6.28	6.62	6.18	
Sulfate	mg/L	1450	1640	1480	1600	1470	1570	860	660	780	780	470	430	770	340	420	740	1100	1100	
Total Dissolved Solids	mg/L	2500	2520	2510	2650	2530	2600	1800	1800	1900	1800	1900	1800	1800	1800	1700	1800	1900	400	
Antimony	mg/L	<0.0010	0.0005 J	<0.0200	<0.0010	<0.0010	<0.0010	0.00029 J	<0.0002	<0.0026	0.0004 J	0.00073 J	<0.0026	<0.0002	<0.0026		<0.0016		<0.0016	
Arsenic	mg/L	<0.0010	0.0005 J	<0.0200	0.0004 J	<0.0010	0.0004 J	<0.0014	<0.0014	<0.0014	<0.0014	<0.0014	<0.0014	<0.0014	<0.0014		<0.002		<0.002	
Barium	mg/L	0.0216	0.02	0.0193	0.0171	0.017	0.017	0.039	0.035	0.038	0.03	0.029	0.025	0.025	0.025		0.018		<0.00011	
Beryllium	mg/L	<0.0010	<0.0010	<0.0200	<0.0010	<0.0010	<0.0010	<0.0002	<0.0002	<0.00055	<0.0002	<0.0002	<0.00055	<0.0002	<0.00055		<0.00015		<0.00055	
Cadmium	mg/L	<0.0010	<0.0010	<0.0200	0.0002 J	<0.0010	<0.0010	<0.0001	<0.00075	<0.0015	<0.0015	<0.0015	<0.0015	<0.0015	<0.0015		<0.0015		<0.000018	
Chromium	mg/L	<0.0020	0.0019	<0.0300	<0.0015	<0.0015	<0.0015	<0.0001	<0.0016	<0.0031	<0.0031	<0.0031	<0.0031	<0.0031	<0.0031		<0.0026		<0.00014	
Cobalt	mg/L	0.0012	0.0010 J	<0.0200	<0.0010	0.0002 J	<0.0010	0.052	0.029	0.023	0.016	0.087	<0.00018	0.00086 J	<0.00018	<0.00063	0.0007 J	<0.00063		
Lead	mg/L	<0.0010	<0.0010	<0.0200	<0.0010	<0.0010	<0.0010	<0.0008	<0.0013	<0.0026	<0.0026	<0.0026	<0.0026	<0.0026	<0.0026		<0.0026		<0.0042	
Lithium	mg/L	0.0141	0.0127	<0.0600	0.012	0.0103	0.012	0.018 J	0.015 J	<0.0042	0.020 J	0.025 J	<0.1	0.021 J	<0.0042		<0.0042		<0.04	
Mercury	mg/L	<0.00020	<0.00020	<0.00020	<0.00020	<0.00020	<0.00020	<0.00020	<0.00019	<0.00019	<0.00019	<0.00019	<0.00019	<0.00019	<0.00019		<0.0002		<0.000093	
Molybdenum	mg/L	<0.0015	<0.0015	<0.0300	<0.0015	<0.0015	<0.0015	0.0015 J	0.0017 J	<0.000095	0.0003 J	0.00055 J	<0.00095	0.00082 J	<0.00095		<0.00014		<0.00028	
Radium 226	pCi/L			<0.04	0.501	0.260 J	0.0628	0.265 J	<0.187	0.338	<0.177	0.197	1.9	0.08	0.14	0.08		0	<0.149	
Radium 228	pCi/L			1.78	0.255	0.439 J	0.888	-0.449	0.853	<0.0622	<0.126	<0.127	<0.458	0.4	1.35	0.64		0.443		0.553
Radium, 226/228 Combined	pCi/L			<1.82	0.756 J	0.699	0.95	0.265	0.853	0.338	<0.177	0.197	1.9	0.48	1.49	0.72		0.443		0.553
Selenium	mg/L	0.0015	0.0014	<0.0200	0.0017	0.0026	0.0015	0.0038 J	0.0027 J	<0.0028	0.0074	0.0061	0.0054	0.0046 J	<0.0028		<0.00033	0.0055	<0.00033	
Thallium	mg/L	<0.0020	0.0042	<0.0400	<0.0200	<0.0020	<0.0020	<0.0007	<0.004	<0.0081	<0.0081	<0.0081	<0.0081	<0.0081	<0.0081		<0.0081	<0.01	<0.00015	
Turbidity	NTU	49.8	22.65	13	5	<1.0	<1.0													

## Notes:

J = Indicates the result is estimated

&lt; = Analyte was not detected above the method detection limit

R = relative percent difference for the laboratory duplicate

mg/L = milligrams per liter

pCi/L = picoCuries per liter

NTU = Nephelometric Turbidity Unit

**Table 3: Analytical Data**  
**Former Emery Pond**  
**Southern Illinois Power Cooperative Mari**  
**Marion, Illinois**

Well ID	EP-2	EP-2	EP-2	EP-2	EP-2	EP-2	EP-2	EP-2	EP-3										
Sample Date	1/30/2020	6/22/2020	1/21/2021	5/31/2021	8/30/2021	12/22/2021	3/7/2022	5/24/2022	9/7/2022	3/23/2017	4/3/2017	5/25/2017	6/22/2017	6/29/2017	7/24/2017	8/1/2017	8/31/2017	3/22/2018	
Sample Purpose	Background	Background	Background	Corrective Action Monitoring	Background														
<b>ANALYTE</b>	Unit																		
Boron	mg/L	0.56	0.47	0.49 J	0.544	0.499	0.33	0.508	0.48	0.408	0.11	0.089	0.081	0.057	0.085	0.083	0.09	0.09	0.078
Calcium	mg/L	430	360	340	372	363	299	406	347	349	34	29	45	93	30	32	34	33	34
Chloride	mg/L	13	19	28	29	34	43	30	33	44	100	120	140	220	66	110	120	110	110
Fluoride	mg/L	<0.06	<0.5	0.28	0.62	0.4	0.36	0.69	0.92	0.47	<0.029	<0.029	<0.029	<0.029	<0.029	<0.029	<0.029	<0.029	<0.25
pH	SU	6.46	5.81	6.37	5.74	5.91	6.32	5.86	5.97	6.19	5.99	5.96	6.03	6.08	6.01	5.96	6.02	6.13	6.1
Sulfate	mg/L	1100	1200	1300	1370	1590	1250	1630	1700	1760	120	180	190	300	73	130	140	110	110
Total Dissolved Solids	mg/L	1900	2200	2300	2120	2370	2090	2480	2460	2580	680	820	1400	560	570	720	630	1000	700
Antimony	mg/L		<0.00052		<0.0010	<0.0010	<0.0200	<0.0010	<0.0010	<0.0010	0.00022 J	<0.0002	<0.0026	0.00026 J	0.00091 J	<0.0026	<0.0002	<0.0026	
Arsenic	mg/L		<0.00027		<0.0010	0.0005 J	<0.0200	<0.0010	0.0013	0.0016	<0.0014	0.0088	0.0076	0.0061	<0.014	0.0093	0.0062	0.0069	
Barium	mg/L		0.019		0.0146	0.0198	0.0168	0.0151	0.0208	0.0205	0.072	0.059	0.059	0.061	0.065	0.064	0.057	0.058	
Beryllium	mg/L		<0.00011		0.0011	0.0003 J	<0.0200	0.0019	0.0056	<0.0010	<0.0002	<0.0002	<0.00055	<0.0002	<0.0002	<0.00055	<0.0002	<0.00055	
Cadmium	mg/L		<0.00002		0.0015	0.0016	<0.0200	0.0014	0.0003 J	0.0003 J	<0.0001	<0.00075	<0.0015	<0.0015	<0.0015	<0.0015	<0.0015	<0.0015	
Chromium	mg/L		<0.011		<0.0015	<0.0015	<0.0300	<0.0015	<0.0015	<0.0015	<0.0001	<0.0016	<0.0031	<0.0031	<0.0031	<0.0031	<0.0031	<0.0031	
Cobalt	mg/L		<0.000037		0.0017	0.0052	<0.0200	0.0159	0.211	0.0325	0.11	0.12	0.091	0.037	0.11	0.12	0.1	0.11	
Lead	mg/L		<0.0033		<0.0010	0.0007 J	<0.0200	<0.0010	<0.0020	<0.0010	<0.0008	0.0056	<0.0026	<0.0026	<0.0026	<0.0026	<0.0026	<0.0026	
Lithium	mg/L		<0.0042		0.0206	0.0148	<0.0600	0.0196	0.0381	0.0123	<0.003	0.0095 J	<0.0042	0.12	0.012 J	<0.1	0.028 J	<0.0042	
Mercury	mg/L		<0.00019		<0.00020	<0.00020	0.00006 J	<0.00020	<0.00020	<0.00020	<0.00019	<0.00019	<0.00019	<0.00019	<0.00019	<0.00019	<0.00019	<0.0002	
Molybdenum	mg/L		<0.000019		<0.0015	<0.0015	<0.0300	<0.0015	<0.0015	0.0009 J	0.00037 J	0.00045 J	<0.000095	<0.0002	<0.0002	<0.00095	0.00047 J	<0.00095	
Radium 226	pCi/L		0.0467			<0.02	0.228 J	0.0315	0.0325	0.365	1.64	0.715	1	0.366	0.317	0.19	0.43	0.41	
Radium 228	pCi/L		0.176			2.51	0.145	0.426 J	0.933	0.899	<0.438	1.92	<0.633	0.42	<0.397	0.77	2.42	0.77	
Radium, 226/228 Combined	pCi/L		0.222			2.53	0.374 J	0.458 J	0.965	1.26	1.64	2.635	1	0.786	0.317	0.96	2.88	1.18	
Selenium	mg/L		0.0031		<0.0010	<0.0010	<0.0200	<0.0010	<0.0010	<0.0010	0.013	0.011	0.016	0.028	0.013	0.016	0.012	0.022	
Thallium	mg/L		<0.004		<0.0020	0.009	<0.0400	<0.0020	<0.0040	<0.0020	<0.0007	<0.004	<0.0081	<0.0081	<0.0081	<0.0081	<0.0081	<0.0081	
Turbidity	NTU				7.34	9.98	1.5	4.9	4.3	<1.0									

## Notes:

J = Indicates the result is estimated

&lt; = Analyte was not detected above the method detection limit

R = relative percent difference for the laboratory duplicate

mg/L = milligrams per liter

pCi/L = picoCuries per liter

NTU = Nephelometric Turbidity Unit

**Table 3: Analytical Data**  
**Former Emery Pond**  
**Southern Illinois Power Cooperative Mari**  
**Marion, Illinois**

Well ID	EP-3	EP-3	EP-3	EP-3	EP-3	EP-3	EP-4	EP-4	EP-4	EP-4	EP-4								
Sample Date	8/27/2018	1/11/2019	6/27/2019	1/30/2020	6/22/2020	1/21/2021	5/31/2021	8/30/2021	12/22/2021	3/8/2022	5/25/2022	9/7/2022	3/23/2017	4/3/2017	5/25/2017	6/22/2017	6/29/2017	7/24/2017	
Sample Purpose	Background	Background	Background	Background	Background	Background	Corrective Action Monitoring	Background	Background	Background	Background	Background							
<b>ANALYTE</b>	Unit																		
Boron	mg/L	0.082	0.033	<0.08	<0.5	0.024	<0.25	0.0556	0.075	0.0501	0.0702	0.067	0.0708	14	23	14	11	13	11
Calcium	mg/L	38	94	76.3	40	80	66	40.6	35.5	58.9	36.3	40.1	36.2	190	170	170	150	190	160
Chloride	mg/L	140	240	150	140	330	230	127	129	183	145	157	147	460	290	380	430	250	180
Fluoride	mg/L	<0.06	<0.06	<3	<0.06	<0.5	0.35	0.22	0.17	0.51	0.2	0.19	0.21	<0.029	<0.029	<0.029	<0.029	<0.029	<0.029
pH	SU	6.1	6.11	5.98	6.31	6.01	6.24	6.13	6.07	6.41	6.17	6.04	6.05	5.51	5.88	5.77	5.8	5.81	5.8
Sulfate	mg/L	150	340	160	190	410	300	148	114	178	153	160	151	620	530	660	730	410	290
Total Dissolved Solids	mg/L	690	750	580	750	960	1500	692	672	812	762	728	670	2300	2300	2400	2000	2100	2300
Antimony	mg/L	<0.0016		<0.0016		<0.00052		<0.0010	<0.0010	<0.0200	<0.0010	<0.0010	<0.0010	0.00028 J	<0.0002	<0.0026	0.00033 J	0.00051 J	<0.0026
Arsenic	mg/L	<0.002		0.0057 J	0.0067	0.0059	<0.05	0.0075	0.0076	<0.0200	0.0068	0.0075	0.007	0.035	0.039	0.037	0.053	0.044	0.044
Barium	mg/L	0.064		<0.00011		0.041		0.0819	0.101	0.084	0.0851	0.0846	0.0855	0.035	0.026	0.028	0.029	0.037	0.026
Beryllium	mg/L	<0.00015	0.00033 J	<0.00015		<0.00011		<0.0010	<0.0010	<0.0200	<0.0010	<0.0010	<0.0010	<0.0002	<0.0002	<0.00055	<0.0002	<0.0002	<0.00055
Cadmium	mg/L	<0.0015		<0.000018		<0.00002		<0.0010	<0.0010	<0.0200	<0.0010	<0.0010	<0.0010	<0.0001	0.0052	<0.0015	<0.0015	<0.0015	<0.0015
Chromium	mg/L	<0.0031	<0.0026	<0.00014		<0.0011		<0.0015	<0.0015	<0.0300	0.0015 J	<0.0015	<0.0015	<0.0001	<0.0016	<0.0031	<0.0031	<0.0031	<0.0031
Cobalt	mg/L	0.088	0.044	0.032	0.087	0.047	0.031	0.0912	0.0882	0.0472	0.0947	0.121	0.104	0.39	0.41	0.44	0.34	0.41	0.41
Lead	mg/L	<0.0026	<0.0042	<0.00016		<0.0033		<0.0010	<0.0010	<0.0200	<0.0010	<0.0010	<0.0010	0.009	0.013	0.011	0.017	<0.0026	0.011
Lithium	mg/L	<0.0042		0.119		0.12		0.0314	0.0169	0.0736	0.0267	0.0321	0.027	0.0044 J	0.0062 J	<0.0042	0.0047 J	0.0063 J	<0.1
Mercury	mg/L	<0.000093		<0.0001		<0.00019		<0.00020	<0.00020	<0.00020	<0.00020	<0.00020	<0.00020	<0.00019	<0.00019	<0.00019	<0.00019	<0.00019	<0.00019
Molybdenum	mg/L	<0.00014		<0.00028		<0.000019		<0.0015	<0.0015	<0.0300	<0.0015	<0.0015	<0.0015	0.00092 J	0.0011 J	<0.000095	<0.0002	0.00058 J	<0.00095
Radium 226	pCi/L	0.679		0.0839		0.513			<0.27	0.196 J	0.365	0.132 J	0.141 J	1.1	1.17	<0.0457	0.18	<0.219	0.3
Radium 228	pCi/L	0.717		0.477		0.304			<0.5	0.768	0.765	1.47	0	<0.442	<0.353	0.864	0.897	<0.490	0.44
Radium, 226/228 Combined	pCi/L	1.396		0.561		0.817			<0.77	0.964	1.13	1.6	0.141	1.1	1.17	0.864	1.077	<0.490	0.74
Selenium	mg/L	<0.00033	<0.0028	<0.00033		<0.00056		<0.0010	<0.0010	<0.0200	<0.0010	<0.0010	<0.0010	0.13	0.12	0.13	0.2	0.13	0.13
Thallium	mg/L	<0.0081	<0.01	<0.00015		<0.004		<0.0020	0.0019 J	<0.0400	<0.0020	<0.0020	<0.0020	<0.0007	0.065	0.092	0.094	0.058	<0.0081
Turbidity	NTU							9.96	6.84	4.2	4.9	1.7	0.42						

## Notes:

J = Indicates the result is estimated

&lt; = Analyte was not detected above the method detection limit

R = relative percent difference for the laboratory duplicate

mg/L = milligrams per liter

pCi/L = picoCuries per liter

NTU = Nephelometric Turbidity Unit

**Table 3: Analytical Data**  
**Former Emery Pond**  
**Southern Illinois Power Cooperative Mari**  
**Marion, Illinois**

Well ID	EP-4	EP-4	EP-4	EP-4	EP-4	EP-4	EP-5	EP-5	EP-5										
Sample Date	8/1/2017	8/31/2017	3/22/2018	8/27/2018	1/11/2019	6/27/2019	1/30/2020	6/22/2020	1/21/2021	5/31/2021	8/30/2021	12/22/2021	3/8/2022	5/25/2022	9/7/2022	12/21/2021	3/7/2022	5/24/2022	
Sample Purpose	Background	Corrective Action Monitoring																	
<b>ANALYTE</b>	Unit																		
Boron	mg/L	14	11	13	11	15	11.5	11	9.9	10	11.9	11.8	11.6	11.1	11.8	11.8	0.0855	0.038	0.0254
Calcium	mg/L	150	150	200	150	140	159	170	150	140	179	162	161	171	188	147	25.4	22.5	21
Chloride	mg/L	210	210	200	310	420	440	370	380	390	484	446	477	456	460	478	4	3	3
Fluoride	mg/L	<0.029	<0.029	<0.25	<0.5	<0.06	<0.06	<0.06	<0.5	<0.2	0.1	0.09 J	0.09 J	0.12	0.12	0.10 J	0.48	0.4	0.38
pH	SU	5.8	5.85	6.04	5.85	6.07	5.86	5.94	5.79	5.91	5.79	5.7	6.05	5.94	5.88	5.7	7.07	6.73	6.55
Sulfate	mg/L	330	340	320	520	750	710	630	610	580	670	565	567	623	531	673	119	141	132
Total Dissolved Solids	mg/L	2200	2300	2100	1900	2000	130	2000	2500	1900	1860 R	1750	1450	1740	1730	1640	294	326	322
Antimony	mg/L	<0.0002	<0.0026		<0.0016		<0.0016		<0.00052		<0.0010	<0.0010	<0.0200	<0.0010	<0.0010	<0.0010	<0.0200	<0.0010	<0.0010
Arsenic	mg/L	0.035	0.049		<0.002		0.026 J	0.019	0.014	<0.05	0.0075	0.0073	<0.0200	0.0053	0.0071	0.0068	<0.0200	0.0004 J	<0.0010
Barium	mg/L	0.031	0.023		0.023		<0.00011		0.027		0.0248	0.027	0.0255	0.0313	0.0329	0.0236	0.0478	0.0513	0.0529
Beryllium	mg/L	<0.0002	<0.00055			<0.00055	<0.00015		<0.00055		<0.0010	<0.0010	<0.0200	<0.0010	<0.0010	<0.0010	<0.0200	<0.0010	<0.0010
Cadmium	mg/L	<0.0015	<0.0015		<0.0015		<0.000018		<0.00002		<0.0010	<0.0010	<0.0200	<0.0010	<0.0010	<0.0200	<0.0010	<0.0010	<0.0010
Chromium	mg/L	<0.0031	<0.0031		0.011	<0.0026	<0.00014		<0.0011		<0.0015	<0.0015	<0.0300	0.002	<0.0015	<0.0015	<0.0300	0.0008 J	<0.0015
Cobalt	mg/L	0.42	0.38		0.31	0.41	0.28	0.26	0.33	0.32	0.287	0.326	0.298	0.200	0.205	0.471	<0.0200	0.0005 J	<0.0010
Lead	mg/L	0.012	0.012		0.015	<0.0042	<0.00016		0.018	<0.025	<0.0010	<0.0010	<0.0200	<0.0010	<0.0010	<0.0200	<0.0010	<0.0010	<0.0010
Lithium	mg/L	0.0053 J	<0.0042		<0.0042		<0.04		<0.0042		<0.0015	0.0023 J	<0.0600	0.0025 J	0.0025 J	0.0021 J	<0.0600	0.0027 J	0.0023 J
Mercury	mg/L	<0.00019	<0.0002		<0.000093		<0.0001		<0.00019		<0.00020	<0.00020	<0.00020	<0.00020	<0.00020	<0.00020	<0.00020	<0.00020	<0.00020
Molybdenum	mg/L	0.0010 J	<0.00095		<0.00014		<0.00028		<0.000019		<0.0015	<0.0015	<0.030	<0.0015	<0.0015	<0.0015	<0.0300	0.003	0.0027
Radium 226	pCi/L	0.15	0.33		0.262		0.77		0.163		<0.11	0.170 J	0.234	0.144 J	0.276	0.564	0.157 J	0.232 J	
Radium 228	pCi/L	0.96	2.14		0.79		0.929		0.41		<0.14	1.21	0.658	1.25	1.22	-0.125	0.474 J	0.287	
Radium, 226/228 Combined	pCi/L	1.11	2.47		1.052		1.7		0.573		<0.25	1.38	0.893	1.39	1.49	0.564 J	0.63	0.519 J	
Selenium	mg/L	0.11	0.16		0.021	<0.0028	<0.00033		0.0012		<0.0010	<0.0010	<0.0200	<0.0010	<0.0010	0.0006 J	<0.0200	0.0017	0.0015
Thallium	mg/L	0.075	0.075		0.14	0.18	<0.00015		<0.004		<0.0020	0.0012 J	<0.0400	<0.0020	<0.0020	<0.0400	0.0031	<0.0020	
Turbidity	NTU										19.22	9.75	10	5	1.5	<1.0	4.9	0.6	<1.0

Notes:

J = Indicates the result is estimated

&lt; = Analyte was not detected above the method detection limit

R = relative percent difference for the laboratory duplicate

mg/L = milligrams per liter

pCi/L = picoCuries per liter

NTU = Nephelometric Turbidity Unit

**Table 3: Analytical Data**  
**Former Emery Pond**  
**Southern Illinois Power Cooperative Mari**  
**Marion, Illinois**

Well ID	EP-5	EP-6	EP-6	EP-6	EP-6	EP-7	EP-7	EP-7
Sample Date	9/6/2022	12/22/2021	3/8/2022	5/24/2022	9/6/2022	12/22/2021	3/8/2022	5/25/2022
Sample Purpose	Corrective Action Monitoring							
<b>ANALYTE</b>								
Boron	mg/L	0.0222	0.0252	<0.0200	<0.0200	0.984	0.91	0.682
Calcium	mg/L	16.7	4.24	1.92	1.65	1.86	178	170
Chloride	mg/L	3 J	25	23	24	23	186	239
Fluoride	mg/L	0.38	0.06 J	0.06 J	0.06 J	0.07 J	0.33	0.3
pH	SU	6.44	5.28	5.1	5.07	5.09	6.16	5.97
Sulfate	mg/L	114	48	67	63	64	549	556
Total Dissolved Solids	mg/L	282	192	254	238	216	1270	1450
Antimony	mg/L	<0.0010	<0.0200	<0.0010	<0.0010	<0.0200	<0.0010	<0.0010
Arsenic	mg/L	<0.0010	<0.0200	<0.0010	<0.0010	<0.0200	0.0173	0.0139
Barium	mg/L	0.0506	0.043	0.0345	0.034	0.0366	0.0344	0.0271
Beryllium	mg/L	<0.0010	<0.0200	<0.0010	<0.0010	<0.0200	<0.0010	<0.0010
Cadmium	mg/L	<0.0010	<0.0200	<0.0010	<0.0010	<0.0010	<0.0200	<0.0010
Chromium	mg/L	<0.0015	<0.0300	0.0013 J	0.0008 J	<0.0015	<0.0300	<0.0015
Cobalt	mg/L	<0.0010	0.0040 J	0.0017	0.0007 J	0.0018	0.110	0.139
Lead	mg/L	<0.0010	<0.0200	<0.0010	<0.0010	<0.0200	<0.0010	0.0008 J
Lithium	mg/L	0.0023 J	<0.0600	0.0113	0.011	0.0094	<0.0600	<0.00300
Mercury	mg/L	<0.00020	0.00010 J	<0.00020	<0.00020	<0.00020	<0.00020	<0.00020
Molybdenum	mg/L	0.0017	<0.0300	<0.0015	<0.0015	<0.0015	<0.0300	0.0012 J
Radium 226	pCi/L	0.214 J	0.0641	0.123 J	0.112 J	0.0891 J	0.103 J	0.0766 J
Radium 228	pCi/L	-0.235	0.297 J	1.01	0.183	0.702	0.0686 J	0.954
Radium, 226/228 Combined	pCi/L	0.214	0.362 J	1.13	0.295	0.791	0.172 J	1.03
Selenium	mg/L	0.0012	<0.0200	<0.0010	<0.0010	<0.0200	<0.0010	<0.0010
Thallium	mg/L	<0.0020	<0.0400	<0.0200	<0.0020	<0.0020	<0.0400	<0.0020
Turbidity	NTU	<1.0	7.5	4	3.3	<1.0	4.3	14
								<1.0

**Notes:**

J = Indicates the result is estimated

&lt; = Analyte was not detected above the method detection limit

R = relative percent difference for the laboratory duplicate

mg/L = milligrams per liter

pCi/L = picoCuries per liter

NTU = Nephelometric Turbidity Unit

Created by: CCC

Checked by: GRD

Reviewed by: MAH

**Table 4: Groundwater Protection Standard Summary**

Analyte	Unit	Background Tolerance Limit <sup>1</sup>	40 CFR Standard <sup>2</sup>	GPS <sup>3</sup>
Antimony	mg/L	ND (0.001)	0.006	0.006
Arsenic	mg/L	ND (0.001)	0.01	0.01
Barium	mg/L	0.28	2	2
Beryllium	mg/L	ND (0.001)	0.004	0.004
Cadmium	mg/L	ND (0.001)	0.005	0.005
Chromium	mg/L	ND (0.0015)	0.1	0.1
Cobalt	mg/L	0.018	0.006	0.018
Fluoride	mg/L	0.64	4	4
Lead	mg/L	ND (0.001)	0.015	0.015
Lithium	mg/L	0.082	0.04	0.082
Mercury	mg/L	ND (0.0002)	0.002	0.002
Molybdenum	mg/L	0.007	0.10	0.1
Selenium	mg/L	0.017	0.05	0.05
Thallium	mg/L	ND (0.002)	0.002	0.002
Radium 226 and 228	pCi/L	3.48	5	5


**Notes:**

1. The background tolerance limit was using the data collected between March 2017 and January 2021 at background well EBG
2. GPS provided in 40 CFR §257.95(h), 40 CFR §141.62 and 40 CFR §141.66
3. The former Emery Pond GPS is the maximum of the background tolerance limit and the GPS provided in 40 CFR §257.95(h)(2), 40 CFR §141.62 and 40 CFR §141.66

**Abbreviations:**

EPA = Environmental Protection Agency  
 GPS = Groundwater Protection Standard  
 mg/L = milligrams per Liter  
 ND = Non-detect concentration  
 pCi/L = picoCuries per Liter  
 pH = potential of Hydrogen

## FIGURES



NOTE(S)

REFERENCE(S)

1. COORDINATE SYSTEM: GCS WGS 1984
2. BASEMAP CONSISTS OF USGS 7.5 MINUTE QUADRANGLE MAPS.

CLIENT

SOUTHERN ILLINOIS POWER COOPERATIVE

PROJECT  
ANNUAL GROUNDWATER AND CORRECTIVE ACTION REPORT  
FORMER EMERY POND

TITLE

SITE LOCATION MAP

CONSULTANT


YYYY-MM-DD	2023-01-30
DESIGNED	CCC
PREPARED	EMM
REVIEWED	DSC
APPROVED	MAH


PROJECT NO. GL21467997.001- CONTROL


REV. -


FIGURE 1


**WSP**

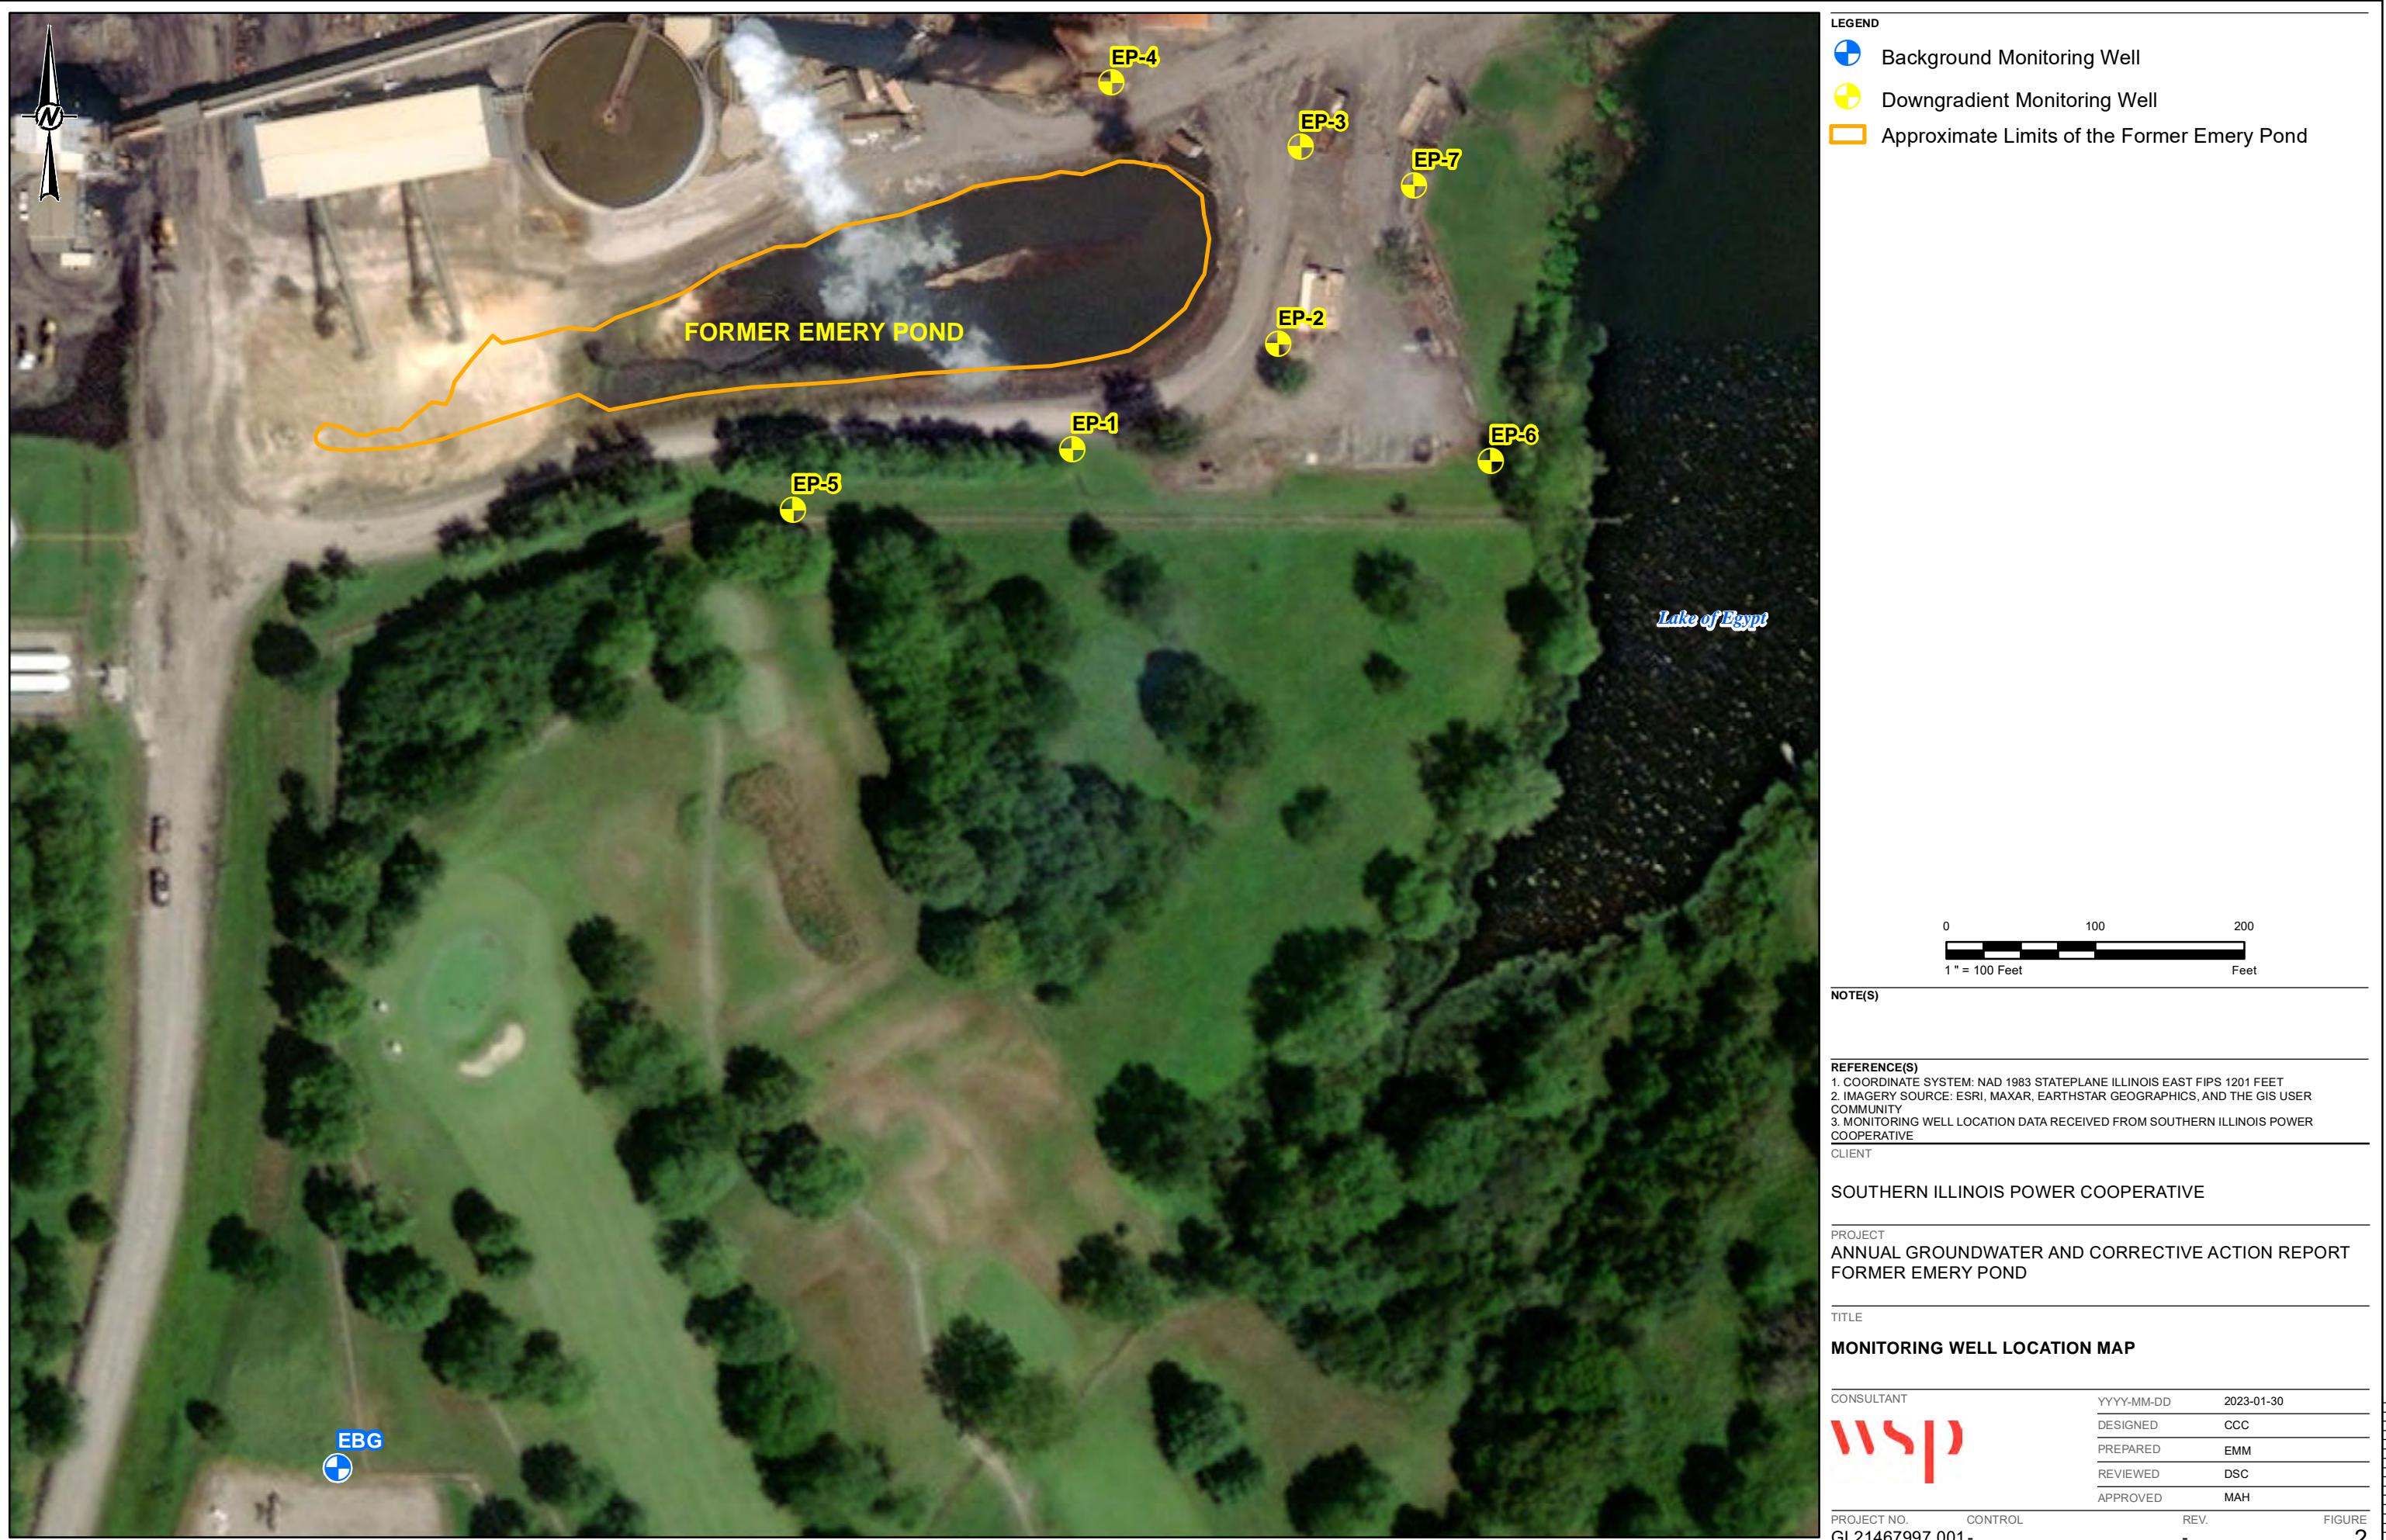


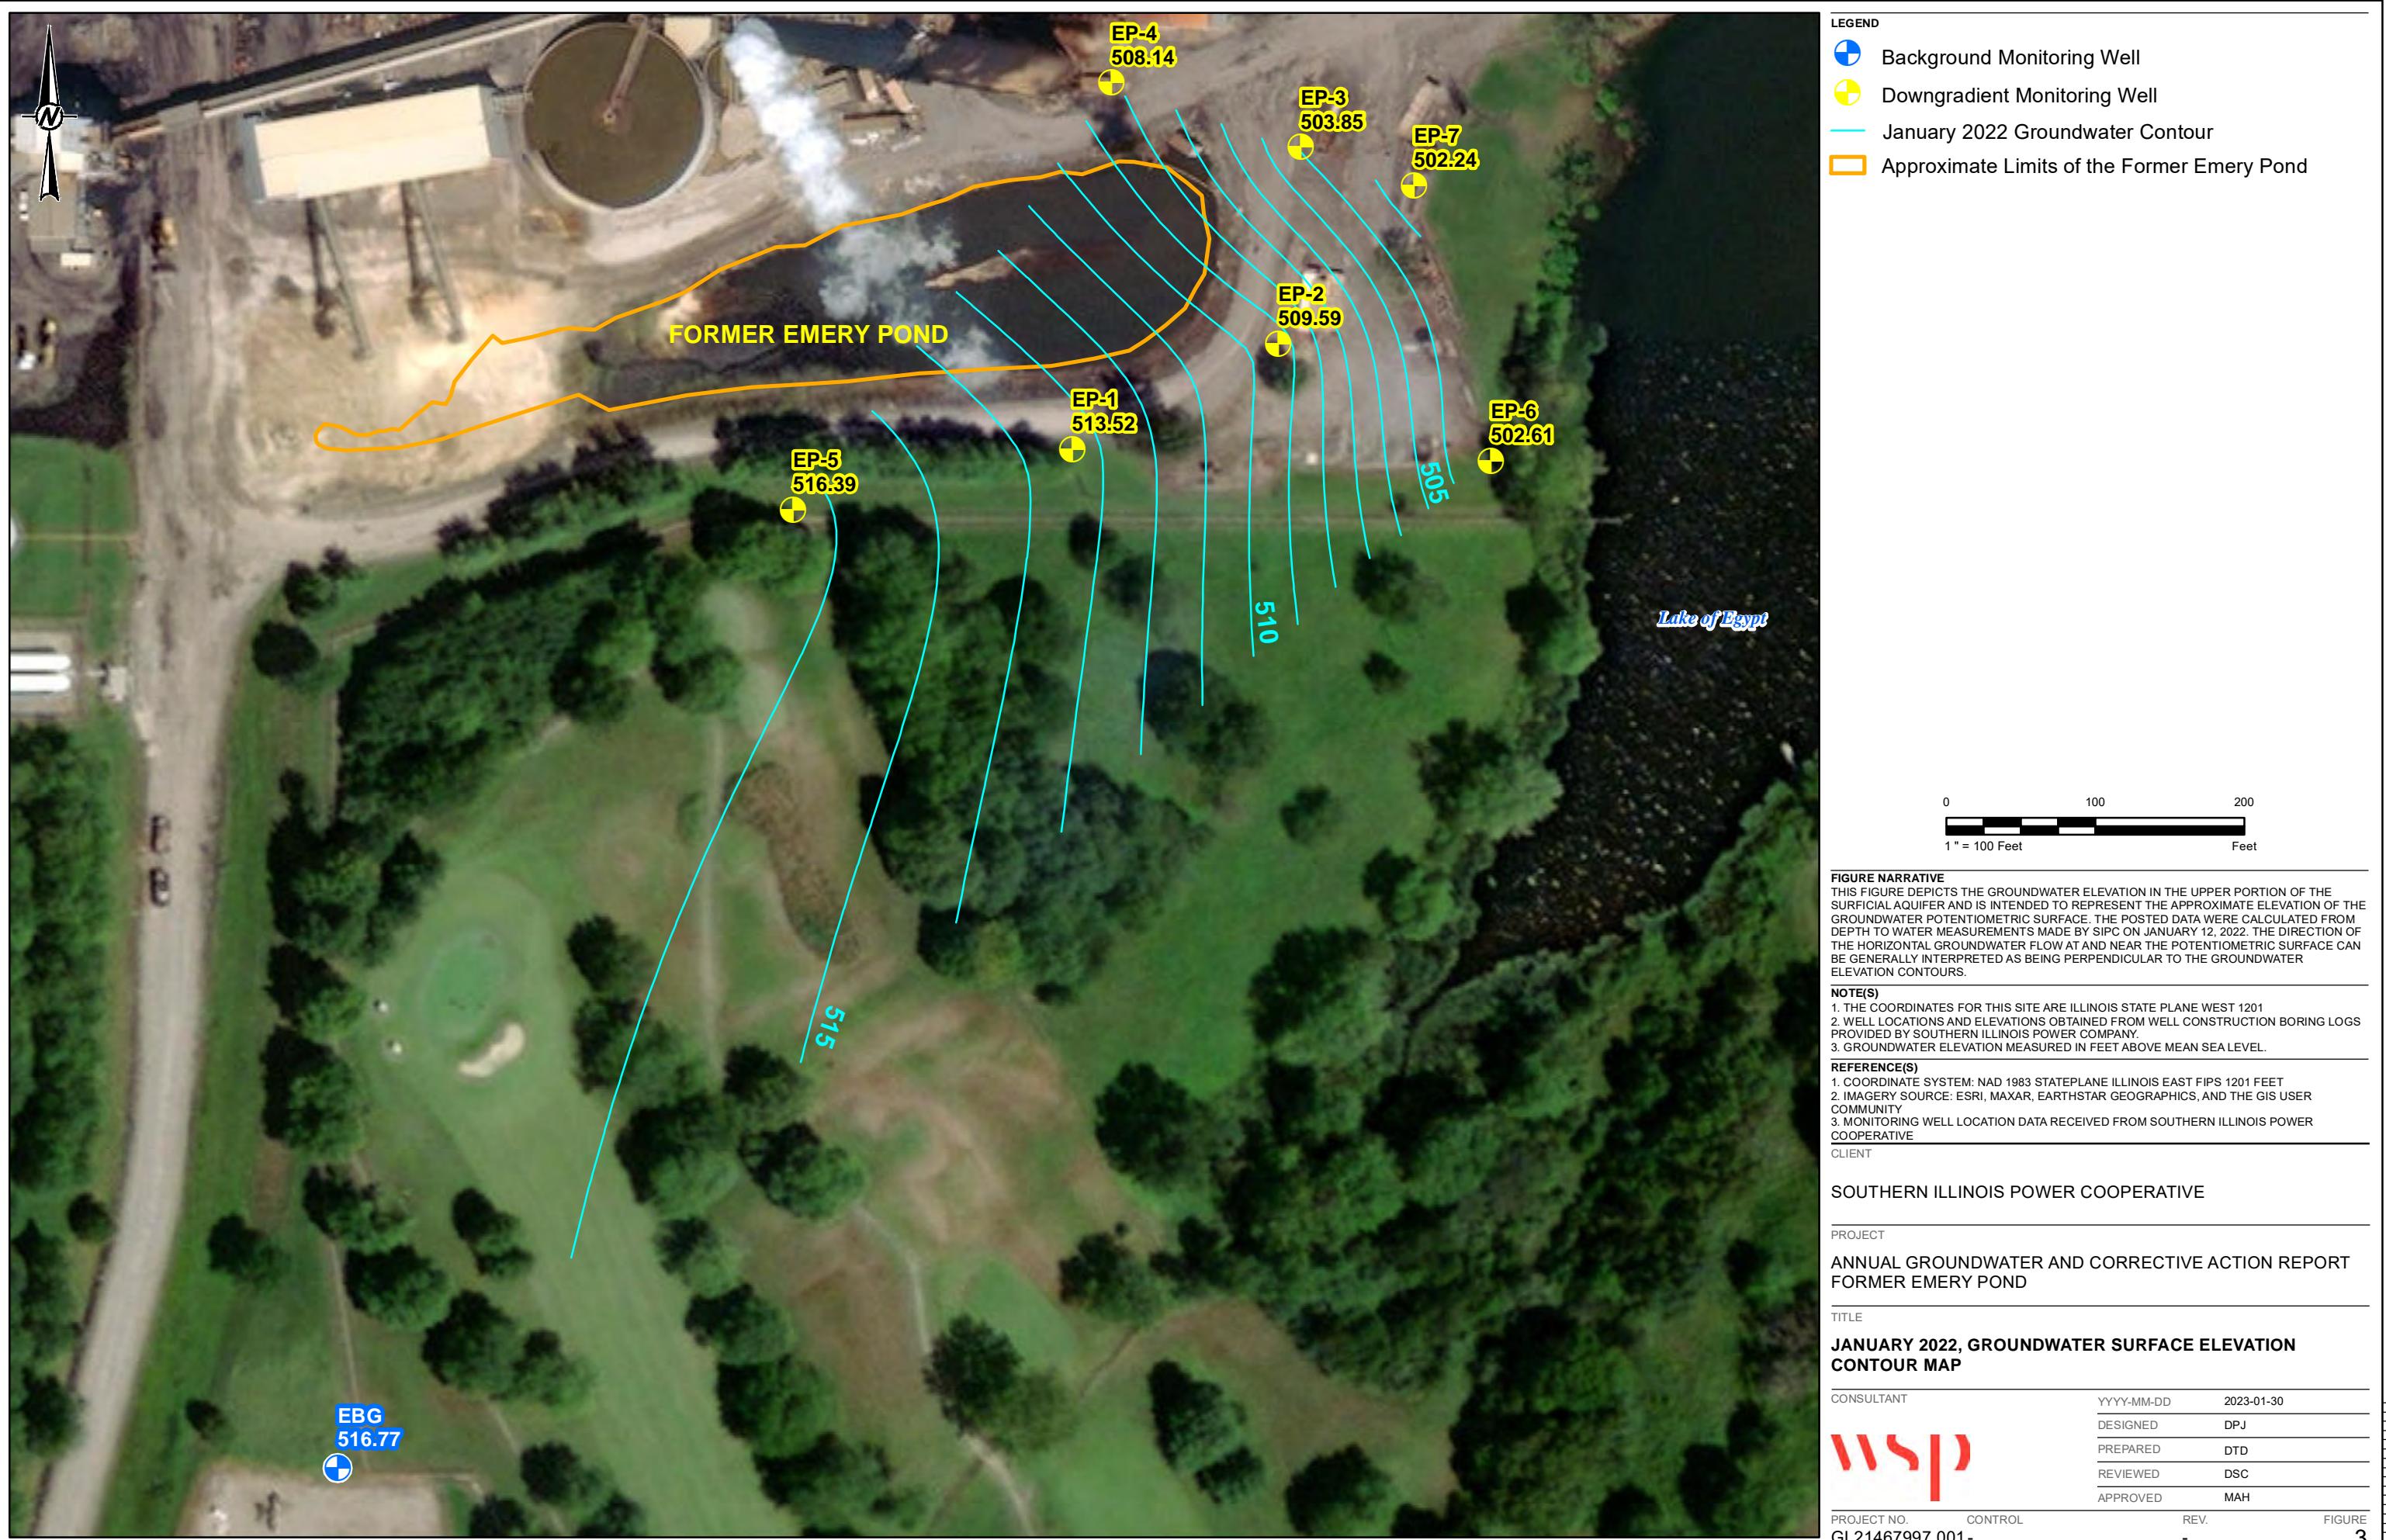


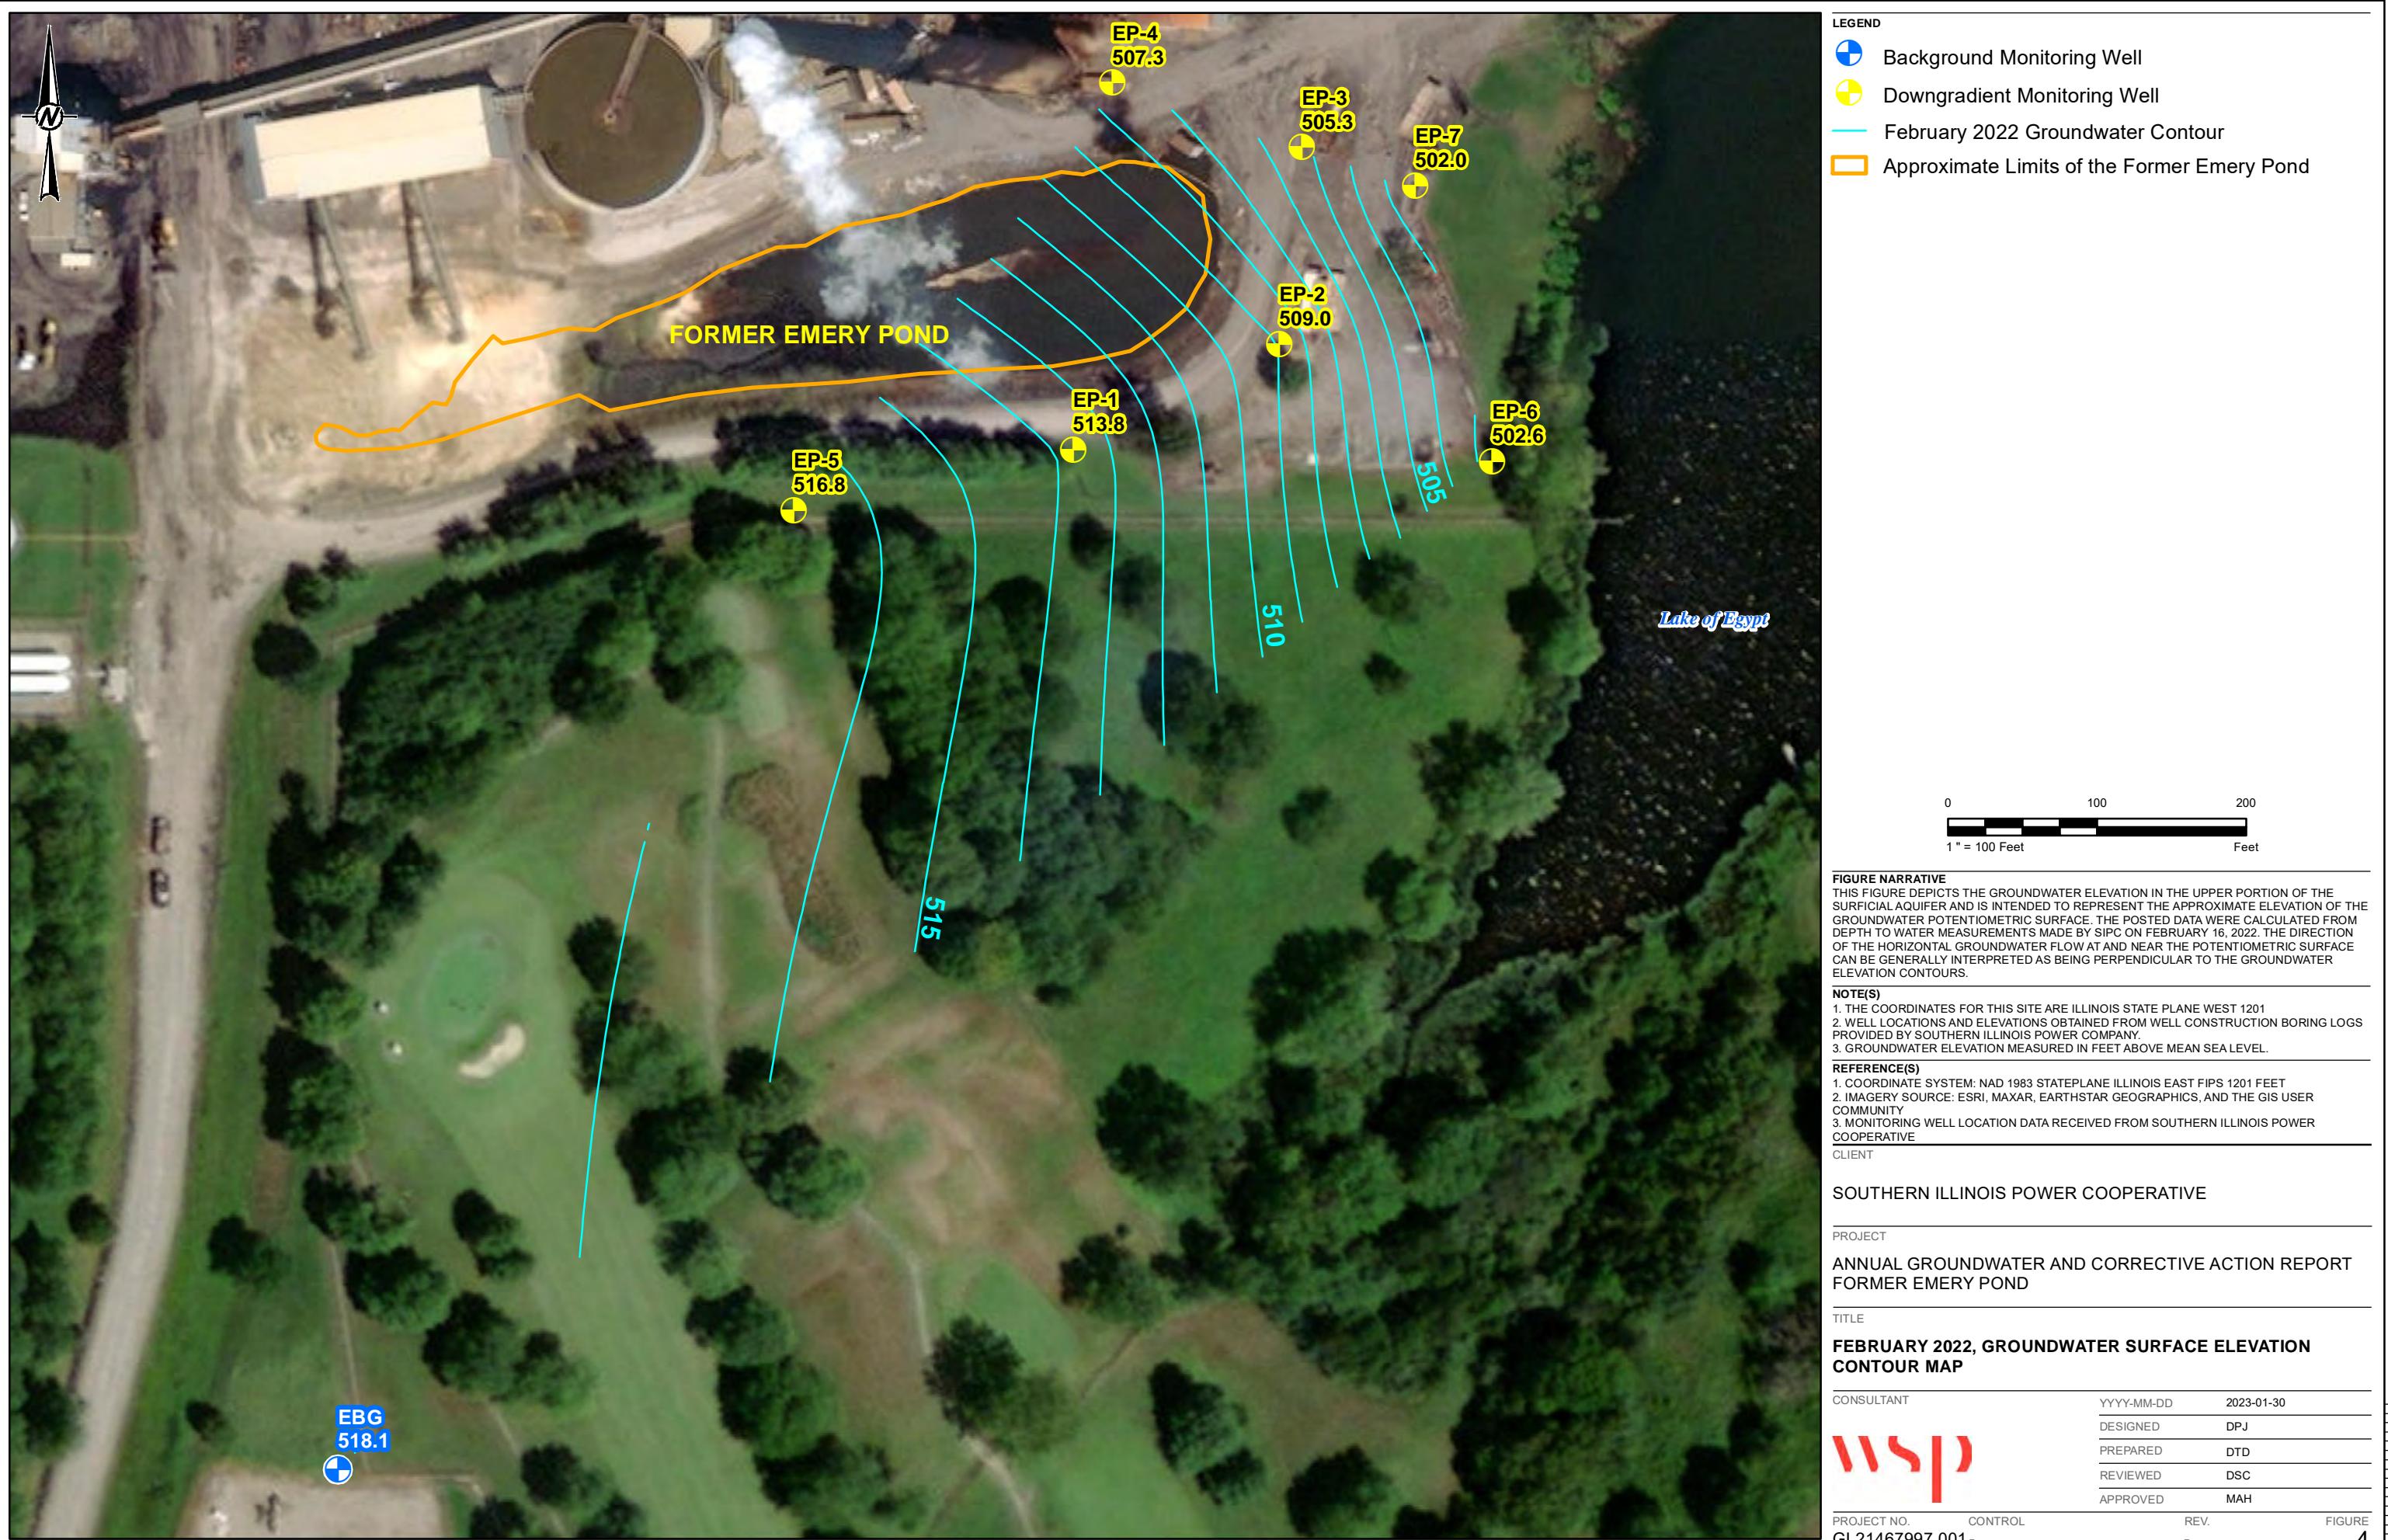


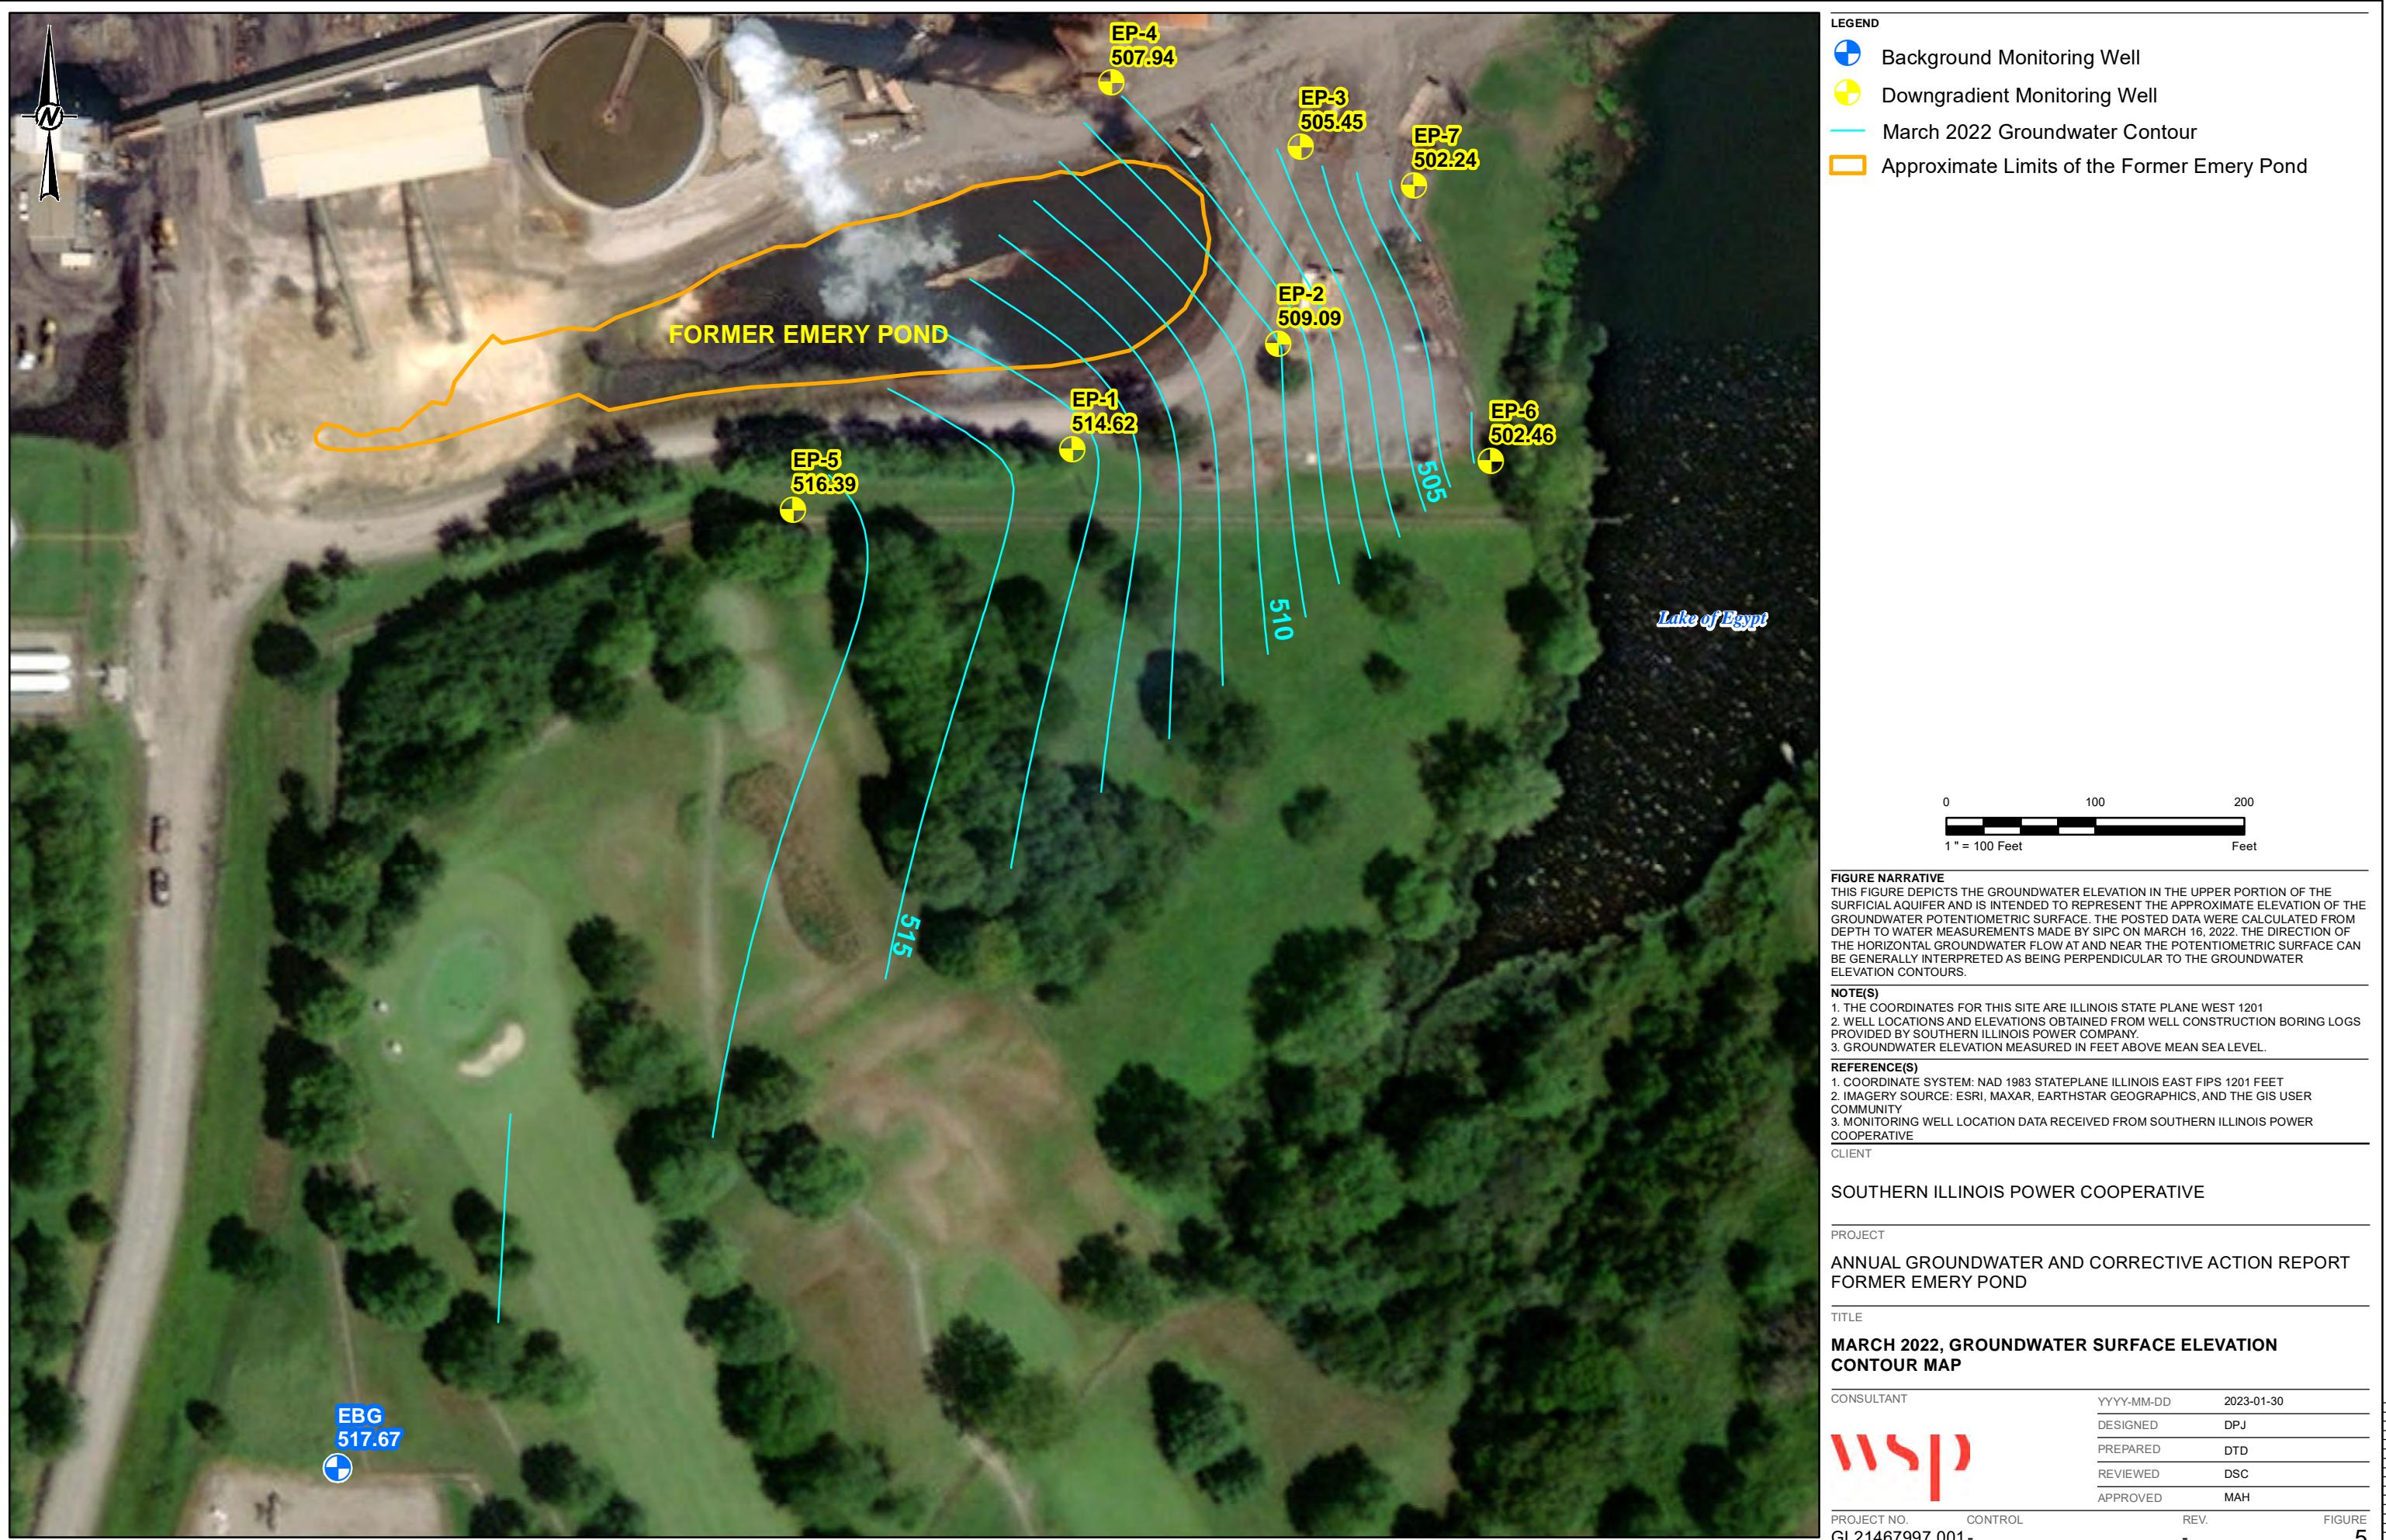


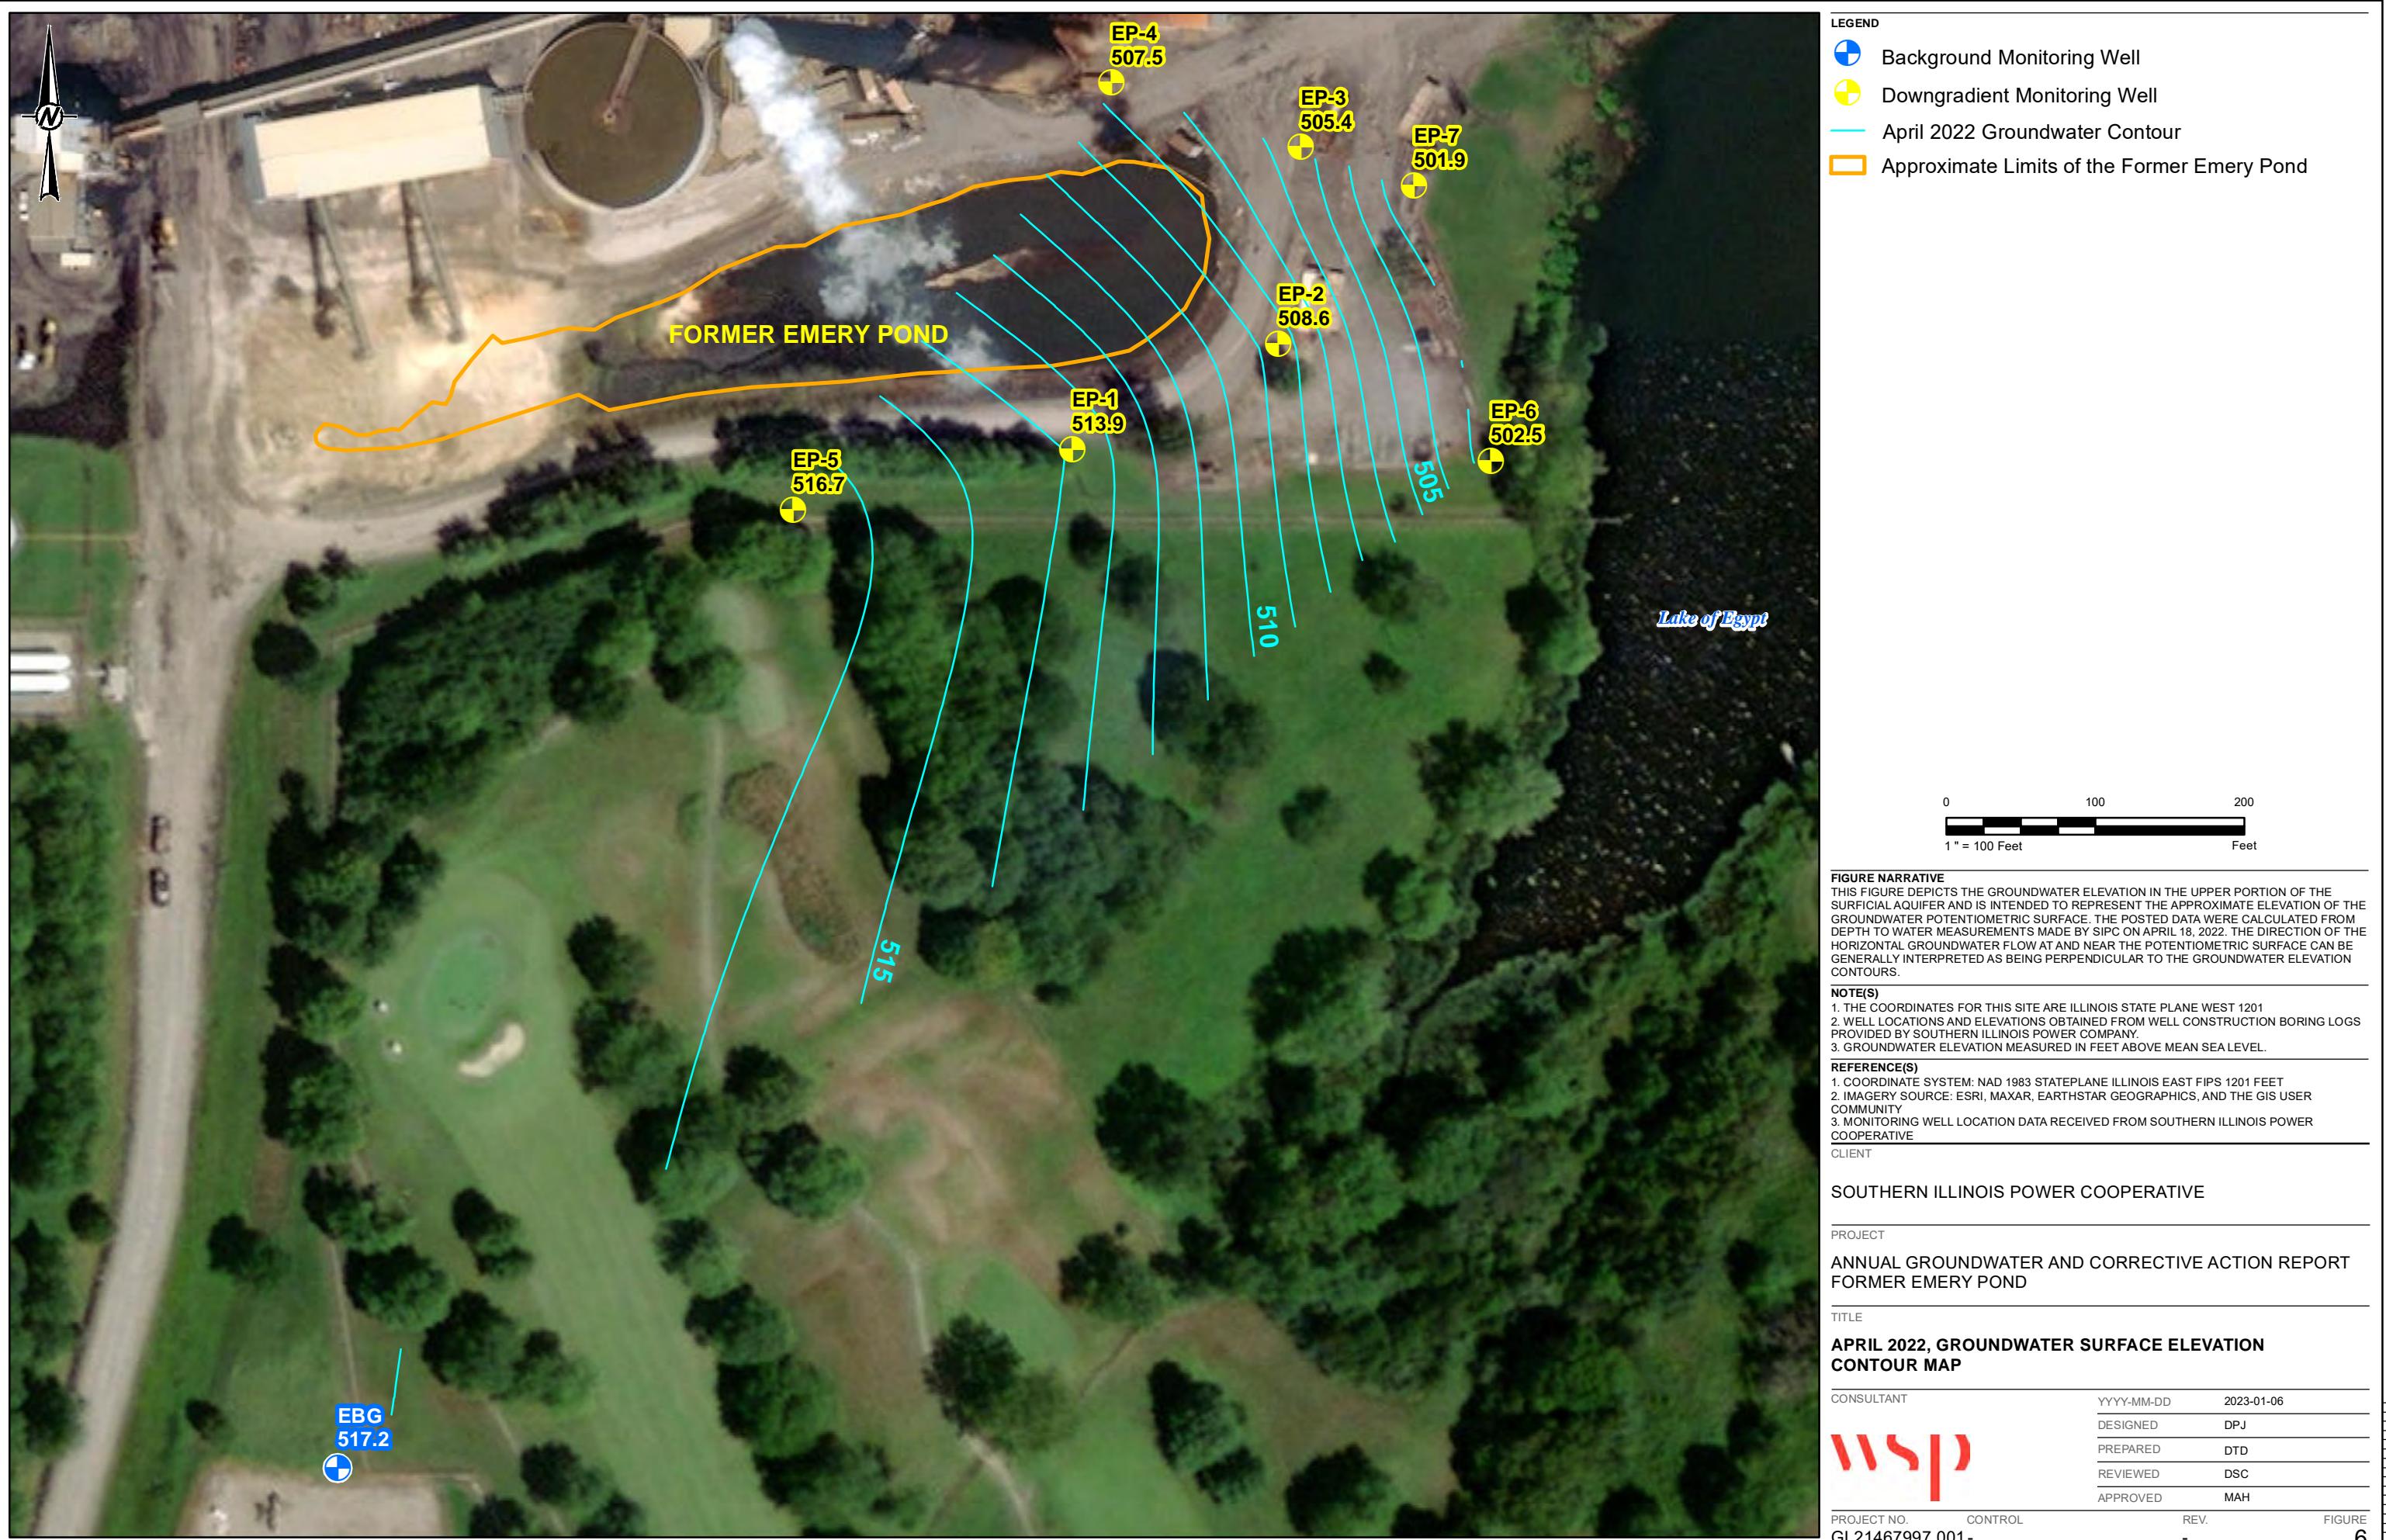


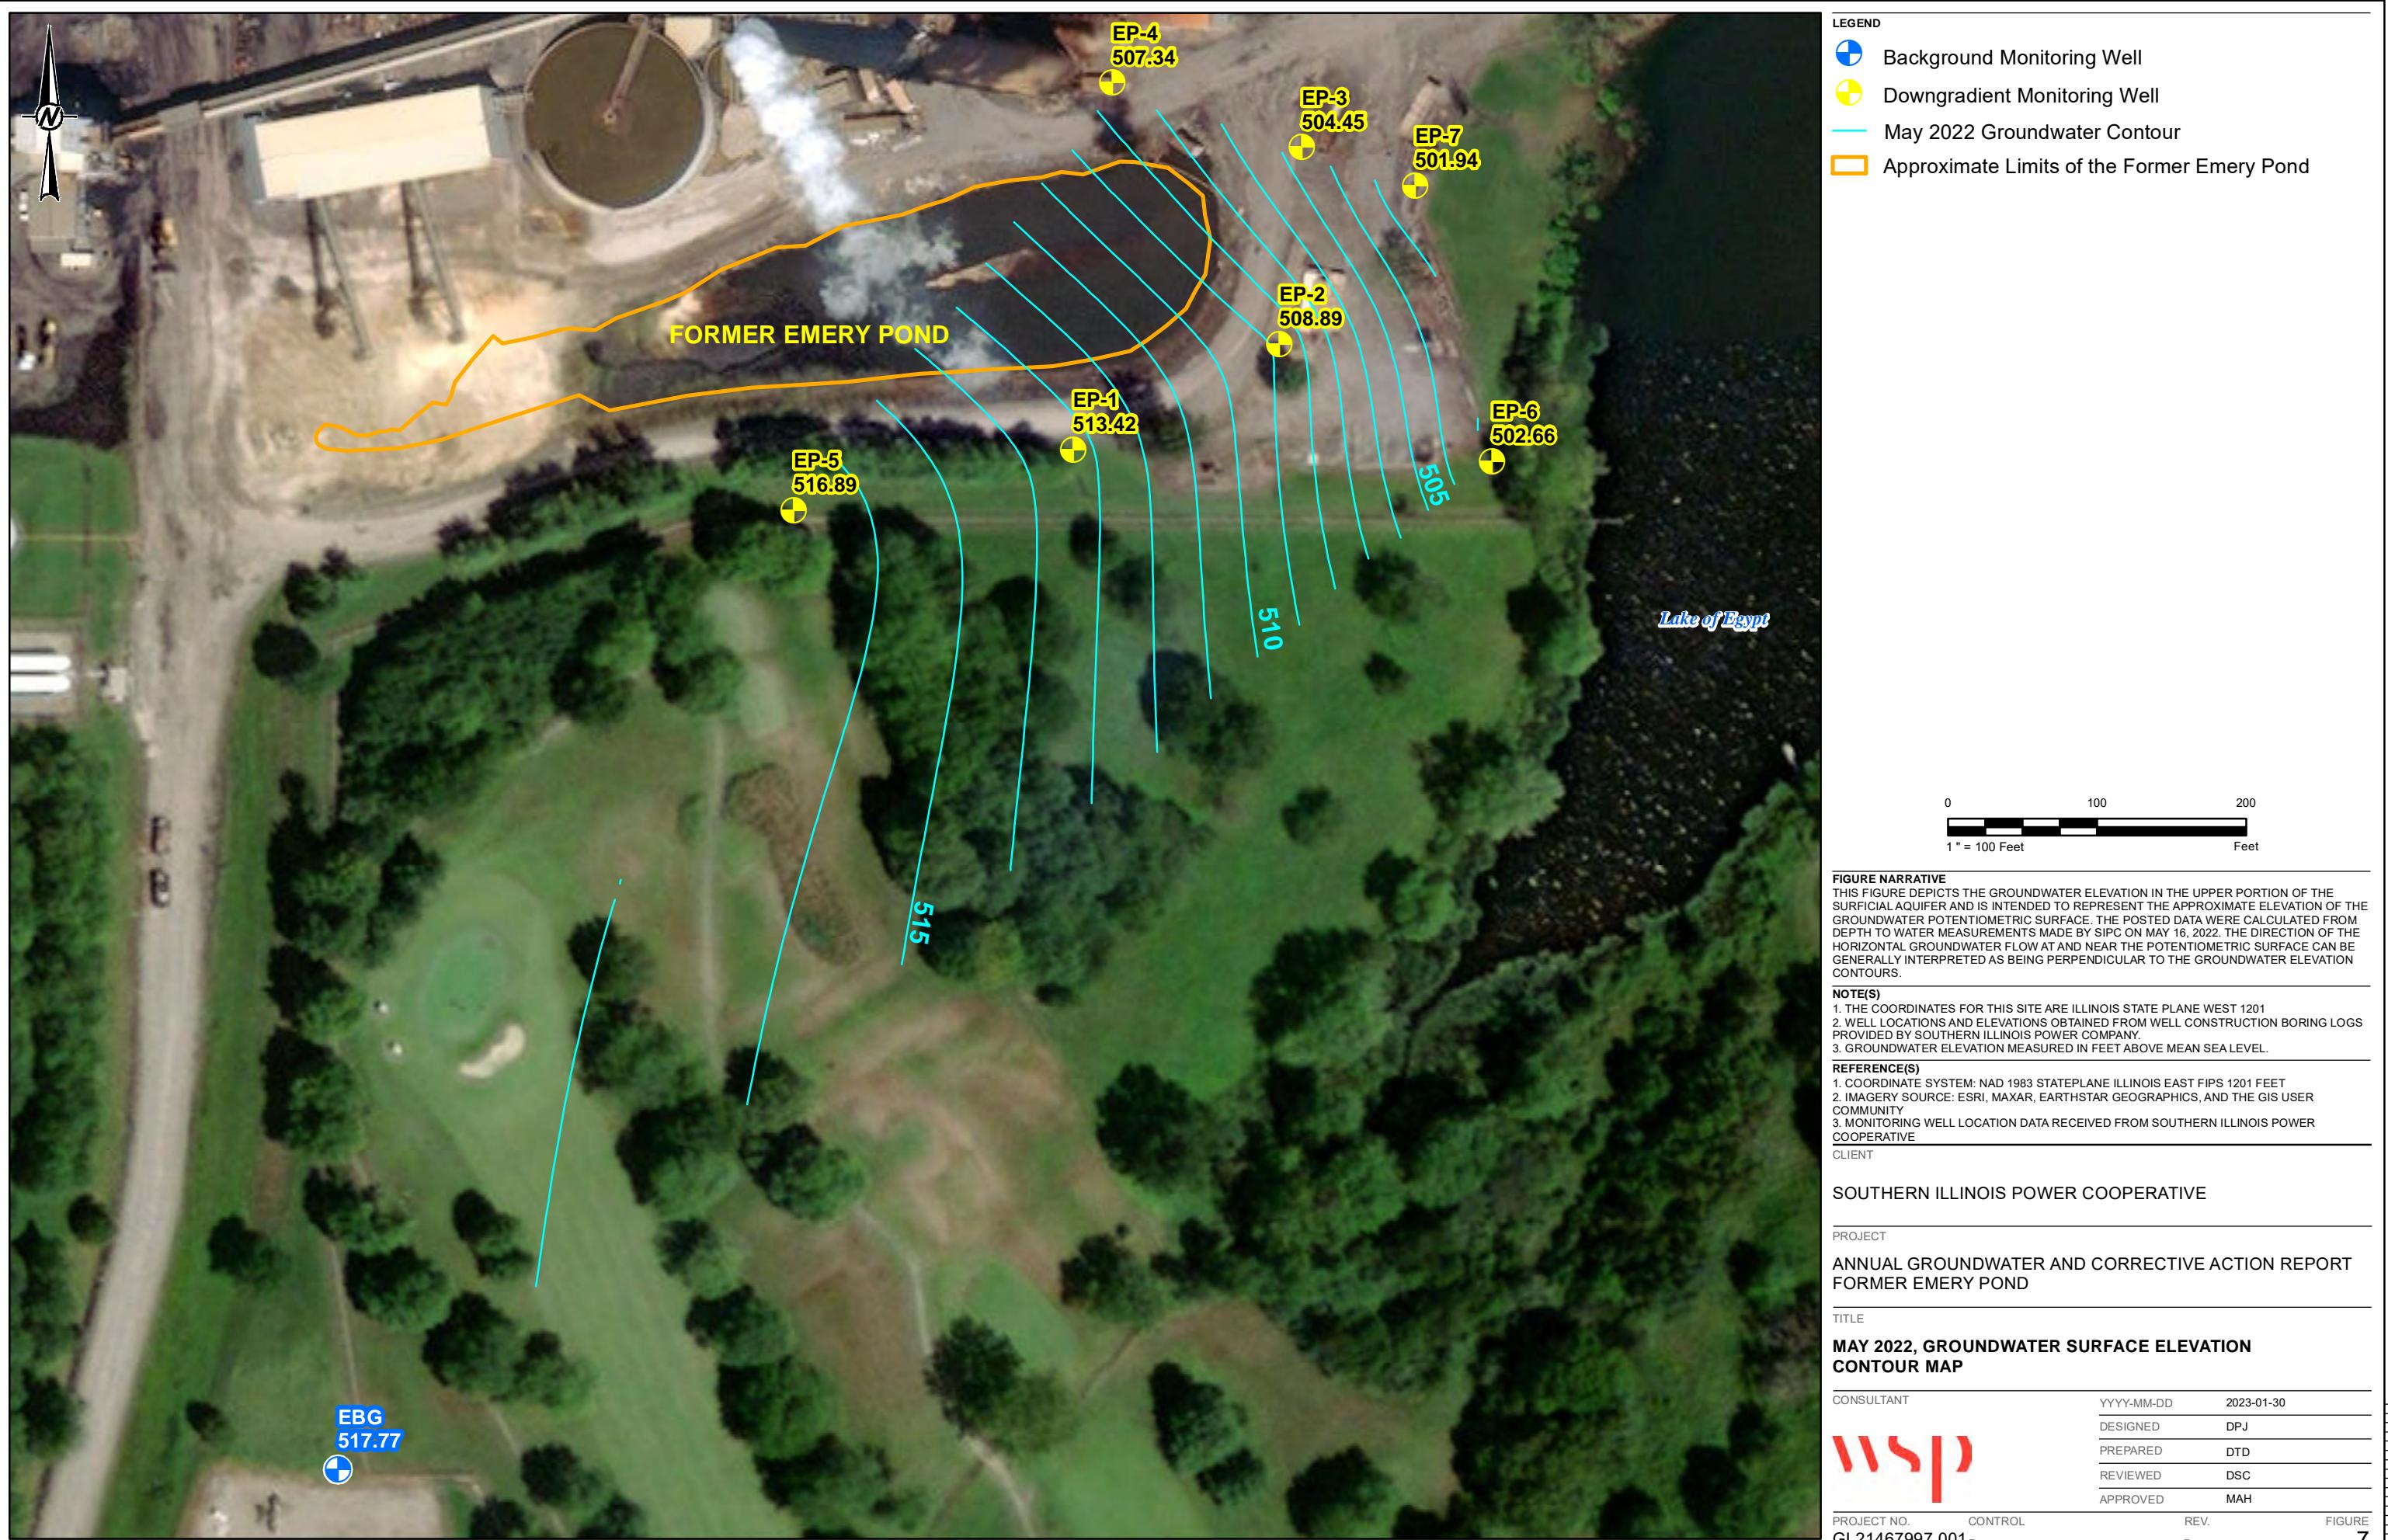


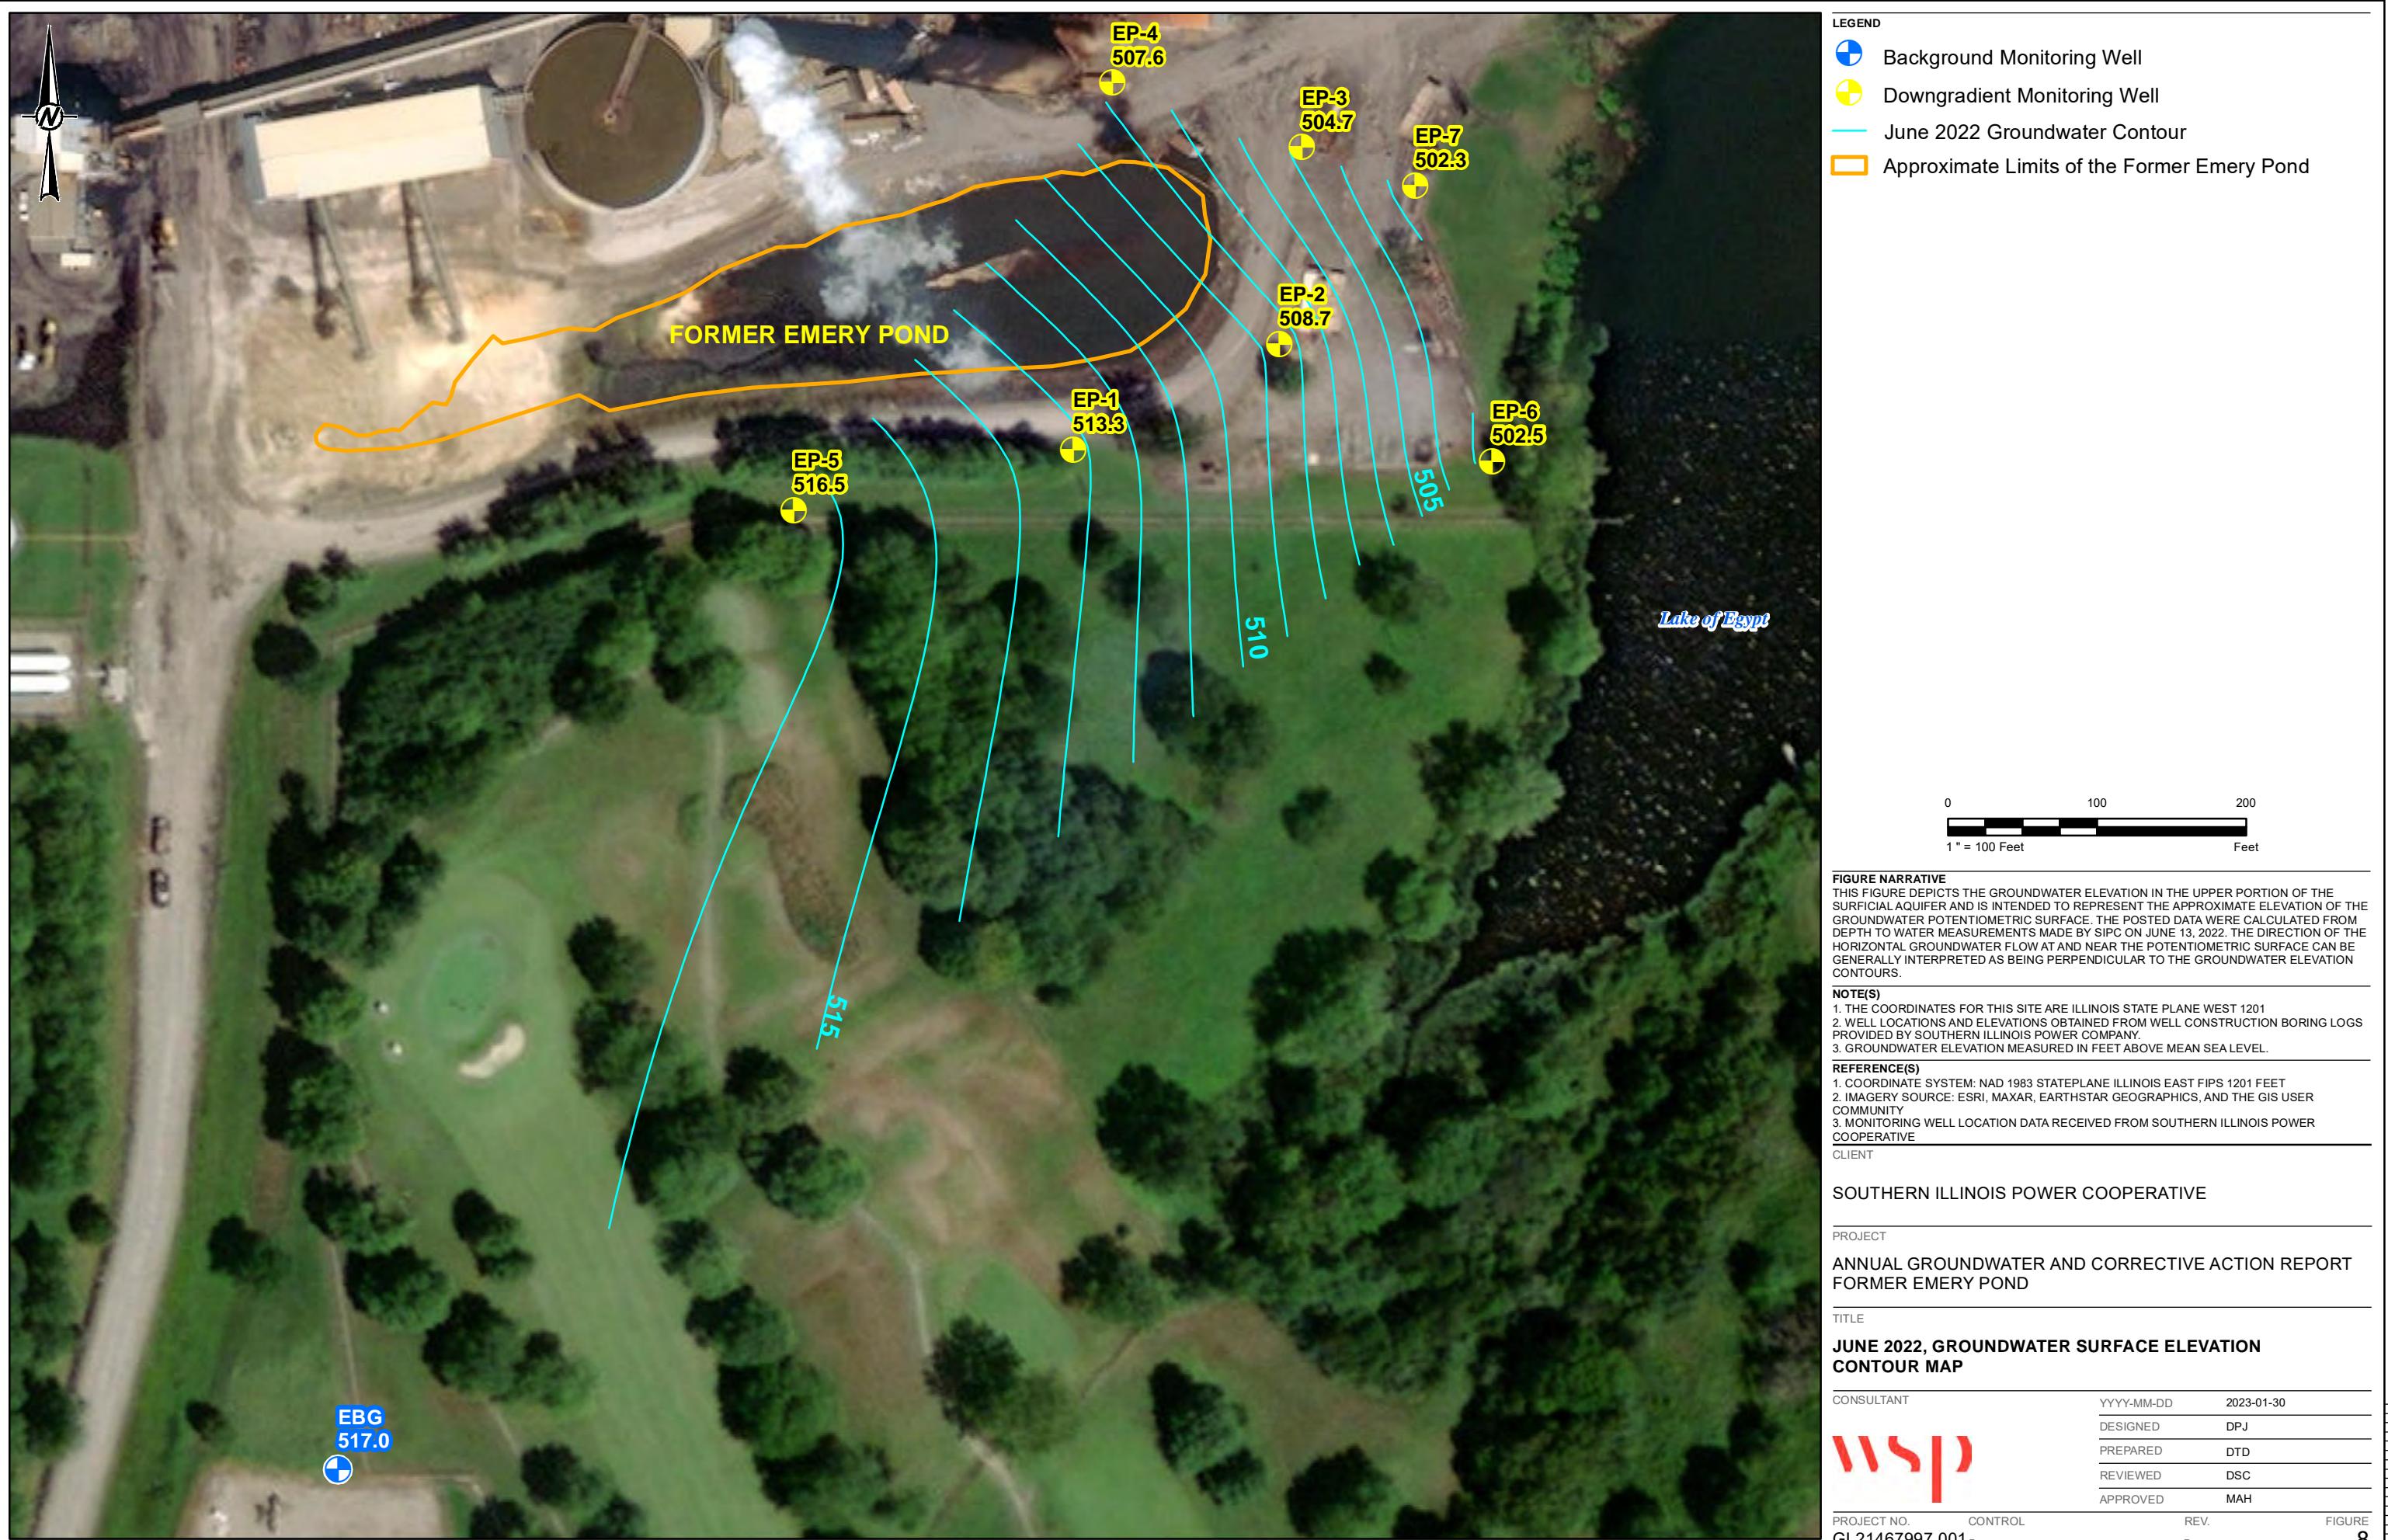


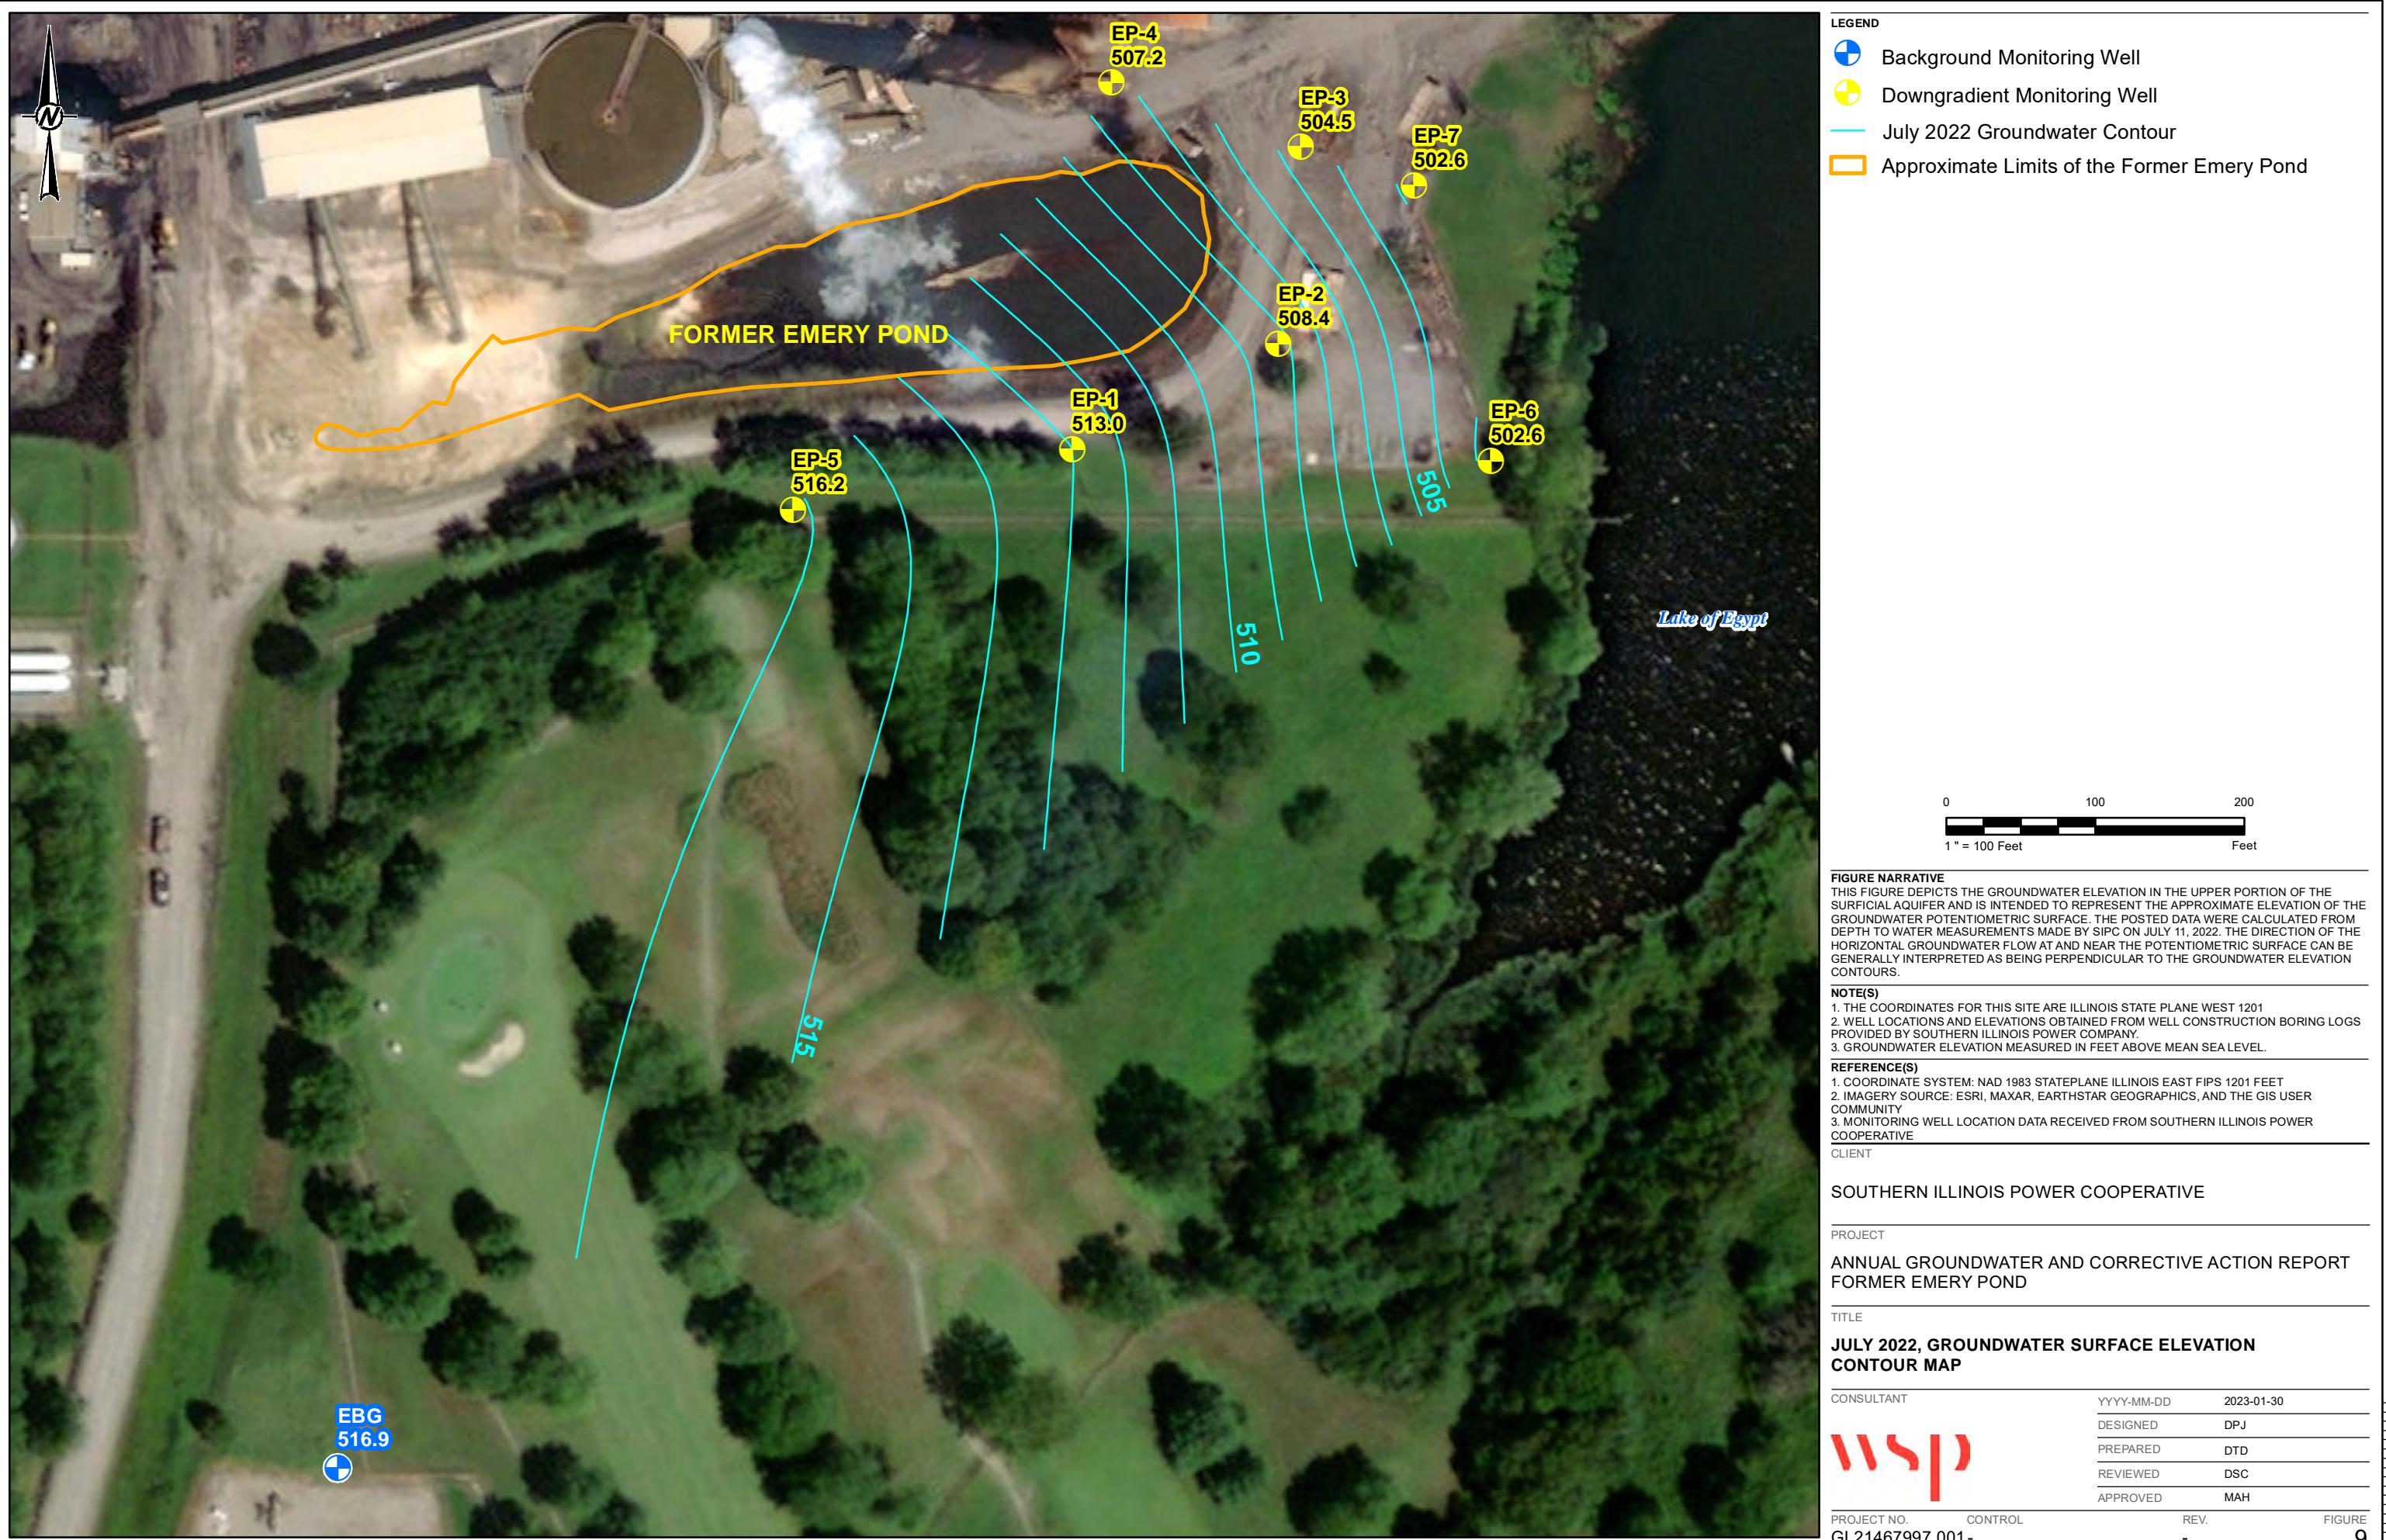


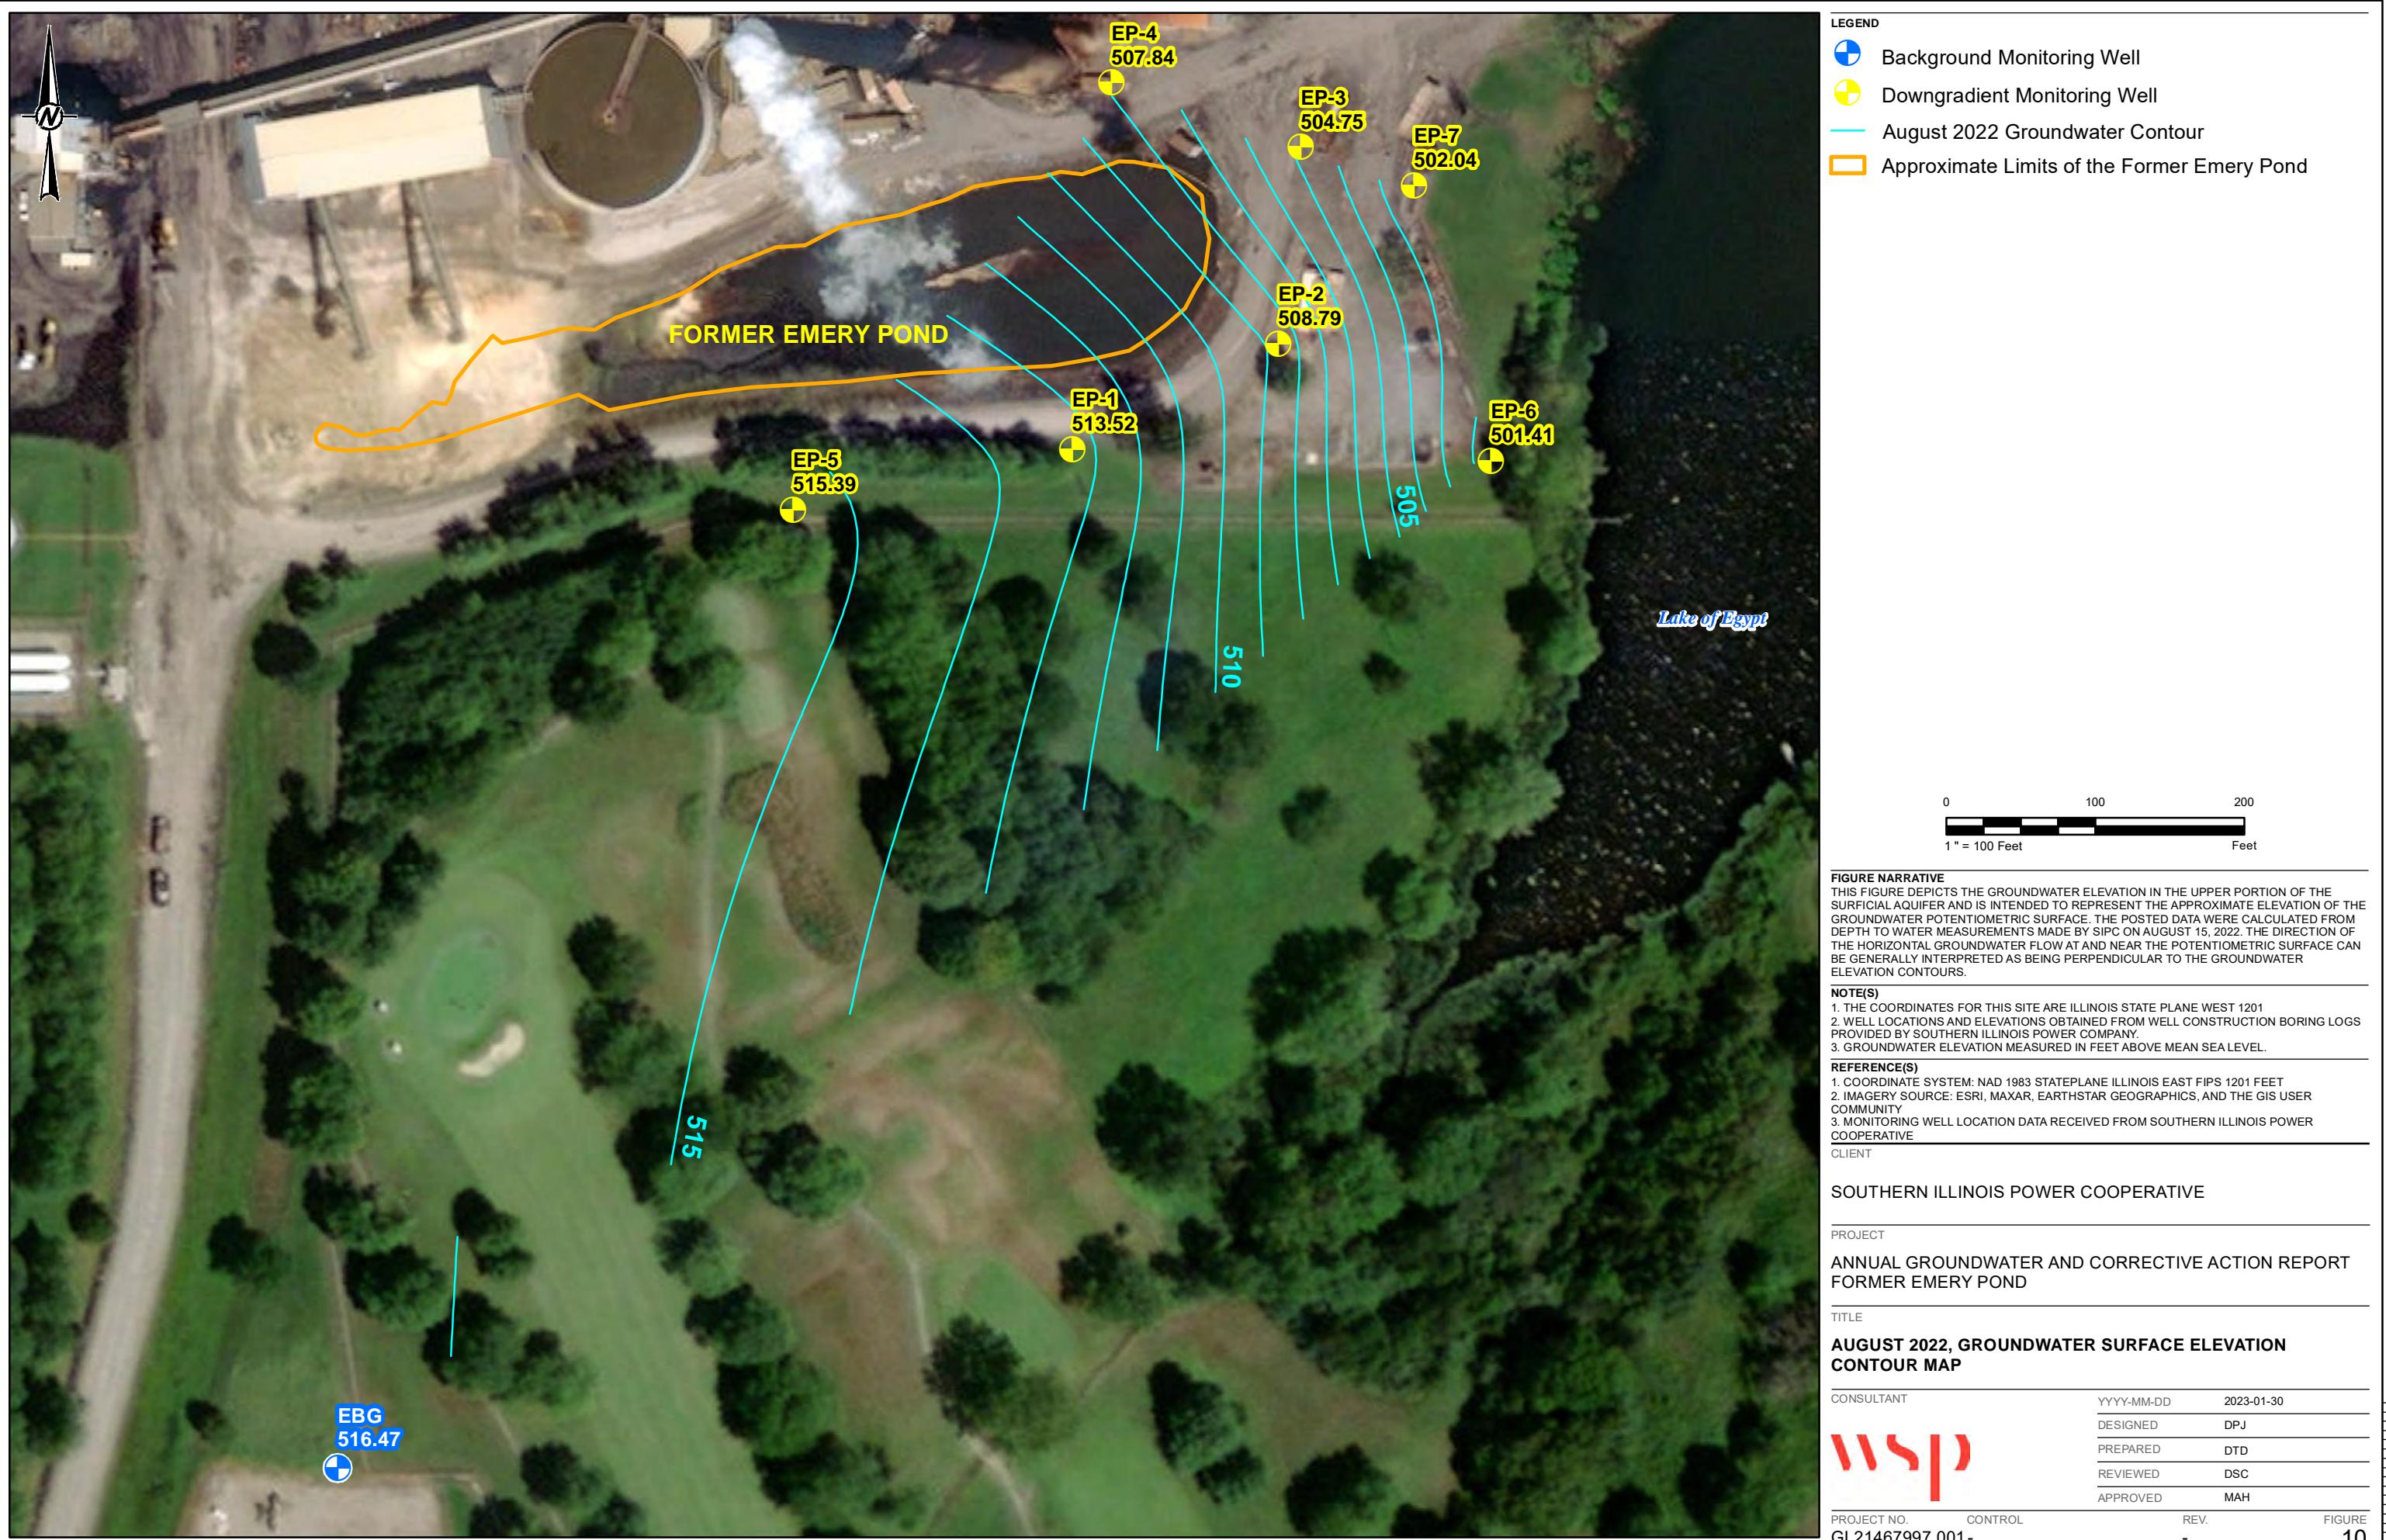

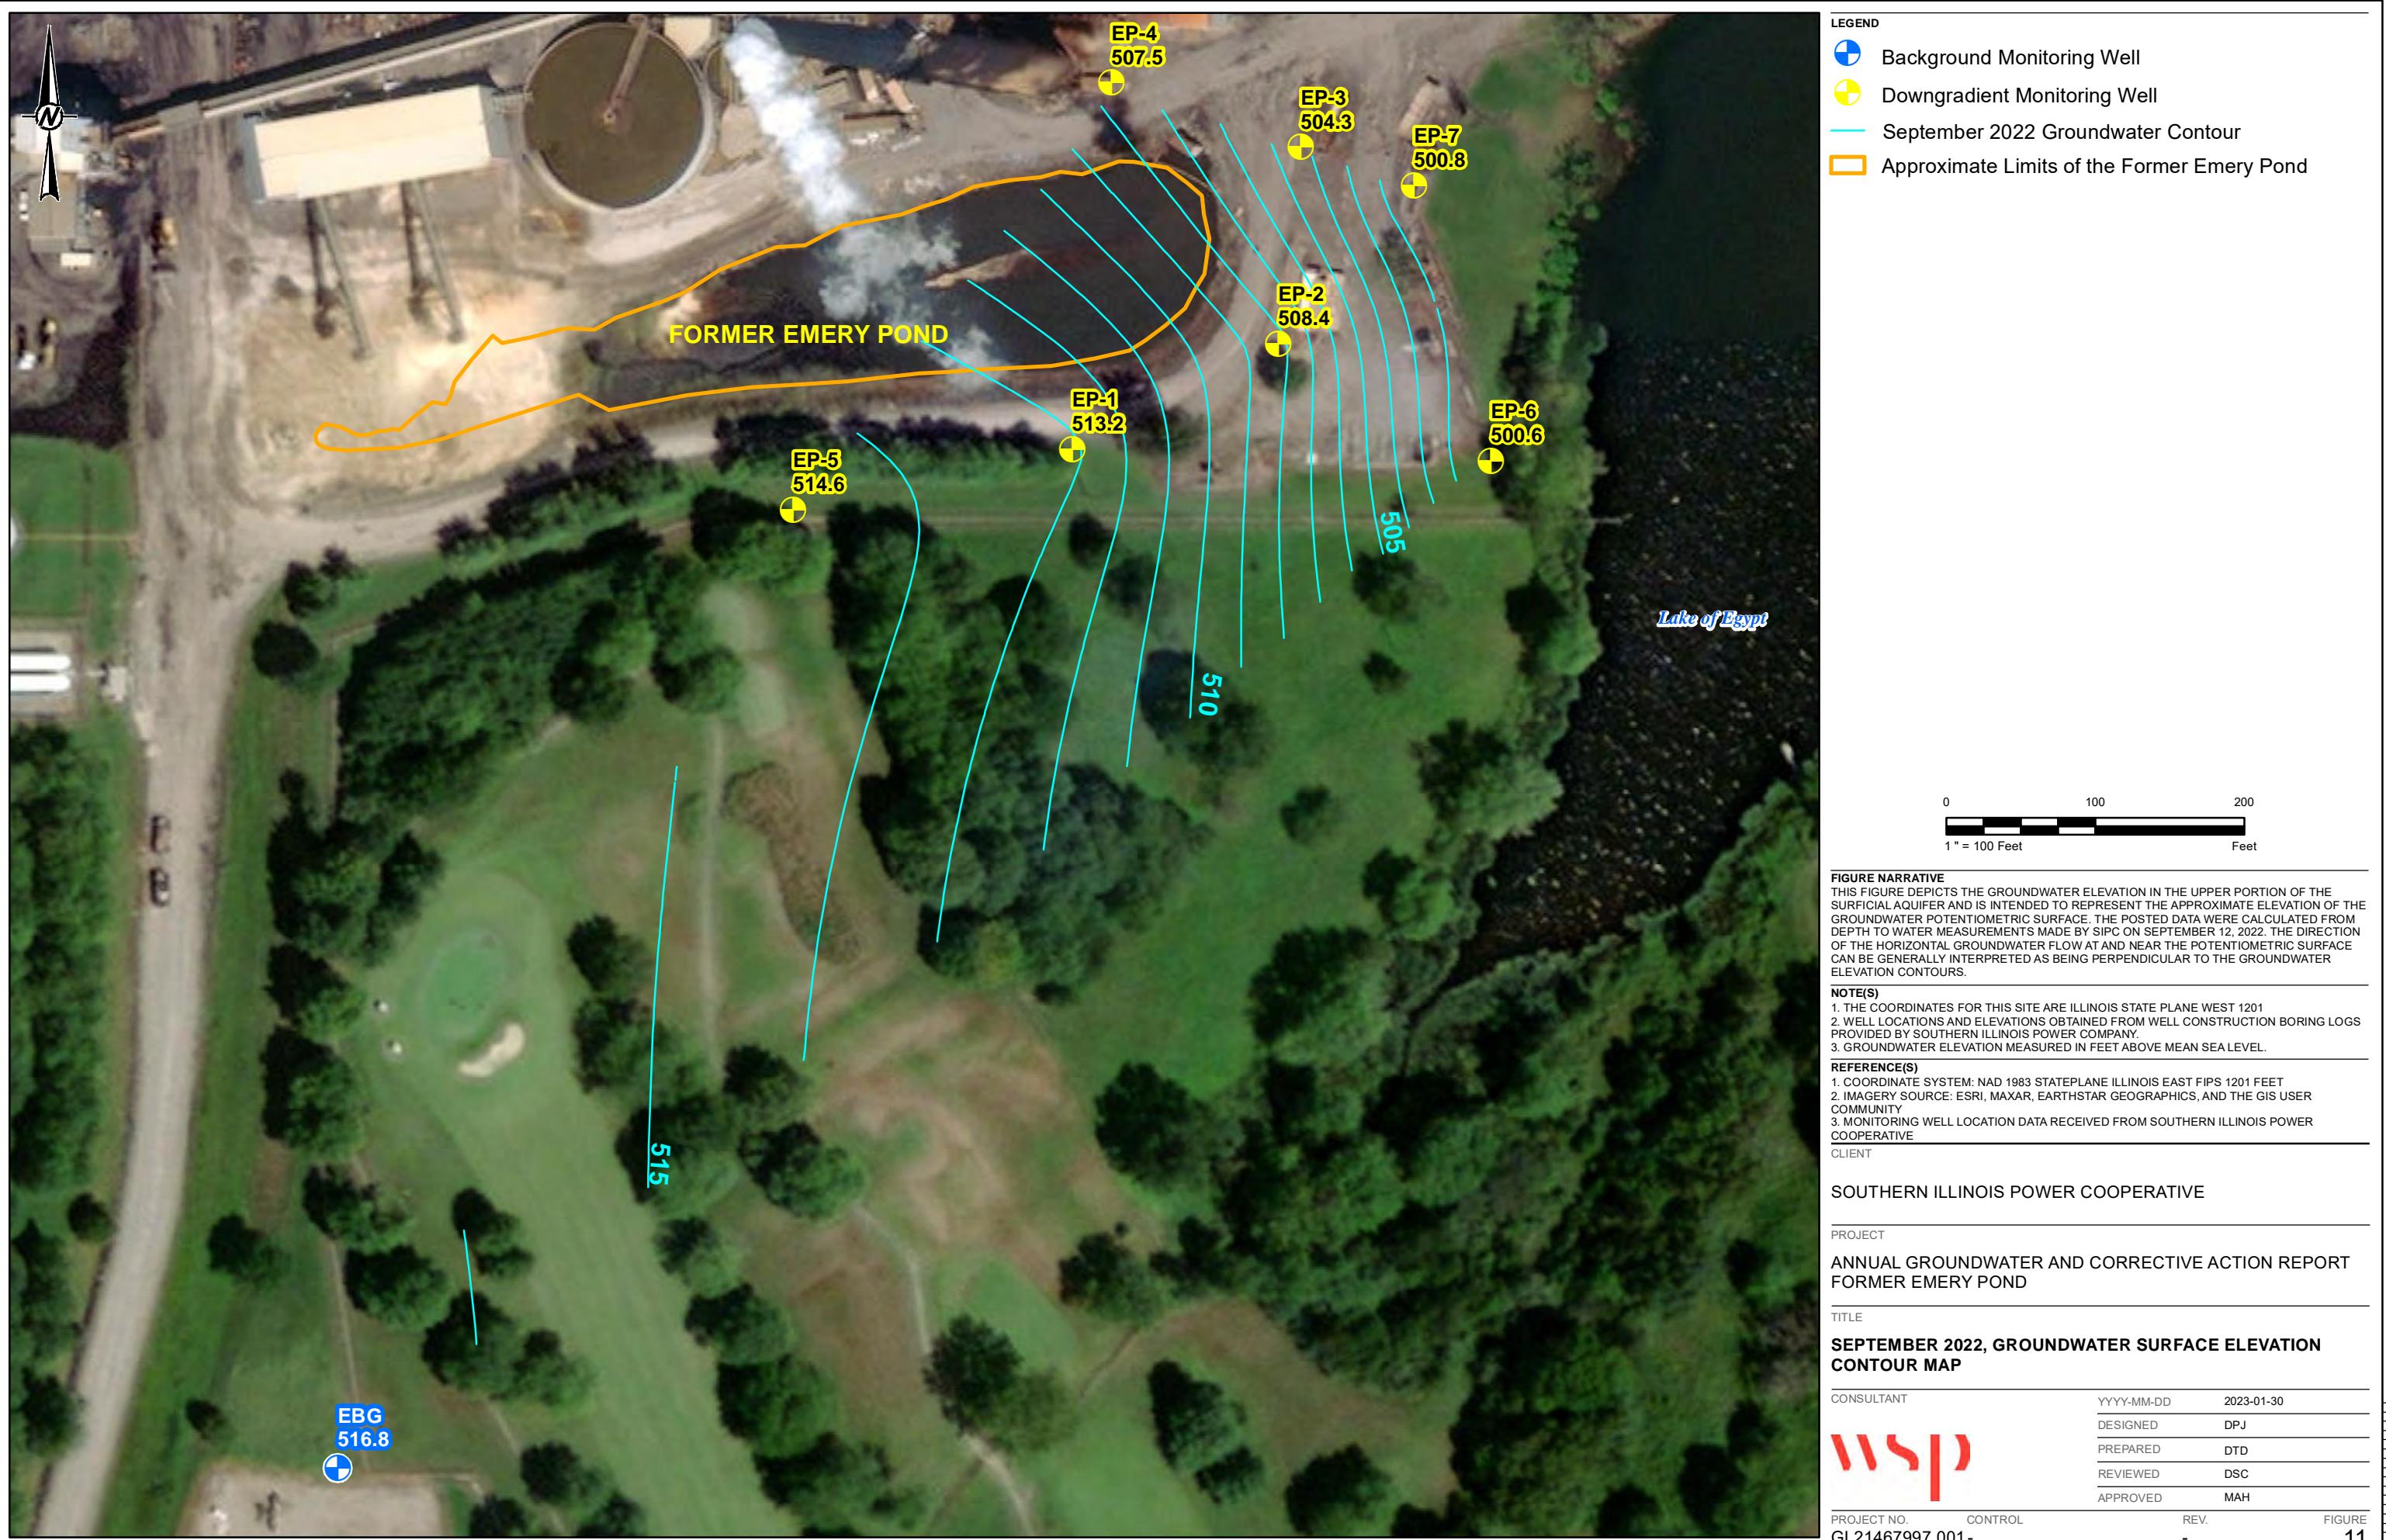

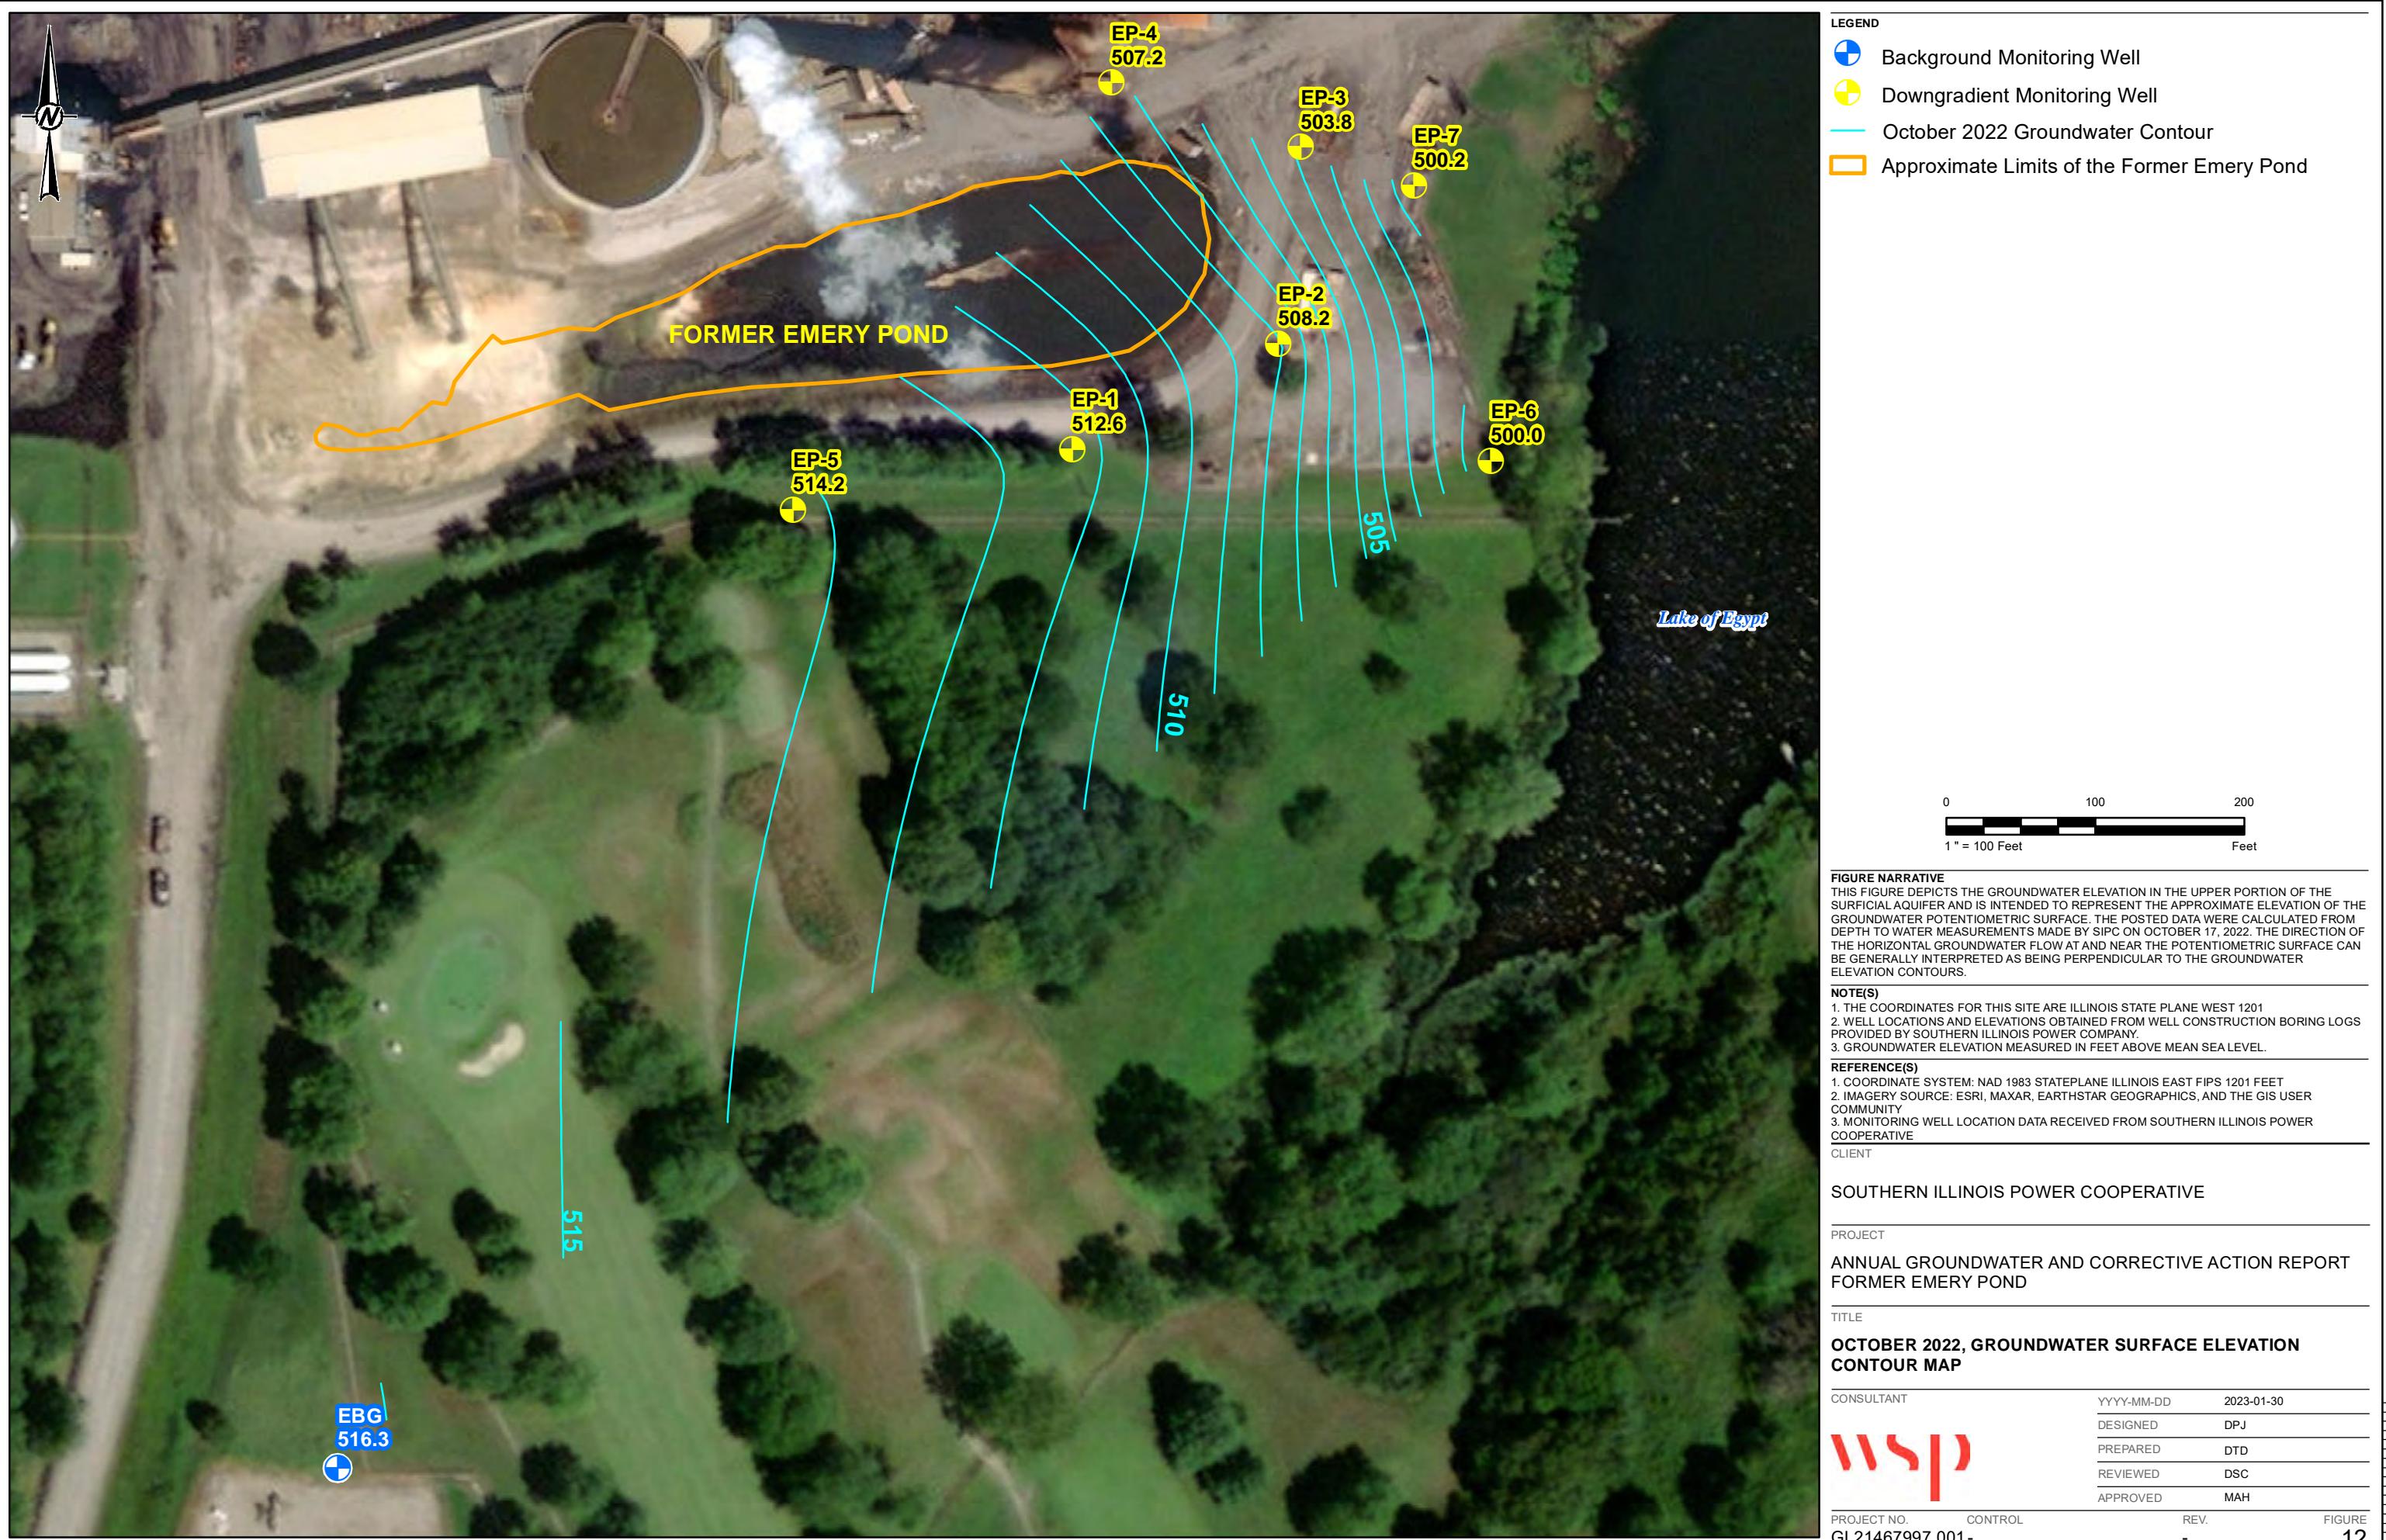

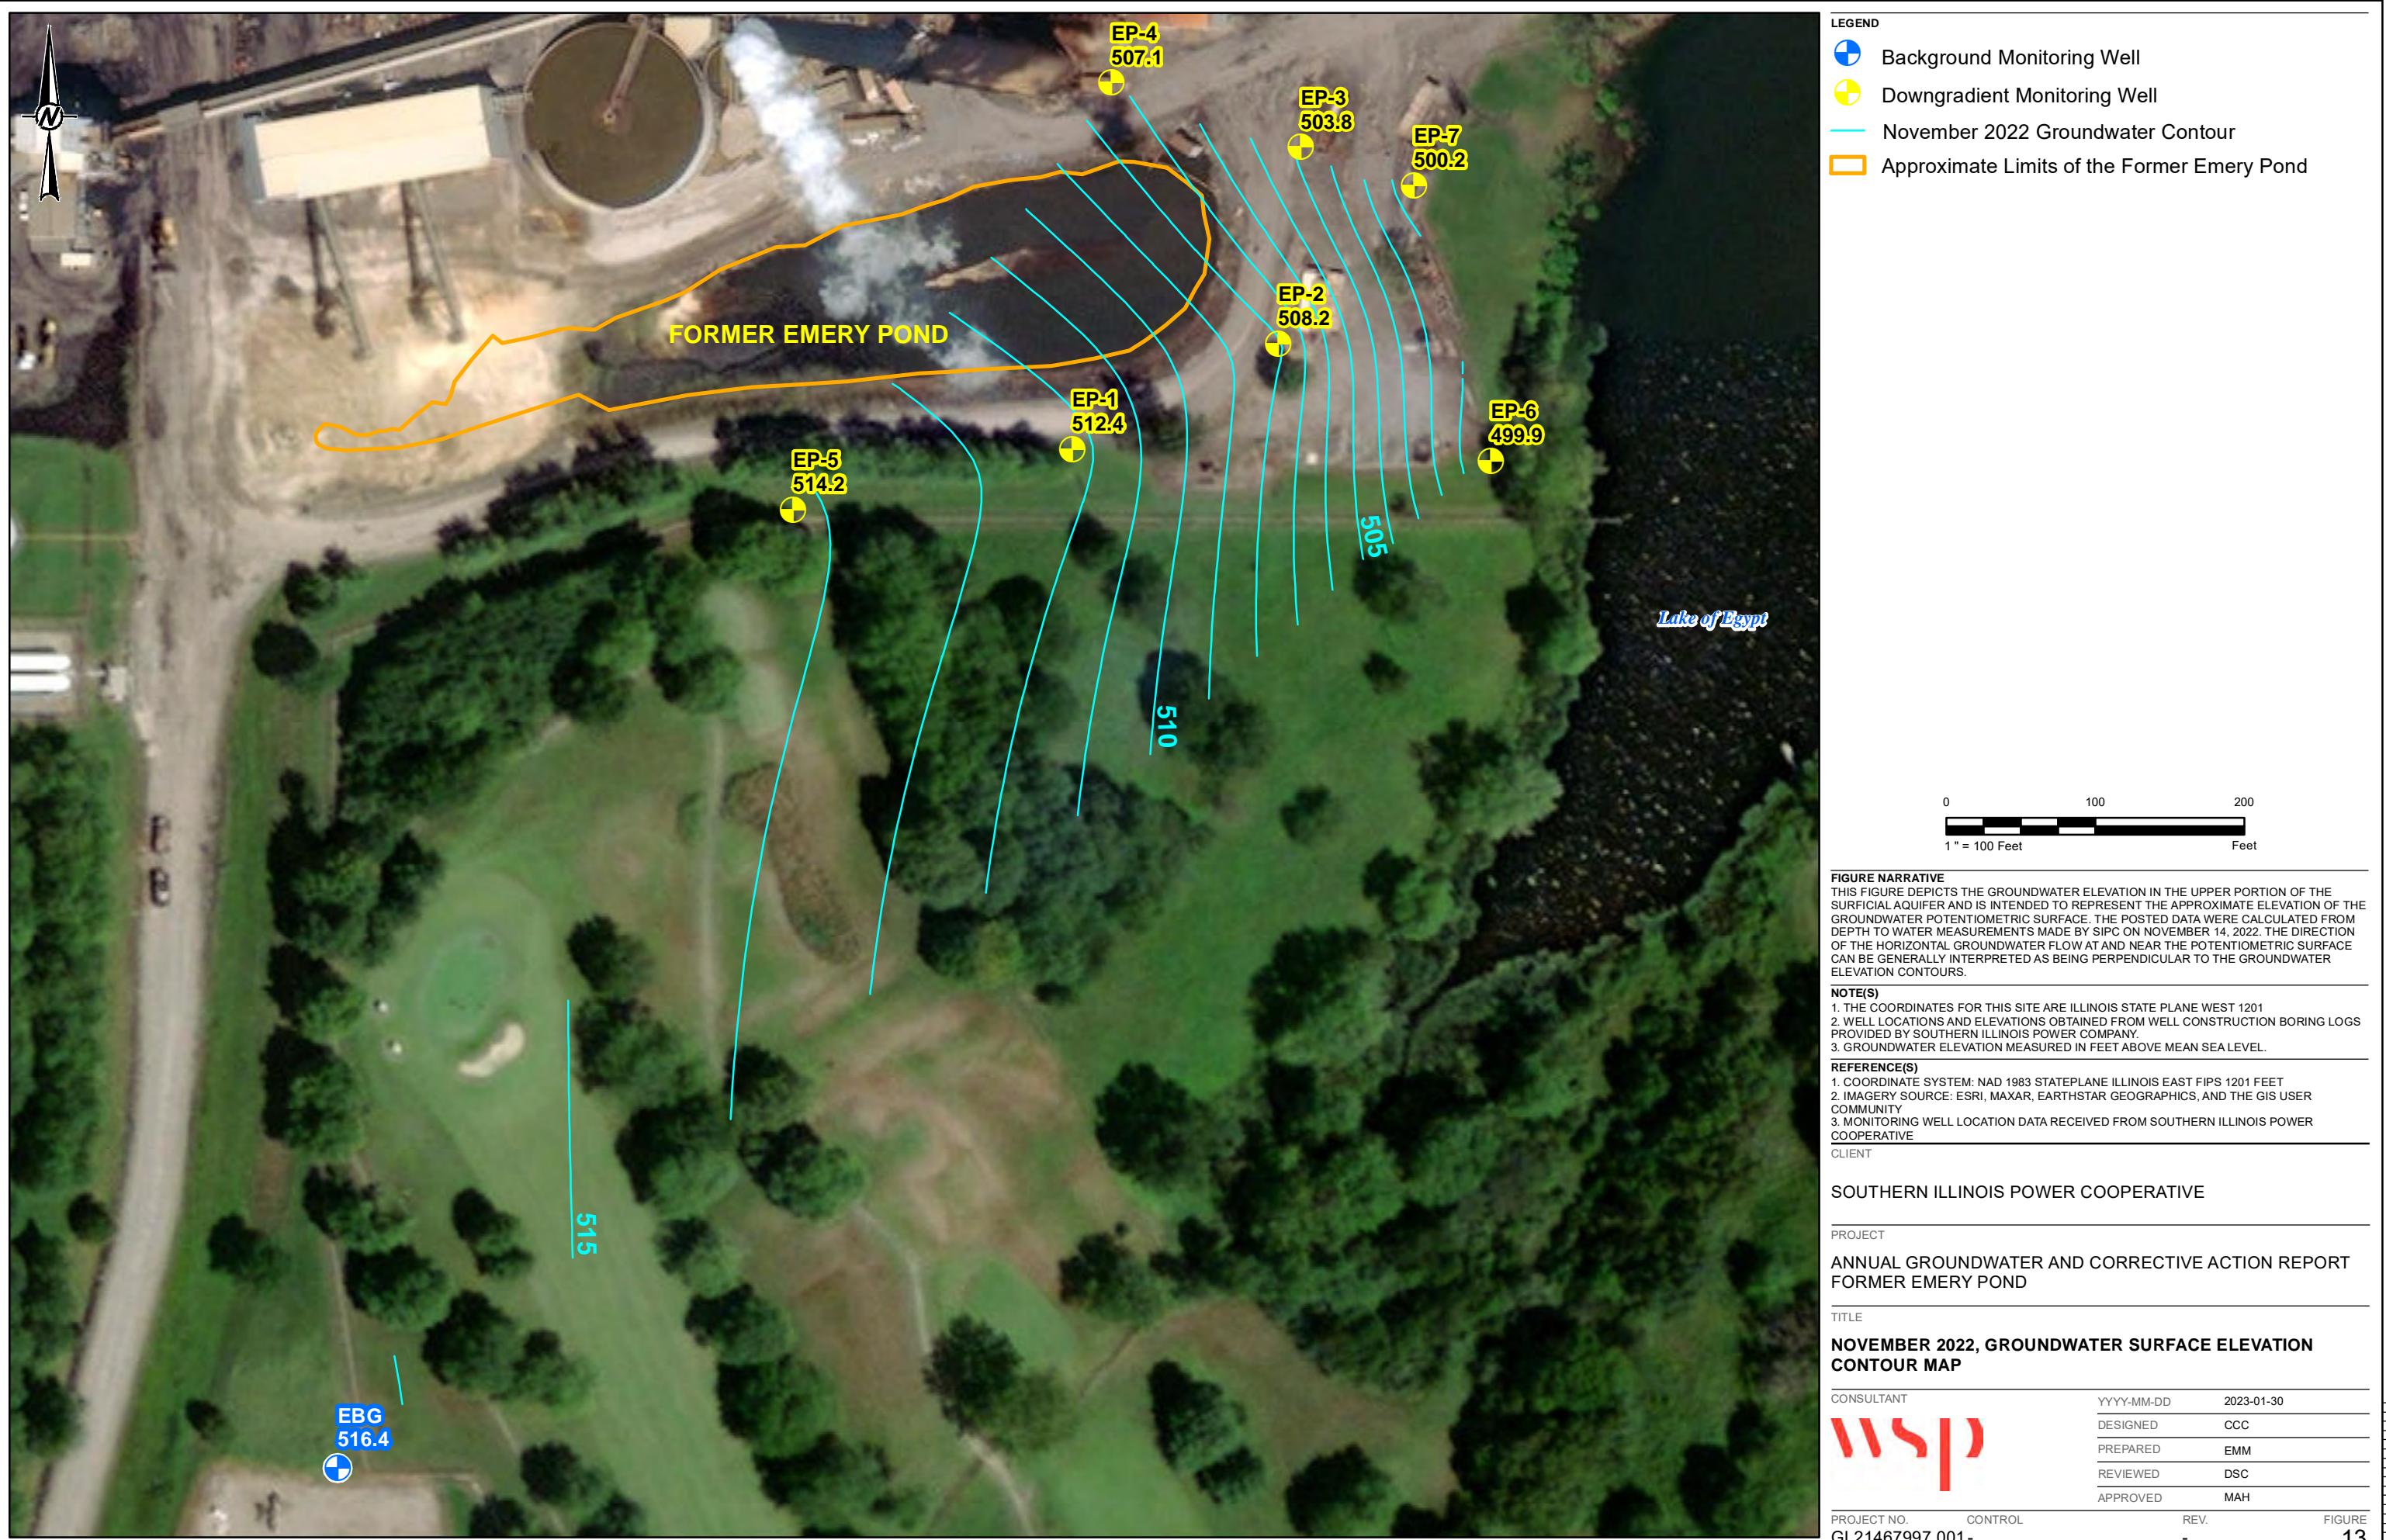

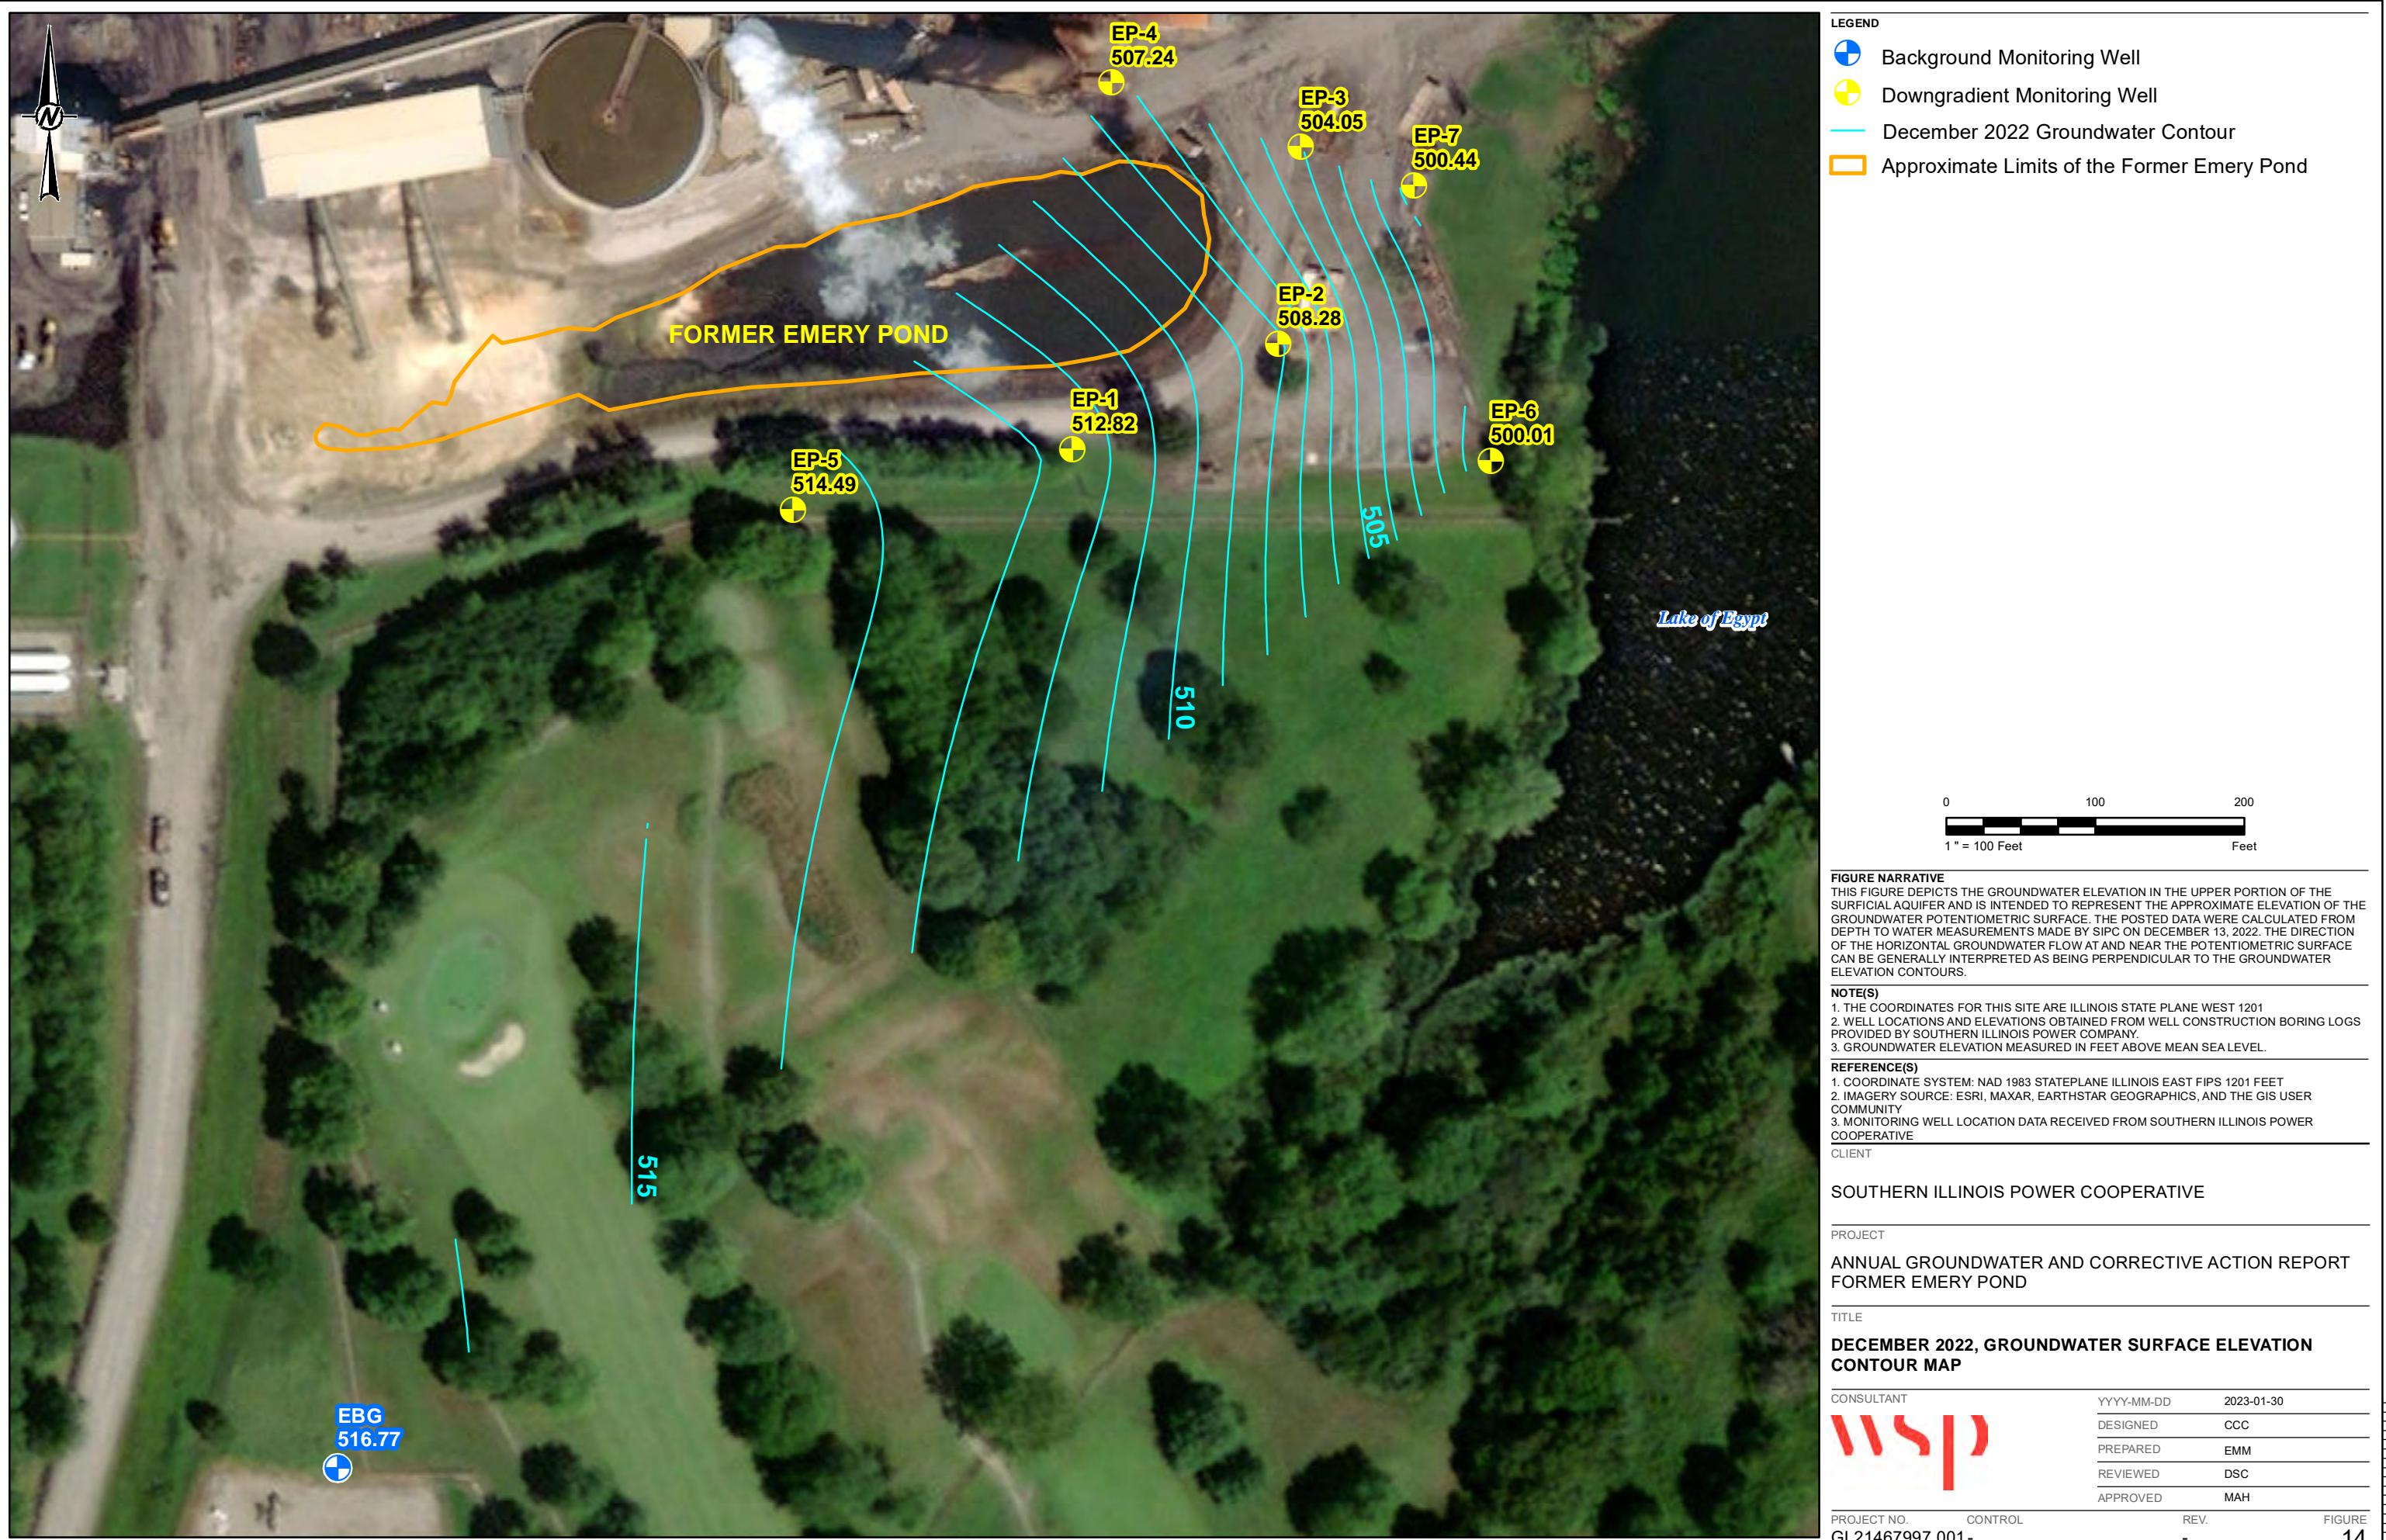

**APPENDIX A**

**Boring Logs**



# KEY TO SYMBOLS

Hanson Professional Services Inc.  
1525 S. Sixth Street  
Springfield, Illinois 62703  
(217) 788-2450

## LITHOLOGIC SYMBOLS (Unified Soil Classification System)

	ASPHALT ASHPALT		MH ELASTIC SILT
	BASALT BASALT		ML SILT
	BLDRCBBL BOULDERS AND COBBLES		OH HIGH PLASTICITY ORGANIC SILT
	BRECCIA BRECCIA		OL LOW PLASTICITY SILT
	CH HIGH PLASTICITY CLAY		PT PEAT
	CL LOW PLASTICITY CLAY		SANDSTONE
	COAL COAL		SC CLAYEY SAND
	CONC. CONCRETE		SHALE
	FILL FILL		SILTSTONE
	GC CLAYEY GRAVEL		SM SILTY SAND
	GM SILTY GRAVEL		SP POORLY GRADED SAND
	GPS SANDY GRAVEL		SW WELL GRADED SAND
	GP POORLY GRADED GRAVEL		TILL GLACIAL TILL
	GW WELL GRADED GRAVEL		TOPSOIL
	LIMESTONE		

## SAMPLER SYMBOLS

	GRAB / AUGER CUTTINGS HAND AUGER [AUG or HA]
	SPLIT SPOON / SPT [SS]
	SHELBY TUBE [SH]
	ROCK CORE [RC]
	CONTINUOUS OR MACROSAMPLER [CS or DP]
	BLIND DRILL [BD]
	MODIFIED CALIFORNIA SAMPLER [MC]

## WELL SYMBOLS

	CONCRETE SURFACE SEAL
	HIGH-SOLIDS BENTONITE GROUT
	BENTONITE CHIP SEAL
	SAND PACK W/SOLID RISER
	SAND PACK W/SCREEN

## ABBREVIATIONS

LL	- Liquid Limit (%)	NP	- Non-Plastic
PL	- Plastic Limit (%)	Qu	- Unconfined Compressive Strength (tsf)
woh	- Weight of Hammer	Qp (P)	- Pocket Penetrometer
wor	- Weight of Rods	TV	- Torvane
MaxGS	- Maximum Grain Size	PID	- Photoionization Detector
<#200	- Percent Passing No. 200 Sieve	ppm	- Parts per Million

## GROUNDWATER LEVELS

Level during drilling,  
or as indicated

Level after 24 hours,  
or as indicated


Level as indicated

**Client: Southern Illinois Power Cooperative**  
**Project Name: SIPC Marion CCR**  
**Project Location: SIPC Marion**  
**Project Number: 60535846**

## Log of EBG

Sheet 1 of 1

Date(s) Drilled and Installed	2/8/2017	Logged By	Suzanne Dale	Reviewed By
Drilling Method	Hollow Stem Auger	Drilling Contractor	Holcomb Engineering	Total Depth of Borehole
Sampling Method	Split Spoon	Water Level TOIC	Not measured	TOC Elevation Ground Surface
Size and Type of Well Casing	2-Inch Schedule 40 PVC	Screen Perforation	0.010 - inch	Northing (Plant) Easting (Plant)
Seal or Backfill	Bentonite Chips			346358.14 ft 804168.155 ft

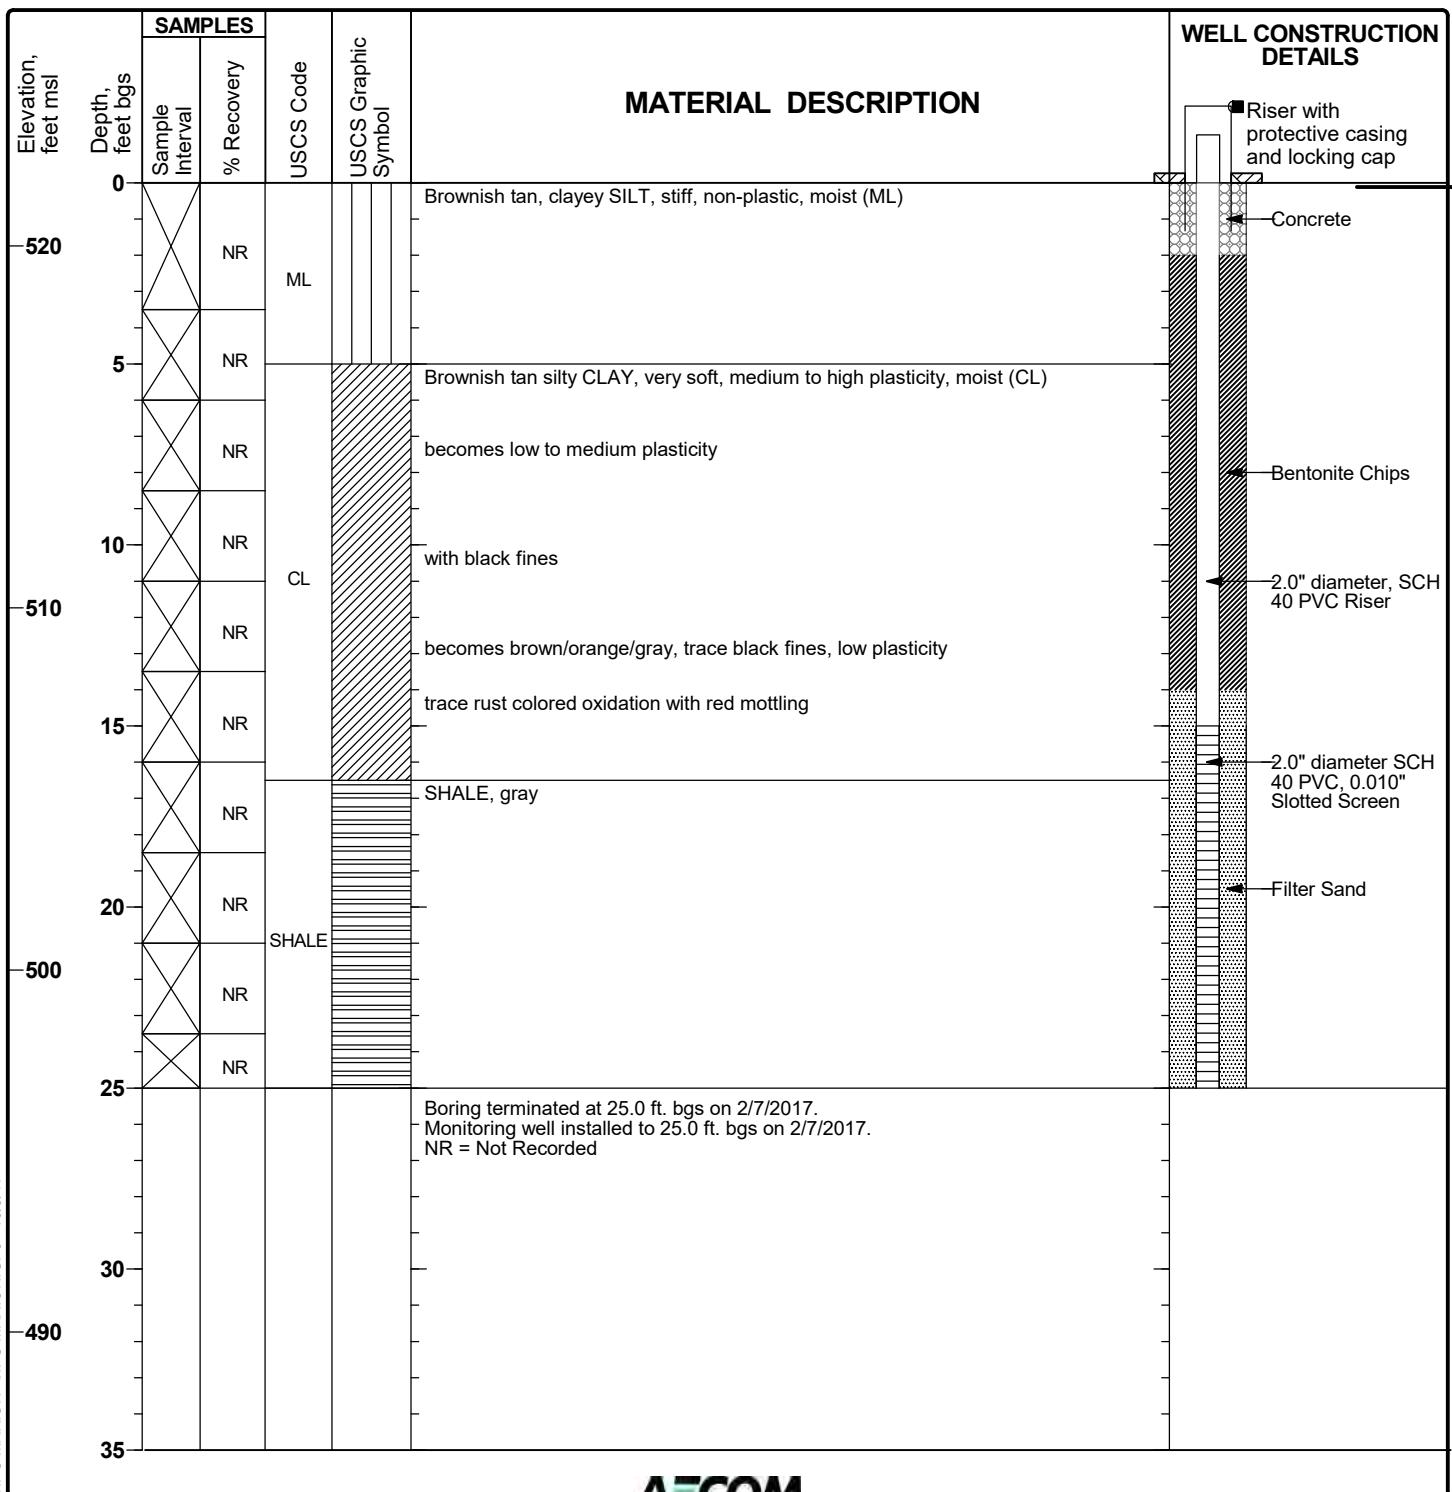


**Client: Southern Illinois Power Cooperative**  
**Project Name: SIPC Marion CCR**  
**Project Location: SIPC Marion**  
**Project Number: 60535846**

## Log of EP-1

Sheet 1 of 1

Date(s) Drilled and Installed	2/7/2017	Logged By	Suzanne Dale	Reviewed By
Drilling Method	Hollow Stem Auger	Drilling Contractor	Holcomb Engineering	Total Depth of Borehole 31.0 feet, bgs
Sampling Method	Split Spoon	Water Level TOIC	Not measured	TOC Elevation Ground Surface 519.72 ft, msl 517.07 ft, msl
Size and Type of Well Casing	2-Inch Schedule 40 PVC	Screen Perforation	0.010 - inch	Northing (Plant) 347042.306 ft Easting (Plant) 804661.174 ft
Seal or Backfill	Bentonite Chips			

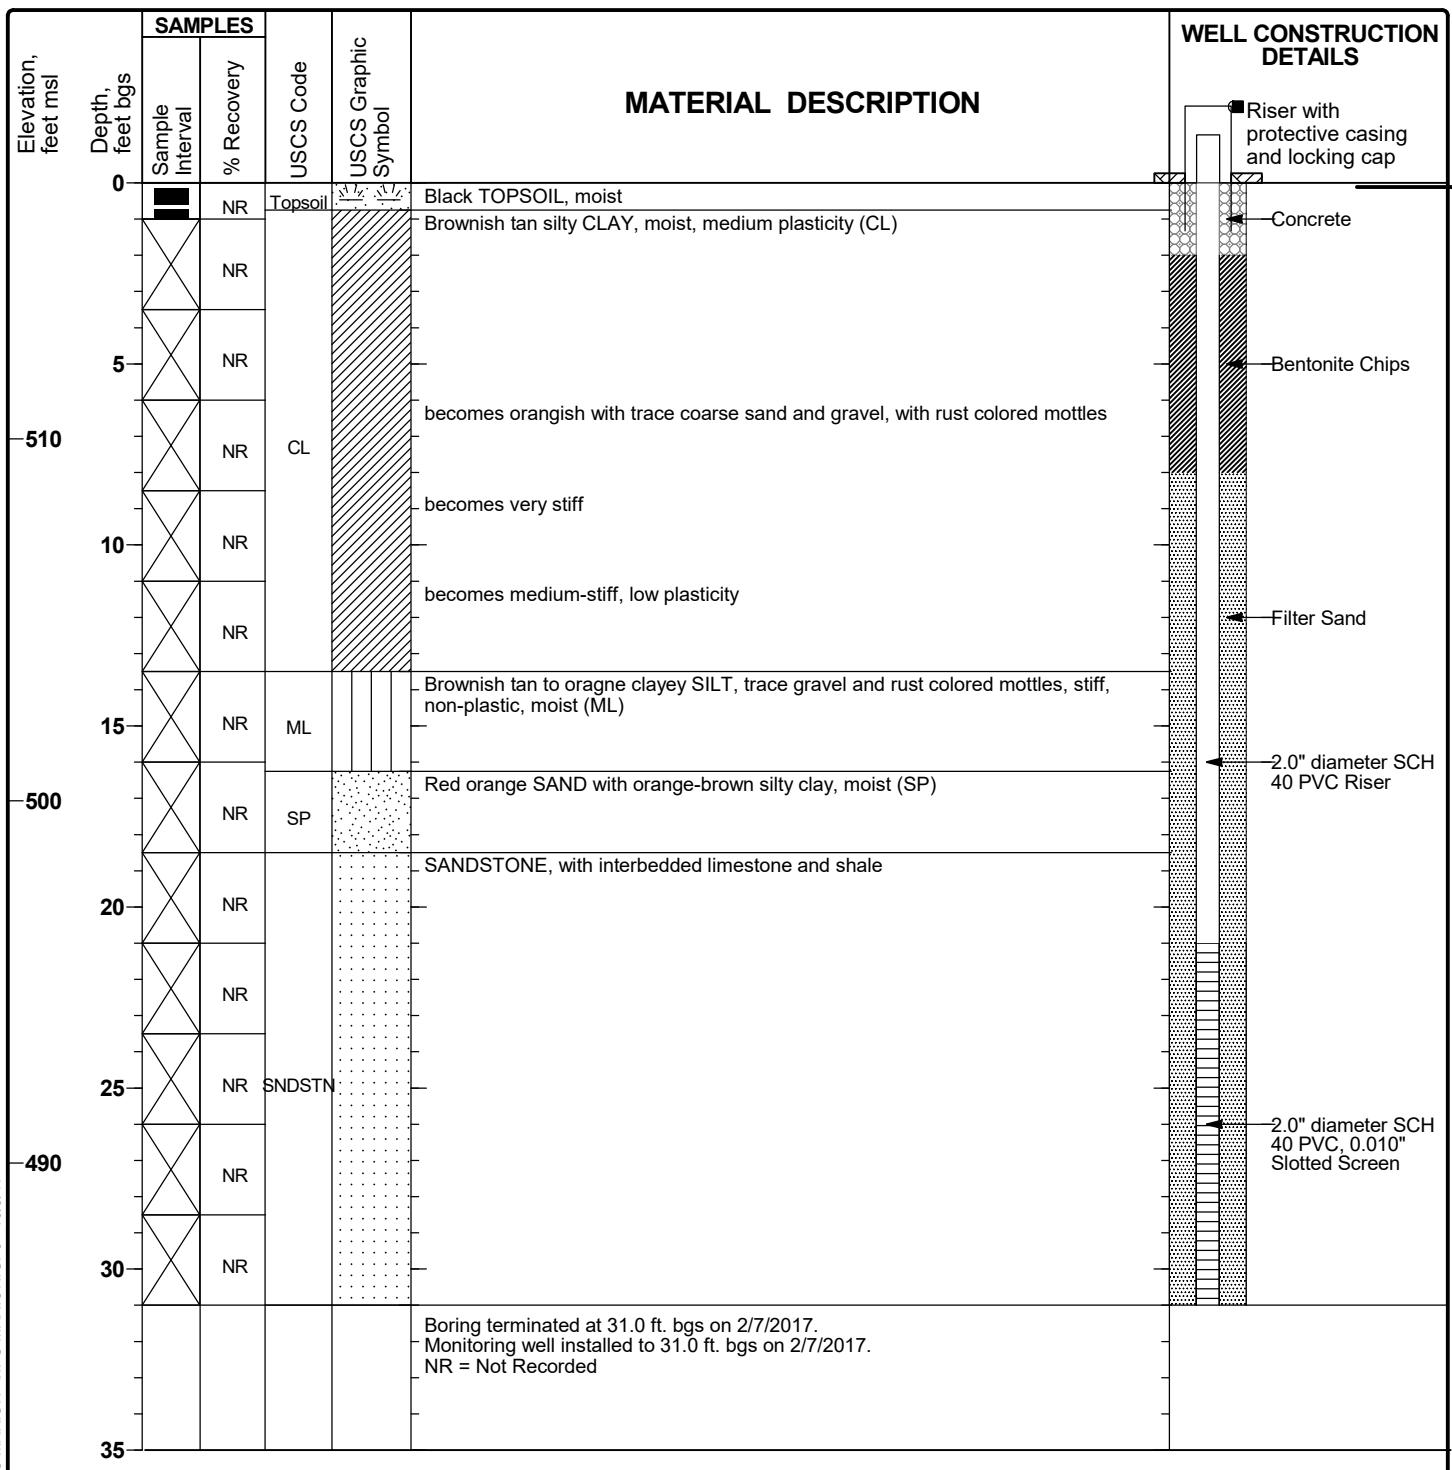


**Client: Southern Illinois Power Cooperative**  
**Project Name: SIPC Marion CCR**  
**Project Location: SIPC Marion**  
**Project Number: 60535846**

## Log of EP-2

Sheet 1 of 1

Date(s) Drilled and Installed	2/7/2017	Logged By	Suzanne Dale	Reviewed By
Drilling Method	Hollow Stem Auger	Drilling Contractor	Holcomb Engineering	Total Depth of Borehole 15.0 feet, bgs
Sampling Method	Split Spoon	Water Level TOIC	Not measured	TOC Elevation Ground Surface 513.79 ft, msl 511.15 ft, msl
Size and Type of Well Casing	2-Inch Schedule 40 PVC	Screen Perforation	0.010 - inch	Northing (Plant) 347113.029 ft Easting (Plant) 804799.408 ft
Seal or Backfill	Bentonite Chips			

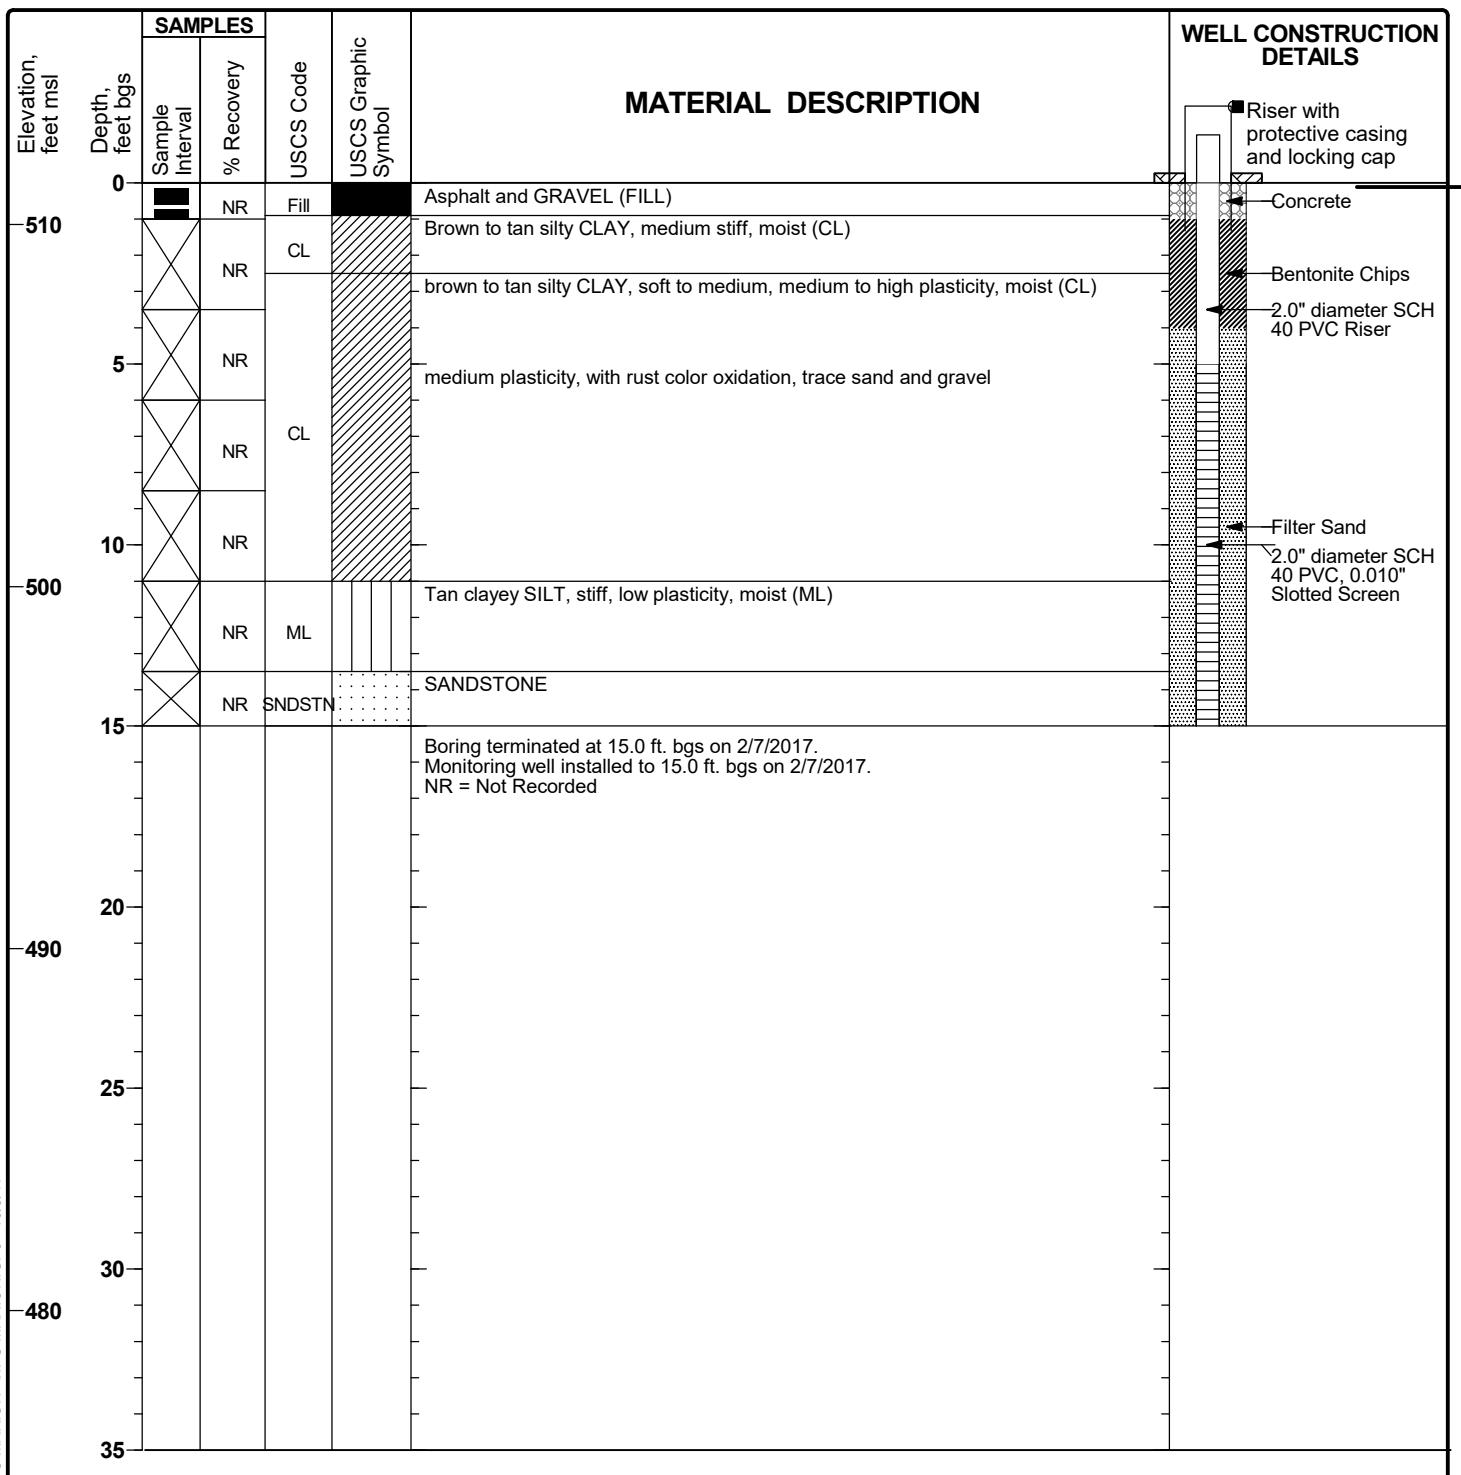


**Client: Southern Illinois Power Cooperative**  
**Project Name: SIPC Marion CCR**  
**Project Location: SIPC Marion**  
**Project Number: 60535846**

## Log of EP-3

Sheet 1 of 1

Date(s) Drilled and Installed	2/8/2017	Logged By	Suzanne Dale	Reviewed By
Drilling Method	Hollow Stem Auger	Drilling Contractor	Holcomb Engineering	Total Depth of Borehole
Sampling Method	Split Spoon	Water Level TOIC	Not measured	TOC Elevation Ground Surface
Size and Type of Well Casing	2-Inch Schedule 40 PVC	Screen Perforation	0.010 - inch	Northing (Plant) Easting (Plant)
Seal or Backfill	Bentonite Chips			347245.08 ft 804814.534 ft

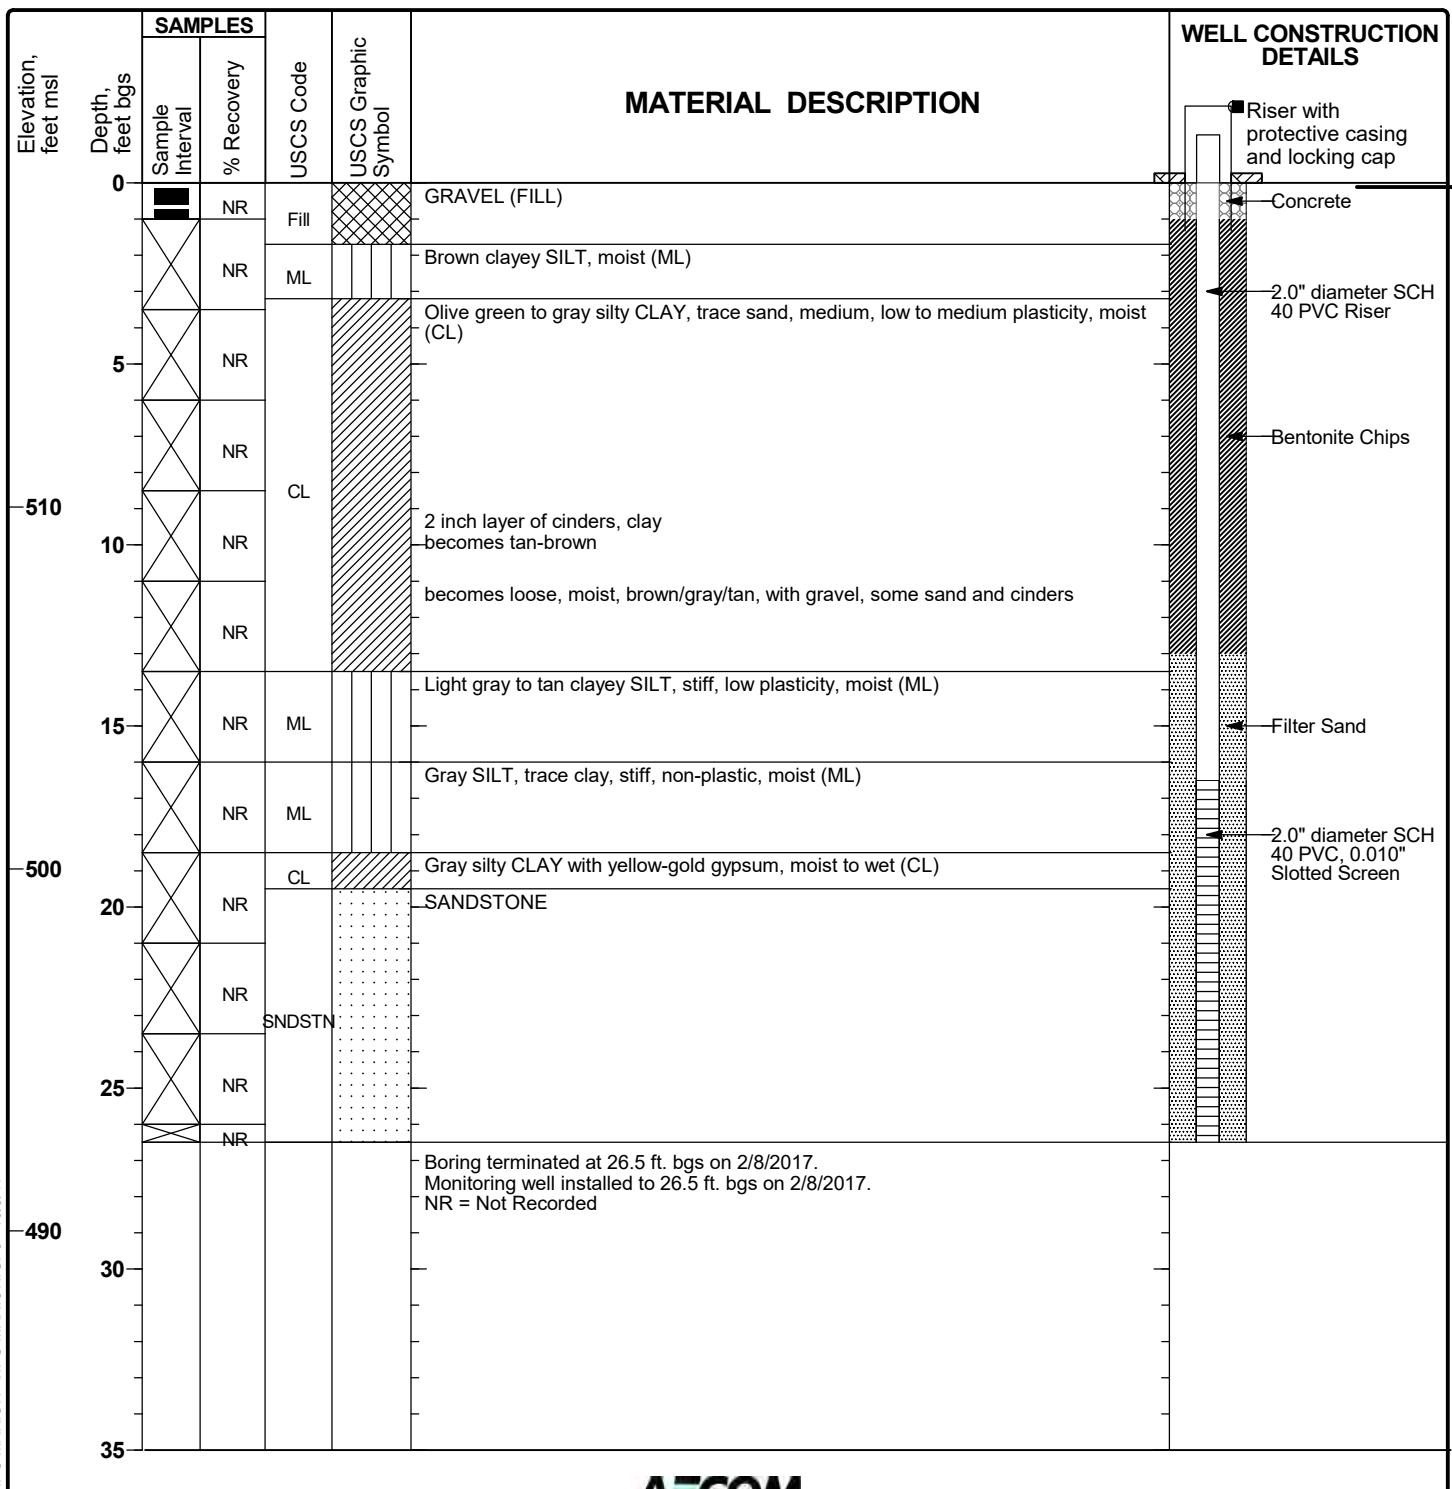


**Client: Southern Illinois Power Cooperative**  
**Project Name: SIPC Marion CCR**  
**Project Location: SIPC Marion**  
**Project Number: 60535846**

## Log of EP-4

Sheet 1 of 1

Date(s) Drilled and Installed	2/8/2017	Logged By	Suzanne Dale	Reviewed By
Drilling Method	Hollow Stem Auger	Drilling Contractor	Holcomb Engineering	Total Depth of Borehole 18.5 feet, bgs
Sampling Method	Split Spoon	Water Level TOIC	Not measured	TOC Elevation Ground Surface 519.74 ft, msl 517.07 ft, msl
Size and Type of Well Casing	2-Inch Schedule 40 PVC	Screen Perforation	0.010 - inch	Northing (Plant) 347288.297 ft Easting (Plant) 804687.527 ft
Seal or Backfill	Bentonite Chips			

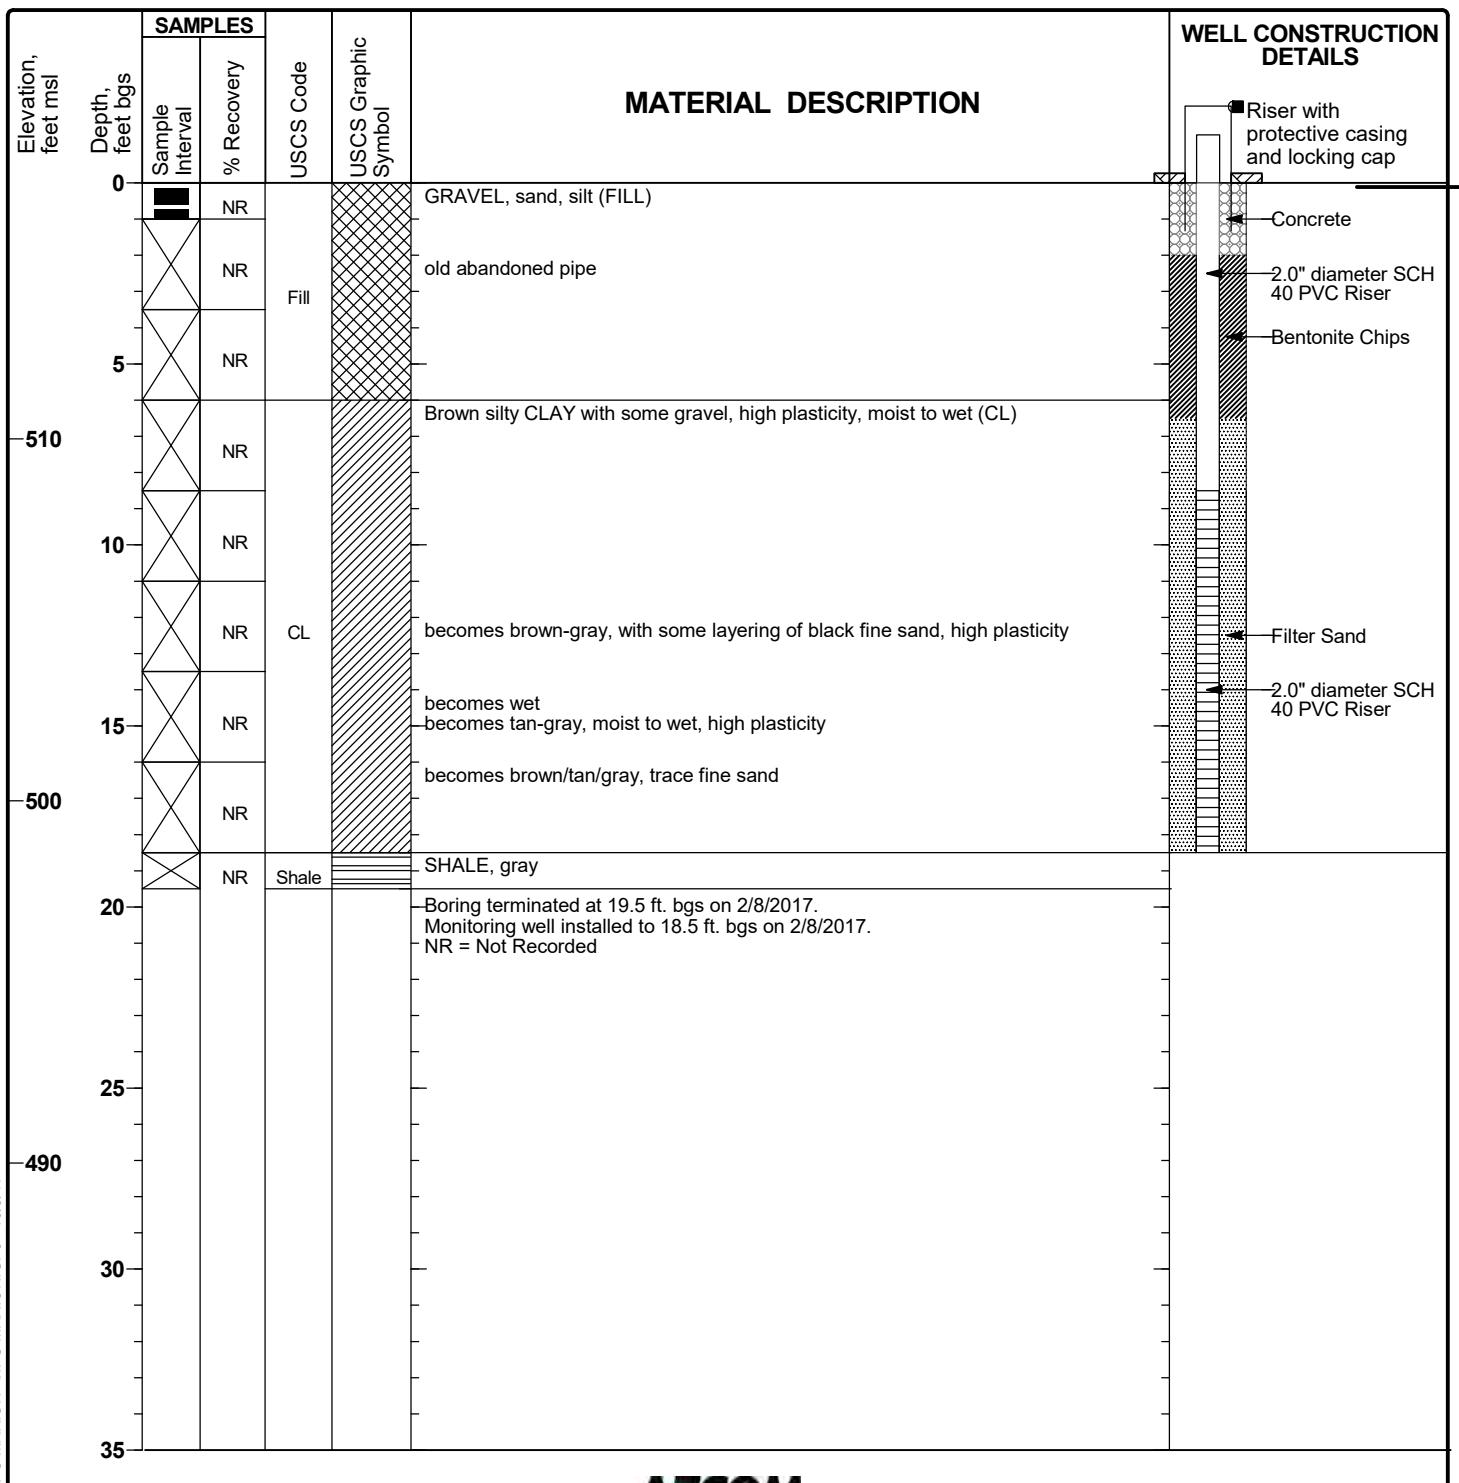

# FIELD BORING LOG



**CLIENT:** Southern Illinois Power Cooperative  
**Site:** Storm Water Basin Monitoring Wells  
**Location:** Marion Power Station, Marion, IL  
**Project:** 21E0079  
**DATES:** Start: 10/5/2021  
 Finish: 10/5/2021  
**WEATHER:** Foggy, cool (low 60's)

**CONTRACTOR:** Holcomb Foundation Engineering Co.  
**Rig mfg/model:** Bobcat T630 with auger attachment  
**Drilling Method:** 3 1/4" Hollow Stem Auger  
**FIELD STAFF:** Driller: J. Carter  
 Helper: J. Taylor  
 Eng/Geo: R. Hasenyager

**BOREHOLE ID:** EP-5  
**Well ID:** EP-5  
**Surface Elev:** 524.64 ft. MSL  
**Completion:** 16.32 ft. BGS  
**Station:** 347,001.63N  
 804,473.78E

SAMPLE		TESTING				TOPOGRAPHIC MAP INFORMATION:		WATER LEVEL INFORMATION:				
Number	Recov/ Total (in) % Recovery	Type	Blows / 6 in N - Value RQD	Water Content (%)	Dry Density (lb/ft <sup>3</sup> )	Qu (tsf) Qp (tsf) Failure Type	Quadrangle: Goreville Township: Southern Section 26, Tier 10S; Range 2E	Depth ft. BGS	Lithologic Description	Borehole Detail	Elevation ft. MSL	Remarks
0/60 0%	AGR							2			524	
0/60 0%	AGR							4			522	
0/60 0%	AGR							6			520	
0/60 0%	AGR							8	Yellowish brown (10YR5/6), moist, medium, CLAY with some silt, little sand, and trace gravel.		518	
0/60 0%	AGR							10			516	
0/60 0%	AGR							12			514	
0/16 0%	AGR							14			512	
								16	Yellowish brown (10YR5/8), weathered SANDSTONE.		510	
EOB = 16.3 ft.												

**NOTE(S):** Boring drilled adjacent to DP-4d.

# FIELD BORING LOG



**CLIENT:** Southern Illinois Power Cooperative  
**Site:** Storm Water Basin Monitoring Wells  
**Location:** Marion Power Station, Marion, IL  
**Project:** 21E0079  
**DATES:** Start: 10/4/2021  
 Finish: 10/4/2021  
**WEATHER:** Sunny, mild (high 70's)

**CONTRACTOR:** Holcomb Foundation Engineering Co.  
**Rig mfg/model:** CME 550X  
**Drilling Method:** 3 1/4" Hollow Stem Auger with split spoon  
**FIELD STAFF:** Driller: J. Carter  
 Helper: J. Taylor  
 Eng/Geo: R. Hasenjager

**BOREHOLE ID:** EP-6  
**Well ID:** EP-6  
**Surface Elev:** 502.08 ft. MSL  
**Completion:** 13.62 ft. BGS  
**Station:** 347,034.68N  
 804,941.94E

SAMPLE		TESTING				TOPOGRAPHIC MAP INFORMATION:			WATER LEVEL INFORMATION:					
Number	Recov/ Total (in) % Recovery	Type	Blows / 6 in N - Value RQD	Water Content (%)	Dry Density (lb/ft <sup>3</sup> )	Qu (tsf) Qp (tsf) Failure Type				Depth ft. BGS	Lithologic Description	Borehole Detail	Elevation ft. MSL	Remarks
2A	0/12 0%	BD												
2A	17/24 71%	ss	5-7 7-5 N=14	18.7		3.5	2				Yellowish brown (10YR5/4) mottles, moist, medium, SILT with few clay and trace sand.		500	
3A	24/36 67%	ss	2-2 4-4 N=6	24.6		1.5	4				Gray (10YR5/1) with 10% Yellowish brown (10YR5/6) mottles, moist, medium, CLAY with some silt and trace sand.		498	
4A	23/24 96%	ss	1-1 4-4 N=5	20.7		3.5	6				Yellowish brown (10YR5/6) with 20% Gray (10YR6/1) mottles, moist, medium, SILT with few clay, trace sand, and trace gravel.		496	
5A	27/36 75%	ss	7-8 13-13 N=21	12.1		4.0	8				Strong brown (7.5YR5/8), moist, dense, very fine- to coarse-grained SAND with some silt.		494	
6A	21/21 100%	ss	4-10 27-60/3" N=37	15.0		4.0	10				Strong brown (7.5YR5/8) with 10% gray (7.5YHR5/1) mottles, moist, hard, weathered SHALE.		492	
	0/10 0%	BD					12						490	
								▼						
EOB = 13.6 ft.														

NOTE(S):

# FIELD BORING LOG



**CLIENT:** Southern Illinois Power Cooperative  
**Site:** Storm Water Basin Monitoring Wells  
**Location:** Marion Power Station, Marion, IL  
**Project:** 21E0079  
**DATES:** Start: 10/4/2021  
Finish: 10/4/2021  
**WEATHER:** Sunny, mild (low 70's)

**CONTRACTOR:** Holcomb Foundation Engineering Co.  
**Rig mfg/model:** CME 550X  
**Drilling Method:** 3 $\frac{1}{4}$ " Hollow Stem Auger with split spoon

**FIELD STAFF:** Driller: J. Carter  
Helper: J. Taylor  
Eng/Geo: R. Hasenyager

**BOREHOLE ID:** EP-7  
**Well ID:** EP-7  
**Surface Elev:** 512.49 ft. MSL  
**Completion:** 18.50 ft. BGS  
**Station:** 347,219.28N  
                  804,890.26E

**NOTE(S):**

**APPENDIX B**

**2022 Groundwater Analytical  
Reports**

January 20, 2022

Jason McLaurin  
Southern Illinois Power Cooperation  
11543 Lake of Egypt Road  
Marion, IL 62959  
TEL: (618) 964-1448  
FAX:



Illinois	100226
Kansas	E-10374
Louisiana	05002
Louisiana	05003
Oklahoma	9978

**RE:** Groundwater Monitoring

**WorkOrder:** 21110629

Dear Jason McLaurin:

TEKLAB, INC received 11 samples on 12/23/2021 08:00:00 for the analysis presented in the following report.

Samples are analyzed on an as received basis unless otherwise requested and documented. The sample results contained in this report relate only to the requested analytes of interest as directed on the chain of custody. NELAP accredited fields of testing are indicated by the letters NELAP under the Certification column. Unless otherwise documented within this report, Teklab Inc. analyzes samples utilizing the most current methods in compliance with 40CFR. All tests are performed in the Collinsville, IL laboratory unless otherwise noted in the Case Narrative.

All quality control criteria applicable to the test methods employed for this project have been satisfactorily met and are in accordance with NELAP except where noted. The following report shall not be reproduced, except in full, without the written approval of Teklab, Inc.

If you have any questions regarding these tests results, please feel free to call.

Sincerely,



Aaron Renner  
Project Manager  
(630)324-6855  
[arenner@teklabinc.com](mailto:arenner@teklabinc.com)

**Client:** Southern Illinois Power Cooperation

**Work Order:** 21110629

**Client Project:** Groundwater Monitoring

**Report Date:** 20-Jan-22

---

This reporting package includes the following:

Cover Letter	1
Report Contents	2
Definitions	3
Case Narrative	5
Accreditations	6
Laboratory Results	7
Quality Control Results	27
Receiving Check List	41
Chain of Custody	Appended

**Client:** Southern Illinois Power Cooperation

**Work Order:** 21110629

**Client Project:** Groundwater Monitoring

**Report Date:** 20-Jan-22

### Abbr Definition

\* Analytes on report marked with an asterisk are not NELAP accredited

CCV Continuing calibration verification is a check of a standard to determine the state of calibration of an instrument between recalibration.

CRQL A Client Requested Quantitation Limit is a reporting limit that varies according to customer request. The CRQL may not be less than the MDL.

DF Dilution factor is the dilution performed during analysis only and does not take into account any dilutions made during sample preparation. The reported result is final and includes all dilution factors.

DNI Did not ignite

DUP Laboratory duplicate is a replicate aliquot prepared under the same laboratory conditions and independently analyzed to obtain a measure of precision.

ICV Initial calibration verification is a check of a standard to determine the state of calibration of an instrument before sample analysis is initiated.

IDPH IL Dept. of Public Health

LCS Laboratory control sample is a sample matrix, free from the analytes of interest, spiked with verified known amounts of analytes and analyzed exactly like a sample to establish intra-laboratory or analyst specific precision and bias or to assess the performance of all or a portion of the measurement system.

LCSD Laboratory control sample duplicate is a replicate laboratory control sample that is prepared and analyzed in order to determine the precision of the approved test method. The acceptable recovery range is listed in the QC Package (provided upon request).

MBLK Method blank is a sample of a matrix similar to the batch of associated sample (when available) that is free from the analytes of interest and is processed simultaneously with and under the same conditions as samples through all steps of the analytical procedures, and in which no target analytes or interferences should present at concentrations that impact the analytical results for sample analyses.

MDL "The method detection limit is defined as the minimum measured concentration of a substance that can be reported with 99% confidence that the measured concentration is distinguishable from method blank results."

MS Matrix spike is an aliquot of matrix fortified (spiked) with known quantities of specific analytes that is subjected to the entire analytical procedures in order to determine the effect of the matrix on an approved test method's recovery system. The acceptable recovery range is listed in the QC Package (provided upon request).

MSD Matrix spike duplicate means a replicate matrix spike that is prepared and analyzed in order to determine the precision of the approved test method. The acceptable recovery range is listed in the QC Package (provided upon request).

MW Molecular weight

NC Data is not acceptable for compliance purposes

ND Not Detected at the Reporting Limit

NELAP NELAP Accredited

PQL Practical quantitation limit means the lowest level that can be reliably achieved within specified limits of precision and accuracy during routine laboratory operation conditions.

RL The reporting limit the lowest level that the data is displayed in the final report. The reporting limit may vary according to customer request or sample dilution. The reporting limit may not be less than the MDL.

RPD Relative percent difference is a calculated difference between two recoveries (ie. MS/MSD). The acceptable recovery limit is listed in the QC Package (provided upon request).

SPK The spike is a known mass of target analyte added to a blank sample or sub-sample; used to determine recovery deficiency or for other quality control purposes.

Surr Surrogates are compounds which are similar to the analytes of interest in chemical composition and behavior in the analytical process, but which are not normally found in environmental samples.

TIC Tentatively identified compound: Analytes tentatively identified in the sample by using a library search. Only results not in the calibration standard will be reported as tentatively identified compounds. Results for tentatively identified compounds that are not present in the calibration standard, but are assigned a specific chemical name based upon the library search, are calculated using total peak areas from reconstructed ion chromatograms and a response factor of one. The nearest Internal Standard is used for the calculation. The results of any TICs must be considered estimated, and are flagged with a "T". If the estimated result is above the calibration range it is flagged "ET"

TNTC Too numerous to count (> 200 CFU)

## Definitions

<http://www.teklabinc.com/>

**Client:** Southern Illinois Power Cooperation

**Work Order:** 21110629

**Client Project:** Groundwater Monitoring

**Report Date:** 20-Jan-22

### Qualifiers

- |   |  |
|---|--|
| # - Unknown hydrocarbon                               | B - Analyte detected in associated Method Blank              |
| C - RL shown is a Client Requested Quantitation Limit | E - Value above quantitation range                           |
| H - Holding times exceeded                            | I - Associated internal standard was outside method criteria |
| J - Analyte detected below quantitation limits        | M - Manual Integration used to determine area response       |
| ND - Not Detected at the Reporting Limit              | R - RPD outside accepted recovery limits                     |
| S - Spike Recovery outside recovery limits            | T - TIC(Tentatively identified compound)                     |
| X - Value exceeds Maximum Contaminant Level           |  |



## Case Narrative

<http://www.teklabinc.com/>

**Client:** Southern Illinois Power Cooperation

**Work Order:** 21110629

**Client Project:** Groundwater Monitoring

**Report Date:** 20-Jan-22

**Cooler Receipt Temp:** 1.4 °C

An employee of Teklab, Inc. collected the sample(s).

Radium analysis was performed by Summit Environmental Technologies. See attached for results.

### Locations

<b>Collinsville</b>	
<b>Address</b>	5445 Horseshoe Lake Road Collinsville, IL 62234-7425
<b>Phone</b>	(618) 344-1004
<b>Fax</b>	(618) 344-1005
<b>Email</b>	jhriley@teklabinc.com

<b>Collinsville Air</b>	
<b>Address</b>	5445 Horseshoe Lake Road Collinsville, IL 62234-7425
<b>Phone</b>	(618) 344-1004
<b>Fax</b>	(618) 344-1005
<b>Email</b>	EHurley@teklabinc.com

<b>Springfield</b>	
<b>Address</b>	3920 Pintail Dr Springfield, IL 62711-9415
<b>Phone</b>	(217) 698-1004
<b>Fax</b>	(217) 698-1005
<b>Email</b>	KKlostermann@teklabinc.com

<b>Chicago</b>	
<b>Address</b>	1319 Butterfield Rd. Downers Grove, IL 60515
<b>Phone</b>	(630) 324-6855
<b>Fax</b>	
<b>Email</b>	arenner@teklabinc.com

<b>Kansas City</b>	
<b>Address</b>	8421 Nieman Road Lenexa, KS 66214
<b>Phone</b>	(913) 541-1998
<b>Fax</b>	(913) 541-1998
<b>Email</b>	jhriley@teklabinc.com

## Accreditations

<http://www.teklabinc.com/>

**Client:** Southern Illinois Power Cooperation

**Work Order:** 21110629

**Client Project:** Groundwater Monitoring

**Report Date:** 20-Jan-22

<b>State</b>	<b>Dept</b>	<b>Cert #</b>	<b>NELAP</b>	<b>Exp Date</b>	<b>Lab</b>
Illinois	IEPA	100226	NELAP	1/31/2022	Collinsville
Kansas	KDHE	E-10374	NELAP	4/30/2022	Collinsville
Louisiana	LDEQ	05002	NELAP	6/30/2022	Collinsville
Louisiana	LDEQ	05003	NELAP	6/30/2022	Collinsville
Oklahoma	ODEQ	9978	NELAP	8/31/2022	Collinsville
Arkansas	ADEQ	88-0966		3/14/2022	Collinsville
Illinois	IDPH	17584		5/31/2023	Collinsville
Kentucky	UST	0073		1/31/2022	Collinsville
Missouri	MDNR	00930		5/31/2023	Collinsville
Missouri	MDNR	930		1/31/2025	Collinsville

**Client:** Southern Illinois Power Cooperation  
**Client Project:** Groundwater Monitoring

**Work Order:** 21110629  
**Report Date:** 20-Jan-22

**Lab ID:** 21110629-001

**Client Sample ID:** EBG

**Matrix:** GROUNDWATER

**Collection Date:** 12/21/2021 11:35

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>FIELD ELEVATION MEASUREMENTS</b>									
Depth to water from measuring point	*	0	0		7.91	ft	1	12/21/2021 11:35	R304525
Elevation of groundwater surface	*	0	0		516.96	ft	1	12/21/2021 11:35	R304525
Measuring Point Elevation	*	0	0		524.87	ft	1	12/21/2021 11:35	R304525
<b>FIELD PURGE VOLUME</b>									
Purge Volume	*	0	0		2.99	gal	1	12/21/2021 11:35	R304525
<b>STANDARD METHODS 2130 B FIELD</b>									
Turbidity	*	1.0	1.0		13	NTU	1	12/21/2021 11:35	R304525
<b>STANDARD METHODS 18TH ED. 2580 B FIELD</b>									
Oxidation-Reduction Potential	*	-300	-300		135	mV	1	12/21/2021 11:35	R304525
<b>STANDARD METHODS 2510 B FIELD</b>									
Spec. Conductance, Field	*	0	0		0.715	mS/cm	1	12/21/2021 11:35	R304525
<b>STANDARD METHODS 2550 B FIELD</b>									
Temperature	*	0	0		14.6	°C	1	12/21/2021 11:35	R304525
<b>STANDARD METHODS 4500-O G FIELD</b>									
Oxygen, Dissolved	*	0	0		9.40	mg/L	1	12/21/2021 11:35	R304525
<b>SW-846 9040B FIELD</b>									
pH	*	0	1.00		6.95		1	12/21/2021 11:35	R304525
<b>STANDARD METHODS 2540 C (TOTAL) 1997, 2011</b>									
Total Dissolved Solids	*	16	20	H	308	mg/L	1	12/30/2021 14:31	R304482
<i>Sample analysis did not meet hold time requirements.</i>									
<b>STANDARD METHODS 4500-CL E (TOTAL) 1997, 2011</b>									
Chloride	*	1	2		12	mg/L	2	12/30/2021 02:49	R304397
<b>SW-846 9036 (TOTAL)</b>									
Sulfate	NELAP	12	20		84	mg/L	2	12/30/2021 02:49	R304396
<b>SW-846 9214 (TOTAL)</b>									
Fluoride	NELAP	0.04	0.10		0.67	mg/L	1	12/28/2021 09:04	R304308
<b>SW-846 3005A, 6010B, METALS BY ICP (TOTAL)</b>									
Barium	NELAP	0.0007	0.0025		0.0475	mg/L	1	12/27/2021 20:06	186250
Boron	NELAP	0.0090	0.020	J	0.013	mg/L	1	12/27/2021 20:06	186250
Calcium	NELAP	0.0350	0.100		11.6	mg/L	1	12/27/2021 20:06	186250
<b>SW-846 3005A, 6020A, METALS BY ICPMS (TOTAL)</b>									
Antimony	NELAP	0.0090	0.0200		< 0.0200	mg/L	100	12/30/2021 20:13	186250
Arsenic	NELAP	0.0080	0.0200		< 0.0200	mg/L	100	12/30/2021 20:13	186250
Beryllium	NELAP	0.0050	0.0200		< 0.0200	mg/L	100	12/30/2021 20:13	186250
Cadmium	NELAP	0.0030	0.0200		< 0.0200	mg/L	100	12/30/2021 20:13	186250
Chromium	NELAP	0.0140	0.0300		< 0.0300	mg/L	100	12/30/2021 20:13	186250
Cobalt	NELAP	0.0023	0.0200		< 0.0200	mg/L	100	12/30/2021 20:13	186250
Lead	NELAP	0.0120	0.0200		< 0.0200	mg/L	100	12/30/2021 20:13	186250
Lithium	*	0.0290	0.0600		< 0.0600	mg/L	100	12/30/2021 20:13	186250
Molybdenum	NELAP	0.0120	0.0300		< 0.0300	mg/L	100	12/30/2021 20:13	186250
Selenium	NELAP	0.0120	0.0200		< 0.0200	mg/L	100	12/30/2021 20:13	186250
Thallium	NELAP	0.0190	0.0400		< 0.0400	mg/L	100	12/30/2021 20:13	186250
<i>Elevated reporting limit due to sample composition.</i>									
<b>SW-846 7470A (TOTAL)</b>									
Mercury	NELAP	0.00006	0.00020		< 0.00020	mg/L	1	12/23/2021 16:55	186251



## Laboratory Results

<http://www.teklabinc.com/>

**Client:** Southern Illinois Power Cooperation

**Work Order:** 21110629

**Client Project:** Groundwater Monitoring

**Report Date:** 20-Jan-22

**Lab ID:** 21110629-001

**Client Sample ID:** EBG

**Matrix:** GROUNDWATER

**Collection Date:** 12/21/2021 11:35

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>EPA 903.0/904.0, RADIUM 226/228</b>									
Radium-226	*	0	0		See Attached	pCi/L	1	01/04/2022 00:00	R305067
Radium-228	*	0	0		See Attached	pCi/L	1	01/04/2022 00:00	R305067

**Client:** Southern Illinois Power Cooperation  
**Client Project:** Groundwater Monitoring

**Work Order:** 21110629  
**Report Date:** 20-Jan-22

**Lab ID:** 21110629-002

**Client Sample ID:** EP-1

**Matrix:** GROUNDWATER

**Collection Date:** 12/21/2021 15:36

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>FIELD ELEVATION MEASUREMENTS</b>									
Depth to water from measuring point	*	0	0		5.46	ft	1	12/21/2021 15:36	R304525
Elevation of groundwater surface	*	0	0		514.26	ft	1	12/21/2021 15:36	R304525
Measuring Point Elevation	*	0	0		519.72	ft	1	12/21/2021 15:36	R304525
<b>FIELD PURGE VOLUME</b>									
Purge Volume	*	0	0		3.12	gal	1	12/21/2021 15:36	R304525
<b>STANDARD METHODS 2130 B FIELD</b>									
Turbidity	*	1.0	1.0		13	NTU	1	12/21/2021 15:36	R304525
<b>STANDARD METHODS 18TH ED. 2580 B FIELD</b>									
Oxidation-Reduction Potential	*	-300	-300		191	mV	1	12/21/2021 15:36	R304525
<b>STANDARD METHODS 2510 B FIELD</b>									
Spec. Conductance, Field	*	0	0		3.86	mS/cm	1	12/21/2021 15:36	R304525
<b>STANDARD METHODS 2550 B FIELD</b>									
Temperature	*	0	0		14.5	°C	1	12/21/2021 15:36	R304525
<b>STANDARD METHODS 4500-O G FIELD</b>									
Oxygen, Dissolved	*	0	0		8.59	mg/L	1	12/21/2021 15:36	R304525
<b>SW-846 9040B FIELD</b>									
pH	*	0	1.00		6.37		1	12/21/2021 15:36	R304525
<b>STANDARD METHODS 2540 C (TOTAL) 1997, 2011</b>									
Total Dissolved Solids	*	16	20	B	2510	mg/L	1	12/28/2021 10:58	R304392
Sample result(s) for TDS exceed 10 times the method blank contamination. Data is reportable per the TNI Standard.									
<b>STANDARD METHODS 4500-CL E (TOTAL) 1997, 2011</b>									
Chloride	*	5	10		46	mg/L	10	12/30/2021 02:54	R304397
<b>SW-846 9036 (TOTAL)</b>									
Sulfate	NELAP	307	500		1480	mg/L	50	12/30/2021 03:05	R304396
<b>SW-846 9214 (TOTAL)</b>									
Fluoride	NELAP	0.04	0.10		0.24	mg/L	1	12/28/2021 09:06	R304308
<b>SW-846 3005A, 6010B, METALS BY ICP (TOTAL)</b>									
Barium	NELAP	0.0007	0.0025		0.0193	mg/L	1	12/27/2021 20:08	186250
Boron	NELAP	0.0090	0.0200		1.07	mg/L	1	12/27/2021 20:08	186250
Calcium	NELAP	0.0350	0.100		506	mg/L	1	12/27/2021 20:08	186250
<b>SW-846 3005A, 6020A, METALS BY ICPMS (TOTAL)</b>									
Antimony	NELAP	0.0090	0.0200		< 0.0200	mg/L	100	12/30/2021 20:21	186250
Arsenic	NELAP	0.0080	0.0200		< 0.0200	mg/L	100	12/30/2021 20:21	186250
Beryllium	NELAP	0.0050	0.0200		< 0.0200	mg/L	100	12/30/2021 20:21	186250
Cadmium	NELAP	0.0030	0.0200		< 0.0200	mg/L	100	12/30/2021 20:21	186250
Chromium	NELAP	0.0140	0.0300		< 0.0300	mg/L	100	12/30/2021 20:21	186250
Cobalt	NELAP	0.0023	0.0200		< 0.0200	mg/L	100	12/30/2021 20:21	186250
Lead	NELAP	0.0120	0.0200		< 0.0200	mg/L	100	12/30/2021 20:21	186250
Lithium	*	0.0290	0.0600		< 0.0600	mg/L	100	12/30/2021 20:21	186250
Molybdenum	NELAP	0.0120	0.0300		< 0.0300	mg/L	100	12/30/2021 20:21	186250
Selenium	NELAP	0.0120	0.0200		< 0.0200	mg/L	100	12/30/2021 20:21	186250
Thallium	NELAP	0.0190	0.0400		< 0.0400	mg/L	100	12/30/2021 20:21	186250
Elevated reporting limit due to sample composition.									
<b>SW-846 7470A (TOTAL)</b>									
Mercury	NELAP	0.00006	0.00020		< 0.00020	mg/L	1	12/23/2021 16:57	186251



## Laboratory Results

<http://www.teklabinc.com/>

**Client:** Southern Illinois Power Cooperation

**Work Order:** 21110629

**Client Project:** Groundwater Monitoring

**Report Date:** 20-Jan-22

**Lab ID:** 21110629-002

**Client Sample ID:** EP-1

**Matrix:** GROUNDWATER

**Collection Date:** 12/21/2021 15:36

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>EPA 903.0/904.0, RADIUM 226/228</b>									
Radium-226	*	0	0		See Attached	pCi/L	1	01/04/2022 00:00	R305067
Radium-228	*	0	0		See Attached	pCi/L	1	01/04/2022 00:00	R305067

**Client:** Southern Illinois Power Cooperation  
**Client Project:** Groundwater Monitoring

**Work Order:** 21110629  
**Report Date:** 20-Jan-22

**Lab ID:** 21110629-003

**Client Sample ID:** EP-2

**Matrix:** GROUNDWATER

**Collection Date:** 12/22/2021 10:14

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>FIELD ELEVATION MEASUREMENTS</b>									
Depth to water from measuring point	*	0	0		9.99	ft	1	12/22/2021 10:14	R304525
Elevation of groundwater surface	*	0	0		503.80	ft	1	12/22/2021 10:14	R304525
Measuring Point Elevation	*	0	0		513.79	ft	1	12/22/2021 10:14	R304525
<b>FIELD PURGE VOLUME</b>									
Purge Volume	*	0	0		1.17	gal	1	12/22/2021 10:14	R304525
<b>STANDARD METHODS 2130 B FIELD</b>									
Turbidity	*	1.0	1.0		1.5	NTU	1	12/22/2021 10:14	R304525
<b>STANDARD METHODS 18TH ED. 2580 B FIELD</b>									
Oxidation-Reduction Potential	*	-300	-300		152	mV	1	12/22/2021 10:14	R304525
<b>STANDARD METHODS 2510 B FIELD</b>									
Spec. Conductance, Field	*	0	0		3.19	mS/cm	1	12/22/2021 10:14	R304525
<b>STANDARD METHODS 2550 B FIELD</b>									
Temperature	*	0	0		14.4	°C	1	12/22/2021 10:14	R304525
<b>STANDARD METHODS 4500-O G FIELD</b>									
Oxygen, Dissolved	*	0	0		2.16	mg/L	1	12/22/2021 10:14	R304525
<b>SW-846 9040B FIELD</b>									
pH	*	0	1.00		6.32		1	12/22/2021 10:14	R304525
<b>STANDARD METHODS 2540 C (TOTAL) 1997, 2011</b>									
Total Dissolved Solids	*	16	20	B	2090	mg/L	1	12/28/2021 14:51	R304392
Sample result(s) for TDS exceed 10 times the method blank contamination. Data is reportable per the TNI Standard.									
<b>STANDARD METHODS 4500-CL E (TOTAL) 1997, 2011</b>									
Chloride	*	5	10		43	mg/L	10	12/30/2021 03:16	R304397
<b>SW-846 9036 (TOTAL)</b>									
Sulfate	NELAP	307	500		1250	mg/L	50	12/30/2021 03:34	R304396
<b>SW-846 9214 (TOTAL)</b>									
Fluoride	NELAP	0.04	0.10		0.36	mg/L	1	12/28/2021 09:08	R304308
<b>SW-846 3005A, 6010B, METALS BY ICP (TOTAL)</b>									
Barium	NELAP	0.0007	0.0025		0.0168	mg/L	1	12/27/2021 20:18	186250
Boron	NELAP	0.0090	0.0200		0.330	mg/L	1	12/29/2021 11:19	186250
Calcium	NELAP	0.0350	0.100		299	mg/L	1	12/27/2021 20:18	186250
<b>SW-846 3005A, 6020A, METALS BY ICPMS (TOTAL)</b>									
Antimony	NELAP	0.0090	0.0200		< 0.0200	mg/L	100	12/30/2021 20:28	186250
Arsenic	NELAP	0.0080	0.0200		< 0.0200	mg/L	100	12/30/2021 20:28	186250
Beryllium	NELAP	0.0050	0.0200		< 0.0200	mg/L	100	12/30/2021 20:28	186250
Cadmium	NELAP	0.0030	0.0200		< 0.0200	mg/L	100	12/30/2021 20:28	186250
Chromium	NELAP	0.0140	0.0300		< 0.0300	mg/L	100	12/30/2021 20:28	186250
Cobalt	NELAP	0.0023	0.0200		< 0.0200	mg/L	100	12/30/2021 20:28	186250
Lead	NELAP	0.0120	0.0200		< 0.0200	mg/L	100	12/30/2021 20:28	186250
Lithium	*	0.0290	0.0600		< 0.0600	mg/L	100	12/30/2021 20:28	186250
Molybdenum	NELAP	0.0120	0.0300		< 0.0300	mg/L	100	12/30/2021 20:28	186250
Selenium	NELAP	0.0120	0.0200		< 0.0200	mg/L	100	12/30/2021 20:28	186250
Thallium	NELAP	0.0190	0.0400		< 0.0400	mg/L	100	12/30/2021 20:28	186250
Elevated reporting limit due to sample composition.									
<b>SW-846 7470A (TOTAL)</b>									
Mercury	NELAP	0.00006	0.00020	J	0.00006	mg/L	1	12/23/2021 17:00	186251



## Laboratory Results

<http://www.teklabinc.com/>

**Client:** Southern Illinois Power Cooperation

**Work Order:** 21110629

**Client Project:** Groundwater Monitoring

**Report Date:** 20-Jan-22

**Lab ID:** 21110629-003

**Client Sample ID:** EP-2

**Matrix:** GROUNDWATER

**Collection Date:** 12/22/2021 10:14

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>EPA 903.0/904.0, RADIUM 226/228</b>									
Radium-226	*	0	0		See Attached	pCi/L	1	01/04/2022 00:00	R305067
Radium-228	*	0	0		See Attached	pCi/L	1	01/04/2022 00:00	R305067

**Client:** Southern Illinois Power Cooperation  
**Client Project:** Groundwater Monitoring

**Work Order:** 21110629  
**Report Date:** 20-Jan-22

**Lab ID:** 21110629-004

**Client Sample ID:** EP-3

**Matrix:** GROUNDWATER

**Collection Date:** 12/22/2021 11:40

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>FIELD ELEVATION MEASUREMENTS</b>									
Depth to water from measuring point	*	0	0		16.49	ft	1	12/22/2021 11:40	R304525
Elevation of groundwater surface	*	0	0		502.46	ft	1	12/22/2021 11:40	R304525
Measuring Point Elevation	*	0	0		518.95	ft	1	12/22/2021 11:40	R304525
<b>FIELD PURGE VOLUME</b>									
Purge Volume	*	0	0		1.56	gal	1	12/22/2021 11:40	R304525
<b>STANDARD METHODS 2130 B FIELD</b>									
Turbidity	*	1.0	1.0		4.2	NTU	1	12/22/2021 11:40	R304525
<b>STANDARD METHODS 18TH ED. 2580 B FIELD</b>									
Oxidation-Reduction Potential	*	-300	-300		-37	mV	1	12/22/2021 11:40	R304525
<b>STANDARD METHODS 2510 B FIELD</b>									
Spec. Conductance, Field	*	0	0		2.06	mS/cm	1	12/22/2021 11:40	R304525
<b>STANDARD METHODS 2550 B FIELD</b>									
Temperature	*	0	0		16.9	°C	1	12/22/2021 11:40	R304525
<b>STANDARD METHODS 4500-O G FIELD</b>									
Oxygen, Dissolved	*	0	0		5.39	mg/L	1	12/22/2021 11:40	R304525
<b>SW-846 9040B FIELD</b>									
pH	*	0	1.00		6.41		1	12/22/2021 11:40	R304525
<b>STANDARD METHODS 2540 C (TOTAL) 1997, 2011</b>									
Total Dissolved Solids	*	32	40	B	812	mg/L	2	12/28/2021 14:52	R304392
Sample result(s) for TDS exceed 10 times the method blank contamination. Data is reportable per the TNI Standard.									
<b>STANDARD METHODS 4500-CL E (TOTAL) 1997, 2011</b>									
Chloride	*	5	10		183	mg/L	10	12/30/2021 03:42	R304397
<b>SW-846 9036 (TOTAL)</b>									
Sulfate	NELAP	61	100		178	mg/L	10	12/30/2021 03:42	R304396
<b>SW-846 9214 (TOTAL)</b>									
Fluoride	NELAP	0.04	0.10		0.51	mg/L	1	12/28/2021 09:10	R304308
<b>SW-846 3005A, 6010B, METALS BY ICP (TOTAL)</b>									
Barium	NELAP	0.0007	0.0025		0.0840	mg/L	1	12/27/2021 20:20	186250
Boron	NELAP	0.0090	0.0200		0.0501	mg/L	1	12/29/2021 11:25	186250
Calcium	NELAP	0.0350	0.100		58.9	mg/L	1	12/27/2021 20:20	186250
<b>SW-846 3005A, 6020A, METALS BY ICPMS (TOTAL)</b>									
Antimony	NELAP	0.0090	0.0200		< 0.0200	mg/L	100	12/30/2021 20:36	186250
Arsenic	NELAP	0.0080	0.0200		< 0.0200	mg/L	100	12/30/2021 20:36	186250
Beryllium	NELAP	0.0050	0.0200		< 0.0200	mg/L	100	12/30/2021 20:36	186250
Cadmium	NELAP	0.0030	0.0200		< 0.0200	mg/L	100	12/30/2021 20:36	186250
Chromium	NELAP	0.0140	0.0300		< 0.0300	mg/L	100	12/30/2021 20:36	186250
Cobalt	NELAP	0.0023	0.0200		0.0472	mg/L	100	12/30/2021 20:36	186250
Lead	NELAP	0.0120	0.0200		< 0.0200	mg/L	100	12/30/2021 20:36	186250
Lithium	*	0.0290	0.0600		0.0736	mg/L	100	12/30/2021 20:36	186250
Molybdenum	NELAP	0.0120	0.0300		< 0.0300	mg/L	100	12/30/2021 20:36	186250
Selenium	NELAP	0.0120	0.0200		< 0.0200	mg/L	100	12/30/2021 20:36	186250
Thallium	NELAP	0.0190	0.0400		< 0.0400	mg/L	100	12/30/2021 20:36	186250
Elevated reporting limit due to sample composition.									
<b>SW-846 7470A (TOTAL)</b>									
Mercury	NELAP	0.00006	0.00020		< 0.00020	mg/L	1	12/23/2021 17:11	186251



## Laboratory Results

<http://www.teklabinc.com/>

**Client:** Southern Illinois Power Cooperation

**Work Order:** 21110629

**Client Project:** Groundwater Monitoring

**Report Date:** 20-Jan-22

**Lab ID:** 21110629-004

**Client Sample ID:** EP-3

**Matrix:** GROUNDWATER

**Collection Date:** 12/22/2021 11:40

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>EPA 903.0/904.0, RADIUM 226/228</b>									
Radium-226	*	0	0		See Attached	pCi/L	1	01/04/2022 00:00	R305067
Radium-228	*	0	0		See Attached	pCi/L	1	01/04/2022 00:00	R305067

**Client:** Southern Illinois Power Cooperation

**Work Order:** 21110629

**Client Project:** Groundwater Monitoring

**Report Date:** 20-Jan-22

**Lab ID:** 21110629-005

**Client Sample ID:** EP-4

**Matrix:** GROUNDWATER

**Collection Date:** 12/22/2021 15:53

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>FIELD ELEVATION MEASUREMENTS</b>									
Depth to water from measuring point	*	0	0		<b>8.50</b>	ft	1	12/22/2021 15:53	R304525
Elevation of groundwater surface	*	0	0		<b>511.24</b>	ft	1	12/22/2021 15:53	R304525
Measuring Point Elevation	*	0	0		<b>519.74</b>	ft	1	12/22/2021 15:53	R304525
<b>FIELD PURGE VOLUME</b>									
Purge Volume	*	0	0		<b>3.12</b>	gal	1	12/22/2021 15:53	R304525
<b>STANDARD METHODS 2130 B FIELD</b>									
Turbidity	*	1.0	1.0		<b>10</b>	NTU	1	12/22/2021 15:53	R304525
<b>STANDARD METHODS 18TH ED. 2580 B FIELD</b>									
Oxidation-Reduction Potential	*	-300	-300		<b>-14</b>	mV	1	12/22/2021 15:53	R304525
<b>STANDARD METHODS 2510 B FIELD</b>									
Spec. Conductance, Field	*	0	0		<b>3.40</b>	mS/cm	1	12/22/2021 15:53	R304525
<b>STANDARD METHODS 2550 B FIELD</b>									
Temperature	*	0	0		<b>17.2</b>	°C	1	12/22/2021 15:53	R304525
<b>STANDARD METHODS 4500-O G FIELD</b>									
Oxygen, Dissolved	*	0	0		<b>5.70</b>	mg/L	1	12/22/2021 15:53	R304525
<b>SW-846 9040B FIELD</b>									
pH	*	0	1.00		<b>6.05</b>		1	12/22/2021 15:53	R304525
<b>STANDARD METHODS 2540 C (TOTAL) 1997, 2011</b>									
Total Dissolved Solids	*	32	40	B	<b>1450</b>	mg/L	2	12/28/2021 14:52	R304392
Sample result for TDS exceeds 10 times the method blank contamination. Data is reportable per the TNI Standard.									
<b>STANDARD METHODS 4500-CL E (TOTAL) 1997, 2011</b>									
Chloride	*	10	20		<b>477</b>	mg/L	20	12/30/2021 03:45	R304397
<b>SW-846 9036 (TOTAL)</b>									
Sulfate	NELAP	123	200		<b>567</b>	mg/L	20	12/30/2021 03:45	R304396
<b>SW-846 9214 (TOTAL)</b>									
Fluoride	NELAP	0.04	0.10	J	<b>0.09</b>	mg/L	1	12/28/2021 09:12	R304308
<b>SW-846 3005A, 6010B, METALS BY ICP (TOTAL)</b>									
Barium	NELAP	0.0007	0.0025		<b>0.0255</b>	mg/L	1	12/27/2021 20:21	186250
Boron	NELAP	0.0090	0.0200	S	<b>11.6</b>	mg/L	1	12/29/2021 11:34	186250
Calcium	NELAP	0.0350	0.100	S	<b>161</b>	mg/L	1	12/27/2021 20:21	186250
Matrix spike control limits for B are not applicable due to high sample/spike ratio.									
Matrix spike control limits for Ca are not applicable due to high sample/spike ratio.									
<b>SW-846 3005A, 6020A, METALS BY ICPMS (TOTAL)</b>									
Antimony	NELAP	0.0090	0.0200		<b>&lt; 0.0200</b>	mg/L	100	12/30/2021 20:43	186250
Arsenic	NELAP	0.0080	0.0200		<b>&lt; 0.0200</b>	mg/L	100	12/30/2021 20:43	186250
Beryllium	NELAP	0.0050	0.0200		<b>&lt; 0.0200</b>	mg/L	100	12/30/2021 20:43	186250
Cadmium	NELAP	0.0030	0.0200		<b>&lt; 0.0200</b>	mg/L	100	12/30/2021 20:43	186250
Chromium	NELAP	0.0140	0.0300		<b>&lt; 0.0300</b>	mg/L	100	12/30/2021 20:43	186250
Cobalt	NELAP	0.0023	0.0200		<b>0.298</b>	mg/L	100	12/30/2021 20:43	186250
Lead	NELAP	0.0120	0.0200		<b>&lt; 0.0200</b>	mg/L	100	12/30/2021 20:43	186250
Lithium	*	0.0290	0.0600		<b>&lt; 0.0600</b>	mg/L	100	12/30/2021 20:43	186250
Molybdenum	NELAP	0.0120	0.0300		<b>&lt; 0.0300</b>	mg/L	100	12/30/2021 20:43	186250
Selenium	NELAP	0.0120	0.0200		<b>&lt; 0.0200</b>	mg/L	100	12/30/2021 20:43	186250
Thallium	NELAP	0.0190	0.0400		<b>&lt; 0.0400</b>	mg/L	100	12/30/2021 20:43	186250
Elevated reporting limit due to sample composition.									



## Laboratory Results

<http://www.teklabinc.com/>

**Client:** Southern Illinois Power Cooperation

**Work Order:** 21110629

**Client Project:** Groundwater Monitoring

**Report Date:** 20-Jan-22

**Lab ID:** 21110629-005

**Client Sample ID:** EP-4

**Matrix:** GROUNDWATER

**Collection Date:** 12/22/2021 15:53

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>SW-846 7470A (TOTAL)</b>									
Mercury	NELAP	0.00006	0.00020		< 0.00020	mg/L	1	12/23/2021 17:14	186251
<b>EPA 903.0/904.0, RADIUM 226/228</b>									
Radium-226	*	0	0		See Attached	pCi/L	1	01/04/2022 00:00	R305067
Radium-228	*	0	0		See Attached	pCi/L	1	01/04/2022 00:00	R305067

**Client:** Southern Illinois Power Cooperation  
**Client Project:** Groundwater Monitoring

**Work Order:** 21110629  
**Report Date:** 20-Jan-22

**Lab ID:** 21110629-006

**Client Sample ID:** EP-5

**Matrix:** GROUNDWATER

**Collection Date:** 12/21/2021 12:59

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>FIELD ELEVATION MEASUREMENTS</b>									
Depth to water from measuring point	*	0	0		12.84	ft	1	12/21/2021 12:59	R304525
Elevation of groundwater surface	*	0	0		514.75	ft	1	12/21/2021 12:59	R304525
Measuring Point Elevation	*	0	0		527.59	ft	1	12/21/2021 12:59	R304525
<b>FIELD PURGE VOLUME</b>									
Purge Volume	*	0	0		1.30	gal	1	12/21/2021 12:59	R304525
<b>STANDARD METHODS 2130 B FIELD</b>									
Turbidity	*	1.0	1.0		4.9	NTU	1	12/21/2021 12:59	R304525
<b>STANDARD METHODS 18TH ED. 2580 B FIELD</b>									
Oxidation-Reduction Potential	*	-300	-300		150	mV	1	12/21/2021 12:59	R304525
<b>STANDARD METHODS 2510 B FIELD</b>									
Spec. Conductance, Field	*	0	0		0.724	mS/cm	1	12/21/2021 12:59	R304525
<b>STANDARD METHODS 2550 B FIELD</b>									
Temperature	*	0	0		14.9	°C	1	12/21/2021 12:59	R304525
<b>STANDARD METHODS 4500-O G FIELD</b>									
Oxygen, Dissolved	*	0	0		8.30	mg/L	1	12/21/2021 12:59	R304525
<b>SW-846 9040B FIELD</b>									
pH	*	0	1.00		7.07		1	12/21/2021 12:59	R304525
<b>STANDARD METHODS 2540 C (TOTAL) 1997, 2011</b>									
Total Dissolved Solids	*	16	20	H	294	mg/L	1	12/30/2021 14:31	R304482
<i>Sample analysis did not meet hold time requirements.</i>									
<b>STANDARD METHODS 4500-CL E (TOTAL) 1997, 2011</b>									
Chloride	*	1	1		4	mg/L	1	12/30/2021 03:50	R304397
<b>SW-846 9036 (TOTAL)</b>									
Sulfate	NELAP	61	100		119	mg/L	10	12/30/2021 03:55	R304396
<b>SW-846 9214 (TOTAL)</b>									
Fluoride	NELAP	0.04	0.10		0.48	mg/L	1	12/28/2021 09:15	R304308
<b>SW-846 3005A, 6010B, METALS BY ICP (TOTAL)</b>									
Barium	NELAP	0.0007	0.0025		0.0478	mg/L	1	12/27/2021 20:26	186250
Boron	NELAP	0.0090	0.0200		0.0855	mg/L	1	12/29/2021 14:09	186250
Calcium	NELAP	0.0350	0.100		25.4	mg/L	1	12/27/2021 20:26	186250
<b>SW-846 3005A, 6020A, METALS BY ICPMS (TOTAL)</b>									
Antimony	NELAP	0.0090	0.0200		< 0.0200	mg/L	100	12/30/2021 21:06	186250
Arsenic	NELAP	0.0080	0.0200		< 0.0200	mg/L	100	12/30/2021 21:06	186250
Beryllium	NELAP	0.0050	0.0200		< 0.0200	mg/L	100	12/30/2021 21:06	186250
Cadmium	NELAP	0.0030	0.0200		< 0.0200	mg/L	100	12/30/2021 21:06	186250
Chromium	NELAP	0.0140	0.0300		< 0.0300	mg/L	100	12/30/2021 21:06	186250
Cobalt	NELAP	0.0023	0.0200		< 0.0200	mg/L	100	12/30/2021 21:06	186250
Lead	NELAP	0.0120	0.0200		< 0.0200	mg/L	100	12/30/2021 21:06	186250
Lithium	*	0.0290	0.0600		< 0.0600	mg/L	100	12/30/2021 21:06	186250
Molybdenum	NELAP	0.0120	0.0300		< 0.0300	mg/L	100	12/30/2021 21:06	186250
Selenium	NELAP	0.0120	0.0200		< 0.0200	mg/L	100	12/30/2021 21:06	186250
Thallium	NELAP	0.0190	0.0400		< 0.0400	mg/L	100	12/30/2021 21:06	186250
<i>Elevated reporting limit due to sample composition.</i>									
<b>SW-846 7470A (TOTAL)</b>									
Mercury	NELAP	0.00006	0.00020		< 0.00020	mg/L	1	12/23/2021 17:16	186251



## Laboratory Results

<http://www.teklabinc.com/>

**Client:** Southern Illinois Power Cooperation

**Work Order:** 21110629

**Client Project:** Groundwater Monitoring

**Report Date:** 20-Jan-22

**Lab ID:** 21110629-006

**Client Sample ID:** EP-5

**Matrix:** GROUNDWATER

**Collection Date:** 12/21/2021 12:59

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>EPA 903.0/904.0, RADIUM 226/228</b>									
Radium-226	*	0	0		See Attached	pCi/L	1	01/04/2022 00:00	R305067
Radium-228	*	0	0		See Attached	pCi/L	1	01/04/2022 00:00	R305067

**Client:** Southern Illinois Power Cooperation  
**Client Project:** Groundwater Monitoring

**Work Order:** 21110629  
**Report Date:** 20-Jan-22

**Lab ID:** 21110629-007

**Client Sample ID:** EP-6

**Matrix:** GROUNDWATER

**Collection Date:** 12/22/2021 09:10

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>FIELD ELEVATION MEASUREMENTS</b>									
Depth to water from measuring point	*	0	0		<b>2.40</b>	ft	1	12/22/2021 09:10	R304525
Elevation of groundwater surface	*	0	0		<b>502.71</b>	ft	1	12/22/2021 09:10	R304525
Measuring Point Elevation	*	0	0		<b>505.11</b>	ft	1	12/22/2021 09:10	R304525
<b>FIELD PURGE VOLUME</b>									
Purge Volume	*	0	0		<b>3.12</b>	gal	1	12/22/2021 09:10	R304525
<b>STANDARD METHODS 2130 B FIELD</b>									
Turbidity	*	1.0	1.0		<b>7.5</b>	NTU	1	12/22/2021 09:10	R304525
<b>STANDARD METHODS 18TH ED. 2580 B FIELD</b>									
Oxidation-Reduction Potential	*	-300	-300		<b>270</b>	mV	1	12/22/2021 09:10	R304525
<b>STANDARD METHODS 2510 B FIELD</b>									
Spec. Conductance, Field	*	0	0		<b>0.357</b>	mS/cm	1	12/22/2021 09:10	R304525
<b>STANDARD METHODS 2550 B FIELD</b>									
Temperature	*	0	0		<b>12.2</b>	°C	1	12/22/2021 09:10	R304525
<b>STANDARD METHODS 4500-O G FIELD</b>									
Oxygen, Dissolved	*	0	0		<b>5.61</b>	mg/L	1	12/22/2021 09:10	R304525
<b>SW-846 9040B FIELD</b>									
pH	*	0	1.00		<b>5.28</b>		1	12/22/2021 09:10	R304525
<b>STANDARD METHODS 2540 C (TOTAL) 1997, 2011</b>									
Total Dissolved Solids	*	16	20	H	<b>192</b>	mg/L	1	12/30/2021 14:32	R304482
<i>Sample analysis did not meet hold time requirements.</i>									
<b>STANDARD METHODS 4500-CL E (TOTAL) 1997, 2011</b>									
Chloride	*	1	1		<b>25</b>	mg/L	1	12/30/2021 03:58	R304397
<b>SW-846 9036 (TOTAL)</b>									
Sulfate	NELAP	6	10		<b>48</b>	mg/L	1	12/30/2021 03:58	R304396
<b>SW-846 9214 (TOTAL)</b>									
Fluoride	NELAP	0.04	0.10	J	<b>0.06</b>	mg/L	1	12/28/2021 09:17	R304308
<b>SW-846 3005A, 6010B, METALS BY ICP (TOTAL)</b>									
Barium	NELAP	0.0007	0.0025		<b>0.0430</b>	mg/L	1	12/27/2021 20:28	186250
Boron	NELAP	0.0090	0.0200		<b>0.0252</b>	mg/L	1	12/29/2021 14:18	186250
Calcium	NELAP	0.0350	0.100		<b>4.24</b>	mg/L	1	12/27/2021 20:28	186250
<b>SW-846 3005A, 6020A, METALS BY ICPMS (TOTAL)</b>									
Antimony	NELAP	0.0090	0.0200		<b>&lt; 0.0200</b>	mg/L	100	12/30/2021 21:14	186250
Arsenic	NELAP	0.0080	0.0200		<b>&lt; 0.0200</b>	mg/L	100	12/30/2021 21:14	186250
Beryllium	NELAP	0.0050	0.0200		<b>&lt; 0.0200</b>	mg/L	100	12/30/2021 21:14	186250
Cadmium	NELAP	0.0030	0.0200		<b>&lt; 0.0200</b>	mg/L	100	12/30/2021 21:14	186250
Chromium	NELAP	0.0140	0.0300		<b>&lt; 0.0300</b>	mg/L	100	12/30/2021 21:14	186250
Cobalt	NELAP	0.0023	0.020	J	<b>0.0040</b>	mg/L	100	12/30/2021 21:14	186250
Lead	NELAP	0.0120	0.0200		<b>&lt; 0.0200</b>	mg/L	100	12/30/2021 21:14	186250
Lithium	*	0.0290	0.0600		<b>&lt; 0.0600</b>	mg/L	100	12/30/2021 21:14	186250
Molybdenum	NELAP	0.0120	0.0300		<b>&lt; 0.0300</b>	mg/L	100	12/30/2021 21:14	186250
Selenium	NELAP	0.0120	0.0200		<b>&lt; 0.0200</b>	mg/L	100	12/30/2021 21:14	186250
Thallium	NELAP	0.0190	0.0400		<b>&lt; 0.0400</b>	mg/L	100	12/30/2021 21:14	186250
<i>Elevated reporting limit due to sample composition.</i>									
<b>SW-846 7470A (TOTAL)</b>									
Mercury	NELAP	0.00006	0.00020	J	<b>0.00010</b>	mg/L	1	12/23/2021 17:18	186251



## Laboratory Results

<http://www.teklabinc.com/>

**Client:** Southern Illinois Power Cooperation

**Work Order:** 21110629

**Client Project:** Groundwater Monitoring

**Report Date:** 20-Jan-22

**Lab ID:** 21110629-007

**Client Sample ID:** EP-6

**Matrix:** GROUNDWATER

**Collection Date:** 12/22/2021 09:10

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>EPA 903.0/904.0, RADIUM 226/228</b>									
Radium-226	*	0	0		See Attached	pCi/L	1	01/04/2022 00:00	R305067
Radium-228	*	0	0		See Attached	pCi/L	1	01/04/2022 00:00	R305067

**Client:** Southern Illinois Power Cooperation  
**Client Project:** Groundwater Monitoring

**Work Order:** 21110629  
**Report Date:** 20-Jan-22

**Lab ID:** 21110629-008

**Client Sample ID:** EP-7

**Matrix:** GROUNDWATER

**Collection Date:** 12/22/2021 13:30

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>FIELD ELEVATION MEASUREMENTS</b>									
Depth to water from measuring point	*	0	0		13.52	ft	1	12/22/2021 13:30	R304525
Elevation of groundwater surface	*	0	0		501.92	ft	1	12/22/2021 13:30	R304525
Measuring Point Elevation	*	0	0		515.44	ft	1	12/22/2021 13:30	R304525
<b>FIELD PURGE VOLUME</b>									
Purge Volume	*	0	0		1.95	gal	1	12/22/2021 13:30	R304525
<b>STANDARD METHODS 2130 B FIELD</b>									
Turbidity	*	1.0	1.0		4.3	NTU	1	12/22/2021 13:30	R304525
<b>STANDARD METHODS 18TH ED. 2580 B FIELD</b>									
Oxidation-Reduction Potential	*	-300	-300		-20	mV	1	12/22/2021 13:30	R304525
<b>STANDARD METHODS 2510 B FIELD</b>									
Spec. Conductance, Field	*	0	0		2.70	mS/cm	1	12/22/2021 13:30	R304525
<b>STANDARD METHODS 2550 B FIELD</b>									
Temperature	*	0	0		17.1	°C	1	12/22/2021 13:30	R304525
<b>STANDARD METHODS 4500-O G FIELD</b>									
Oxygen, Dissolved	*	0	0		2.48	mg/L	1	12/22/2021 13:30	R304525
<b>SW-846 9040B FIELD</b>									
pH	*	0	1.00		6.16		1	12/22/2021 13:30	R304525
<b>STANDARD METHODS 2540 C (TOTAL) 1997, 2011</b>									
Total Dissolved Solids	*	32	40	B	1270	mg/L	2	12/28/2021 14:54	R304392
Sample result(s) for TDS exceed 10 times the method blank contamination. Data is reportable per the TNI Standard.									
<b>STANDARD METHODS 4500-CL E (TOTAL) 1997, 2011</b>									
Chloride	*	5	10		186	mg/L	10	12/30/2021 04:12	R304397
<b>SW-846 9036 (TOTAL)</b>									
Sulfate	NELAP	123	200		549	mg/L	20	12/30/2021 19:31	R304463
<b>SW-846 9214 (TOTAL)</b>									
Fluoride	NELAP	0.04	0.10		0.33	mg/L	1	12/28/2021 09:19	R304308
<b>SW-846 3005A, 6010B, METALS BY ICP (TOTAL)</b>									
Barium	NELAP	0.0007	0.0025		0.0344	mg/L	1	12/27/2021 20:30	186250
Boron	NELAP	0.0090	0.0200		0.984	mg/L	1	12/29/2021 14:26	186250
Calcium	NELAP	0.0350	0.100		178	mg/L	1	12/27/2021 20:30	186250
<b>SW-846 3005A, 6020A, METALS BY ICPMS (TOTAL)</b>									
Antimony	NELAP	0.0090	0.0200		< 0.0200	mg/L	100	12/30/2021 21:22	186250
Arsenic	NELAP	0.0080	0.0200		< 0.0200	mg/L	100	12/30/2021 21:22	186250
Beryllium	NELAP	0.0050	0.0200		< 0.0200	mg/L	100	12/30/2021 21:22	186250
Cadmium	NELAP	0.0030	0.0200		< 0.0200	mg/L	100	12/30/2021 21:22	186250
Chromium	NELAP	0.0140	0.0300		< 0.0300	mg/L	100	12/30/2021 21:22	186250
Cobalt	NELAP	0.0023	0.0200		0.110	mg/L	100	12/30/2021 21:22	186250
Lead	NELAP	0.0120	0.0200		< 0.0200	mg/L	100	12/30/2021 21:22	186250
Lithium	*	0.0290	0.0600		< 0.0600	mg/L	100	12/30/2021 21:22	186250
Molybdenum	NELAP	0.0120	0.0300		< 0.0300	mg/L	100	12/30/2021 21:22	186250
Selenium	NELAP	0.0120	0.0200		< 0.0200	mg/L	100	12/30/2021 21:22	186250
Thallium	NELAP	0.0190	0.0400		< 0.0400	mg/L	100	12/30/2021 21:22	186250
Elevated reporting limit due to sample composition.									
<b>SW-846 7470A (TOTAL)</b>									
Mercury	NELAP	0.00006	0.00020		< 0.00020	mg/L	1	12/23/2021 17:21	186251



## Laboratory Results

<http://www.teklabinc.com/>

**Client:** Southern Illinois Power Cooperation

**Work Order:** 21110629

**Client Project:** Groundwater Monitoring

**Report Date:** 20-Jan-22

**Lab ID:** 21110629-008

**Client Sample ID:** EP-7

**Matrix:** GROUNDWATER

**Collection Date:** 12/22/2021 13:30

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>EPA 903.0/904.0, RADIUM 226/228</b>									
Radium-226	*	0	0		See Attached	pCi/L	1	01/05/2022 00:00	R305067
Radium-228	*	0	0		See Attached	pCi/L	1	01/05/2022 00:00	R305067

**Client:** Southern Illinois Power Cooperation

**Work Order:** 21110629

**Client Project:** Groundwater Monitoring

**Report Date:** 20-Jan-22

**Lab ID:** 21110629-009

**Client Sample ID:** Equipment Blank

**Matrix:** AQUEOUS

**Collection Date:** 12/22/2021 15:58

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>STANDARD METHODS 2540 C (TOTAL) 1997, 2011</b>									
Total Dissolved Solids	*	16	20	B	< 20	mg/L	1	12/28/2021 14:55	R304392
Contamination present in the MBLK for TDS. Sample results below the reporting limit are reportable per the TNI Standard.									
<b>STANDARD METHODS 4500-CL E (TOTAL) 1997, 2011</b>									
Chloride	*	1	1		< 1	mg/L	1	12/30/2021 04:30	R304397
<b>SW-846 9036 (TOTAL)</b>									
Sulfate	NELAP	6	10		< 10	mg/L	1	12/30/2021 04:30	R304396
<b>SW-846 9214 (TOTAL)</b>									
Fluoride	NELAP	0.04	0.10		< 0.10	mg/L	1	12/28/2021 09:29	R304308
<b>SW-846 3005A, 6010B, METALS BY ICP (TOTAL)</b>									
Barium	NELAP	0.0007	0.0025		< 0.0025	mg/L	1	12/27/2021 20:32	186250
Boron	NELAP	0.0090	0.0200		< 0.0200	mg/L	1	12/27/2021 20:32	186250
Calcium	NELAP	0.0350	0.100		< 0.100	mg/L	1	12/27/2021 20:32	186250
CCV recovered outside the upper control limits for B. Sample results are below the reporting limit. Data is reportable per the TNI standard.									
<b>SW-846 3005A, 6020A, METALS BY ICPMS (TOTAL)</b>									
Antimony	NELAP	0.0090	0.0200		< 0.0200	mg/L	100	12/30/2021 22:00	186250
Arsenic	NELAP	0.0080	0.0200		< 0.0200	mg/L	100	12/30/2021 22:00	186250
Beryllium	NELAP	0.0050	0.0200		< 0.0200	mg/L	100	12/30/2021 22:00	186250
Cadmium	NELAP	0.0030	0.0200		< 0.0200	mg/L	100	12/30/2021 22:00	186250
Chromium	NELAP	0.0140	0.0300		< 0.0300	mg/L	100	12/30/2021 22:00	186250
Cobalt	NELAP	0.0023	0.0200		< 0.0200	mg/L	100	12/30/2021 22:00	186250
Lead	NELAP	0.0120	0.0200		< 0.0200	mg/L	100	12/30/2021 22:00	186250
Lithium	*	0.0290	0.0600		< 0.0600	mg/L	100	12/30/2021 22:00	186250
Molybdenum	NELAP	0.0120	0.0300		< 0.0300	mg/L	100	12/30/2021 22:00	186250
Selenium	NELAP	0.0120	0.0200		< 0.0200	mg/L	100	12/30/2021 22:00	186250
Thallium	NELAP	0.0190	0.0400		< 0.0400	mg/L	100	12/30/2021 22:00	186250
Elevated reporting limit due to sample composition.									
<b>SW-846 7470A (TOTAL)</b>									
Mercury	NELAP	0.00006	0.00020		< 0.00020	mg/L	1	12/23/2021 17:23	186251
<b>EPA 903.0/904.0, RADIUM 226/228</b>									
Radium-226	*	0	0		See Attached	pCi/L	1	01/05/2022 00:00	R305067
Radium-228	*	0	0		See Attached	pCi/L	1	01/05/2022 00:00	R305067

**Client:** Southern Illinois Power Cooperation

**Work Order:** 21110629

**Client Project:** Groundwater Monitoring

**Report Date:** 20-Jan-22

**Lab ID:** 21110629-010

**Client Sample ID:** Field Blank

**Matrix:** AQUEOUS

**Collection Date:** 12/22/2021 11:44

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>STANDARD METHODS 2540 C (TOTAL) 1997, 2011</b>									
Total Dissolved Solids	*	16	20	H	< 20	mg/L	1	12/30/2021 14:33	R304482
<i>Sample analysis did not meet hold time requirements.</i>									
<b>STANDARD METHODS 4500-CL E (TOTAL) 1997, 2011</b>									
Chloride	*	1	1		< 1	mg/L	1	12/30/2021 04:36	R304397
<b>SW-846 9036 (TOTAL)</b>									
Sulfate	NELAP	6	10		< 10	mg/L	1	12/30/2021 04:35	R304396
<b>SW-846 9214 (TOTAL)</b>									
Fluoride	NELAP	0.04	0.10		< 0.10	mg/L	1	12/28/2021 09:32	R304308
<b>SW-846 3005A, 6010B, METALS BY ICP (TOTAL)</b>									
Barium	NELAP	0.0007	0.0025		< 0.0025	mg/L	1	12/27/2021 20:42	186250
Boron	NELAP	0.0090	0.0200		< 0.0200	mg/L	1	12/27/2021 20:42	186250
Calcium	NELAP	0.0350	0.100		< 0.100	mg/L	1	12/27/2021 20:42	186250
<i>CCV recovered outside the upper control limits for B. Sample results are below the reporting limit. Data is reportable per the TNI standard.</i>									
<b>SW-846 3005A, 6020A, METALS BY ICPMS (TOTAL)</b>									
Antimony	NELAP	0.0090	0.0200		< 0.0200	mg/L	100	12/30/2021 22:07	186250
Arsenic	NELAP	0.0080	0.0200		< 0.0200	mg/L	100	12/30/2021 22:07	186250
Beryllium	NELAP	0.0050	0.0200		< 0.0200	mg/L	100	12/30/2021 22:07	186250
Cadmium	NELAP	0.0030	0.0200		< 0.0200	mg/L	100	12/30/2021 22:07	186250
Chromium	NELAP	0.0140	0.0300		< 0.0300	mg/L	100	12/30/2021 22:07	186250
Cobalt	NELAP	0.0023	0.0200		< 0.0200	mg/L	100	12/30/2021 22:07	186250
Lead	NELAP	0.0120	0.0200		< 0.0200	mg/L	100	12/30/2021 22:07	186250
Lithium	*	0.0290	0.0600		< 0.0600	mg/L	100	12/30/2021 22:07	186250
Molybdenum	NELAP	0.0120	0.0300		< 0.0300	mg/L	100	12/30/2021 22:07	186250
Selenium	NELAP	0.0120	0.0200		< 0.0200	mg/L	100	12/30/2021 22:07	186250
Thallium	NELAP	0.0190	0.0400		< 0.0400	mg/L	100	12/30/2021 22:07	186250
<i>Elevated reporting limit due to sample composition.</i>									
<b>SW-846 7470A (TOTAL)</b>									
Mercury	NELAP	0.00006	0.00020		< 0.00020	mg/L	1	12/23/2021 17:35	186251
<b>EPA 903.0/904.0, RADIUM 226/228</b>									
Radium-226	*	0	0		See Attached	pCi/L	1	01/05/2022 00:00	R305067
Radium-228	*	0	0		See Attached	pCi/L	1	01/05/2022 00:00	R305067

**Client:** Southern Illinois Power Cooperation  
**Client Project:** Groundwater Monitoring

**Work Order:** 21110629  
**Report Date:** 20-Jan-22

**Lab ID:** 21110629-011

**Client Sample ID:** Field Duplicate

**Matrix:** GROUNDWATER

**Collection Date:** 12/22/2021 10:14

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>FIELD ELEVATION MEASUREMENTS</b>									
Depth to water from measuring point	*	0	0		9.99	ft	1	12/22/2021 10:14	R304525
Elevation of groundwater surface	*	0	0		503.80	ft	1	12/22/2021 10:14	R304525
Measuring Point Elevation	*	0	0		513.79	ft	1	12/22/2021 10:14	R304525
<b>FIELD PURGE VOLUME</b>									
Purge Volume	*	0	0		1.17	gal	1	12/22/2021 10:14	R304525
<b>STANDARD METHODS 2130 B FIELD</b>									
Turbidity	*	1.0	1.0		1.5	NTU	1	12/22/2021 10:14	R304525
<b>STANDARD METHODS 18TH ED. 2580 B FIELD</b>									
Oxidation-Reduction Potential	*	-300	-300		152	mV	1	12/22/2021 10:14	R304525
<b>STANDARD METHODS 2510 B FIELD</b>									
Spec. Conductance, Field	*	0	0		3.19	mS/cm	1	12/22/2021 10:14	R304525
<b>STANDARD METHODS 2550 B FIELD</b>									
Temperature	*	0	0		14.4	°C	1	12/22/2021 10:14	R304525
<b>STANDARD METHODS 4500-O G FIELD</b>									
Oxygen, Dissolved	*	0	0		2.16	mg/L	1	12/22/2021 10:14	R304525
<b>SW-846 9040B FIELD</b>									
pH	*	0	1.00		6.32		1	12/22/2021 10:14	R304525
<b>STANDARD METHODS 2540 C (TOTAL) 1997, 2011</b>									
Total Dissolved Solids	*	16	20	B	1980	mg/L	1	12/28/2021 14:56	R304392
Sample result for TDS exceeds 10 times the method blank contamination. Data is reportable per the TNI Standard.									
<b>STANDARD METHODS 4500-CL E (TOTAL) 1997, 2011</b>									
Chloride	*	5	10		44	mg/L	10	12/30/2021 04:38	R304397
<b>SW-846 9036 (TOTAL)</b>									
Sulfate	NELAP	307	500		1210	mg/L	50	12/30/2021 04:43	R304396
<b>SW-846 9214 (TOTAL)</b>									
Fluoride	NELAP	0.04	0.10		0.34	mg/L	1	12/28/2021 09:34	R304308
<b>SW-846 3005A, 6010B, METALS BY ICP (TOTAL)</b>									
Barium	NELAP	0.0007	0.0025		0.0172	mg/L	1	12/27/2021 20:43	186250
Boron	NELAP	0.0090	0.0200		0.332	mg/L	1	12/29/2021 14:20	186250
Calcium	NELAP	0.0350	0.100		300	mg/L	1	12/27/2021 20:43	186250
<b>SW-846 3005A, 6020A, METALS BY ICPMS (TOTAL)</b>									
Antimony	NELAP	0.0090	0.0200		< 0.0200	mg/L	100	12/30/2021 22:15	186250
Arsenic	NELAP	0.0080	0.0200		< 0.0200	mg/L	100	12/30/2021 22:15	186250
Beryllium	NELAP	0.0050	0.0200		< 0.0200	mg/L	100	12/30/2021 22:15	186250
Cadmium	NELAP	0.0030	0.0200		< 0.0200	mg/L	100	12/30/2021 22:15	186250
Chromium	NELAP	0.0140	0.0300		< 0.0300	mg/L	100	12/30/2021 22:15	186250
Cobalt	NELAP	0.0023	0.0200		< 0.0200	mg/L	100	12/30/2021 22:15	186250
Lead	NELAP	0.0120	0.0200		< 0.0200	mg/L	100	12/30/2021 22:15	186250
Lithium	*	0.0290	0.0600		< 0.0600	mg/L	100	12/30/2021 22:15	186250
Molybdenum	NELAP	0.0120	0.0300		< 0.0300	mg/L	100	12/30/2021 22:15	186250
Selenium	NELAP	0.0120	0.0200		< 0.0200	mg/L	100	12/30/2021 22:15	186250
Thallium	NELAP	0.0190	0.0400		< 0.0400	mg/L	100	12/30/2021 22:15	186250
Elevated reporting limit due to sample composition.									
<b>SW-846 7470A (TOTAL)</b>									
Mercury	NELAP	0.00006	0.00020	J	0.00006	mg/L	1	12/23/2021 17:37	186251



## Laboratory Results

<http://www.teklabinc.com/>

**Client:** Southern Illinois Power Cooperation

**Work Order:** 21110629

**Client Project:** Groundwater Monitoring

**Report Date:** 20-Jan-22

**Lab ID:** 21110629-011

**Client Sample ID:** Field Duplicate

**Matrix:** GROUNDWATER

**Collection Date:** 12/22/2021 10:14

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>EPA 903.0/904.0, RADIUM 226/228</b>									
Radium-226	*	0	0		See Attached	pCi/L	1	01/05/2022 00:00	R305067
Radium-228	*	0	0		See Attached	pCi/L	1	01/05/2022 00:00	R305067



## Quality Control Results

<http://www.teklabinc.com/>

Client: Southern Illinois Power Cooperation

Work Order: 21110629

Client Project: Groundwater Monitoring

Report Date: 20-Jan-22

### STANDARD METHODS 2510 B FIELD

Batch R304525	SampType: LCS	Units $\mu\text{S}/\text{cm}$								
SampID: LCS-R304525										Date Analyzed
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Spec. Conductance, Field	*	0		1430	1409	0	101.5	90	110	12/22/2021
Spec. Conductance, Field	*	0		1450	1409	0	102.9	90	110	12/21/2021

### SW-846 9040B FIELD

Batch R304525	SampType: LCS	Units								
SampID: LCS-R304525										Date Analyzed
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
pH	*	1.00		7.07	7.000	0	101.0	98.57	101.4	12/21/2021
pH	*	1.00		7.00	7.000	0	100.0	98.57	101.4	12/22/2021

### STANDARD METHODS 2540 C (TOTAL) 1997, 2011

Batch R304392	SampType: MBLK	Units $\text{mg}/\text{L}$								
SampID: MBLK										Date Analyzed
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Total Dissolved Solids	*	20	S	38	16.00	0	237.5	-100	100	12/28/2021

### Batch R304392 SampType: LCS Units $\text{mg}/\text{L}$

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Total Dissolved Solids	*	20	B	998	1000	0	99.8	90	110	12/28/2021

### Batch R304392 SampType: DUP Units $\text{mg}/\text{L}$

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Total Dissolved Solids	*	20	B	2050				1978	3.48	12/28/2021

### Batch R304482 SampType: MBLK Units $\text{mg}/\text{L}$

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Total Dissolved Solids	*	20		< 20	16.00	0	0	-100	100	12/30/2021

### Batch R304482 SampType: LCS Units $\text{mg}/\text{L}$

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Total Dissolved Solids	*	20		922	1000	0	92.2	90	110	12/30/2021



## Quality Control Results

<http://www.teklabinc.com/>

Client: Southern Illinois Power Cooperation

Work Order: 21110629

Client Project: Groundwater Monitoring

Report Date: 20-Jan-22

### STANDARD METHODS 2540 C (TOTAL) 1997, 2011

Batch R304482	SampType: DUP	Units mg/L				RPD Limit 5				Date Analyzed
SampID: 21110629-007ADUP										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Total Dissolved Solids	*	20	H	200				192.0	4.08	12/30/2021

### STANDARD METHODS 4500-CL E (TOTAL) 1997, 2011

Batch R304397	SampType: MBLK	Units mg/L				Low Limit				Date Analyzed
SampID: ICB/MBLK										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Chloride	*	1		< 1	0.5000	0	0	-100	100	12/29/2021

### Batch R304397 SampType: LCS Units mg/L

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Chloride	*	1		20	20.00	0	102.2	90	110	12/29/2021

### Batch R304397 SampType: MS Units mg/L

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Chloride	*	10		252	200.0	46.20	103.1	85	115	12/30/2021

### Batch R304397 SampType: MSD Units mg/L

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Chloride	*	10		256	200.0	46.20	104.8	252.4	1.34	12/30/2021

### Batch R304397 SampType: MS Units mg/L

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Chloride	*	1	S	38	20.00	22.43	76.1	85	115	12/29/2021

### Batch R304397 SampType: MSD Units mg/L

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Chloride	*	1	S	39	20.00	22.43	81.9	37.65	3.03	12/29/2021



## Quality Control Results

<http://www.teklabinc.com/>

Client: Southern Illinois Power Cooperation

Work Order: 21110629

Client Project: Groundwater Monitoring

Report Date: 20-Jan-22

### STANDARD METHODS 4500-CL E (TOTAL) 1997, 2011

Batch R304397 SampType: MS Units mg/L

SampID: 21120916-004AMS

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Chloride	*	2	S	53	40.00	23.33	75.2	85	115	12/29/2021

Batch R304397 SampType: MSD Units mg/L

SampID: 21120916-004AMSD

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Chloride	*	2	S	55	40.00	23.33	78.0	53.42	2.07	12/29/2021

Batch R304397 SampType: MS Units mg/L

SampID: 21120916-006AMS

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Chloride	*	1	S	35	20.00	20.87	71.7	85	115	12/29/2021

Batch R304397 SampType: MSD Units mg/L

SampID: 21120916-006AMSD

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Chloride	*	1	S	35	20.00	20.87	71.3	35.21	0.23	12/29/2021

Batch R304397 SampType: MS Units mg/L

SampID: 21121023-001CMS

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Chloride	*	2		96	40.00	58.87	92.2	85	115	12/29/2021

Batch R304397 SampType: MSD Units mg/L

SampID: 21121023-001CMDS

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Chloride	*	2		93	40.00	58.87	86.5	95.75	2.40	12/29/2021

Batch R304397 SampType: MS Units mg/L

SampID: 21121037-001CMS

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Chloride		1		23	20.00	1.810	107.6	85	115	12/30/2021

Batch R304397 SampType: MSD Units mg/L

SampID: 21121037-001CMDS

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Chloride		1		21	20.00	1.810	96.6	23.32	9.85	12/30/2021



## Quality Control Results

<http://www.teklabinc.com/>

Client: Southern Illinois Power Cooperation

Work Order: 21110629

Client Project: Groundwater Monitoring

Report Date: 20-Jan-22

### STANDARD METHODS 4500-CL E (TOTAL) 1997, 2011

Batch R304397 SampType: MS Units mg/L

SampID: 21121183-001CMS

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Chloride	*	1		28	20.00	9.860	92.2	85	115	12/29/2021

Batch R304397 SampType: MSD Units mg/L

SampID: 21121183-001CMSD

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Chloride	*	1		28	20.00	9.860	91.0	28.31	0.92	12/29/2021

Batch R304397 SampType: MS Units mg/L

SampID: 21121374-001EMS

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Chloride	*	50		1210	1000	264.1	94.1	85	115	12/30/2021

Batch R304397 SampType: MSD Units mg/L

SampID: 21121374-001EMSD

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Chloride	*	50		1220	1000	264.1	95.1	1206	0.79	12/30/2021

Batch R304397 SampType: MS Units mg/L

SampID: 21121384-001AMS

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Chloride	*	10		478	200.0	282.8	97.8	85	115	12/30/2021

Batch R304397 SampType: MSD Units mg/L

SampID: 21121384-001AMSD

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Chloride	*	10		478	200.0	282.8	97.6	478.5	0.08	12/30/2021

Batch R304464 SampType: MBLK Units mg/L

SampID: ICB/MBLK

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Chloride	*	1		<1	0.5000	0	0	-100	100	12/30/2021

Batch R304464 SampType: LCS Units mg/L

SampID: ICV/LCS

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Chloride	*	1		21	20.00	0	103.0	90	110	12/30/2021



## Quality Control Results

<http://www.teklabinc.com/>

Client: Southern Illinois Power Cooperation

Work Order: 21110629

Client Project: Groundwater Monitoring

Report Date: 20-Jan-22

### STANDARD METHODS 4500-CL E (TOTAL) 1997, 2011

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Chloride	*	5		139	100.0	47.00	92.1	85	115	12/30/2021

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Chloride	*	5		137	100.0	47.00	89.6	139.1	1.78	12/30/2021

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Chloride	*	20		591	400.0	239.8	87.7	85	115	12/30/2021

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Chloride	*	20		600	400.0	239.8	90.0	590.5	1.57	12/30/2021

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Chloride	*	1		24	20.00	4.170	99.0	85	115	12/30/2021

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Chloride	*	1		24	20.00	4.170	99.6	23.96	0.54	12/30/2021

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Chloride	*	1		22	20.00	0.9700	104.1	85	115	12/31/2021

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Chloride	*	1		22	20.00	0.9700	104.8	21.79	0.64	12/31/2021

## Quality Control Results

<http://www.teklabinc.com/>
**Client:** Southern Illinois Power Cooperation

**Work Order:** 21110629

**Client Project:** Groundwater Monitoring

**Report Date:** 20-Jan-22

**SW-846 9036 (TOTAL)**

Batch R304396 SampType: MBLK		Units mg/L								Date Analyzed	
SampID:	ICB/MBLK	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	
Sulfate		10		< 10		6.140	0	0	-100	100	12/29/2021

**Batch R304396 SampType: LCS**

Batch R304396 SampType: LCS		Units mg/L								Date Analyzed	
SampID:	ICV/LCS	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	
Sulfate		10		21		20.00	0	103.4	90	110	12/29/2021

**Batch R304396 SampType: MS**

Batch R304396 SampType: MS		Units mg/L								Date Analyzed	
SampID:	21110629-002AMS	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	
Sulfate		500		2440		1000	1483	96.1	85	115	12/30/2021

**Batch R304396 SampType: MSD**

Batch R304396 SampType: MSD		Units mg/L								RPD Limit 10	Date Analyzed
SampID:	21110629-002AMSD	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	
Sulfate		500	E	2500		1000	1483	102.2	2444	2.48	12/30/2021

**Batch R304396 SampType: MS**

Batch R304396 SampType: MS		Units mg/L								Date Analyzed	
SampID:	21120916-004AMS	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	
Sulfate		20	SE	113		40.00	85.94	67.5	90	110	12/29/2021

**Batch R304396 SampType: MSD**

Batch R304396 SampType: MSD		Units mg/L								RPD Limit 10	Date Analyzed
SampID:	21120916-004AMSD	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	
Sulfate		20	SE	115		40.00	85.94	71.8	112.9	1.49	12/29/2021

**Batch R304396 SampType: MS**

Batch R304396 SampType: MS		Units mg/L								Date Analyzed	
SampID:	21120916-006AMS	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	
Sulfate		200		781		400.0	399.9	95.2	90	110	12/29/2021

**Batch R304396 SampType: MSD**

Batch R304396 SampType: MSD		Units mg/L								RPD Limit 10	Date Analyzed
SampID:	21120916-006AMSD	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	
Sulfate		200		775		400.0	399.9	93.8	780.5	0.73	12/29/2021



## Quality Control Results

<http://www.teklabinc.com/>

Client: Southern Illinois Power Cooperation

Work Order: 21110629

Client Project: Groundwater Monitoring

Report Date: 20-Jan-22

### SW-846 9036 (TOTAL)

Batch R304396 SampType: MS		Units mg/L								
SampID: 21121023-001CMS										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Sulfate		20	SE	119	40.00	92.83	66.4	90	110	12/29/2021

Batch R304396 SampType: MSD		Units mg/L		RPD Limit 10						
SampID: 21121023-001CMSD										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Sulfate		20	SE	117	40.00	92.83	59.5	119.4	2.32	12/29/2021

Batch R304396 SampType: MS		Units mg/L								
SampID: 21121037-001CMS										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Sulfate		10		25	20.00	6.270	92.6	85	115	12/30/2021

Batch R304396 SampType: MSD		Units mg/L		RPD Limit 10						
SampID: 21121037-001CMSD										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Sulfate		10		24	20.00	6.270	89.4	24.80	2.66	12/30/2021

Batch R304396 SampType: MS		Units mg/L								
SampID: 21121122-007AMS										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Sulfate		100		474	200.0	258.0	108.0	85	115	12/29/2021

Batch R304396 SampType: MSD		Units mg/L		RPD Limit 10						
SampID: 21121122-007AMSD										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Sulfate		100		443	200.0	258.0	92.5	474.0	6.73	12/29/2021

Batch R304396 SampType: MS		Units mg/L								
SampID: 21121183-001CMS										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Sulfate		100		430	200.0	230.0	100.2	90	110	12/30/2021

Batch R304396 SampType: MSD		Units mg/L		RPD Limit 10						
SampID: 21121183-001CMSD										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Sulfate		100		428	200.0	230.0	98.9	430.4	0.57	12/30/2021



## Quality Control Results

<http://www.teklabinc.com/>

Client: Southern Illinois Power Cooperation

Work Order: 21110629

Client Project: Groundwater Monitoring

Report Date: 20-Jan-22

### SW-846 9036 (TOTAL)

Batch R304396 SampType: MS		Units mg/L								
SampID: 21121374-001EMS									Date Analyzed	
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Sulfate		500		1980	1000	902.0	107.8	90	110	12/30/2021

Batch R304396 SampType: MSD		Units mg/L		RPD Limit 10						
SampID: 21121374-001EMSD									Date Analyzed	
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Sulfate		500		1950	1000	902.0	105.1	1980	1.36	12/30/2021

Batch R304463 SampType: MBLK		Units mg/L								
SampID: ICB/MBLK									Date Analyzed	
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Sulfate		10		< 10	6.140	0	0	-100	100	12/30/2021

Batch R304463 SampType: LCS		Units mg/L								
SampID: ICV/LCS									Date Analyzed	
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Sulfate		10		21	20.00	0	103.7	90	110	12/30/2021

Batch R304463 SampType: MS		Units mg/L								
SampID: 21120916-001AMS									Date Analyzed	
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Sulfate		500		1580	1000	536.8	104.4	90	110	12/30/2021

Batch R304463 SampType: MSD		Units mg/L		RPD Limit 10						
SampID: 21120916-001AMSD									Date Analyzed	
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Sulfate		500		1590	1000	536.8	105.0	1580	0.42	12/30/2021

Batch R304463 SampType: MS		Units mg/L								
SampID: 21121384-001AMS									Date Analyzed	
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Sulfate		1000		3650	2000	1670	99.0	90	110	12/30/2021

Batch R304463 SampType: MSD		Units mg/L		RPD Limit 10						
SampID: 21121384-001AMSD									Date Analyzed	
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Sulfate		1000		3500	2000	1670	91.6	3650	4.14	12/30/2021



## Quality Control Results

<http://www.teklabinc.com/>

Client: Southern Illinois Power Cooperation

Work Order: 21110629

Client Project: Groundwater Monitoring

Report Date: 20-Jan-22

### SW-846 9214 (TOTAL)

Batch R304308	SampType: MBLK	Units mg/L								
SampID: MBLK										Date Analyzed
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Fluoride		0.10		< 0.10	0.0370	0	0	-100	100	12/28/2021

Batch R304308	SampType: LCS	Units mg/L								
SampID: LCS										Date Analyzed
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Fluoride		0.10		1.01	1.000	0	101.1	90	110	12/28/2021

Batch R304308	SampType: MS	Units mg/L								
SampID: 21110629-008AMS										Date Analyzed
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Fluoride		0.10		2.58	2.000	0.3270	112.6	75	125	12/28/2021

Batch R304308	SampType: MSD	Units mg/L								
SampID: 21110629-008AMSD										RPD Limit 15
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Fluoride		0.10		2.56	2.000	0.3270	111.8	2.578	0.62	12/28/2021

Batch R304308	SampType: MS	Units mg/L								
SampID: 21121462-005AMS										Date Analyzed
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Fluoride		0.10		4.62	2.000	2.336	114.0	75	125	12/28/2021

Batch R304308	SampType: MSD	Units mg/L								
SampID: 21121462-005AMSD										RPD Limit 15
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Fluoride		0.10		4.59	2.000	2.336	112.8	4.615	0.50	12/28/2021

Batch R304308	SampType: MS	Units mg/L								
SampID: 21121462-009AMS										Date Analyzed
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Fluoride		1.00		47.0	20.00	26.42	102.8	75	125	12/28/2021

Batch R304308	SampType: MSD	Units mg/L								
SampID: 21121462-009AMSD										RPD Limit 15
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Fluoride		1.00		47.0	20.00	26.42	102.7	46.98	0.04	12/28/2021



## Quality Control Results

<http://www.teklabinc.com/>

Client: Southern Illinois Power Cooperation

Work Order: 21110629

Client Project: Groundwater Monitoring

Report Date: 20-Jan-22

### SW-846 9214 (TOTAL)

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Fluoride		0.10		2.82	2.000	0.5690	112.7	75	125	12/28/2021

### Batch R304308 SampType: MSD Units mg/L RPD Limit 15

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Fluoride		0.10		2.80	2.000	0.5690	111.3	2.823	1.00	12/28/2021

### SW-846 3005A, 6010B, METALS BY ICP (TOTAL)

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Barium		0.0025		< 0.0025	0.0007	0	0	-100	100	12/27/2021
Boron		0.0200		< 0.0200	0.0090	0	0	-100	100	12/27/2021
Calcium		0.100		< 0.100	0.0350	0	0	-100	100	12/27/2021

### Batch 186250 SampType: LCS Units mg/L

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Barium		0.0025		2.03	2.000	0	101.5	85	115	12/27/2021
Boron		0.0200		0.497	0.5000	0	99.3	85	115	12/27/2021
Calcium		0.100		2.48	2.500	0	99.4	85	115	12/27/2021

### Batch 186250 SampType: MS Units mg/L

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Barium		0.0025		2.06	2.000	0.02550	101.7	75	125	12/27/2021
Boron		0.0200	S	11.8	0.5000	11.56	58.0	75	125	12/29/2021
Calcium		0.100	S	164	2.500	160.8	145.2	75	125	12/27/2021

### Batch 186250 SampType: MSD Units mg/L RPD Limit 20

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Barium		0.0025		2.08	2.000	0.02550	102.7	2.060	0.97	12/27/2021
Boron		0.0200	S	11.8	0.5000	11.56	57.7	11.85	0.02	12/29/2021
Calcium		0.100		164	2.500	160.8	119.6	164.4	0.39	12/27/2021



## Quality Control Results

<http://www.teklabinc.com/>

Client: Southern Illinois Power Cooperation

Work Order: 21110629

Client Project: Groundwater Monitoring

Report Date: 20-Jan-22

### SW-846 3005A, 6010B, METALS BY ICP (TOTAL)

Batch	186250	SampType:	MS	Units	mg/L					
SampID: 21121435-009AMS										Date Analyzed
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Lead		0.0750		1.21	0.5000	0.6995	101.3	75	125	12/29/2021

### Batch 186250 SampType: MSD Units mg/L RPD Limit 20

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Lead		0.0750		1.20	0.5000	0.6995	100.1	1.206	0.50	12/29/2021

### SW-846 3005A, 6020A, METALS BY ICPMS (TOTAL)

Batch	186250	SampType:	MBLK	Units	mg/L					
SampID: MBLK-186250										Date Analyzed
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Antimony		0.0010		< 0.0010	0.0004	0	0	-100	100	12/29/2021
Arsenic		0.0010		< 0.0010	0.0004	0	0	-100	100	12/29/2021
Beryllium		0.0010		< 0.0010	0.0002	0	0	-100	100	12/29/2021
Cadmium		0.0010		< 0.0010	0.0001	0	0	-100	100	12/29/2021
Chromium		0.0015		< 0.0015	0.0007	0	0	-100	100	12/29/2021
Cobalt		0.0010		< 0.0010	0.0001	0	0	-100	100	12/29/2021
Lead		0.0010		< 0.0010	0.0006	0	0	-100	100	12/29/2021
Lithium	*	0.0030		< 0.0030	0.0015	0	0	-100	100	12/29/2021
Molybdenum		0.0015		< 0.0015	0.0006	0	0	-100	100	12/29/2021
Selenium		0.0010		< 0.0010	0.0006	0	0	-100	100	12/29/2021
Thallium		0.0020		< 0.0020	0.0010	0	0	-100	100	12/29/2021

## Quality Control Results

<http://www.teklabinc.com/>
**Client:** Southern Illinois Power Cooperation

**Work Order:** 21110629

**Client Project:** Groundwater Monitoring

**Report Date:** 20-Jan-22

**SW-846 3005A, 6020A, METALS BY ICPMS (TOTAL)**

Batch	186250	SampType:	LCS	Units mg/L							Date Analyzed	
Analyses		Cert	RL	Qual	Result	Spike	SPK	Ref Val	%REC	Low Limit	High Limit	
Antimony			0.0010		<b>0.483</b>	0.5000	0		96.7	85	115	12/29/2021
Arsenic			0.0010		<b>0.520</b>	0.5000	0		104.0	85	115	12/29/2021
Beryllium			0.0010		<b>0.0472</b>	0.0500	0		94.4	85	115	12/29/2021
Cadmium			0.0010		<b>0.0492</b>	0.0500	0		98.3	85	115	12/29/2021
Chromium			0.0015		<b>0.191</b>	0.2000	0		95.4	85	115	12/29/2021
Cobalt			0.0010		<b>0.497</b>	0.5000	0		99.3	85	115	12/29/2021
Lead			0.0010		<b>0.493</b>	0.5000	0		98.6	85	115	12/29/2021
Lithium		*	0.0030		<b>0.500</b>	0.5000	0		100.0	85	115	12/29/2021
Molybdenum			0.0015		<b>0.488</b>	0.5000	0		97.6	85	115	12/29/2021
Selenium			0.0010		<b>0.485</b>	0.5000	0		97.1	85	115	12/29/2021
Thallium			0.0020		<b>0.235</b>	0.2500	0		93.9	85	115	12/29/2021

**Batch 186250 SampType: MS Units mg/L**

Batch	186250	SampType:	MS	Units mg/L							Date Analyzed	
Analyses		Cert	RL	Qual	Result	Spike	SPK	Ref Val	%REC	Low Limit	High Limit	
Antimony			0.0200		<b>0.450</b>	0.5000	0		89.9	75	125	12/30/2021
Arsenic			0.0200		<b>0.502</b>	0.5000	0		100.5	75	125	12/30/2021
Beryllium			0.0200		<b>0.0497</b>	0.0500	0		99.4	75	125	12/30/2021
Cadmium			0.0200		<b>0.0458</b>	0.0500	0		91.7	75	125	12/30/2021
Chromium			0.0300		<b>0.199</b>	0.2000	0		99.3	75	125	12/30/2021
Cobalt			0.0200		<b>0.784</b>	0.5000	0.2978		97.1	75	125	12/30/2021
Lead			0.0200		<b>0.485</b>	0.5000	0		97.0	75	125	12/30/2021
Lithium		*	0.0600		<b>0.534</b>	0.5000	0		106.9	75	125	12/30/2021
Molybdenum			0.0300		<b>0.457</b>	0.5000	0		91.4	75	125	12/30/2021
Selenium			0.0200		<b>0.478</b>	0.5000	0		95.7	75	125	12/30/2021
Thallium			0.0400		<b>0.247</b>	0.2500	0		98.9	75	125	12/30/2021



## Quality Control Results

<http://www.teklabinc.com/>

Client: Southern Illinois Power Cooperation

Work Order: 21110629

Client Project: Groundwater Monitoring

Report Date: 20-Jan-22

### SW-846 3005A, 6020A, METALS BY ICPMS (TOTAL)

Batch	186250	SampType:	MSD	Units	mg/L	RPD Limit 20					Date Analyzed
SampID: 21110629-005CMSD											
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD		
Antimony		0.0200		<b>0.451</b>	0.5000	0	90.3	0.4496	0.39		12/30/2021
Arsenic		0.0200		<b>0.491</b>	0.5000	0	98.2	0.5023	2.28		12/30/2021
Beryllium		0.0200		<b>0.0496</b>	0.0500	0	99.2	0.04971	0.19		12/30/2021
Cadmium		0.0200		<b>0.0452</b>	0.0500	0	90.4	0.04583	1.34		12/30/2021
Chromium		0.0300		<b>0.199</b>	0.2000	0	99.5	0.1987	0.16		12/30/2021
Cobalt		0.0200		<b>0.726</b>	0.5000	0.2978	85.6	0.7835	7.64		12/30/2021
Lead		0.0200		<b>0.466</b>	0.5000	0	93.1	0.4849	4.05		12/30/2021
Lithium	*	0.0600		<b>0.527</b>	0.5000	0	105.4	0.5345	1.40		12/30/2021
Molybdenum		0.0300		<b>0.463</b>	0.5000	0	92.6	0.4568	1.32		12/30/2021
Selenium		0.0200		<b>0.475</b>	0.5000	0	95.1	0.4784	0.66		12/30/2021
Thallium		0.0400		<b>0.247</b>	0.2500	0	99.0	0.2474	0.05		12/30/2021

### SW-846 7470A (TOTAL)

Batch	186251	SampType:	MBLK	Units	mg/L	Date Analyzed					
SampID: MBLK-186251											
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit		
Mercury		0.00020		< 0.00020	0.0001	0	0	-100	100		12/23/2021

### Batch 186251 SampType: LCS

Batch	186251	SampType:	LCS	Units	mg/L	Date Analyzed					
SampID: LCS-186251											
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit		
Mercury		0.00020		<b>0.00515</b>	0.0050	0	103.0	85	115		12/27/2021

### Batch 186251 SampType: MS

Batch	186251	SampType:	MS	Units	mg/L	Date Analyzed					
SampID: 21110629-003CMS											
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit		
Mercury		0.00020		<b>0.00431</b>	0.0050	0.00005570	85.1	75	125		12/23/2021

### Batch 186251 SampType: MSD

Batch	186251	SampType:	MSD	Units	mg/L	RPD Limit 15					Date Analyzed
SampID: 21110629-003CMSD											
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD		
Mercury		0.00020		<b>0.00440</b>	0.0050	0.00005570	87.0	0.004309	2.17		12/23/2021



## Quality Control Results

<http://www.teklabinc.com/>

**Client:** Southern Illinois Power Cooperation

**Work Order:** 21110629

**Client Project:** Groundwater Monitoring

**Report Date:** 20-Jan-22

### SW-846 7470A (TOTAL)

Batch 186251 SampType: MS		Units mg/L								
SampID: 21110629-009CMS										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Mercury		0.00020		<b>0.00481</b>	0.0050	0	96.1	75	125	12/23/2021

Batch 186251 SampType: MSD		Units mg/L		RPD Limit 15						
SampID: 21110629-009CMSD										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Mercury		0.00020		<b>0.00475</b>	0.0050	0	95.0	0.004806	1.19	12/23/2021

## Receiving Check List

<http://www.teklabinc.com/>

**Client:** Southern Illinois Power Cooperation

**Work Order:** 21110629

**Client Project:** Groundwater Monitoring

**Report Date:** 20-Jan-22

**Carrier:** Adam Bridges

**Received By:** PWR

**Completed by:**

On:

23-Dec-21



Patrick Riley

**Reviewed by:**

On:

23-Dec-21



Elizabeth A. Hurley

**Pages to follow:** Chain of custody

2

Extra pages included

21

Shipping container/cooler in good condition?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>	Not Present <input type="checkbox"/>	Temp °C <b>1.4</b>
Type of thermal preservation?	None <input type="checkbox"/>	Ice <input checked="" type="checkbox"/>	Blue Ice <input type="checkbox"/>	Dry Ice <input type="checkbox"/>
Chain of custody present?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>		
Chain of custody signed when relinquished and received?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>		
Chain of custody agrees with sample labels?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>		
Samples in proper container/bottle?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>		
Sample containers intact?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>		
Sufficient sample volume for indicated test?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>		
All samples received within holding time?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>		
Reported field parameters measured:	Field <input checked="" type="checkbox"/>	Lab <input type="checkbox"/>	NA <input type="checkbox"/>	
Container/Temp Blank temperature in compliance?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>		
<i>When thermal preservation is required, samples are compliant with a temperature between 0.1°C - 6.0°C, or when samples are received on ice the same day as collected.</i>				
Water – at least one vial per sample has zero headspace?	Yes <input type="checkbox"/>	No <input type="checkbox"/>	No VOA vials <input checked="" type="checkbox"/>	
Water - TOX containers have zero headspace?	Yes <input type="checkbox"/>	No <input type="checkbox"/>	No TOX containers <input checked="" type="checkbox"/>	
Water - pH acceptable upon receipt?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>	NA <input type="checkbox"/>	
NPDES/CWA TCN interferences checked/treated in the field?	Yes <input type="checkbox"/>	No <input type="checkbox"/>	NA <input checked="" type="checkbox"/>	

**Any No responses must be detailed below or on the COC.**

pH strip #77625. - patrickriley - 12/23/2021 8:49:22 AM

# CHAIN OF CUSTODY

pg. 1 of 2 Work order # 21110629

**TEKLAB, INC. 5445 Horseshoe Lake Road - Collinsville, IL 62234 - Phone: (618) 344-1004 - Fax: (618) 344-1005**

<b>Client:</b> Southern Illinois Power Cooperation <b>Address:</b> 11543 Lake of Egypt Road <b>City / State / Zip</b> Marion, IL 62959		<b>Samples on:</b> <input checked="" type="checkbox"/> ICE <input type="checkbox"/> BLUE ICE <input type="checkbox"/> NO ICE <b>1.4</b> °C LTG# <b>1</b> <b>Preserved in:</b> <input type="checkbox"/> LAB <input checked="" type="checkbox"/> FIELD <b>77625</b> <b>861423/21</b> <b>FOR LAB USE ONLY</b> <b>Lab Notes:</b>	
<b>Contact:</b> Jason McLaurin <b>E-Mail:</b> jmclaurin@sipower.org		<b>Phone:</b> (618) 964-1448 <b>Fax:</b>	
Are these samples known to be involved in litigation? If yes, a surcharge will apply <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No Are these samples known to be hazardous? <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No Are there any required reporting limits to be met on the requested analysis? If yes, please provide limits in the comment section. <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No			
<b>Project Name/Number</b> Groundwater Monitoring		<b>Sample Collector's Name</b> <i>J.RILEY A. BRIDGES</i>	
<b>Results Requested</b> <input checked="" type="checkbox"/> Standard <input type="checkbox"/> 1-2 Day (100% Surcharge) <input type="checkbox"/> Other <input type="checkbox"/> 3 Day (50% Surcharge)		<b>Billing Instructions</b> <i># and Type of Containers</i>	
		UNP      HNO <sub>3</sub>	
<b>Lab Use Only</b>		<b>Date/Time Sampled</b>	
21110629-cc1		EBG 12/21/21 1135	
-cc2		EP-1 12/21/21 1536	
-cc3		EP-2 * 12/22/21 1014	
-cc4		EP-3 12/22/21 1140	
-cc5		EP-4 12/22/21 1550	
-cc6		EP-5 12/21/21 1259	
-cc7		EP-6 12/22/21 0910	
-cc8		EP-7 12/22/21 1230	
-cc9		Equipment Blank 12/22/21 1558	
-cc10		Field Blank 12/22/21 1194	
<b>Relinquished By</b> <i>Mark Bule</i>		<b>Date/Time</b> <i>12-23-21 0800</i>	
		<b>Received By</b> <i>John B.</i>	
		<b>Date/Time</b> <i>12/23/21 0800</i>	

Aqueous	MATRIX		INDICATE ANALYSIS REQUESTED							
	Field Parameters	Chloride	Fluoride	ICP/Metals	Mercury	Ra226/228	Sulfate	TDS		
X	X X X X X X X X X X									
X	X X X X X X X X X X									
X	X X X X X X X X X X									
X	X X X X X X X X X X									
X	X X X X X X X X X X									
X	X X X X X X X X X X									
X	X X X X X X X X X X									
X	X X X X X X X X X X									
X	X X X X X X X X X X									
X	X X X X X X X X X X									
X	X X X X X X X X X X									

TE Sat 11/19/21

The individual signing this agreement on behalf of the client, acknowledges that he/she has read and understands the terms and conditions of this agreement, and that he/she has the authority to sign on behalf of the client. See [www.teklabinc.com](http://www.teklabinc.com) for terms and conditions.

BottleOrder: 69155



12/22/21

# CHAIN OF CUSTODY

pg. 2 of 2 Work order # 21110629

**TEKLAB, INC. 5445 Horseshoe Lake Road - Collinsville, IL 62234 - Phone: (618) 344-1004 - Fax: (618) 344-1005**

<b>Client:</b> Southern Illinois Power Cooperation <b>Address:</b> 11543 Lake of Egypt Road <b>City / State / Zip</b> Marion, IL 62959 <b>Contact:</b> Jason McLaurin <b>Phone:</b> (618) 964-1448 <b>E-Mail:</b> jmclaurin@sipower.org <b>Fax:</b>				Samples on: <input type="checkbox"/> ICE <input checked="" type="checkbox"/> BLUE ICE <input type="checkbox"/> NO ICE      °C      LTG# _____ Preserved in: <input type="checkbox"/> LAB <input checked="" type="checkbox"/> FIELD <b>FOR LAB USE ONLY</b> <b>Lab Notes:</b>  <b>Client Comments</b> ICP: Ba B Ca ICP/MS: Sb As Be Cd Cr Co Pb Li Mo Se Ti Field Parameters = Elevations, pH, Conductivity, Temperature, Turbidity, DO, ORP and Purge Volume Ra226/228: subcontract to Pace-National																					
Are these samples known to be involved in litigation? If yes, a surcharge will apply <input type="checkbox"/> Yes <input type="checkbox"/> No Are these samples known to be hazardous? <input type="checkbox"/> Yes <input type="checkbox"/> No Are there any required reporting limits to be met on the requested analysis? If yes, please provide limits in the comment section. <input type="checkbox"/> Yes <input type="checkbox"/> No																									
Project Name/Number			Sample Collector's Name																						
Groundwater Monitoring																									
<b>Results Requested</b>		<b>Billing Instructions</b>		<b># and Type of Containers</b>																					
<input type="checkbox"/> Standard <input type="checkbox"/> 1-2 Day (100% Surcharge) <input type="checkbox"/> Other <input type="checkbox"/> 3 Day (50% Surcharge)				UNP	HNO3																				
<b>Lab Use Only</b>		<b>Sample Identification</b>		<b>Date/Time Sampled</b>																					
21110629 -011		Field Duplicate		12/22/21 10:14																					
MATRIX													INDICATE ANALYSIS REQUESTED												
Aqueous													TDS												
Groundwater													Ra226/228												
Chloride													Sulfate												
Field Parameters													TDS												
Fluoride													Ra226/228												
ICP/Metals													Mercury												
ICP/MS Metals													Chloride												
Fluoride													Mercury												
Field Parameters													Chloride												
Fluoride													Mercury												
ICP/Metals													Chloride												
ICP/MS Metals													Mercury												
Field Parameters													Chloride												
Fluoride													Mercury												
ICP/Metals													Chloride												
ICP/MS Metals													Mercury												
Field Parameters													Chloride												
Fluoride													Mercury												
ICP/Metals													Chloride												
ICP/MS Metals													Mercury												
Field Parameters													Chloride												
Fluoride													Mercury												
ICP/Metals													Chloride												
ICP/MS Metals													Mercury												
Field Parameters													Chloride												
Fluoride													Mercury												
ICP/Metals													Chloride												
ICP/MS Metals													Mercury												
Field Parameters													Chloride												
Fluoride													Mercury												
ICP/Metals													Chloride												
ICP/MS Metals													Mercury												
Field Parameters													Chloride												
Fluoride													Mercury												
ICP/Metals													Chloride												
ICP/MS Metals													Mercury												
Field Parameters													Chloride												
Fluoride													Mercury												
ICP/Metals													Chloride												
ICP/MS Metals													Mercury												
Field Parameters													Chloride												
Fluoride													Mercury												
ICP/Metals													Chloride												
ICP/MS Metals													Mercury												
Field Parameters													Chloride												
Fluoride													Mercury												
ICP/Metals													Chloride												
ICP/MS Metals													Mercury												
Field Parameters													Chloride												
Fluoride													Mercury												
ICP/Metals													Chloride												
ICP/MS Metals													Mercury												
Field Parameters													Chloride												
Fluoride													Mercury												
ICP/Metals													Chloride												
ICP/MS Metals													Mercury												
Field Parameters													Chloride												
Fluoride													Mercury												
ICP/Metals													Chloride												
ICP/MS Metals													Mercury												
Field Parameters													Chloride												
Fluoride													Mercury												
ICP/Metals													Chloride												
ICP/MS Metals													Mercury												
Field Parameters													Chloride												
Fluoride													Mercury												
ICP/Metals													Chloride												
ICP/MS Metals													Mercury												
Field Parameters													Chloride												
Fluoride													Mercury												
ICP/Metals													Chloride												
ICP/MS Metals													Mercury												
Field Parameters													Chloride												
Fluoride													Mercury												
ICP/Metals													Chloride												
ICP/MS Metals													Mercury												
Field Parameters													Chloride												
Fluoride													Mercury												
ICP/Metals													Chloride												
ICP/MS Metals													Mercury												
Field Parameters													Chloride												
Fluoride													Mercury												
ICP/Metals													Chloride												
ICP/MS Metals													Mercury												
Field Parameters													Chloride												
Fluoride													Mercury												
ICP/Metals													Chloride												
ICP/MS Metals													Mercury												
Field Parameters													Chloride												
Fluoride													Mercury												
ICP/Metals													Chloride												
ICP/MS Metals													Mercury												
Field Parameters													Chloride												
Fluoride													Mercury												
ICP/Metals													Chloride												
ICP/MS Metals													Mercury												
Field Parameters													Chloride												
Fluoride													Mercury												
ICP/Metals													Chloride												
ICP/MS Metals													Mercury												
Field Parameters													Chloride												
Fluoride													Mercury												
ICP/Metals													Chloride												
ICP/MS Metals													Mercury												
Field Parameters													Chloride												
Fluoride													Mercury												
ICP/Metals													Chloride												
ICP/MS Metals													Mercury												
Field Parameters													Chloride												
Fluoride													Mercury												
ICP/Metals													Chloride												
ICP/MS Metals													Mercury												
Field Parameters													Chloride												
Fluoride													Mercury												
ICP/Metals													Chloride												
ICP/MS Metals													Mercury												
Field Parameters													Chloride												
Fluoride													Mercury												
ICP/Metals													Chloride												
ICP/MS Metals													Mercury												
Field Parameters													Chloride												
Fluoride													Mercury												
ICP/Metals													Chloride												
ICP/MS Metals													Mercury												
Field Parameters													Chloride												
Fluoride													Mercury												
ICP/Metals													Chloride												
ICP/MS Metals													Mercury												
Field Parameters													Chloride												
Fluoride													Mercury												
ICP/Metals													Chloride												
ICP/MS Metals													Mercury												
Field Parameters													Chloride												
Fluoride													Mercury												
ICP/Metals													Chloride												
ICP/MS Metals													Mercury												
Field Parameters													Chloride												
Fluoride													Mercury												
ICP/Metals													Chloride												
ICP/MS Metals													Mercury												
Field Parameters													Chloride												
Fluoride													Mercury												
ICP/Metals													Chloride												
ICP/MS Metals													Mercury												
Field Parameters													Chloride												
Fluoride													Mercury												
ICP/Metals													Chloride												
ICP/MS Metals													Mercury												
Field Parameters													Chloride												
Fluoride													Mercury												
ICP/Metals													Chloride												
ICP/MS Metals																									



# ANALYTICAL REPORT

January 18, 2022

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

<sup>7</sup>GI

<sup>8</sup>AI

<sup>9</sup>SC

## TEKLAB, Inc.

Sample Delivery Group: L1445869

Samples Received: 12/27/2021

Project Number: 21110629

Description:

Report To: Elizabeth Hurley  
5445 Horseshoe Lake Road  
Collinsville, IL 62234

Entire Report Reviewed By:

Mark W. Beasley  
Project Manager

Results relate only to the items tested or calibrated and are reported as rounded values. This test report shall not be reproduced, except in full, without written approval of the laboratory. Where applicable, sampling conducted by Pace Analytical National is performed per guidance provided in laboratory standard operating procedures ENV-SOP-MTJL-0067 and ENV-SOP-MTJL-0068. Where sampling conducted by the customer, results relate to the accuracy of the information provided, and as the samples are received.

Pace Analytical National

12065 Lebanon Rd Mount Juliet, TN 37122 615-758-5858 800-767-5859 [www.pacenational.com](http://www.pacenational.com)

ACCOUNT:

TEKLAB, Inc.

PROJECT:

21110629

SDG:

L1445869

DATE/TIME:


01/18/22 14:54

PAGE:

1 of 21

# TABLE OF CONTENTS

<b>Cp: Cover Page</b>	<b>1</b>	<b>1</b>
<b>Tc: Table of Contents</b>	<b>2</b>	<b>2</b>
<b>Ss: Sample Summary</b>	<b>3</b>	<b>3</b>
<b>Cn: Case Narrative</b>	<b>5</b>	<b>4</b>
<b>Sr: Sample Results</b>	<b>6</b>	<b>5</b>
<b>21110629-001 L1445869-01</b>	<b>6</b>	<b>6</b>
<b>21110629-002 L1445869-02</b>	<b>7</b>	<b>7</b>
<b>21110629-003 L1445869-03</b>	<b>8</b>	<b>8</b>
<b>21110629-004 L1445869-04</b>	<b>9</b>	<b>9</b>
<b>21110629-005 L1445869-05</b>	<b>10</b>	<b>10</b>
<b>21110629-006 L1445869-06</b>	<b>11</b>	<b>11</b>
<b>21110629-007 L1445869-07</b>	<b>12</b>	<b>12</b>
<b>21110629-008 L1445869-08</b>	<b>13</b>	<b>13</b>
<b>21110629-009 L1445869-09</b>	<b>14</b>	<b>14</b>
<b>21110629-010 L1445869-10</b>	<b>15</b>	<b>15</b>
<b>21110629-011 L1445869-11</b>	<b>16</b>	<b>16</b>
<b>Qc: Quality Control Summary</b>	<b>17</b>	<b>6</b>
<b>Radiochemistry by Method 904/9320</b>	<b>17</b>	<b>7</b>
<b>Radiochemistry by Method SM7500Ra B M</b>	<b>18</b>	<b>8</b>
<b>Gl: Glossary of Terms</b>	<b>19</b>	<b>9</b>
<b>Al: Accreditations &amp; Locations</b>	<b>20</b>	
<b>Sc: Sample Chain of Custody</b>	<b>21</b>	



# SAMPLE SUMMARY

			Collected by	Collected date/time	Received date/time	
				12/21/21 11:35	12/27/21 10:30	
2110629-001 L1445869-01 Non-Potable Water	Method	Batch	Dilution	Preparation date/time	Analysis date/time	Analyst Location
Radiochemistry by Method 904/9320		WG1792917	1	12/28/21 10:30	01/04/22 13:30	JMR Mt. Juliet, TN
Radiochemistry by Method Calculation		WG1797372	1	01/03/22 15:00	01/04/22 15:02	JMR Mt. Juliet, TN
Radiochemistry by Method SM7500Ra B M		WG1797372	1	01/03/22 15:00	01/04/22 15:02	RGT Mt. Juliet, TN
2110629-002 L1445869-02 Non-Potable Water				Collected by	Collected date/time	Received date/time
					12/21/21 15:36	12/27/21 10:30
Method	Batch	Dilution	Preparation date/time	Analysis date/time	Analyst	Location
Radiochemistry by Method 904/9320	WG1792917	1	12/28/21 10:30	01/04/22 13:30	JMR	Mt. Juliet, TN
Radiochemistry by Method Calculation	WG1797372	1	01/03/22 15:00	01/04/22 15:02	JMR	Mt. Juliet, TN
Radiochemistry by Method SM7500Ra B M	WG1797372	1	01/03/22 15:00	01/04/22 15:02	RGT	Mt. Juliet, TN
2110629-003 L1445869-03 Non-Potable Water				Collected by	Collected date/time	Received date/time
					12/21/21 10:14	12/27/21 10:30
Method	Batch	Dilution	Preparation date/time	Analysis date/time	Analyst	Location
Radiochemistry by Method 904/9320	WG1792917	1	12/28/21 10:30	01/04/22 13:30	JMR	Mt. Juliet, TN
Radiochemistry by Method Calculation	WG1797372	1	01/03/22 15:00	01/04/22 15:02	JMR	Mt. Juliet, TN
Radiochemistry by Method SM7500Ra B M	WG1797372	1	01/03/22 15:00	01/04/22 15:02	RGT	Mt. Juliet, TN
2110629-004 L1445869-04 Non-Potable Water				Collected by	Collected date/time	Received date/time
					12/21/21 11:40	12/27/21 10:30
Method	Batch	Dilution	Preparation date/time	Analysis date/time	Analyst	Location
Radiochemistry by Method 904/9320	WG1792917	1	12/28/21 10:30	01/04/22 13:30	JMR	Mt. Juliet, TN
Radiochemistry by Method Calculation	WG1797372	1	01/03/22 15:00	01/04/22 15:02	JMR	Mt. Juliet, TN
Radiochemistry by Method SM7500Ra B M	WG1797372	1	01/03/22 15:00	01/04/22 15:02	RGT	Mt. Juliet, TN
2110629-005 L1445869-05 Non-Potable Water				Collected by	Collected date/time	Received date/time
					12/21/21 15:53	12/27/21 10:30
Method	Batch	Dilution	Preparation date/time	Analysis date/time	Analyst	Location
Radiochemistry by Method 904/9320	WG1792917	1	12/28/21 10:30	01/17/22 14:30	JMR	Mt. Juliet, TN
Radiochemistry by Method Calculation	WG1797372	1	01/03/22 15:00	01/17/22 14:30	JMR	Mt. Juliet, TN
Radiochemistry by Method SM7500Ra B M	WG1797372	1	01/03/22 15:00	01/04/22 15:02	RGT	Mt. Juliet, TN
2110629-006 L1445869-06 Non-Potable Water				Collected by	Collected date/time	Received date/time
					12/21/21 12:59	12/27/21 10:30
Method	Batch	Dilution	Preparation date/time	Analysis date/time	Analyst	Location
Radiochemistry by Method 904/9320	WG1792917	1	12/28/21 10:30	01/17/22 14:30	JMR	Mt. Juliet, TN
Radiochemistry by Method Calculation	WG1797372	1	01/03/22 15:00	01/17/22 14:30	JMR	Mt. Juliet, TN
Radiochemistry by Method SM7500Ra B M	WG1797372	1	01/03/22 15:00	01/04/22 15:02	RGT	Mt. Juliet, TN

1 Cp

2 Tc

3 Ss

4 Cn

5 Sr

6 Qc

7 Gl

8 Al

9 Sc

# SAMPLE SUMMARY

			Collected by	Collected date/time	Received date/time	
				12/22/21 09:10	12/27/21 10:30	
2110629-007 L1445869-07 Non-Potable Water	Method	Batch	Dilution	Preparation date/time	Analysis date/time	Analyst Location
Radiochemistry by Method 904/9320		WG1792917	1	12/28/21 10:30	01/17/22 14:30	JMR Mt. Juliet, TN
Radiochemistry by Method Calculation		WG1797372	1	01/03/22 15:00	01/17/22 14:30	JMR Mt. Juliet, TN
Radiochemistry by Method SM7500Ra B M		WG1797372	1	01/03/22 15:00	01/04/22 15:02	RGT Mt. Juliet, TN
2110629-008 L1445869-08 Non-Potable Water				Collected by	Collected date/time	Received date/time
					12/22/21 13:30	12/27/21 10:30
Method	Batch	Dilution	Preparation date/time	Analysis date/time	Analyst	Location
Radiochemistry by Method 904/9320	WG1792917	1	12/28/21 10:30	01/17/22 14:30	JMR	Mt. Juliet, TN
Radiochemistry by Method Calculation	WG1797372	1	01/03/22 15:00	01/17/22 14:30	JMR	Mt. Juliet, TN
Radiochemistry by Method SM7500Ra B M	WG1797372	1	01/03/22 15:00	01/05/22 14:05	RGT	Mt. Juliet, TN
2110629-009 L1445869-09 Non-Potable Water				Collected by	Collected date/time	Received date/time
					12/22/21 15:58	12/27/21 10:30
Method	Batch	Dilution	Preparation date/time	Analysis date/time	Analyst	Location
Radiochemistry by Method 904/9320	WG1792917	1	12/28/21 10:30	01/17/22 14:30	JMR	Mt. Juliet, TN
Radiochemistry by Method Calculation	WG1797372	1	01/03/22 15:00	01/17/22 14:30	JMR	Mt. Juliet, TN
Radiochemistry by Method SM7500Ra B M	WG1797372	1	01/03/22 15:00	01/05/22 14:05	RGT	Mt. Juliet, TN
2110629-010 L1445869-10 Non-Potable Water				Collected by	Collected date/time	Received date/time
					12/22/21 11:44	12/27/21 10:30
Method	Batch	Dilution	Preparation date/time	Analysis date/time	Analyst	Location
Radiochemistry by Method 904/9320	WG1792917	1	12/28/21 10:30	01/17/22 14:30	JMR	Mt. Juliet, TN
Radiochemistry by Method Calculation	WG1797372	1	01/03/22 15:00	01/17/22 14:30	JMR	Mt. Juliet, TN
Radiochemistry by Method SM7500Ra B M	WG1797372	1	01/03/22 15:00	01/05/22 14:05	RGT	Mt. Juliet, TN
2110629-011 L1445869-11 Non-Potable Water				Collected by	Collected date/time	Received date/time
					12/22/21 10:14	12/27/21 10:30
Method	Batch	Dilution	Preparation date/time	Analysis date/time	Analyst	Location
Radiochemistry by Method 904/9320	WG1792917	1	12/28/21 10:30	01/17/22 14:30	JMR	Mt. Juliet, TN
Radiochemistry by Method Calculation	WG1797372	1	01/03/22 15:00	01/17/22 14:30	JMR	Mt. Juliet, TN
Radiochemistry by Method SM7500Ra B M	WG1797372	1	01/03/22 15:00	01/05/22 14:05	RGT	Mt. Juliet, TN

1 Cp

2 Tc

3 Ss

4 Cn

5 Sr

6 Qc

7 Gl

8 Al

9 Sc

# CASE NARRATIVE

All sample aliquots were received at the correct temperature, in the proper containers, with the appropriate preservatives, and within method specified holding times, unless qualified or notated within the report. Where applicable, all MDL (LOD) and RDL (LOQ) values reported for environmental samples have been corrected for the dilution factor used in the analysis. All radiochemical sample results for solids are reported on a dry weight basis with the exception of tritium, carbon-14 and radon, unless wet weight was requested by the client. All Method and Batch Quality Control are within established criteria except where addressed in this case narrative, a non-conformance form or properly qualified within the sample results. By my digital signature below, I affirm to the best of my knowledge, all problems/anomalies observed by the laboratory as having the potential to affect the quality of the data have been identified by the laboratory, and no information or data have been knowingly withheld that would affect the quality of the data.



Mark W. Beasley  
Project Manager

- <sup>1</sup> Cp
- <sup>2</sup> Tc
- <sup>3</sup> Ss
- <sup>4</sup> Cn
- <sup>5</sup> Sr
- <sup>6</sup> Qc
- <sup>7</sup> GI
- <sup>8</sup> AI
- <sup>9</sup> Sc

21110629-001

Collected date/time: 12/21/21 11:35

## SAMPLE RESULTS - 01

L1445869

## Radiochemistry by Method 904/9320

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-228	0.194	<u>U</u>	0.303	0.565	01/04/2022 13:30	<u>WG1792917</u>
(T) Barium	104			62.0-143	01/04/2022 13:30	<u>WG1792917</u>
(T) Yttrium	101			79.0-136	01/04/2022 13:30	<u>WG1792917</u>

<sup>1</sup>Cp<sup>2</sup>Tc<sup>3</sup>Ss<sup>4</sup>Cn<sup>5</sup>Sr<sup>6</sup>Qc<sup>7</sup>Gl<sup>8</sup>Al<sup>9</sup>Sc

## Radiochemistry by Method Calculation

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
Combined Radium	0.297	<u>U</u>	0.451	0.783	01/04/2022 15:02	<u>WG1797372</u>

## Radiochemistry by Method SM7500Ra B M

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-226	0.104	<u>J</u>	0.148	0.218	01/04/2022 15:02	<u>WG1797372</u>
(T) Barium-133	97.9			30.0-143	01/04/2022 15:02	<u>WG1797372</u>

21110629-002

Collected date/time: 12/21/21 15:36

## SAMPLE RESULTS - 02

L1445869

## Radiochemistry by Method 904/9320

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-228	0.255	<u>U</u>	0.400	0.745	01/04/2022 13:30	<u>WG1792917</u>
( <i>T</i> ) Barium	103			62.0-143	01/04/2022 13:30	<u>WG1792917</u>
( <i>T</i> ) Yttrium	103			79.0-136	01/04/2022 13:30	<u>WG1792917</u>

<sup>1</sup>Cp<sup>2</sup>Tc<sup>3</sup>Ss<sup>4</sup>Cn<sup>5</sup>Sr<sup>6</sup>Qc<sup>7</sup>Gl<sup>8</sup>Al<sup>9</sup>Sc

## Radiochemistry by Method Calculation

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
Combined Radium	0.756	<u>J</u>	0.730	1.06	01/04/2022 15:02	<u>WG1797372</u>

## Radiochemistry by Method SM7500Ra B M

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-226	0.501		0.330	0.318	01/04/2022 15:02	<u>WG1797372</u>
( <i>T</i> ) Barium-133	91.1			30.0-143	01/04/2022 15:02	<u>WG1797372</u>

21110629-003

Collected date/time: 12/21/21 10:14

## SAMPLE RESULTS - 03

L1445869

## Radiochemistry by Method 904/9320

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-228	0.145	<u>U</u>	0.282	0.529	01/04/2022 13:30	<u>WG1792917</u>
( <i>T</i> ) Barium	101			62.0-143	01/04/2022 13:30	<u>WG1792917</u>
( <i>T</i> ) Yttrium	96.0			79.0-136	01/04/2022 13:30	<u>WG1792917</u>

<sup>1</sup>Cp<sup>2</sup>Tc<sup>3</sup>Ss<sup>4</sup>Cn<sup>5</sup>Sr<sup>6</sup>Qc<sup>7</sup>Gl<sup>8</sup>Al<sup>9</sup>Sc

## Radiochemistry by Method Calculation

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
Combined Radium	0.374	<u>J</u>	0.512	0.813	01/04/2022 15:02	<u>WG1797372</u>

## Radiochemistry by Method SM7500Ra B M

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-226	0.228	<u>J</u>	0.230	0.284	01/04/2022 15:02	<u>WG1797372</u>
( <i>T</i> ) Barium-133	96.0			30.0-143	01/04/2022 15:02	<u>WG1797372</u>

21110629-004

Collected date/time: 12/21/21 11:40

## SAMPLE RESULTS - 04

L1445869

## Radiochemistry by Method 904/9320

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-228	0.768		0.310	0.558	01/04/2022 13:30	<a href="#">WG1792917</a>
(T) Barium	101			62.0-143	01/04/2022 13:30	<a href="#">WG1792917</a>
(T) Yttrium	94.7			79.0-136	01/04/2022 13:30	<a href="#">WG1792917</a>

<sup>1</sup>Cp<sup>2</sup>Tc<sup>3</sup>Ss<sup>4</sup>Cn<sup>5</sup>Sr<sup>6</sup>Qc<sup>7</sup>Gl<sup>8</sup>Al<sup>9</sup>Sc

## Radiochemistry by Method Calculation

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
Combined Radium	0.964		0.549	0.886	01/04/2022 15:02	<a href="#">WG1797372</a>

## Radiochemistry by Method SM7500Ra B M

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-226	0.196	J	0.239	0.328	01/04/2022 15:02	<a href="#">WG1797372</a>
(T) Barium-133	98.0			30.0-143	01/04/2022 15:02	<a href="#">WG1797372</a>

21110629-005

Collected date/time: 12/21/21 15:53

## SAMPLE RESULTS - 05

L1445869

## Radiochemistry by Method 904/9320

Analyte	Result pCi/l	<u>Qualifier</u>	Uncertainty + / -	MDA pCi/l	Analysis Date date / time	<u>Batch</u>
RADIUM-228	1.21		0.419	0.360	01/17/2022 14:30	<a href="#">WG1792917</a>
( <i>T</i> ) Barium	112			62.0-143	01/17/2022 14:30	<a href="#">WG1792917</a>
( <i>T</i> ) Yttrium	92.0			79.0-136	01/17/2022 14:30	<a href="#">WG1792917</a>

<sup>1</sup>Cp<sup>2</sup>Tc<sup>3</sup>Ss<sup>4</sup>Cn<sup>5</sup>Sr<sup>6</sup>Qc<sup>7</sup>Gl<sup>8</sup>Al<sup>9</sup>Sc

## Radiochemistry by Method Calculation

Analyte	Result pCi/l	<u>Qualifier</u>	Uncertainty + / -	MDA pCi/l	Analysis Date date / time	<u>Batch</u>
Combined Radium	1.38		0.709	0.793	01/17/2022 14:30	<a href="#">WG1797372</a>

## Radiochemistry by Method SM7500Ra B M

Analyte	Result pCi/l	<u>Qualifier</u>	Uncertainty + / -	MDA pCi/l	Analysis Date date / time	<u>Batch</u>
RADIUM-226	0.170	J	0.290	0.433	01/04/2022 15:02	<a href="#">WG1797372</a>
( <i>T</i> ) Barium-133	92.4			30.0-143	01/04/2022 15:02	<a href="#">WG1797372</a>

21110629-006

Collected date/time: 12/21/21 12:59

## SAMPLE RESULTS - 06

L1445869

## Radiochemistry by Method 904/9320

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-228	-0.125	<u>U</u>	0.367	0.336	01/17/2022 14:30	<u>WG1792917</u>
( <i>T</i> ) Barium	101			62.0-143	01/17/2022 14:30	<u>WG1792917</u>
( <i>T</i> ) Yttrium	101			79.0-136	01/17/2022 14:30	<u>WG1792917</u>

<sup>1</sup>Cp<sup>2</sup>Tc<sup>3</sup>Ss<sup>4</sup>Cn<sup>5</sup>Sr<sup>6</sup>Qc<sup>7</sup>Gl<sup>8</sup>Al<sup>9</sup>Sc

## Radiochemistry by Method Calculation

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
Combined Radium	0.564	<u>J</u>	0.708	0.632	01/17/2022 14:30	<u>WG1797372</u>

## Radiochemistry by Method SM7500Ra B M

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-226	0.564		0.341	0.296	01/04/2022 15:02	<u>WG1797372</u>
( <i>T</i> ) Barium-133	95.5			30.0-143	01/04/2022 15:02	<u>WG1797372</u>

21110629-007

Collected date/time: 12/22/21 09:10

## SAMPLE RESULTS - 07

L1445869

## Radiochemistry by Method 904/9320

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-228	0.297	J	0.365	0.327	01/17/2022 14:30	<a href="#">WG1792917</a>
(T) Barium	98.4			62.0-143	01/17/2022 14:30	<a href="#">WG1792917</a>
(T) Yttrium	103			79.0-136	01/17/2022 14:30	<a href="#">WG1792917</a>

<sup>1</sup>Cp<sup>2</sup>Tc<sup>3</sup>Ss<sup>4</sup>Cn<sup>5</sup>Sr<sup>6</sup>Qc<sup>7</sup>Gl<sup>8</sup>Al<sup>9</sup>Sc

## Radiochemistry by Method Calculation

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
Combined Radium	0.362	J	0.492	0.549	01/17/2022 14:30	<a href="#">WG1797372</a>

## Radiochemistry by Method SM7500Ra B M

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-226	0.0641	U	0.127	0.222	01/04/2022 15:02	<a href="#">WG1797372</a>
(T) Barium-133	97.5			30.0-143	01/04/2022 15:02	<a href="#">WG1797372</a>

21110629-008

Collected date/time: 12/22/21 13:30

## SAMPLE RESULTS - 08

L1445869

## Radiochemistry by Method 904/9320

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-228	0.0686	J	0.373	0.338	01/17/2022 14:30	<a href="#">WG1792917</a>
(T) Barium	103			62.0-143	01/17/2022 14:30	<a href="#">WG1792917</a>
(T) Yttrium	102			79.0-136	01/17/2022 14:30	<a href="#">WG1792917</a>

<sup>1</sup>Cp<sup>2</sup>Tc<sup>3</sup>Ss<sup>4</sup>Cn<sup>5</sup>Sr<sup>6</sup>Qc<sup>7</sup>Gl<sup>8</sup>Al<sup>9</sup>Sc

## Radiochemistry by Method Calculation

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
Combined Radium	0.172	J	0.547	0.615	01/17/2022 14:30	<a href="#">WG1797372</a>

## Radiochemistry by Method SM7500Ra B M

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-226	0.103	J	0.174	0.277	01/05/2022 14:05	<a href="#">WG1797372</a>
(T) Barium-133	96.0			30.0-143	01/05/2022 14:05	<a href="#">WG1797372</a>

21110629-009

Collected date/time: 12/22/21 15:58

## SAMPLE RESULTS - 09

L1445869

## Radiochemistry by Method 904/9320

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-228	3.06		0.440	0.353	01/17/2022 14:30	<a href="#">WG1792917</a>
(T) Barium	101			62.0-143	01/17/2022 14:30	<a href="#">WG1792917</a>
(T) Yttrium	106			79.0-136	01/17/2022 14:30	<a href="#">WG1792917</a>

<sup>1</sup>Cp<sup>2</sup>Tc<sup>3</sup>Ss<sup>4</sup>Cn<sup>5</sup>Sr<sup>6</sup>Qc<sup>7</sup>Gl<sup>8</sup>Al<sup>9</sup>Sc

## Radiochemistry by Method Calculation

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
Combined Radium	3.16		0.601	0.595	01/17/2022 14:30	<a href="#">WG1797372</a>

## Radiochemistry by Method SM7500Ra B M

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-226	0.108	J	0.161	0.242	01/05/2022 14:05	<a href="#">WG1797372</a>
(T) Barium-133	98.5			30.0-143	01/05/2022 14:05	<a href="#">WG1797372</a>

21110629-010

Collected date/time: 12/22/21 11:44

## SAMPLE RESULTS - 10

L1445869

## Radiochemistry by Method 904/9320

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-228	0.465		0.374	0.332	01/17/2022 14:30	<a href="#">WG1792917</a>
(T) Barium	101			62.0-143	01/17/2022 14:30	<a href="#">WG1792917</a>
(T) Yttrium	101			79.0-136	01/17/2022 14:30	<a href="#">WG1792917</a>

<sup>1</sup>Cp<sup>2</sup>Tc<sup>3</sup>Ss<sup>4</sup>Cn<sup>5</sup>Sr<sup>6</sup>Qc<sup>7</sup>Gl<sup>8</sup>Al<sup>9</sup>Sc

## Radiochemistry by Method Calculation

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
Combined Radium	0.482	<u>J</u>	0.484	0.586	01/17/2022 14:30	<a href="#">WG1797372</a>

## Radiochemistry by Method SM7500Ra B M

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-226	0.0177	<u>U</u>	0.110	0.254	01/05/2022 14:05	<a href="#">WG1797372</a>
(T) Barium-133	101			30.0-143	01/05/2022 14:05	<a href="#">WG1797372</a>

21110629-011

Collected date/time: 12/22/21 10:14

## SAMPLE RESULTS - 11

L1445869

## Radiochemistry by Method 904/9320

Analyte	Result pCi/l	<u>Qualifier</u>	Uncertainty + / -	MDA pCi/l	Analysis Date date / time	<u>Batch</u>
RADIUM-228	1.13		0.369	0.316	01/17/2022 14:30	<a href="#">WG1792917</a>
( <i>T</i> ) Barium	110			62.0-143	01/17/2022 14:30	<a href="#">WG1792917</a>
( <i>T</i> ) Yttrium	101			79.0-136	01/17/2022 14:30	<a href="#">WG1792917</a>

<sup>1</sup>Cp<sup>2</sup>Tc<sup>3</sup>Ss<sup>4</sup>Cn<sup>5</sup>Sr<sup>6</sup>Qc<sup>7</sup>Gl<sup>8</sup>Al<sup>9</sup>Sc

## Radiochemistry by Method Calculation

Analyte	Result pCi/l	<u>Qualifier</u>	Uncertainty + / -	MDA pCi/l	Analysis Date date / time	<u>Batch</u>
Combined Radium	1.13		0.497	0.618	01/17/2022 14:30	<a href="#">WG1797372</a>

## Radiochemistry by Method SM7500Ra B M

Analyte	Result pCi/l	<u>Qualifier</u>	Uncertainty + / -	MDA pCi/l	Analysis Date date / time	<u>Batch</u>
RADIUM-226	-0.0207	<u>U</u>	0.128	0.302	01/05/2022 14:05	<a href="#">WG1797372</a>
( <i>T</i> ) Barium-133	98.3			30.0-143	01/05/2022 14:05	<a href="#">WG1797372</a>

## QUALITY CONTROL SUMMARY

[L1445869-01,02,03,04,05,06,07,08,09,10,11](#)

## Method Blank (MB)

(MB) R3750966-5 01/17/22 14:30

Analyte	MB Result pCi/l	<u>MB Qualifier</u>	MB Uncertainty + / -	MB MDA pCi/l
Radium-228	0.340		0.276	0.245
(T) Barium	106		106	
(T) Yttrium	107		107	

<sup>1</sup>Cp<sup>2</sup>Tc<sup>3</sup>Ss<sup>4</sup>Cn<sup>5</sup>Sr<sup>6</sup>Qc<sup>7</sup>Gl<sup>8</sup>Al<sup>9</sup>Sc

## L1445869-03 Original Sample (OS) • Duplicate (DUP)

(OS) L1445869-03 01/04/22 13:30 • (DUP) R3750966-4 01/04/22 13:30

Analyte	Original Result pCi/l	Original Uncertainty + / -	Original MDA pCi/l	DUP Result pCi/l	DUP Uncertainty + / -	DUP MDA pCi/l	Dilution	DUP RPD %	DUP RER	<u>DUP Qualifier</u>	DUP RPD Limits %	DUP RER Limit
Radium-228	0.145	0.282	0.529	-0.170	0.679	0.529	1	200	0.429	U	20	3
(T) Barium	101			100	100							
(T) Yttrium	96.0			97.4	97.4							

## Laboratory Control Sample (LCS)

(LCS) R3750966-1 01/04/22 13:30

Analyte	Spike Amount pCi/l	LCS Result pCi/l	LCS Rec. %	Rec. Limits %	<u>LCS Qualifier</u>
Radium-228	5.00	5.22	104	80.0-120	
(T) Barium			103		
(T) Yttrium			101		

## L1445869-02 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1445869-02 01/04/22 13:30 • (MS) R3750966-2 01/04/22 13:30 • (MSD) R3750966-3 01/04/22 13:30

Analyte	Spike Amount pCi/l	Original Result pCi/l	MS Result pCi/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	<u>MS Qualifier</u>	<u>MSD Qualifier</u>	RPD %	MS RER	RPD Limits %
Radium-228	16.7	0.255	20.5	19.6	121	116	1	70.0-130		4.74		20
(T) Barium		103			111	99.6						
(T) Yttrium		103		95.5	99.4							

## QUALITY CONTROL SUMMARY

[L1445869-01,02,03,04,05,06,07,08,09,10,11](#)

## Method Blank (MB)

(MB) R3748491-1 01/04/22 15:02

Analyte	MB Result pCi/l	<u>MB Qualifier</u> + / -	MB Uncertainty pCi/l	MB MDA pCi/l
Radium-226	0.000567	<u>U</u>	0.0442	0.0899
(T) Barium-133	95.8		95.8	

<sup>1</sup>Cp<sup>2</sup>Tc<sup>3</sup>Ss<sup>4</sup>Cn<sup>5</sup>Sr<sup>6</sup>Qc<sup>7</sup>Gl<sup>8</sup>Al<sup>9</sup>Sc

## L1446861-01 Original Sample (OS) • Duplicate (DUP)

(OS) L1446861-01 01/05/22 14:05 • (DUP) R3748491-5 01/04/22 15:02

Analyte	Original Result pCi/l	Original Uncertainty + / -	Original MDA pCi/l	DUP Result pCi/l	DUP Uncertainty + / -	DUP MDA pCi/l	Dilution	DUP RPD %	DUP RER	<u>DUP Qualifier</u>	DUP RPD Limits %	DUP RER Limit
Radium-226	-0.0540	0.0967	0.309	0.297	0.237	0.309	1	200	1.37		20	3
(T) Barium-133	95.5			96.4	96.4							

## Laboratory Control Sample (LCS)

(LCS) R3748491-2 01/04/22 15:02

Analyte	Spike Amount pCi/l	LCS Result pCi/l	LCS Rec. %	Rec. Limits %	<u>LCS Qualifier</u>
Radium-226	5.02	5.12	102	80.0-120	
(T) Barium-133			93.5		

## L1445869-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1445869-01 01/04/22 15:02 • (MS) R3748491-3 01/04/22 15:02 • (MSD) R3748491-4 01/04/22 15:02

Analyte	Spike Amount pCi/l	Original Result pCi/l	MS Result pCi/l	MSD Result pCi/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	<u>MS Qualifier</u>	<u>MSD Qualifier</u>	RPD %	MS RER	RPD Limits %
Radium-226	20.1	0.104	17.9	17.9	88.7	88.3	1	75.0-125			0.447		20
(T) Barium-133		97.9			96.5	98.8							

# GLOSSARY OF TERMS

## Guide to Reading and Understanding Your Laboratory Report

The information below is designed to better explain the various terms used in your report of analytical results from the Laboratory. This is not intended as a comprehensive explanation, and if you have additional questions please contact your project representative.

**Results Disclaimer -** Information that may be provided by the customer, and contained within this report, include Permit Limits, Project Name, Sample ID, Sample Matrix, Sample Preservation, Field Blanks, Field Spikes, Field Duplicates, On-Site Data, Sampling Collection Dates/Times, and Sampling Location. Results relate to the accuracy of this information provided, and as the samples are received.

### Abbreviations and Definitions

MDA	Minimum Detectable Activity.	<sup>1</sup> Cp
Rec.	Recovery.	<sup>2</sup> Tc
RER	Replicate Error Ratio.	<sup>3</sup> Ss
RPD	Relative Percent Difference.	<sup>4</sup> Cn
SDG	Sample Delivery Group.	<sup>5</sup> Sr
(T)	Tracer - A radioisotope of known concentration added to a solution of chemically equivalent radioisotopes at a known concentration to assist in monitoring the yield of the chemical separation.	<sup>6</sup> Qc
Analyte	The name of the particular compound or analysis performed. Some Analyses and Methods will have multiple analytes reported.	<sup>7</sup> GI
Dilution	If the sample matrix contains an interfering material, the sample preparation volume or weight values differ from the standard, or if concentrations of analytes in the sample are higher than the highest limit of concentration that the laboratory can accurately report, the sample may be diluted for analysis. If a value different than 1 is used in this field, the result reported has already been corrected for this factor.	<sup>8</sup> AI
Limits	These are the target % recovery ranges or % difference value that the laboratory has historically determined as normal for the method and analyte being reported. Successful QC Sample analysis will target all analytes recovered or duplicated within these ranges.	<sup>9</sup> Sc
Original Sample	The non-spiked sample in the prep batch used to determine the Relative Percent Difference (RPD) from a quality control sample. The Original Sample may not be included within the reported SDG.	
Qualifier	This column provides a letter and/or number designation that corresponds to additional information concerning the result reported. If a Qualifier is present, a definition per Qualifier is provided within the Glossary and Definitions page and potentially a discussion of possible implications of the Qualifier in the Case Narrative if applicable.	
Result	The actual analytical final result (corrected for any sample specific characteristics) reported for your sample. If there was no measurable result returned for a specific analyte, the result in this column may state "ND" (Not Detected) or "BDL" (Below Detectable Levels). The information in the results column should always be accompanied by either an MDL (Method Detection Limit) or RDL (Reporting Detection Limit) that defines the lowest value that the laboratory could detect or report for this analyte.	
Uncertainty (Radiochemistry)	Confidence level of 2 sigma.	
Case Narrative (Cn)	A brief discussion about the included sample results, including a discussion of any non-conformances to protocol observed either at sample receipt by the laboratory from the field or during the analytical process. If present, there will be a section in the Case Narrative to discuss the meaning of any data qualifiers used in the report.	
Quality Control Summary (Qc)	This section of the report includes the results of the laboratory quality control analyses required by procedure or analytical methods to assist in evaluating the validity of the results reported for your samples. These analyses are not being performed on your samples typically, but on laboratory generated material.	
Sample Chain of Custody (Sc)	This is the document created in the field when your samples were initially collected. This is used to verify the time and date of collection, the person collecting the samples, and the analyses that the laboratory is requested to perform. This chain of custody also documents all persons (excluding commercial shippers) that have had control or possession of the samples from the time of collection until delivery to the laboratory for analysis.	
Sample Results (Sr)	This section of your report will provide the results of all testing performed on your samples. These results are provided by sample ID and are separated by the analyses performed on each sample. The header line of each analysis section for each sample will provide the name and method number for the analysis reported.	
Sample Summary (Ss)	This section of the Analytical Report defines the specific analyses performed for each sample ID, including the dates and times of preparation and/or analysis.	

### Qualifier      Description

J	The identification of the analyte is acceptable; the reported value is an estimate.
U	Below Detectable Limits: Indicates that the analyte was not detected.

# ACCREDITATIONS & LOCATIONS

Pace Analytical National 12065 Lebanon Rd Mount Juliet, TN 37122

Alabama	40660	Nebraska	NE-OS-15-05
Alaska	17-026	Nevada	TN000032021-1
Arizona	AZ0612	New Hampshire	2975
Arkansas	88-0469	New Jersey—NELAP	TN002
California	2932	New Mexico <sup>1</sup>	TN00003
Colorado	TN00003	New York	11742
Connecticut	PH-0197	North Carolina	Env375
Florida	E87487	North Carolina <sup>1</sup>	DW21704
Georgia	NELAP	North Carolina <sup>3</sup>	41
Georgia <sup>1</sup>	923	North Dakota	R-140
Idaho	TN00003	Ohio—VAP	CL0069
Illinois	200008	Oklahoma	9915
Indiana	C-TN-01	Oregon	TN200002
Iowa	364	Pennsylvania	68-02979
Kansas	E-10277	Rhode Island	LA000356
Kentucky <sup>1,6</sup>	KY90010	South Carolina	84004002
Kentucky <sup>2</sup>	16	South Dakota	n/a
Louisiana	AI30792	Tennessee <sup>1,4</sup>	2006
Louisiana	LA018	Texas	T104704245-20-18
Maine	TN00003	Texas <sup>5</sup>	LAB0152
Maryland	324	Utah	TN000032021-11
Massachusetts	M-TN003	Vermont	VT2006
Michigan	9958	Virginia	110033
Minnesota	047-999-395	Washington	C847
Mississippi	TN00003	West Virginia	233
Missouri	340	Wisconsin	998093910
Montana	CERT0086	Wyoming	A2LA
A2LA – ISO 17025	1461.01	AIHA-LAP,LLC EMLAP	100789
A2LA – ISO 17025 <sup>5</sup>	1461.02	DOD	1461.01
Canada	1461.01	USDA	P330-15-00234
EPA-Crypto	TN00003		

<sup>1</sup> Drinking Water <sup>2</sup> Underground Storage Tanks <sup>3</sup> Aquatic Toxicity <sup>4</sup> Chemical/Microbiological <sup>5</sup> Mold <sup>6</sup> Wastewater n/a Accreditation not applicable

\* Not all certifications held by the laboratory are applicable to the results reported in the attached report.

\* Accreditation is only applicable to the test methods specified on each scope of accreditation held by Pace Analytical.

<sup>1</sup> Cp

<sup>2</sup> Tc

<sup>3</sup> Ss

<sup>4</sup> Cn

<sup>5</sup> Sr

<sup>6</sup> Qc

<sup>7</sup> Gl

<sup>8</sup> Al

<sup>9</sup> Sc

A115

## **TEKLAB, INC. Chain of Custody**

5445 Horseshoe Lake Road, Collinsville, IL 62234 Phone (618) 344-1004 Fax (618) 344-1005

Are the samples chilled?	YES <input type="checkbox"/>	NO <input checked="" type="checkbox"/>	With: <input type="checkbox"/> Ice <input type="checkbox"/> Blue Ice	Preserved in: <input type="checkbox"/> Lab <input type="checkbox"/> Field
Teklab Inc 5445 Horseshoe Lake Road Collinsville, IL 62234	Cooler Temp: <input type="text"/>		Sampler: Joseph Riley/Adam Bridges	QC Level: <input type="text" value="3"/>
Project# <input type="text" value="21110629"/>	Comments: <b>Please Issue reports and invoices via email only</b> Please analyze for Radium 226/228 per methods specified for Vistra/Ramboll projects. IL site Batch QC is required for all analyses requested.			
Contact: <input type="text" value="Elizabeth Hurley"/>	Email: <input type="text" value="EHurley@TekLabInc.com"/>	Any changes to analysis/methods must be approved by Teklab, Inc.		
Requested Due Date: <input type="text" value="10-15 day TAT"/>	Billing/PO: <input type="text" value="32279"/>	Phone: <input type="text" value="(618) 344-1004"/>		

**PLEASE NOTE:**

NELAP accreditation is required on the requested analytes and must be documented as such on the final report. If your laboratory does not currently hold a NELAP accreditation for the requested method and/or analytes, please contact Teklab immediately. If your laboratory loses accreditation or is suspended for any analyte/method during the life of the contract, you must contact Teklab immediately.

*Relinquished By 	Date/Time 12/23/21 16:00	Received By 	Date/Time 12/27/21 10:30

Sample Receipt Checklist
COC Seal Present/Intact: <input checked="" type="checkbox"/> Y <input type="checkbox"/> N If Applicable
COC Signed/Accurate: <input checked="" type="checkbox"/> Y <input type="checkbox"/> N VOA Zero Headspace: <input checked="" type="checkbox"/> Y <input type="checkbox"/> N
Bottles arrive intact: <input checked="" type="checkbox"/> Y <input type="checkbox"/> N Pres.Correct/Check: <input checked="" type="checkbox"/> Y <input type="checkbox"/> N
Correct bottles used: <input checked="" type="checkbox"/> Y <input type="checkbox"/> N
Sufficient volume sent: <input checked="" type="checkbox"/> Y <input type="checkbox"/> N
RAD Screen <0.5 mR/hr: <input checked="" type="checkbox"/> Y <input type="checkbox"/> N

uch does not provide client/sampler information without proper authorization, and proprietary rights, directed by local, state or federal laws. (Teklab QAM Section 9.1, TNI V1 M2 Section 4.1.5 c) 5

rights,  
c) 5300 5201 9296  
SubCoch  
2/2/2016

March 28, 2022

Jason McLaurin  
Southern Illinois Power Cooperation  
11543 Lake of Egypt Road  
Marion, IL 62959  
TEL: (618) 964-1448  
FAX:



Illinois	100226
Kansas	E-10374
Louisiana	05002
Louisiana	05003
Oklahoma	9978

**RE:** Groundwater Monitoring

**WorkOrder:** 22021140

Dear Jason McLaurin:

TEKLAB, INC received 11 samples on 3/9/2022 8:00:00 AM for the analysis presented in the following report.

Samples are analyzed on an as received basis unless otherwise requested and documented. The sample results contained in this report relate only to the requested analytes of interest as directed on the chain of custody. NELAP accredited fields of testing are indicated by the letters NELAP under the Certification column. Unless otherwise documented within this report, Teklab Inc. analyzes samples utilizing the most current methods in compliance with 40CFR. All tests are performed in the Collinsville, IL laboratory unless otherwise noted in the Case Narrative.

All quality control criteria applicable to the test methods employed for this project have been satisfactorily met and are in accordance with NELAP except where noted. The following report shall not be reproduced, except in full, without the written approval of Teklab, Inc.

If you have any questions regarding these tests results, please feel free to call.

Sincerely,



Elizabeth A. Hurley  
Project Manager  
(618)344-1004 ex 33  
[ehurley@teklabinc.com](mailto:ehurley@teklabinc.com)

**Client:** Southern Illinois Power Cooperation

**Work Order:** 22021140

**Client Project:** Groundwater Monitoring

**Report Date:** 28-Mar-22

---

This reporting package includes the following:

Cover Letter	1
Report Contents	2
Definitions	3
Case Narrative	5
Accreditations	6
Laboratory Results	7
Quality Control Results	27
Receiving Check List	40
Chain of Custody	Appended

**Client:** Southern Illinois Power Cooperation

**Work Order:** 22021140

**Client Project:** Groundwater Monitoring

**Report Date:** 28-Mar-22

### Abbr Definition

\* Analytes on report marked with an asterisk are not NELAP accredited

CCV Continuing calibration verification is a check of a standard to determine the state of calibration of an instrument between recalibration.

CRQL A Client Requested Quantitation Limit is a reporting limit that varies according to customer request. The CRQL may not be less than the MDL.

DF Dilution factor is the dilution performed during analysis only and does not take into account any dilutions made during sample preparation. The reported result is final and includes all dilution factors.

DNI Did not ignite

DUP Laboratory duplicate is a replicate aliquot prepared under the same laboratory conditions and independently analyzed to obtain a measure of precision.

ICV Initial calibration verification is a check of a standard to determine the state of calibration of an instrument before sample analysis is initiated.

IDPH IL Dept. of Public Health

LCS Laboratory control sample is a sample matrix, free from the analytes of interest,spiked with verified known amounts of analytes and analyzed exactly like a sample to establish intra-laboratory or analyst specific precision and bias or to assess the performance of all or a portion of the measurement system.

LCSD Laboratory control sample duplicate is a replicate laboratory control sample that is prepared and analyzed in order to determine the precision of the approved test method. The acceptable recovery range is listed in the QC Package (provided upon request).

MBLK Method blank is a sample of a matrix similar to the batch of associated sample (when available) that is free from the analytes of interest and is processed simultaneously with and under the same conditions as samples through all steps of the analytical procedures, and in which no target analytes or interferences should present at concentrations that impact the analytical results for sample analyses.

MDL "The method detection limit is defined as the minimum measured concentration of a substance that can be reported with 99% confidence that the measured concentration is distinguishable from method blank results."

MS Matrix spike is an aliquot of matrix fortified (spiked) with known quantities of specific analytes that is subjected to the entire analytical procedures in order to determine the effect of the matrix on an approved test method's recovery system. The acceptable recovery range is listed in the QC Package (provided upon request).

MSD Matrix spike duplicate means a replicate matrix spike that is prepared and analyzed in order to determine the precision of the approved test method. The acceptable recovery range is listed in the QC Package (provided upon request).

MW Molecular weight

NC Data is not acceptable for compliance purposes

ND Not Detected at the Reporting Limit

NELAP NELAP Accredited

PQL Practical quantitation limit means the lowest level that can be reliably achieved within specified limits of precision and accuracy during routine laboratory operation conditions.

RL The reporting limit the lowest level that the data is displayed in the final report. The reporting limit may vary according to customer request or sample dilution. The reporting limit may not be less than the MDL.

RPD Relative percent difference is a calculated difference between two recoveries (ie. MS/MSD). The acceptable recovery limit is listed in the QC Package (provided upon request).

SPK The spike is a known mass of target analyte added to a blank sample or sub-sample; used to determine recovery deficiency or for other quality control purposes.

Surr Surrogates are compounds which are similar to the analytes of interest in chemical composition and behavior in the analytical process, but which are not normally found in environmental samples.

TIC Tentatively identified compound: Analytes tentatively identified in the sample by using a library search. Only results not in the calibration standard will be reported as tentatively identified compounds. Results for tentatively identified compounds that are not present in the calibration standard, but are assigned a specific chemical name based upon the library search, are calculated using total peak areas from reconstructed ion chromatograms and a response factor of one. The nearest Internal Standard is used for the calculation. The results of any TICs must be considered estimated, and are flagged with a "T". If the estimated result is above the calibration range it is flagged "ET"

TNTC Too numerous to count ( > 200 CFU )

## Definitions

<http://www.teklabinc.com/>

**Client:** Southern Illinois Power Cooperation

**Work Order:** 22021140

**Client Project:** Groundwater Monitoring

**Report Date:** 28-Mar-22

### Qualifiers

- |   |  |
|---|--|
| # - Unknown hydrocarbon                               | B - Analyte detected in associated Method Blank              |
| C - RL shown is a Client Requested Quantitation Limit | E - Value above quantitation range                           |
| H - Holding times exceeded                            | I - Associated internal standard was outside method criteria |
| J - Analyte detected below quantitation limits        | M - Manual Integration used to determine area response       |
| ND - Not Detected at the Reporting Limit              | R - RPD outside accepted recovery limits                     |
| S - Spike Recovery outside recovery limits            | T - TIC(Tentatively identified compound)                     |
| X - Value exceeds Maximum Contaminant Level           |  |



## Case Narrative

<http://www.teklabinc.com/>

**Client:** Southern Illinois Power Cooperation

**Work Order:** 22021140

**Client Project:** Groundwater Monitoring

**Report Date:** 28-Mar-22

**Cooler Receipt Temp:** 4.0 °C

An employee of Teklab, Inc. collected the sample(s).

Radium-226 and Radium-228 analysis was performed by Pace Analytical Services, LLC. See attached report for

### Locations

<b>Collinsville</b>	
<b>Address</b>	5445 Horseshoe Lake Road Collinsville, IL 62234-7425
<b>Phone</b>	(618) 344-1004
<b>Fax</b>	(618) 344-1005
<b>Email</b>	jhriley@teklabinc.com

<b>Collinsville Air</b>	
<b>Address</b>	5445 Horseshoe Lake Road Collinsville, IL 62234-7425
<b>Phone</b>	(618) 344-1004
<b>Fax</b>	(618) 344-1005
<b>Email</b>	EHurley@teklabinc.com

<b>Springfield</b>	
<b>Address</b>	3920 Pintail Dr Springfield, IL 62711-9415
<b>Phone</b>	(217) 698-1004
<b>Fax</b>	(217) 698-1005
<b>Email</b>	KKlostermann@teklabinc.com

<b>Chicago</b>	
<b>Address</b>	1319 Butterfield Rd. Downers Grove, IL 60515
<b>Phone</b>	(630) 324-6855
<b>Fax</b>	
<b>Email</b>	arenner@teklabinc.com

<b>Kansas City</b>	
<b>Address</b>	8421 Nieman Road Lenexa, KS 66214
<b>Phone</b>	(913) 541-1998
<b>Fax</b>	(913) 541-1998
<b>Email</b>	jhriley@teklabinc.com

## Accreditations

<http://www.teklabinc.com/>

**Client:** Southern Illinois Power Cooperation

**Work Order:** 22021140

**Client Project:** Groundwater Monitoring

**Report Date:** 28-Mar-22

<b>State</b>	<b>Dept</b>	<b>Cert #</b>	<b>NELAP</b>	<b>Exp Date</b>	<b>Lab</b>
Illinois	IEPA	100226	NELAP	1/31/2023	Collinsville
Kansas	KDHE	E-10374	NELAP	4/30/2022	Collinsville
Louisiana	LDEQ	05002	NELAP	6/30/2022	Collinsville
Louisiana	LDEQ	05003	NELAP	6/30/2022	Collinsville
Oklahoma	ODEQ	9978	NELAP	8/31/2022	Collinsville
Arkansas	ADEQ	88-0966		3/14/2023	Collinsville
Illinois	IDPH	17584		5/31/2023	Collinsville
Kentucky	UST	0073		1/31/2023	Collinsville
Missouri	MDNR	00930		5/31/2023	Collinsville
Missouri	MDNR	930		1/31/2025	Collinsville

**Client:** Southern Illinois Power Cooperation  
**Client Project:** Groundwater Monitoring

**Work Order:** 22021140  
**Report Date:** 28-Mar-22

**Lab ID:** 22021140-001

**Client Sample ID:** EBG

**Matrix:** GROUNDWATER

**Collection Date:** 03/07/2022 11:42

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>FIELD ELEVATION MEASUREMENTS</b>									
Depth to water from measuring point	*	0	0		8.02	ft	1	03/07/2022 11:42	R308346
Elevation of groundwater surface	*	0	0		516.85	ft	1	03/07/2022 11:42	R308346
Measuring Point Elevation	*	0	0		524.87	ft	1	03/07/2022 11:42	R308346
<b>FIELD PURGE VOLUME</b>									
Purge Volume	*	0	0		5.20	gal	1	03/07/2022 11:42	R308346
<b>STANDARD METHODS 2130 B FIELD</b>									
Turbidity	*	1.0	1.0		16	NTU	1	03/07/2022 11:42	R308346
<b>STANDARD METHODS 18TH ED. 2580 B FIELD</b>									
Oxidation-Reduction Potential	*	-300	-300		113	mV	1	03/07/2022 11:42	R308346
<b>STANDARD METHODS 2510 B FIELD</b>									
Spec. Conductance, Field	*	0	0		0.663	mS/cm	1	03/07/2022 11:42	R308346
<b>STANDARD METHODS 2550 B FIELD</b>									
Temperature	*	0	0		12.7	°C	1	03/07/2022 11:42	R308346
<b>STANDARD METHODS 4500-O G FIELD</b>									
Oxygen, Dissolved	*	0	0		5.81	mg/L	1	03/07/2022 11:42	R308346
<b>SW-846 9040B FIELD</b>									
pH	*	0	1.00		6.78		1	03/07/2022 11:42	R308346
<b>STANDARD METHODS 2540 C (TOTAL) 1997, 2011</b>									
Total Dissolved Solids	*	16	20		428	mg/L	1	03/11/2022 13:51	R308313
<b>STANDARD METHODS 4500-CL E (TOTAL) 1997, 2011</b>									
Chloride	NELAP	1	4		15	mg/L	1	03/09/2022 19:54	R308033
<b>SW-846 9036 (TOTAL)</b>									
Sulfate	NELAP	12	20		83	mg/L	2	03/09/2022 20:12	R308032
<b>SW-846 9214 (TOTAL)</b>									
Fluoride	NELAP	0.04	0.10		0.58	mg/L	1	03/09/2022 14:48	R308014
<b>SW-846 3005A, 6010B, METALS BY ICP (TOTAL)</b>									
Barium	NELAP	0.0007	0.0025		0.0540	mg/L	1	03/10/2022 21:13	188407
Boron	NELAP	0.0090	0.0200		0.0225	mg/L	1	03/10/2022 21:13	188407
Calcium	NELAP	0.0350	0.100		11.9	mg/L	1	03/10/2022 21:13	188407
<b>SW-846 3005A, 6020A, METALS BY ICPMS (TOTAL)</b>									
Antimony	NELAP	0.0004	0.0010		< 0.0010	mg/L	5	03/15/2022 1:24	188407
Arsenic	NELAP	0.0004	0.0010		< 0.0010	mg/L	5	03/15/2022 1:24	188407
Beryllium	NELAP	0.0002	0.0010		< 0.0010	mg/L	5	03/15/2022 1:24	188407
Cadmium	NELAP	0.0002	0.0010		< 0.0010	mg/L	5	03/15/2022 1:24	188407
Chromium	NELAP	0.0007	0.0015	J	0.0009	mg/L	5	03/15/2022 1:24	188407
Cobalt	NELAP	0.0001	0.0010	J	0.0005	mg/L	5	03/15/2022 1:24	188407
Lead	NELAP	0.0006	0.0010		< 0.0010	mg/L	5	03/15/2022 1:24	188407
Lithium	*	0.0015	0.0030		0.0162	mg/L	5	03/15/2022 1:24	188407
Molybdenum	NELAP	0.0006	0.0015	J	0.0014	mg/L	5	03/15/2022 1:24	188407
Selenium	NELAP	0.0006	0.0010	J	0.0007	mg/L	5	03/15/2022 1:24	188407
Thallium	NELAP	0.0010	0.0020		< 0.0020	mg/L	5	03/15/2022 1:24	188407
<b>SW-846 7470A (TOTAL)</b>									
Mercury	NELAP	0.00008	0.00020		< 0.00020	mg/L	1	03/10/2022 19:43	188417
<b>EPA 903.0/904.0, RADIUM 226/228</b>									
Radium-226	*	0	0		See Attached	pci/L	1	03/16/2022 0:00	R308837

## Laboratory Results

<http://www.teklabinc.com/>**Client:** Southern Illinois Power Cooperation**Work Order:** 22021140**Client Project:** Groundwater Monitoring**Report Date:** 28-Mar-22**Lab ID:** 22021140-001**Client Sample ID:** EBG**Matrix:** GROUNDWATER**Collection Date:** 03/07/2022 11:42

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>EPA 903.0/904.0, RADIUM 226/228</b>									
Radium-228	*	0	0		See Attached	pCi/L	1	03/16/2022 0:00	R308837

**Client:** Southern Illinois Power Cooperation

**Work Order:** 22021140

**Client Project:** Groundwater Monitoring

**Report Date:** 28-Mar-22

**Lab ID:** 22021140-002

**Client Sample ID:** EP-1

**Matrix:** GROUNDWATER

**Collection Date:** 03/07/2022 14:11

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>FIELD ELEVATION MEASUREMENTS</b>									
Depth to water from measuring point	*	0	0		4.37	ft	1	03/07/2022 14:11	R308346
Elevation of groundwater surface	*	0	0		515.35	ft	1	03/07/2022 14:11	R308346
Measuring Point Elevation	*	0	0		519.72	ft	1	03/07/2022 14:11	R308346
<b>FIELD PURGE VOLUME</b>									
Purge Volume	*	0	0		1.82	gal	1	03/07/2022 14:11	R308346
<b>STANDARD METHODS 2130 B FIELD</b>									
Turbidity	*	1.0	1.0		5.0	NTU	1	03/07/2022 14:11	R308346
<b>STANDARD METHODS 18TH ED. 2580 B FIELD</b>									
Oxidation-Reduction Potential	*	-300	-300		146	mV	1	03/07/2022 14:11	R308346
<b>STANDARD METHODS 2510 B FIELD</b>									
Spec. Conductance, Field	*	0	0		3.58	mS/cm	1	03/07/2022 14:11	R308346
<b>STANDARD METHODS 2550 B FIELD</b>									
Temperature	*	0	0		9.6	°C	1	03/07/2022 14:11	R308346
<b>STANDARD METHODS 4500-O G FIELD</b>									
Oxygen, Dissolved	*	0	0		1.86	mg/L	1	03/07/2022 14:11	R308346
<b>SW-846 9040B FIELD</b>									
pH	*	0	1.00		6.19		1	03/07/2022 14:11	R308346
<b>STANDARD METHODS 2540 C (TOTAL) 1997, 2011</b>									
Total Dissolved Solids	*	16	20		2650	mg/L	1	03/11/2022 13:51	R308313
<b>STANDARD METHODS 4500-CL E (TOTAL) 1997, 2011</b>									
Chloride	NELAP	1	8		44	mg/L	2	03/09/2022 20:15	R308033
<b>SW-846 9036 (TOTAL)</b>									
Sulfate	NELAP	307	500		1600	mg/L	50	03/11/2022 15:16	R308169
<b>SW-846 9214 (TOTAL)</b>									
Fluoride	NELAP	0.04	0.10		0.19	mg/L	1	03/09/2022 14:50	R308014
<b>SW-846 3005A, 6010B, METALS BY ICP (TOTAL)</b>									
Barium	NELAP	0.0007	0.0025		0.0171	mg/L	1	03/10/2022 21:17	188407
Boron	NELAP	0.0090	0.0200		0.914	mg/L	1	03/10/2022 21:17	188407
Calcium	NELAP	0.0350	0.100		474	mg/L	1	03/10/2022 21:17	188407
<b>SW-846 3005A, 6020A, METALS BY ICPMS (TOTAL)</b>									
Antimony	NELAP	0.0004	0.0010		< 0.0010	mg/L	5	03/15/2022 1:29	188407
Arsenic	NELAP	0.0004	0.0010	J	0.0004	mg/L	5	03/15/2022 1:29	188407
Beryllium	NELAP	0.0002	0.0010		< 0.0010	mg/L	5	03/15/2022 1:29	188407
Cadmium	NELAP	0.0002	0.0010	J	0.0002	mg/L	5	03/15/2022 1:29	188407
Chromium	NELAP	0.0007	0.0015		< 0.0015	mg/L	5	03/15/2022 1:29	188407
Cobalt	NELAP	0.0001	0.0010		< 0.0010	mg/L	5	03/15/2022 1:29	188407
Lead	NELAP	0.0006	0.0010		< 0.0010	mg/L	5	03/15/2022 1:29	188407
Lithium	*	0.0015	0.0030		0.0120	mg/L	5	03/15/2022 1:29	188407
Molybdenum	NELAP	0.0006	0.0015		< 0.0015	mg/L	5	03/15/2022 1:29	188407
Selenium	NELAP	0.0006	0.0010		0.0017	mg/L	5	03/15/2022 1:29	188407
Thallium	NELAP	0.0010	0.0020		< 0.0020	mg/L	5	03/15/2022 1:29	188407
<b>SW-846 7470A (TOTAL)</b>									
Mercury	NELAP	0.00008	0.00020		< 0.00020	mg/L	1	03/10/2022 19:45	188417
<b>EPA 903.0/904.0, RADIUM 226/228</b>									
Radium-226	*	0	0		See Attached	pci/L	1	03/16/2022 0:00	R308837



## Laboratory Results

<http://www.teklabinc.com/>

**Client:** Southern Illinois Power Cooperation

**Work Order:** 22021140

**Client Project:** Groundwater Monitoring

**Report Date:** 28-Mar-22

**Lab ID:** 22021140-002

**Client Sample ID:** EP-1

**Matrix:** GROUNDWATER

**Collection Date:** 03/07/2022 14:11

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>EPA 903.0/904.0, RADIUM 226/228</b>									
Radium-228	*	0	0		See Attached	pCi/L	1	03/16/2022 0:00	R308837

**Client:** Southern Illinois Power Cooperation  
**Client Project:** Groundwater Monitoring

**Work Order:** 22021140  
**Report Date:** 28-Mar-22

**Lab ID:** 22021140-003

**Client Sample ID:** EP-2

**Matrix:** GROUNDWATER

**Collection Date:** 03/07/2022 15:25

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>FIELD ELEVATION MEASUREMENTS</b>									
Depth to water from measuring point	*	0	0		3.91	ft	1	03/07/2022 15:25	R308346
Elevation of groundwater surface	*	0	0		509.88	ft	1	03/07/2022 15:25	R308346
Measuring Point Elevation	*	0	0		512.79	ft	1	03/07/2022 15:25	R308346
<b>FIELD PURGE VOLUME</b>									
Purge Volume	*	0	0		1.82	gal	1	03/07/2022 15:25	R308346
<b>STANDARD METHODS 2130 B FIELD</b>									
Turbidity	*	1.0	1.0		4.9	NTU	1	03/07/2022 15:25	R308346
<b>STANDARD METHODS 18TH ED. 2580 B FIELD</b>									
Oxidation-Reduction Potential	*	-300	-300		124	mV	1	03/07/2022 15:25	R308346
<b>STANDARD METHODS 2510 B FIELD</b>									
Spec. Conductance, Field	*	0	0		3.32	mS/cm	1	03/07/2022 15:25	R308346
<b>STANDARD METHODS 2550 B FIELD</b>									
Temperature	*	0	0		11.5	°C	1	03/07/2022 15:25	R308346
<b>STANDARD METHODS 4500-O G FIELD</b>									
Oxygen, Dissolved	*	0	0		1.03	mg/L	1	03/07/2022 15:25	R308346
<b>SW-846 9040B FIELD</b>									
pH	*	0	1.00		5.86		1	03/07/2022 15:25	R308346
<b>STANDARD METHODS 2540 C (TOTAL) 1997, 2011</b>									
Total Dissolved Solids	*	16	20		2480	mg/L	1	03/11/2022 13:52	R308313
<b>STANDARD METHODS 4500-CL E (TOTAL) 1997, 2011</b>									
Chloride	NELAP	1	4		30	mg/L	1	03/09/2022 20:23	R308033
<b>SW-846 9036 (TOTAL)</b>									
Sulfate	NELAP	307	500		1630	mg/L	50	03/09/2022 20:29	R308032
<b>SW-846 9214 (TOTAL)</b>									
Fluoride	NELAP	0.04	0.10		0.69	mg/L	1	03/09/2022 15:02	R308014
<b>SW-846 3005A, 6010B, METALS BY ICP (TOTAL)</b>									
Barium	NELAP	0.0007	0.0025		0.0151	mg/L	1	03/10/2022 21:20	188407
Boron	NELAP	0.0090	0.0200		0.508	mg/L	1	03/10/2022 21:20	188407
Calcium	NELAP	0.0350	0.100		406	mg/L	1	03/10/2022 21:20	188407
<b>SW-846 3005A, 6020A, METALS BY ICPMS (TOTAL)</b>									
Antimony	NELAP	0.0004	0.0010		< 0.0010	mg/L	5	03/15/2022 1:35	188407
Arsenic	NELAP	0.0004	0.0010		< 0.0010	mg/L	5	03/15/2022 1:35	188407
Beryllium	NELAP	0.0002	0.0010		0.0019	mg/L	5	03/15/2022 1:35	188407
Cadmium	NELAP	0.0002	0.0010		0.0014	mg/L	5	03/15/2022 1:35	188407
Chromium	NELAP	0.0007	0.0015		< 0.0015	mg/L	5	03/15/2022 1:35	188407
Cobalt	NELAP	0.0001	0.0010		0.0159	mg/L	5	03/15/2022 1:35	188407
Lead	NELAP	0.0006	0.0010		< 0.0010	mg/L	5	03/15/2022 1:35	188407
Lithium	*	0.0015	0.0030		0.0196	mg/L	5	03/15/2022 1:35	188407
Molybdenum	NELAP	0.0006	0.0015		< 0.0015	mg/L	5	03/15/2022 1:35	188407
Selenium	NELAP	0.0006	0.0010		< 0.0010	mg/L	5	03/15/2022 1:35	188407
Thallium	NELAP	0.0010	0.0020		< 0.0020	mg/L	5	03/15/2022 1:35	188407
<b>SW-846 7470A (TOTAL)</b>									
Mercury	NELAP	0.00008	0.00020		< 0.00020	mg/L	1	03/10/2022 19:48	188417
<b>EPA 903.0/904.0, RADIUM 226/228</b>									
Radium-226	*	0	0		See Attached	pci/L	1	03/16/2022 0:00	R308837



## Laboratory Results

<http://www.teklabinc.com/>

**Client:** Southern Illinois Power Cooperation

**Work Order:** 22021140

**Client Project:** Groundwater Monitoring

**Report Date:** 28-Mar-22

**Lab ID:** 22021140-003

**Client Sample ID:** EP-2

**Matrix:** GROUNDWATER

**Collection Date:** 03/07/2022 15:25

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>EPA 903.0/904.0, RADIUM 226/228</b>									
Radium-228	*	0	0		See Attached	pCi/L	1	03/16/2022 0:00	R308837

**Client:** Southern Illinois Power Cooperation

**Work Order:** 22021140

**Client Project:** Groundwater Monitoring

**Report Date:** 28-Mar-22

**Lab ID:** 22021140-004

**Client Sample ID:** EP-3

**Matrix:** GROUNDWATER

**Collection Date:** 03/08/2022 13:08

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>FIELD ELEVATION MEASUREMENTS</b>									
Depth to water from measuring point	*	0	0		16.18	ft	1	03/08/2022 13:08	R308346
Elevation of groundwater surface	*	0	0		502.77	ft	1	03/08/2022 13:08	R308346
Measuring Point Elevation	*	0	0		518.95	ft	1	03/08/2022 13:08	R308346
<b>FIELD PURGE VOLUME</b>									
Purge Volume	*	0	0		4.68	gal	1	03/08/2022 13:08	R308346
<b>STANDARD METHODS 2130 B FIELD</b>									
Turbidity	*	1.0	1.0		4.9	NTU	1	03/08/2022 13:08	R308346
<b>STANDARD METHODS 18TH ED. 2580 B FIELD</b>									
Oxidation-Reduction Potential	*	-300	-300		-71	mV	1	03/08/2022 13:08	R308346
<b>STANDARD METHODS 2510 B FIELD</b>									
Spec. Conductance, Field	*	0	0		1.52	mS/cm	1	03/08/2022 13:08	R308346
<b>STANDARD METHODS 2550 B FIELD</b>									
Temperature	*	0	0		16.8	°C	1	03/08/2022 13:08	R308346
<b>STANDARD METHODS 4500-O G FIELD</b>									
Oxygen, Dissolved	*	0	0		0.23	mg/L	1	03/08/2022 13:08	R308346
<b>SW-846 9040B FIELD</b>									
pH	*	0	1.00		6.17		1	03/08/2022 13:08	R308346
<b>STANDARD METHODS 2540 C (TOTAL) 1997, 2011</b>									
Total Dissolved Solids	*	16	20		762	mg/L	1	03/11/2022 13:53	R308313
<b>STANDARD METHODS 4500-CL E (TOTAL) 1997, 2011</b>									
Chloride	NELAP	2	20		145	mg/L	5	03/09/2022 20:31	R308033
<b>SW-846 9036 (TOTAL)</b>									
Sulfate	NELAP	31	50		153	mg/L	5	03/09/2022 20:31	R308032
<b>SW-846 9214 (TOTAL)</b>									
Fluoride	NELAP	0.04	0.10		0.20	mg/L	1	03/09/2022 15:04	R308014
<b>SW-846 3005A, 6010B, METALS BY ICP (TOTAL)</b>									
Barium	NELAP	0.0007	0.0025		0.0851	mg/L	1	03/10/2022 21:24	188407
Boron	NELAP	0.0090	0.0200		0.0702	mg/L	1	03/10/2022 21:24	188407
Calcium	NELAP	0.0350	0.100		36.3	mg/L	1	03/10/2022 21:24	188407
<b>SW-846 3005A, 6020A, METALS BY ICPMS (TOTAL)</b>									
Antimony	NELAP	0.0004	0.0010		< 0.0010	mg/L	5	03/15/2022 1:41	188407
Arsenic	NELAP	0.0004	0.0010		0.0068	mg/L	5	03/15/2022 1:41	188407
Beryllium	NELAP	0.0002	0.0010		< 0.0010	mg/L	5	03/15/2022 1:41	188407
Cadmium	NELAP	0.0002	0.0010		< 0.0010	mg/L	5	03/15/2022 1:41	188407
Chromium	NELAP	0.0007	0.0015	J	0.0015	mg/L	5	03/15/2022 1:41	188407
Cobalt	NELAP	0.0001	0.0010		0.0947	mg/L	5	03/15/2022 1:41	188407
Lead	NELAP	0.0006	0.0010		< 0.0010	mg/L	5	03/15/2022 1:41	188407
Lithium	*	0.0015	0.0030		0.0267	mg/L	5	03/15/2022 1:41	188407
Molybdenum	NELAP	0.0006	0.0015		< 0.0015	mg/L	5	03/15/2022 1:41	188407
Selenium	NELAP	0.0006	0.0010		< 0.0010	mg/L	5	03/15/2022 1:41	188407
Thallium	NELAP	0.0010	0.0020		< 0.0020	mg/L	5	03/15/2022 1:41	188407
<b>SW-846 7470A (TOTAL)</b>									
Mercury	NELAP	0.00008	0.00020		< 0.00020	mg/L	1	03/10/2022 19:50	188417
<b>EPA 903.0/904.0, RADIUM 226/228</b>									
Radium-226	*	0	0		See Attached	pci/L	1	03/16/2022 0:00	R308837



## Laboratory Results

<http://www.teklabinc.com/>

**Client:** Southern Illinois Power Cooperation

**Work Order:** 22021140

**Client Project:** Groundwater Monitoring

**Report Date:** 28-Mar-22

**Lab ID:** 22021140-004

**Client Sample ID:** EP-3

**Matrix:** GROUNDWATER

**Collection Date:** 03/08/2022 13:08

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>EPA 903.0/904.0, RADIUM 226/228</b>									
Radium-228	*	0	0		See Attached	pCi/L	1	03/16/2022 0:00	R308837

**Client:** Southern Illinois Power Cooperation  
**Client Project:** Groundwater Monitoring

**Work Order:** 22021140  
**Report Date:** 28-Mar-22

**Lab ID:** 22021140-005

**Client Sample ID:** EP-4

**Matrix:** GROUNDWATER

**Collection Date:** 03/08/2022 14:35

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>FIELD ELEVATION MEASUREMENTS</b>									
Depth to water from measuring point	*	0	0		7.99	ft	1	03/08/2022 14:35	R308346
Elevation of groundwater surface	*	0	0		511.75	ft	1	03/08/2022 14:35	R308346
Measuring Point Elevation	*	0	0		519.74	ft	1	03/08/2022 14:35	R308346
<b>FIELD PURGE VOLUME</b>									
Purge Volume	*	0	0		2.60	gal	1	03/08/2022 14:35	R308346
<b>STANDARD METHODS 2130 B FIELD</b>									
Turbidity	*	1.0	1.0		5.0	NTU	1	03/08/2022 14:35	R308346
<b>STANDARD METHODS 18TH ED. 2580 B FIELD</b>									
Oxidation-Reduction Potential	*	-300	-300		-44	mV	1	03/08/2022 14:35	R308346
<b>STANDARD METHODS 2510 B FIELD</b>									
Spec. Conductance, Field	*	0	0		3.19	mS/cm	1	03/08/2022 14:35	R308346
<b>STANDARD METHODS 2550 B FIELD</b>									
Temperature	*	0	0		14.2	°C	1	03/08/2022 14:35	R308346
<b>STANDARD METHODS 4500-O G FIELD</b>									
Oxygen, Dissolved	*	0	0		0.14	mg/L	1	03/08/2022 14:35	R308346
<b>SW-846 9040B FIELD</b>									
pH	*	0	1.00		5.94		1	03/08/2022 14:35	R308346
<b>STANDARD METHODS 2540 C (TOTAL) 1997, 2011</b>									
Total Dissolved Solids	*	16	20		1740	mg/L	1	03/11/2022 13:53	R308313
<b>STANDARD METHODS 4500-CL E (TOTAL) 1997, 2011</b>									
Chloride	NELAP	10	20		456	mg/L	20	03/11/2022 17:43	R308170
<b>SW-846 9036 (TOTAL)</b>									
Sulfate	NELAP	123	200		623	mg/L	20	03/11/2022 17:43	R308169
<b>SW-846 9214 (TOTAL)</b>									
Fluoride	NELAP	0.04	0.10		0.12	mg/L	1	03/09/2022 15:12	R308014
<b>SW-846 3005A, 6010B, METALS BY ICP (TOTAL)</b>									
Barium	NELAP	0.0007	0.0025		0.0313	mg/L	1	03/10/2022 21:46	188407
Boron	NELAP	0.0090	0.0200	S	11.1	mg/L	1	03/10/2022 21:46	188407
Calcium	NELAP	0.0350	0.100	S	171	mg/L	1	03/10/2022 21:46	188407
Matrix spike control limits for B and Ca are not applicable due to high sample/spike ratio.									
<b>SW-846 3005A, 6020A, METALS BY ICPMS (TOTAL)</b>									
Antimony	NELAP	0.0004	0.0010		< 0.0010	mg/L	5	03/16/2022 19:17	188407
Arsenic	NELAP	0.0004	0.0010		0.0053	mg/L	5	03/16/2022 19:17	188407
Beryllium	NELAP	0.0002	0.0010		< 0.0010	mg/L	5	03/15/2022 1:47	188407
Cadmium	NELAP	0.0002	0.0010		< 0.0010	mg/L	5	03/15/2022 19:29	188407
Chromium	NELAP	0.0007	0.0015		0.0020	mg/L	5	03/15/2022 1:47	188407
Cobalt	NELAP	0.0001	0.0010		0.200	mg/L	5	03/15/2022 1:47	188407
Lead	NELAP	0.0006	0.0010		< 0.0010	mg/L	5	03/15/2022 1:47	188407
Lithium	*	0.0015	0.0030	J	0.0025	mg/L	5	03/15/2022 1:47	188407
Molybdenum	NELAP	0.0006	0.0015		< 0.0015	mg/L	5	03/16/2022 19:17	188407
Selenium	NELAP	0.0006	0.0010		< 0.0010	mg/L	5	03/16/2022 19:17	188407
Thallium	NELAP	0.0010	0.0020		< 0.0020	mg/L	5	03/15/2022 1:47	188407
<b>SW-846 7470A (TOTAL)</b>									
Mercury	NELAP	0.00008	0.00020		< 0.00020	mg/L	1	03/10/2022 19:52	188417

## Laboratory Results

<http://www.teklabinc.com/>

**Client:** Southern Illinois Power Cooperation

**Work Order:** 22021140

**Client Project:** Groundwater Monitoring

**Report Date:** 28-Mar-22

**Lab ID:** 22021140-005

**Client Sample ID:** EP-4

**Matrix:** GROUNDWATER

**Collection Date:** 03/08/2022 14:35

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>EPA 903.0/904.0, RADIUM 226/228</b>									
Radium-226	*	0	0		See Attached	pCi/L	1	03/16/2022 0:00	R308837
Radium-228	*	0	0		See Attached	pCi/L	1	03/16/2022 0:00	R308837

**Client:** Southern Illinois Power Cooperation  
**Client Project:** Groundwater Monitoring

**Work Order:** 22021140  
**Report Date:** 28-Mar-22

**Lab ID:** 22021140-006

**Client Sample ID:** EP-5

**Matrix:** GROUNDWATER

**Collection Date:** 03/07/2022 12:49

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>FIELD ELEVATION MEASUREMENTS</b>									
Depth to water from measuring point	*	0	0		11.14	ft	1	03/07/2022 12:49	R308346
Elevation of groundwater surface	*	0	0		516.45	ft	1	03/07/2022 12:49	R308346
Measuring Point Elevation	*	0	0		527.59	ft	1	03/07/2022 12:49	R308346
<b>FIELD PURGE VOLUME</b>									
Purge Volume	*	0	0		0.91	gal	1	03/07/2022 12:49	R308346
<b>STANDARD METHODS 2130 B FIELD</b>									
Turbidity	*	1.0	1.0		0.6	NTU	1	03/07/2022 12:49	R308346
<b>STANDARD METHODS 18TH ED. 2580 B FIELD</b>									
Oxidation-Reduction Potential	*	-300	-300		136	mV	1	03/07/2022 12:49	R308346
<b>STANDARD METHODS 2510 B FIELD</b>									
Spec. Conductance, Field	*	0	0		0.619	mS/cm	1	03/07/2022 12:49	R308346
<b>STANDARD METHODS 2550 B FIELD</b>									
Temperature	*	0	0		11.3	°C	1	03/07/2022 12:49	R308346
<b>STANDARD METHODS 4500-O G FIELD</b>									
Oxygen, Dissolved	*	0	0		5.50	mg/L	1	03/07/2022 12:49	R308346
<b>SW-846 9040B FIELD</b>									
pH	*	0	1.00		6.73		1	03/07/2022 12:49	R308346
<b>STANDARD METHODS 2540 C (TOTAL) 1997, 2011</b>									
Total Dissolved Solids	*	16	20		326	mg/L	1	03/11/2022 13:54	R308313
<b>STANDARD METHODS 4500-CL E (TOTAL) 1997, 2011</b>									
Chloride	NELAP	1	1		3	mg/L	1	03/15/2022 13:44	R308309
<b>SW-846 9036 (TOTAL)</b>									
Sulfate	NELAP	31	50		141	mg/L	5	03/11/2022 17:46	R308169
<b>SW-846 9214 (TOTAL)</b>									
Fluoride	NELAP	0.04	0.10		0.40	mg/L	1	03/09/2022 15:10	R308014
<b>SW-846 3005A, 6010B, METALS BY ICP (TOTAL)</b>									
Barium	NELAP	0.0007	0.0025		0.0513	mg/L	1	03/10/2022 21:28	188407
Boron	NELAP	0.0090	0.0200		0.0380	mg/L	1	03/10/2022 21:28	188407
Calcium	NELAP	0.0350	0.100		22.5	mg/L	1	03/10/2022 21:28	188407
<b>SW-846 3005A, 6020A, METALS BY ICPMS (TOTAL)</b>									
Antimony	NELAP	0.0004	0.0010		< 0.0010	mg/L	5	03/15/2022 2:05	188407
Arsenic	NELAP	0.0004	0.0010	J	0.0004	mg/L	5	03/15/2022 2:05	188407
Beryllium	NELAP	0.0002	0.0010		< 0.0010	mg/L	5	03/15/2022 2:05	188407
Cadmium	NELAP	0.0002	0.0010		< 0.0010	mg/L	5	03/15/2022 2:05	188407
Chromium	NELAP	0.0007	0.0015	J	0.0008	mg/L	5	03/15/2022 2:05	188407
Cobalt	NELAP	0.0001	0.0010	J	0.0005	mg/L	5	03/15/2022 2:05	188407
Lead	NELAP	0.0006	0.0010		< 0.0010	mg/L	5	03/15/2022 2:05	188407
Lithium	*	0.0015	0.0030	J	0.0027	mg/L	5	03/15/2022 2:05	188407
Molybdenum	NELAP	0.0006	0.0015		0.0030	mg/L	5	03/15/2022 2:05	188407
Selenium	NELAP	0.0006	0.0010		0.0017	mg/L	5	03/15/2022 2:05	188407
Thallium	NELAP	0.0010	0.0020		0.0031	mg/L	5	03/15/2022 2:05	188407
<b>SW-846 7470A (TOTAL)</b>									
Mercury	NELAP	0.00008	0.00020		< 0.00020	mg/L	1	03/10/2022 19:59	188417
<b>EPA 903.0/904.0, RADIUM 226/228</b>									
Radium-226	*	0	0		See Attached	pci/L	1	03/16/2022 0:00	R308837

**Laboratory Results**<http://www.teklabinc.com/>**Client:** Southern Illinois Power Cooperation**Work Order:** 22021140**Client Project:** Groundwater Monitoring**Report Date:** 28-Mar-22**Lab ID:** 22021140-006**Client Sample ID:** EP-5**Matrix:** GROUNDWATER**Collection Date:** 03/07/2022 12:49

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>EPA 903.0/904.0, RADIUM 226/228</b>									
Radium-228	*	0	0		See Attached	pCi/L	1	03/16/2022 0:00	R308837

Client: Southern Illinois Power Cooperation  
 Client Project: Groundwater Monitoring

Work Order: 22021140  
 Report Date: 28-Mar-22

Lab ID: 22021140-007

Client Sample ID: EP-6

Matrix: GROUNDWATER

Collection Date: 03/08/2022 8:36

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>FIELD ELEVATION MEASUREMENTS</b>									
Depth to water from measuring point	*	0	0		2.61	ft	1	03/08/2022 8:36	R308346
Elevation of groundwater surface	*	0	0		502.50	ft	1	03/08/2022 8:36	R308346
Measuring Point Elevation	*	0	0		505.11	ft	1	03/08/2022 8:36	R308346
<b>FIELD PURGE VOLUME</b>									
Purge Volume	*	0	0		1.69	gal	1	03/08/2022 8:36	R308346
<b>STANDARD METHODS 2130 B FIELD</b>									
Turbidity	*	1.0	1.0		4.0	NTU	1	03/08/2022 8:36	R308346
<b>STANDARD METHODS 18TH ED. 2580 B FIELD</b>									
Oxidation-Reduction Potential	*	-300	-300		227	mV	1	03/08/2022 8:36	R308346
<b>STANDARD METHODS 2510 B FIELD</b>									
Spec. Conductance, Field	*	0	0		0.359	mS/cm	1	03/08/2022 8:36	R308346
<b>STANDARD METHODS 2550 B FIELD</b>									
Temperature	*	0	0		9.6	°C	1	03/08/2022 8:36	R308346
<b>STANDARD METHODS 4500-O G FIELD</b>									
Oxygen, Dissolved	*	0	0		2.22	mg/L	1	03/08/2022 8:36	R308346
<b>SW-846 9040B FIELD</b>									
pH	*	0	1.00		5.10		1	03/08/2022 8:36	R308346
<b>STANDARD METHODS 2540 C (TOTAL) 1997, 2011</b>									
Total Dissolved Solids	*	16	20		254	mg/L	1	03/11/2022 13:54	R308313
<b>STANDARD METHODS 4500-CL E (TOTAL) 1997, 2011</b>									
Chloride	NELAP	1	4		23	mg/L	1	03/09/2022 21:06	R308033
<b>SW-846 9036 (TOTAL)</b>									
Sulfate	NELAP	12	20		67	mg/L	2	03/09/2022 21:11	R308032
<b>SW-846 9214 (TOTAL)</b>									
Fluoride	NELAP	0.04	0.10	J	0.06	mg/L	1	03/09/2022 15:23	R308014
<b>SW-846 3005A, 6010B, METALS BY ICP (TOTAL)</b>									
Barium	NELAP	0.0007	0.0025		0.0345	mg/L	1	03/10/2022 21:57	188407
Boron	NELAP	0.0090	0.0200		< 0.0200	mg/L	1	03/14/2022 11:39	188407
Calcium	NELAP	0.0350	0.100		1.92	mg/L	1	03/10/2022 21:57	188407
<b>SW-846 3005A, 6020A, METALS BY ICPMS (TOTAL)</b>									
Antimony	NELAP	0.0004	0.0010		< 0.0010	mg/L	5	03/15/2022 2:11	188407
Arsenic	NELAP	0.0004	0.0010		< 0.0010	mg/L	5	03/15/2022 2:11	188407
Beryllium	NELAP	0.0002	0.0010		< 0.0010	mg/L	5	03/15/2022 2:11	188407
Cadmium	NELAP	0.0002	0.0010		< 0.0010	mg/L	5	03/15/2022 2:11	188407
Chromium	NELAP	0.0007	0.0015	J	0.0013	mg/L	5	03/15/2022 2:11	188407
Cobalt	NELAP	0.0001	0.0010		0.0017	mg/L	5	03/15/2022 2:11	188407
Lead	NELAP	0.0006	0.0010		< 0.0010	mg/L	5	03/15/2022 2:11	188407
Lithium	*	0.0015	0.0030		0.0113	mg/L	5	03/15/2022 2:11	188407
Molybdenum	NELAP	0.0006	0.0015		< 0.0015	mg/L	5	03/15/2022 2:11	188407
Selenium	NELAP	0.0006	0.0010		< 0.0010	mg/L	5	03/15/2022 2:11	188407
Thallium	NELAP	0.0010	0.0020		< 0.0020	mg/L	5	03/15/2022 2:11	188407
<b>SW-846 7470A (TOTAL)</b>									
Mercury	NELAP	0.00008	0.00020		< 0.00020	mg/L	1	03/10/2022 20:01	188417
<b>EPA 903.0/904.0, RADIUM 226/228</b>									
Radium-226	*	0	0		See Attached	pci/L	1	03/16/2022 0:00	R308837



## Laboratory Results

<http://www.teklabinc.com/>

**Client:** Southern Illinois Power Cooperation

**Work Order:** 22021140

**Client Project:** Groundwater Monitoring

**Report Date:** 28-Mar-22

**Lab ID:** 22021140-007

**Client Sample ID:** EP-6

**Matrix:** GROUNDWATER

**Collection Date:** 03/08/2022 8:36

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>EPA 903.0/904.0, RADIUM 226/228</b>									
Radium-228	*	0	0		See Attached	pCi/L	1	03/16/2022 0:00	R308837

**Client:** Southern Illinois Power Cooperation  
**Client Project:** Groundwater Monitoring

**Work Order:** 22021140  
**Report Date:** 28-Mar-22

**Lab ID:** 22021140-008

**Client Sample ID:** EP-7

**Matrix:** GROUNDWATER

**Collection Date:** 03/08/2022 11:03

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>FIELD ELEVATION MEASUREMENTS</b>									
Depth to water from measuring point	*	0	0		13.09	ft	1	03/08/2022 11:03	R308346
Elevation of groundwater surface	*	0	0		502.35	ft	1	03/08/2022 11:03	R308346
Measuring Point Elevation	*	0	0		515.44	ft	1	03/08/2022 11:03	R308346
<b>FIELD PURGE VOLUME</b>									
Purge Volume	*	0	0		5.20	gal	1	03/08/2022 11:03	R308346
<b>STANDARD METHODS 2130 B FIELD</b>									
Turbidity	*	1.0	1.0		14	NTU	1	03/08/2022 11:03	R308346
<b>STANDARD METHODS 18TH ED. 2580 B FIELD</b>									
Oxidation-Reduction Potential	*	-300	-300		-35	mV	1	03/08/2022 11:03	R308346
<b>STANDARD METHODS 2510 B FIELD</b>									
Spec. Conductance, Field	*	0	0		2.42	mS/cm	1	03/08/2022 11:03	R308346
<b>STANDARD METHODS 2550 B FIELD</b>									
Temperature	*	0	0		15.1	°C	1	03/08/2022 11:03	R308346
<b>STANDARD METHODS 4500-O G FIELD</b>									
Oxygen, Dissolved	*	0	0		0.16	mg/L	1	03/08/2022 11:03	R308346
<b>SW-846 9040B FIELD</b>									
pH	*	0	1.00		5.97		1	03/08/2022 11:03	R308346
<b>STANDARD METHODS 2540 C (TOTAL) 1997, 2011</b>									
Total Dissolved Solids	*	16	20		1450	mg/L	1	03/11/2022 13:55	R308313
<b>STANDARD METHODS 4500-CL E (TOTAL) 1997, 2011</b>									
Chloride	NELAP	2	20		239	mg/L	5	03/09/2022 21:14	R308033
<b>SW-846 9036 (TOTAL)</b>									
Sulfate	NELAP	123	200		556	mg/L	20	03/09/2022 21:19	R308032
<b>SW-846 9214 (TOTAL)</b>									
Fluoride	NELAP	0.04	0.10		0.30	mg/L	1	03/09/2022 15:06	R308014
<b>SW-846 3005A, 6010B, METALS BY ICP (TOTAL)</b>									
Barium	NELAP	0.0007	0.0025		0.0271	mg/L	1	03/10/2022 22:01	188407
Boron	NELAP	0.0090	0.0200		0.910	mg/L	1	03/10/2022 22:01	188407
Calcium	NELAP	0.0350	0.100		170	mg/L	1	03/10/2022 22:01	188407
<b>SW-846 3005A, 6020A, METALS BY ICPMS (TOTAL)</b>									
Antimony	NELAP	0.0004	0.0010		< 0.0010	mg/L	5	03/15/2022 2:17	188407
Arsenic	NELAP	0.0004	0.0010		0.0173	mg/L	5	03/15/2022 2:17	188407
Beryllium	NELAP	0.0002	0.0010		< 0.0010	mg/L	5	03/15/2022 2:17	188407
Cadmium	NELAP	0.0002	0.0010		< 0.0010	mg/L	5	03/15/2022 2:17	188407
Chromium	NELAP	0.0007	0.0015		< 0.0015	mg/L	5	03/15/2022 2:17	188407
Cobalt	NELAP	0.0001	0.0010		0.139	mg/L	5	03/15/2022 2:17	188407
Lead	NELAP	0.0006	0.0010		< 0.0010	mg/L	5	03/15/2022 2:17	188407
Lithium	*	0.0015	0.0030		< 0.0030	mg/L	5	03/15/2022 2:17	188407
Molybdenum	NELAP	0.0006	0.0015	J	0.0012	mg/L	5	03/15/2022 2:17	188407
Selenium	NELAP	0.0006	0.0010		< 0.0010	mg/L	5	03/15/2022 2:17	188407
Thallium	NELAP	0.0010	0.0020		< 0.0020	mg/L	5	03/15/2022 2:17	188407
<b>SW-846 7470A (TOTAL)</b>									
Mercury	NELAP	0.00008	0.00020		< 0.00020	mg/L	1	03/10/2022 20:04	188417
<b>EPA 903.0/904.0, RADIUM 226/228</b>									
Radium-226	*	0	0		See Attached	pci/L	1	03/16/2022 0:00	R308837



## Laboratory Results

<http://www.teklabinc.com/>

**Client:** Southern Illinois Power Cooperation

**Work Order:** 22021140

**Client Project:** Groundwater Monitoring

**Report Date:** 28-Mar-22

**Lab ID:** 22021140-008

**Client Sample ID:** EP-7

**Matrix:** GROUNDWATER

**Collection Date:** 03/08/2022 11:03

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>EPA 903.0/904.0, RADIUM 226/228</b>									
Radium-228	*	0	0		See Attached	pCi/L	1	03/16/2022 0:00	R308837

**Client:** Southern Illinois Power Cooperation  
**Client Project:** Groundwater Monitoring

**Work Order:** 22021140  
**Report Date:** 28-Mar-22

**Lab ID:** 22021140-009

**Client Sample ID:** Equipment Blank

**Matrix:** AQUEOUS

**Collection Date:** 03/08/2022 14:38

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>STANDARD METHODS 2540 C (TOTAL) 1997, 2011</b>									
Total Dissolved Solids	*	16	20		< 20	mg/L	1	03/11/2022 13:55	R308313
<b>STANDARD METHODS 4500-CL E (TOTAL) 1997, 2011</b>									
Chloride	NELAP	1	4		< 4	mg/L	1	03/09/2022 21:25	R308033
<b>SW-846 9036 (TOTAL)</b>									
Sulfate	NELAP	6	10		< 10	mg/L	1	03/09/2022 21:25	R308032
<b>SW-846 9214 (TOTAL)</b>									
Fluoride	NELAP	0.04	0.10		< 0.10	mg/L	1	03/09/2022 15:08	R308014
<b>SW-846 3005A, 6010B, METALS BY ICP (TOTAL)</b>									
Barium	NELAP	0.0007	0.0025		< 0.0025	mg/L	1	03/10/2022 22:05	188407
Boron	NELAP	0.0090	0.0200		0.0302	mg/L	1	03/10/2022 22:05	188407
Calcium	NELAP	0.035	0.10	J	0.064	mg/L	1	03/10/2022 22:05	188407
<b>SW-846 3005A, 6020A, METALS BY ICPMS (TOTAL)</b>									
Antimony	NELAP	0.0004	0.0010		< 0.0010	mg/L	5	03/15/2022 2:59	188407
Arsenic	NELAP	0.0004	0.0010		< 0.0010	mg/L	5	03/15/2022 2:59	188407
Beryllium	NELAP	0.0002	0.0010		< 0.0010	mg/L	5	03/15/2022 2:59	188407
Cadmium	NELAP	0.0002	0.0010		< 0.0010	mg/L	5	03/15/2022 2:59	188407
Chromium	NELAP	0.0007	0.0015		< 0.0015	mg/L	5	03/15/2022 2:59	188407
Cobalt	NELAP	0.0001	0.0010		< 0.0010	mg/L	5	03/15/2022 2:59	188407
Lead	NELAP	0.0006	0.0010		< 0.0010	mg/L	5	03/15/2022 2:59	188407
Lithium	*	0.0015	0.0030		< 0.0030	mg/L	5	03/15/2022 2:59	188407
Molybdenum	NELAP	0.0006	0.0015		< 0.0015	mg/L	5	03/15/2022 2:59	188407
Selenium	NELAP	0.0006	0.0010		< 0.0010	mg/L	5	03/15/2022 2:59	188407
Thallium	NELAP	0.0010	0.0020		< 0.0020	mg/L	5	03/18/2022 18:42	188407
<b>SW-846 7470A (TOTAL)</b>									
Mercury	NELAP	0.00008	0.00020		< 0.00020	mg/L	1	03/10/2022 20:06	188417
<b>EPA 903.0/904.0, RADIUM 226/228</b>									
Radium-226	*	0	0		See Attached	pci/L	1	03/17/2022 0:00	R308837
Radium-228	*	0	0		See Attached	pci/L	1	03/17/2022 0:00	R308837

## Laboratory Results

<http://www.teklabinc.com/>

**Client:** Southern Illinois Power Cooperation  
**Client Project:** Groundwater Monitoring

**Work Order:** 22021140  
**Report Date:** 28-Mar-22

**Lab ID:** 22021140-010

**Client Sample ID:** Field Blank

**Matrix:** AQUEOUS

**Collection Date:** 03/07/2022 15:28

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>STANDARD METHODS 2540 C (TOTAL) 1997, 2011</b>									
Total Dissolved Solids	*	16	20		< 20	mg/L	1	03/11/2022 13:56	R308313
<b>STANDARD METHODS 4500-CL E (TOTAL) 1997, 2011</b>									
Chloride	NELAP	1	4		< 4	mg/L	1	03/09/2022 21:27	R308033
<b>SW-846 9036 (TOTAL)</b>									
Sulfate	NELAP	6	10		< 10	mg/L	1	03/09/2022 21:27	R308032
<b>SW-846 9214 (TOTAL)</b>									
Fluoride	NELAP	0.04	0.10		< 0.10	mg/L	1	03/09/2022 15:16	R308014
<b>SW-846 3005A, 6010B, METALS BY ICP (TOTAL)</b>									
Barium	NELAP	0.0007	0.0025		< 0.0025	mg/L	1	03/10/2022 22:08	188407
Boron	NELAP	0.0090	0.020	J	0.019	mg/L	1	03/10/2022 22:08	188407
Calcium	NELAP	0.0350	0.100		< 0.100	mg/L	1	03/10/2022 22:08	188407
<b>SW-846 3005A, 6020A, METALS BY ICPMS (TOTAL)</b>									
Antimony	NELAP	0.0004	0.0010		< 0.0010	mg/L	5	03/15/2022 3:05	188407
Arsenic	NELAP	0.0004	0.0010		< 0.0010	mg/L	5	03/15/2022 3:05	188407
Beryllium	NELAP	0.0002	0.0010		< 0.0010	mg/L	5	03/15/2022 3:05	188407
Cadmium	NELAP	0.0002	0.0010		< 0.0010	mg/L	5	03/15/2022 3:05	188407
Chromium	NELAP	0.0007	0.0015		< 0.0015	mg/L	5	03/15/2022 3:05	188407
Cobalt	NELAP	0.0001	0.0010		< 0.0010	mg/L	5	03/15/2022 3:05	188407
Lead	NELAP	0.0006	0.0010		< 0.0010	mg/L	5	03/15/2022 3:05	188407
Lithium	*	0.0015	0.0030		< 0.0030	mg/L	5	03/15/2022 3:05	188407
Molybdenum	NELAP	0.0006	0.0015		< 0.0015	mg/L	5	03/15/2022 3:05	188407
Selenium	NELAP	0.0006	0.0010		< 0.0010	mg/L	5	03/15/2022 3:05	188407
Thallium	NELAP	0.0010	0.0020		< 0.0020	mg/L	5	03/15/2022 3:05	188407
<b>SW-846 7470A (TOTAL)</b>									
Mercury	NELAP	0.00008	0.00020		< 0.00020	mg/L	1	03/10/2022 20:08	188417
<b>EPA 903.0/904.0, RADIUM 226/228</b>									
Radium-226	*	0	0		See Attached	pci/L	1	03/17/2022 0:00	R308837
Radium-228	*	0	0		See Attached	pci/L	1	03/17/2022 0:00	R308837

**Client:** Southern Illinois Power Cooperation  
**Client Project:** Groundwater Monitoring

**Work Order:** 22021140  
**Report Date:** 28-Mar-22

**Lab ID:** 22021140-011

**Client Sample ID:** Field Duplicate

**Matrix:** GROUNDWATER

**Collection Date:** 03/07/2022 15:25

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>FIELD ELEVATION MEASUREMENTS</b>									
Depth to water from measuring point	*	0	0		3.91	ft	1	03/07/2022 15:25	R308346
Elevation of groundwater surface	*	0	0		509.88	ft	1	03/07/2022 15:25	R308346
Measuring Point Elevation	*	0	0		513.79	ft	1	03/07/2022 15:25	R308346
<b>FIELD PURGE VOLUME</b>									
Purge Volume	*	0	0		1.82	gal	1	03/07/2022 15:25	R308346
<b>STANDARD METHODS 2130 B FIELD</b>									
Turbidity	*	1.0	1.0		4.9	NTU	1	03/07/2022 15:25	R308346
<b>STANDARD METHODS 18TH ED. 2580 B FIELD</b>									
Oxidation-Reduction Potential	*	-300	-300		124	mV	1	03/07/2022 15:25	R308346
<b>STANDARD METHODS 2510 B FIELD</b>									
Spec. Conductance, Field	*	0	0		3.32	uS/cm	1	03/07/2022 15:25	R308346
<b>STANDARD METHODS 2550 B FIELD</b>									
Temperature	*	0	0		11.5	°C	1	03/07/2022 15:25	R308346
<b>STANDARD METHODS 4500-O G FIELD</b>									
Oxygen, Dissolved	*	0	0		1.03	mg/L	1	03/07/2022 15:25	R308346
<b>SW-846 9040B FIELD</b>									
pH	*	0	1.00		5.86		1	03/07/2022 15:25	R308346
<b>STANDARD METHODS 2540 C (TOTAL) 1997, 2011</b>									
Total Dissolved Solids	*	16	20		2490	mg/L	1	03/11/2022 13:56	R308313
<b>STANDARD METHODS 4500-CL E (TOTAL) 1997, 2011</b>									
Chloride	NELAP	1	4		30	mg/L	1	03/09/2022 21:30	R308033
<b>SW-846 9036 (TOTAL)</b>									
Sulfate	NELAP	307	500		1720	mg/L	50	03/09/2022 21:35	R308032
<b>SW-846 9214 (TOTAL)</b>									
Fluoride	NELAP	0.04	0.10		0.68	mg/L	1	03/09/2022 15:25	R308014
<b>SW-846 3005A, 6010B, METALS BY ICP (TOTAL)</b>									
Barium	NELAP	0.0007	0.0025		0.0145	mg/L	1	03/10/2022 22:12	188407
Boron	NELAP	0.0090	0.0200		0.519	mg/L	1	03/10/2022 22:12	188407
Calcium	NELAP	0.0350	0.100		408	mg/L	1	03/10/2022 22:12	188407
<b>SW-846 3005A, 6020A, METALS BY ICPMS (TOTAL)</b>									
Antimony	NELAP	0.0004	0.0010		< 0.0010	mg/L	5	03/15/2022 3:11	188407
Arsenic	NELAP	0.0004	0.0010		< 0.0010	mg/L	5	03/15/2022 3:11	188407
Beryllium	NELAP	0.0002	0.0010		0.0025	mg/L	5	03/16/2022 19:35	188407
Cadmium	NELAP	0.0002	0.0010		0.0014	mg/L	5	03/15/2022 3:11	188407
Chromium	NELAP	0.0007	0.0015		< 0.0015	mg/L	5	03/15/2022 3:11	188407
Cobalt	NELAP	0.0001	0.0010		0.0179	mg/L	5	03/15/2022 3:11	188407
Lead	NELAP	0.0006	0.0010		< 0.0010	mg/L	5	03/15/2022 3:11	188407
Lithium	*	0.0015	0.0030		0.0198	mg/L	5	03/15/2022 3:11	188407
Molybdenum	NELAP	0.0006	0.0015		< 0.0015	mg/L	5	03/15/2022 3:11	188407
Selenium	NELAP	0.0006	0.0010	J	0.0006	mg/L	5	03/15/2022 3:11	188407
Thallium	NELAP	0.0010	0.0020		< 0.0020	mg/L	5	03/15/2022 3:11	188407
<b>SW-846 7470A (TOTAL)</b>									
Mercury	NELAP	0.00007	0.00020		< 0.00020	mg/L	1	03/12/2022 12:34	188481
<b>EPA 903.0/904.0, RADIUM 226/228</b>									
Radium-226	*	0	0		See Attached	pci/L	1	03/17/2022 0:00	R308837

## Laboratory Results

<http://www.teklabinc.com/>**Client:** Southern Illinois Power Cooperation**Work Order:** 22021140**Client Project:** Groundwater Monitoring**Report Date:** 28-Mar-22**Lab ID:** 22021140-011**Client Sample ID:** Field Duplicate**Matrix:** GROUNDWATER**Collection Date:** 03/07/2022 15:25

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>EPA 903.0/904.0, RADIUM 226/228</b>									
Radium-228	*	0	0		See Attached	pCi/L	1	03/17/2022 0:00	R308837



## Quality Control Results

<http://www.teklabinc.com/>

Client: Southern Illinois Power Cooperation

Work Order: 22021140

Client Project: Groundwater Monitoring

Report Date: 28-Mar-22

### STANDARD METHODS 2510 B FIELD

Batch	R308346	SampType:	LCS	Units	mS/cm						
Analyses										Date Analyzed	
		Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	
Spec. Conductance, Field		*	0		1.42	1.409	0	100.8	90	110	03/08/2022
Spec. Conductance, Field		*	0		1.43	1.409	0	101.5	90	110	03/07/2022

### SW-846 9040B FIELD

Batch	R308346	SampType:	LCS	Units							
Analyses										Date Analyzed	
		Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	
pH		*	1.00		7.06	7.000	0	100.9	98.57	101.4	03/07/2022
pH		*	1.00		6.99	7.000	0	99.9	98.57	101.4	03/08/2022

### STANDARD METHODS 2540 C (TOTAL) 1997, 2011

Batch	R308313	SampType:	MBLK	Units	mg/L						
Analyses										Date Analyzed	
		Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	
Total Dissolved Solids		*	20		< 20	16.00	0	0	-100	100	03/11/2022

### Batch R308313 SampType: LCS Units mg/L

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Total Dissolved Solids	*	20		952	1000	0	95.2	90	110	03/11/2022

### Batch R308313 SampType: DUP Units mg/L RPD Limit: 5

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Total Dissolved Solids	*	20		704				714.0	1.41	03/11/2022

### STANDARD METHODS 4500-CL E (TOTAL) 1997, 2011

Batch	R308033	SampType:	MBLK	Units	mg/L						
Analyses										Date Analyzed	
		Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	
Chloride			4		< 4	0.5000	0	0	-100	100	03/09/2022

### Batch R308033 SampType: LCS Units mg/L

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed	
Chloride			4		20	20.00	0	102.5	90	110	03/09/2022



## Quality Control Results

<http://www.teklabinc.com/>

Client: Southern Illinois Power Cooperation

Work Order: 22021140

Client Project: Groundwater Monitoring

Report Date: 28-Mar-22

### STANDARD METHODS 4500-CL E (TOTAL) 1997, 2011

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Chloride		20		231	100.0	145.4	86.1	85	115	03/09/2022

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Chloride		20		234	100.0	145.4	88.8	231.4	1.15	03/09/2022

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Chloride		4		32	20.00	12.58	96.8	85	115	03/09/2022

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Chloride		4		32	20.00	12.58	98.1	31.95	0.78	03/09/2022

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Chloride		80	E	1020	400.0	615.5	101.3	85	115	03/09/2022

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Chloride		80	E	1010	400.0	615.5	99.7	1021	0.60	03/09/2022

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Chloride		40		281	200.0	76.38	102.5	85	115	03/09/2022

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Chloride		40		280	200.0	76.38	101.7	281.3	0.55	03/09/2022



## Quality Control Results

<http://www.teklabinc.com/>

Client: Southern Illinois Power Cooperation

Work Order: 22021140

Client Project: Groundwater Monitoring

Report Date: 28-Mar-22

### STANDARD METHODS 4500-CL E (TOTAL) 1997, 2011

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Chloride		200	E	2620	1000	1734	88.9	85	115	03/09/2022

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Chloride		200	E	2610	1000	1734	87.3	2623	0.61	03/09/2022

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Chloride		200		1750	1000	830.7	91.5	85	115	03/09/2022

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Chloride		200		1750	1000	830.7	91.7	1745	0.16	03/09/2022

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Chloride		1		< 1	0.5000	0	0	-100	100	03/11/2022

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Chloride	*	1		< 1	0.5000	0	0	-100	100	03/11/2022

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Chloride		1		20	20.00	0	100.8	90	110	03/11/2022

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Chloride		2		96	40.00	62.45	85.1	85	115	03/11/2022



## Quality Control Results

<http://www.teklabinc.com/>

Client: Southern Illinois Power Cooperation

Work Order: 22021140

Client Project: Groundwater Monitoring

Report Date: 28-Mar-22

### STANDARD METHODS 4500-CL E (TOTAL) 1997, 2011

Batch R308170	SampType: MSD	Units mg/L							RPD Limit: 15	Date Analyzed
SampID: 22030673-002AMSD										
Analyses		Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD
Chloride			2		98	40.00	62.45	87.8	96.49	1.13

### Batch R308170 SampType: MS Units mg/L

Batch R308170	SampType: MS	Units mg/L							RPD Limit: 15	Date Analyzed
SampID: 22030687-001AMS										
Analyses		Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit
Chloride			20		677	400.0	302.4	93.6	85	115

### Batch R308170 SampType: MSD Units mg/L

Batch R308170	SampType: MSD	Units mg/L							RPD Limit: 15	Date Analyzed
SampID: 22030687-001AMSD										
Analyses		Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD
Chloride			20		673	400.0	302.4	92.7	676.6	0.49

### Batch R308170 SampType: MS Units mg/L

Batch R308170	SampType: MS	Units mg/L							RPD Limit: 15	Date Analyzed
SampID: 22030697-001AMS										
Analyses		Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit
Chloride			200		9140	4000	5707	85.7	85	115

### Batch R308170 SampType: MSD Units mg/L

Batch R308170	SampType: MSD	Units mg/L							RPD Limit: 15	Date Analyzed
SampID: 22030697-001AMSD										
Analyses		Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD
Chloride			200		9280	4000	5707	89.4	9136	1.58

### Batch R308170 SampType: MS Units mg/L

Batch R308170	SampType: MS	Units mg/L							RPD Limit: 15	Date Analyzed
SampID: 22030763-002AMS										
Analyses		Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit
Chloride			20	E	1050	400.0	690.0	91.2	85	115

### Batch R308170 SampType: MSD Units mg/L

Batch R308170	SampType: MSD	Units mg/L							RPD Limit: 15	Date Analyzed
SampID: 22030763-002AMSD										
Analyses		Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD
Chloride			20	E	1060	400.0	690.0	92.2	1055	0.36

### Batch R308309 SampType: MBLK Units mg/L

Batch R308309	SampType: MBLK	Units mg/L							RPD Limit: 15	Date Analyzed
SampID: ICB/MBLK										
Analyses		Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit
Chloride			1		<1	0.5000	0	0	-100	100



## Quality Control Results

<http://www.teklabinc.com/>

Client: Southern Illinois Power Cooperation

Work Order: 22021140

Client Project: Groundwater Monitoring

Report Date: 28-Mar-22

### STANDARD METHODS 4500-CL E (TOTAL) 1997, 2011

Batch R308309	SampType: LCS	Units mg/L								
SampID: ICV/LCS										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Chloride		1		20	20.00	0	100.5	90	110	03/15/2022

### Batch R308309 SampType: MS Units mg/L

SampID: 22021140-006AMS										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Chloride		1		23	20.00	3.220	98.2	85	115	03/15/2022

### Batch R308309 SampType: MSD Units mg/L

SampID: 22021140-006AMSD									RPD Limit: 15	Date Analyzed
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Chloride		1		23	20.00	3.220	98.8	22.86	0.52	03/15/2022

### SW-846 9036 (TOTAL)

Batch R308032	SampType: MBLK	Units mg/L								
SampID: ICB/MBLK										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Sulfate		10		< 10	6.140	0	0	-100	100	03/09/2022

### Batch R308032 SampType: LCS Units mg/L

SampID: ICV/LCS										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Sulfate		10		20	20.00	0	99.5	90	110	03/09/2022

### Batch R308032 SampType: MS Units mg/L

SampID: 22021140-004AMS										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Sulfate		50		238	100.0	152.8	85.4	85	115	03/09/2022

### Batch R308032 SampType: MSD Units mg/L

SampID: 22021140-004AMSD									RPD Limit: 10	Date Analyzed
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Sulfate		50		238	100.0	152.8	85.6	238.1	0.07	03/09/2022

## Quality Control Results

<http://www.teklabinc.com/>
**Client:** Southern Illinois Power Cooperation

**Work Order:** 22021140

**Client Project:** Groundwater Monitoring

**Report Date:** 28-Mar-22

**SW-846 9036 (TOTAL)**

Batch R308032 SampType: MS		Units mg/L								
SampID: 22030442-004CMS										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Sulfate		50		192	100.0	98.94	93.3	90	110	03/09/2022

Batch R308032 SampType: MSD		Units mg/L		RPD Limit: 10						
SampID: 22030442-004CMSD										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Sulfate		50		195	100.0	98.94	95.7	192.2	1.28	03/09/2022

Batch R308032 SampType: MS		Units mg/L								
SampID: 22030465-001AMS										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Sulfate		100		353	200.0	156.0	98.7	90	110	03/09/2022

Batch R308032 SampType: MSD		Units mg/L		RPD Limit: 10						
SampID: 22030465-001AMSD										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Sulfate		100		356	200.0	156.0	100.2	353.3	0.85	03/09/2022

Batch R308032 SampType: MS		Units mg/L								
SampID: 22030502-001AMS										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Sulfate		100		377	200.0	186.5	95.4	90	110	03/09/2022

Batch R308032 SampType: MSD		Units mg/L		RPD Limit: 10						
SampID: 22030502-001AMSD										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Sulfate		100		388	200.0	186.5	100.6	377.3	2.71	03/09/2022

Batch R308032 SampType: MS		Units mg/L								
SampID: 22030593-001AMS										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Sulfate		100		467	200.0	275.0	96.2	85	115	03/09/2022

Batch R308032 SampType: MSD		Units mg/L		RPD Limit: 10						
SampID: 22030593-001AMSD										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Sulfate		100		459	200.0	275.0	91.8	467.5	1.93	03/09/2022

## Quality Control Results

<http://www.teklabinc.com/>
**Client:** Southern Illinois Power Cooperation

**Work Order:** 22021140

**Client Project:** Groundwater Monitoring

**Report Date:** 28-Mar-22

**SW-846 9036 (TOTAL)**

Batch R308032 SampType: MS		Units mg/L								
SampID: 22030614-001AMS										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Sulfate		2000		6600	4000	2742	96.5	90	110	03/09/2022

Batch R308032 SampType: MSD		Units mg/L		RPD Limit: 10						
SampID: 22030614-001AMSD										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Sulfate		2000		6880	4000	2742	103.5	6603	4.15	03/09/2022

Batch R308169 SampType: MBLK		Units mg/L								
SampID: ICB/MBLK										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Sulfate		10		< 10	6.140	0	0	-100	100	03/11/2022

Batch R308169 SampType: MBLK		Units mg/L								
SampID: MBLK 220310										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Sulfate	*	10		< 10	7.620	0	0	-100	100	03/11/2022

Batch R308169 SampType: LCS		Units mg/L								
SampID: ICV/LCS										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Sulfate		10		20	20.00	0	99.0	90	110	03/11/2022

Batch R308169 SampType: MS		Units mg/L								
SampID: 22030503-004AMS										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Sulfate		1000		3690	2000	1697	99.5	90	110	03/11/2022

Batch R308169 SampType: MSD		Units mg/L		RPD Limit: 10						
SampID: 22030503-004AMSD										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Sulfate		1000		3700	2000	1697	100.0	3687	0.27	03/11/2022

Batch R308169 SampType: MS		Units mg/L								
SampID: 22030673-002AMS										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Sulfate		20		96	40.00	56.54	99.5	90	110	03/11/2022

## Quality Control Results

<http://www.teklabinc.com/>
**Client:** Southern Illinois Power Cooperation

**Work Order:** 22021140

**Client Project:** Groundwater Monitoring

**Report Date:** 28-Mar-22

**SW-846 9036 (TOTAL)**

Batch R308169 SampType: MSD		Units mg/L		RPD Limit: 10					Date Analyzed		
SampID: 22030673-002AMSD		Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	
Analyses											
Sulfate		20			97	40.00	56.54	101.8	96.32	0.97	03/11/2022

**Batch R308169 SampType: MS**

Batch R308169 SampType: MS		Units mg/L		RPD Limit: 10					Date Analyzed		
SampID: 22030697-001AMS		Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	
Analyses											
Sulfate		2000	S		8920	4000	5561	83.9	90	110	03/11/2022

**Batch R308169 SampType: MSD**

Batch R308169 SampType: MSD		Units mg/L		RPD Limit: 10					Date Analyzed		
SampID: 22030697-001AMSD		Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	
Analyses											
Sulfate		2000			9390	4000	5561	95.8	8919	5.18	03/11/2022

**Batch R308169 SampType: MS**

Batch R308169 SampType: MS		Units mg/L		RPD Limit: 10					Date Analyzed		
SampID: 22030859-002AMS		Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	
Analyses											
Sulfate		100			459	200.0	276.0	91.4	85	115	03/11/2022

**Batch R308169 SampType: MSD**

Batch R308169 SampType: MSD		Units mg/L		RPD Limit: 10					Date Analyzed		
SampID: 22030859-002AMSD		Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	
Analyses											
Sulfate		100			457	200.0	276.0	90.6	458.9	0.39	03/11/2022

**SW-846 9214 (TOTAL)**

Batch R308014 SampType: MBLK		Units mg/L		RPD Limit: 10					Date Analyzed		
SampID: MBLK		Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	
Analyses											
Fluoride		0.10			< 0.10	0.0370	0	0	-100	100	03/09/2022

**Batch R308014 SampType: LCS**

Batch R308014 SampType: LCS		Units mg/L		RPD Limit: 10					Date Analyzed		
SampID: LCS		Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	
Analyses											
Fluoride		0.10			1.00	1.000	0	99.5	90	110	03/09/2022



## Quality Control Results

<http://www.teklabinc.com/>

Client: Southern Illinois Power Cooperation

Work Order: 22021140

Client Project: Groundwater Monitoring

Report Date: 28-Mar-22

### SW-846 9214 (TOTAL)

Batch R308014 SampType: MS		Units mg/L								
SampID: 22030553-001CMS										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Fluoride		0.10		2.75	2.000	0.7280	101.1	75	125	03/09/2022

Batch R308014 SampType: MSD		Units mg/L		RPD Limit: 15						
SampID: 22030553-001CMSD										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Fluoride		0.10		2.76	2.000	0.7280	101.8	2.750	0.47	03/09/2022

Batch R308014 SampType: MS		Units mg/L								
SampID: 22030614-001AMS										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Fluoride		1.00		35.1	20.00	14.72	102.0	75	125	03/09/2022

Batch R308014 SampType: MSD		Units mg/L		RPD Limit: 15						
SampID: 22030614-001AMSD										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Fluoride		1.00		35.6	20.00	14.72	104.4	35.11	1.39	03/09/2022

### SW-846 3005A, 6010B, METALS BY ICP (TOTAL)

Batch 188407 SampType: MBLK		Units mg/L								
SampID: MBLK-188407										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Barium		0.0025		< 0.0025	0.0007	0	0	-100	100	03/10/2022
Boron		0.0200		< 0.0200	0.0090	0	0	-100	100	03/10/2022
Calcium		0.100		< 0.100	0.0350	0	0	-100	100	03/10/2022

Batch 188407 SampType: LCS		Units mg/L								
SampID: LCS-188407										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Barium		0.0025		2.05	2.000	0	102.7	85	115	03/10/2022
Boron		0.0200		0.506	0.5000	0	101.2	85	115	03/10/2022
Calcium		0.100		2.58	2.500	0	103.2	85	115	03/10/2022



## Quality Control Results

<http://www.teklabinc.com/>

Client: Southern Illinois Power Cooperation

Work Order: 22021140

Client Project: Groundwater Monitoring

Report Date: 28-Mar-22

### SW-846 3005A, 6010B, METALS BY ICP (TOTAL)

Batch	188407	SampType:	MS	Units	mg/L						
SampID: 22021140-005CMS										Date Analyzed	
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit		
Barium		0.0025		2.10	2.000	0.03130	103.7	75	125	03/10/2022	
Boron		0.0200	S	11.8	0.5000	11.10	144.0	75	125	03/10/2022	
Calcium		0.100	S	175	2.500	170.6	168.0	75	125	03/10/2022	

Batch	188407	SampType:	MSD	Units	mg/L	RPD Limit: 20					
SampID: 22021140-005CMSD										Date Analyzed	
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD		
Barium		0.0025		2.08	2.000	0.03130	102.4	2.105	1.24	03/10/2022	
Boron		0.0200		11.6	0.5000	11.10	110.0	11.82	1.45	03/10/2022	
Calcium		0.100		173	2.500	170.6	84.0	174.8	1.21	03/10/2022	

Batch	188407	SampType:	MS	Units	mg/L						
SampID: 22030500-002BMS										Date Analyzed	
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit		
Calcium		0.100	S	281	2.500	277.7	148.0	75	125	03/10/2022	

Batch	188407	SampType:	MSD	Units	mg/L	RPD Limit: 20					
SampID: 22030500-002BMSD										Date Analyzed	
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD		
Calcium		0.100	S	284	2.500	277.7	236.0	281.4	0.78	03/10/2022	

SW-846 3005A, 6020A, METALS BY ICPMS (TOTAL)											
Batch	188407	SampType:	MBLK	Units	mg/L						
SampID: MBLK-188407										Date Analyzed	
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit		
Antimony		0.0010		< 0.0010	0.0004	0	0	-100	100	03/15/2022	
Arsenic		0.0010		< 0.0010	0.0004	0	0	-100	100	03/15/2022	
Beryllium		0.0010		< 0.0010	0.0002	0	0	-100	100	03/15/2022	
Cadmium		0.0010		< 0.0010	0.0001	0	0	-100	100	03/15/2022	
Chromium		0.0015		< 0.0015	0.0007	0	0	-100	100	03/15/2022	
Cobalt		0.0010		< 0.0010	0.0001	0	0	-100	100	03/15/2022	
Lead		0.0010		< 0.0010	0.0006	0	0	-100	100	03/15/2022	
Lithium	*	0.0030		< 0.0030	0.0015	0	0	-100	100	03/15/2022	
Molybdenum		0.0015		< 0.0015	0.0006	0	0	-100	100	03/15/2022	
Selenium		0.0010		< 0.0010	0.0006	0	0	-100	100	03/15/2022	
Thallium		0.0020		< 0.0020	0.0010	0	0	-100	100	03/15/2022	

## Quality Control Results

<http://www.teklabinc.com/>

**Client:** Southern Illinois Power Cooperation

**Work Order:** 22021140

**Client Project:** Groundwater Monitoring

**Report Date:** 28-Mar-22

### SW-846 3005A, 6020A, METALS BY ICPMS (TOTAL)

Batch	188407	SampType:	LCS	Units	mg/L						
				SampID:	LCS-188407 <th data-cs="6" data-kind="parent"></th> <th data-kind="ghost"></th> <th data-kind="ghost"></th> <th data-kind="ghost"></th> <th data-kind="ghost"></th> <th data-kind="ghost"></th>						
Analyses	Cert	RL	Qual	Result	Spike	SPK	Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Antimony		0.0010		<b>0.486</b>	0.5000	0		97.2	80	120	03/15/2022
Arsenic		0.0010		<b>0.508</b>	0.5000	0		101.6	80	120	03/15/2022
Beryllium		0.0010		<b>0.0476</b>	0.0500	0		95.2	80	120	03/15/2022
Cadmium		0.0010		<b>0.0521</b>	0.0500	0		104.1	80	120	03/15/2022
Chromium		0.0015		<b>0.196</b>	0.2000	0		98.1	80	120	03/15/2022
Cobalt		0.0010		<b>0.506</b>	0.5000	0		101.1	80	120	03/15/2022
Lead		0.0010		<b>0.493</b>	0.5000	0		98.5	80	120	03/15/2022
Lithium	*	0.0030		<b>0.511</b>	0.5000	0		102.2	80	120	03/15/2022
Molybdenum		0.0015		<b>0.490</b>	0.5000	0		98.0	80	120	03/15/2022
Selenium		0.0010		<b>0.466</b>	0.5000	0		93.1	80	120	03/15/2022
Thallium		0.0020		<b>0.233</b>	0.2500	0		93.2	80	120	03/15/2022

### Batch 188407 SampType: MS Units mg/L

Batch	188407	SampType:	MS	Units	mg/L						
				SampID:	22021140-005CMS						
Analyses	Cert	RL	Qual	Result	Spike	SPK	Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Antimony		0.0010		<b>0.523</b>	0.5000	0		104.6	75	125	03/16/2022
Arsenic		0.0010		<b>0.529</b>	0.5000	0.005331		104.7	75	125	03/16/2022
Beryllium		0.0010		<b>0.0472</b>	0.0500	0		94.3	75	125	03/15/2022
Cadmium		0.0010		<b>0.0549</b>	0.0500	0		109.9	75	125	03/15/2022
Chromium		0.0015		<b>0.201</b>	0.2000	0.002030		99.5	75	125	03/15/2022
Cobalt		0.0010		<b>0.705</b>	0.5000	0.1997		101.1	75	125	03/15/2022
Lead		0.0010		<b>0.512</b>	0.5000	0		102.4	75	125	03/15/2022
Lithium	*	0.0030		<b>0.532</b>	0.5000	0.002539		105.9	75	125	03/15/2022
Molybdenum		0.0015		<b>0.521</b>	0.5000	0		104.3	75	125	03/16/2022
Selenium		0.0010		<b>0.486</b>	0.5000	0		97.1	75	125	03/16/2022
Thallium		0.0020		<b>0.246</b>	0.2500	0		98.4	75	125	03/15/2022



## Quality Control Results

<http://www.teklabinc.com/>

Client: Southern Illinois Power Cooperation

Work Order: 22021140

Client Project: Groundwater Monitoring

Report Date: 28-Mar-22

### SW-846 3005A, 6020A, METALS BY ICPMS (TOTAL)

Batch	188407	SampType:	MSD	Units	mg/L	RPD Limit: 20					Date Analyzed
SampID: 22021140-005CMSD											
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD		
Antimony		0.0010		<b>0.518</b>	0.5000	0	103.7	0.5228	0.85	03/16/2022	
Arsenic		0.0010		<b>0.512</b>	0.5000	0.005331	101.3	0.5289	3.26	03/16/2022	
Beryllium		0.0010		<b>0.0462</b>	0.0500	0	92.4	0.04717	2.11	03/15/2022	
Cadmium		0.0010		<b>0.0534</b>	0.0500	0	106.8	0.05493	2.87	03/15/2022	
Chromium		0.0015		<b>0.191</b>	0.2000	0.002030	94.6	0.2010	4.98	03/15/2022	
Cobalt		0.0010		<b>0.676</b>	0.5000	0.1997	95.3	0.7052	4.21	03/15/2022	
Lead		0.0010		<b>0.488</b>	0.5000	0	97.5	0.5121	4.88	03/15/2022	
Lithium	*	0.0030		<b>0.503</b>	0.5000	0.002539	100.1	0.5321	5.59	03/15/2022	
Molybdenum		0.0015		<b>0.516</b>	0.5000	0	103.2	0.5215	1.04	03/16/2022	
Selenium		0.0010		<b>0.468</b>	0.5000	0	93.5	0.4856	3.74	03/16/2022	
Thallium		0.0020		<b>0.241</b>	0.2500	0	96.6	0.2459	1.85	03/15/2022	

### SW-846 7470A (TOTAL)

Batch	188417	SampType:	MBLK	Units	mg/L						Date Analyzed
SampID: MBLK-188417											
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit		
Mercury		0.00020		<b>&lt; 0.00020</b>	0.0001	0	0	-100	100	03/10/2022	

### Batch 188417 SampType: LCS

Batch	188417	SampType:	LCS	Units	mg/L						Date Analyzed
SampID: LCS-188417											
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit		
Mercury		0.00020		<b>0.00465</b>	0.0050	0	93.1	85	115	03/10/2022	

### Batch 188417 SampType: MS

Batch	188417	SampType:	MS	Units	mg/L						Date Analyzed
SampID: 22030593-002BMS											
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit		
Mercury		0.00020		<b>0.00455</b>	0.0050	0	91.0	75	125	03/10/2022	

### Batch 188417 SampType: MSD

Batch	188417	SampType:	MSD	Units	mg/L						RPD Limit: 15
SampID: 22030593-002BMSD											
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD		
Mercury		0.00020		<b>0.00444</b>	0.0050	0	88.9	0.004552	2.38	03/10/2022	



## Quality Control Results

<http://www.teklabinc.com/>

Client: Southern Illinois Power Cooperation

Work Order: 22021140

Client Project: Groundwater Monitoring

Report Date: 28-Mar-22

### SW-846 7470A (TOTAL)

Batch 188417 SampType: MS		Units mg/L								
SampID: 22030678-001CMS										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Mercury		0.00020		<b>0.00458</b>	0.0050	0	91.5	75	125	03/10/2022

Batch 188417 SampType: MSD		Units mg/L		RPD Limit: 15						
SampID: 22030678-001CMSD										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Mercury		0.00020		<b>0.00447</b>	0.0050	0	89.4	0.004576	2.34	03/10/2022

Batch 188481 SampType: MBLK		Units mg/L								
SampID: MBLK-188481										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Mercury		0.00020		< 0.00020	0.0001	0	0	-100	100	03/12/2022

Batch 188481 SampType: LCS		Units mg/L								
SampID: LCS-188481										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Mercury		0.00020		<b>0.00460</b>	0.0050	0	92.0	85	115	03/12/2022

Batch 188481 SampType: MS		Units mg/L								
SampID: 22021140-011CMS										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Mercury		0.00020		<b>0.00467</b>	0.0050	0	93.4	75	125	03/12/2022

Batch 188481 SampType: MSD		Units mg/L		RPD Limit: 15						
SampID: 22021140-011CMSD										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Mercury		0.00020		<b>0.00481</b>	0.0050	0	96.1	0.004672	2.83	03/12/2022

## Receiving Check List

<http://www.teklabinc.com/>

**Client:** Southern Illinois Power Cooperation

**Work Order:** 22021140

**Client Project:** Groundwater Monitoring

**Report Date:** 28-Mar-22

**Carrier:** Adam Bridges

**Received By:** PRY

**Completed by:**

On:

09-Mar-22

*Mary E. Kemp*

Mary E. Kemp

**Reviewed by:**

On:

09-Mar-22

*Elizabeth A. Hurley*

Elizabeth A. Hurley

**Pages to follow:** Chain of custody

2

Extra pages included

22

	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>	Not Present <input type="checkbox"/>	Temp °C <input type="checkbox"/>	4.0 <input type="checkbox"/>
Shipping container/cooler in good condition?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>	Not Present <input type="checkbox"/>	Blue Ice <input type="checkbox"/>	Dry Ice <input type="checkbox"/>
Type of thermal preservation?	None <input type="checkbox"/>	Ice <input checked="" type="checkbox"/>	No <input type="checkbox"/>		
Chain of custody present?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>			
Chain of custody signed when relinquished and received?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>			
Chain of custody agrees with sample labels?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>			
Samples in proper container/bottle?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>			
Sample containers intact?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>			
Sufficient sample volume for indicated test?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>			
All samples received within holding time?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>			
Reported field parameters measured:	Field <input checked="" type="checkbox"/>	Lab <input type="checkbox"/>	NA <input type="checkbox"/>		
Container/Temp Blank temperature in compliance?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>			
<i>When thermal preservation is required, samples are compliant with a temperature between 0.1°C - 6.0°C, or when samples are received on ice the same day as collected.</i>					
Water – at least one vial per sample has zero headspace?	Yes <input type="checkbox"/>	No <input type="checkbox"/>	No VOA vials <input checked="" type="checkbox"/>		
Water - TOX containers have zero headspace?	Yes <input type="checkbox"/>	No <input type="checkbox"/>	No TOX containers <input checked="" type="checkbox"/>		
Water - pH acceptable upon receipt?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>	NA <input type="checkbox"/>		
NPDES/CWA TCN interferences checked/treated in the field?	Yes <input type="checkbox"/>	No <input type="checkbox"/>	NA <input checked="" type="checkbox"/>		

**Any No responses must be detailed below or on the COC.**

pH strip #78011. - PRY/MKemp - 3/9/2022 8:40:51 AM

## CHAIN OF CUSTODY

pg. 1 of 2 Work order # 22021140

TEKLAB, INC. 5445 Horseshoe Lake Road - Collinsville, IL 62234 - Phone: (618) 344-1004 - Fax: (618) 344-1005

Client:	Southern Illinois Power Cooperation		
Address:	11543 Lake of Egypt Road		
City / State / Zip	Marion, IL 62959		
Contact:	Jason McLaurin	Phone:	(618) 964-1448
E-Mail:	jmclaurin@sipower.org		

Are these samples known to be involved in litigation? If yes, a surcharge will apply  Yes  No

Are these samples known to be hazardous?  Yes  No

Are there any required reporting limits to be met on the requested analysis? If yes, please provide limits in the comment section.  Yes  No

Samples on:  ICE  BLUE ICE  NO ICE 9:00 °C LTG#

Preserved in:  LAB  FIELD

FOR LAB USE ONLY

Lab Notes: PHV 78011. PNT 319722

Client Comments: X-Dry

ICP: Ba B Ca

ICP/MS: Sb As Be Cd Cr Co Pb Li Mo Se Ti

Field Parameters = Elevations, Purge Volume, pH, Conductivity, Temperature, DO, ORP, and Turbidity

Project Name/Number		Sample Collector's Name			MATRIX	INDICATE ANALYSIS REQUESTED												
Groundwater Monitoring		J. RELEY A. BRIDGES					Field Parameters	Chloride	Fluoride	ICP/MS Metals	Mercury	Ra226/228	Sulfate	TDS				
Results Requested		Billing Instructions		# and Type of Containers	Groundwater													
<input checked="" type="checkbox"/> Standard	<input type="checkbox"/> 1-2 Day (100% Surcharge)			UNP	Aqueous													
<input type="checkbox"/> Other	<input type="checkbox"/> 3 Day (50% Surcharge)			HNO3														
Lab Use Only	Sample Identification	Date/Time Sampled		1	3													
22021140-001	EBG	03/07/22 14:42		1	3	X		X	X	X	X	X	X	X	X	X	X	
002	EP-1	03/07/22 14:11		1	3	X		X	X	X	X	X	X	X	X	X	X	
003	EP-2 *	03/07/22 15:25		1	3	X		X	X	X	X	X	X	X	X	X	X	
004	EP-3	03/08/22 13:08		1	3	X		X	X	X	X	X	X	X	X	X	X	
005	EP-4	03/08/22 14:35		1	3	X		X	X	X	X	X	X	X	X	X	X	
006	EP-5	03/07/22 12:49		1	3	X		X	X	X	X	X	X	X	X	X	X	
007	EP-6	03/08/22 08:36		1	3	X		X	X	X	X	X	X	X	X	X	X	
008	EP-7	03/08/22 11:03		1	3	X		X	X	X	X	X	X	X	X	X	X	
009	Equipment Blank	03/08/22 14:36		1	3	X		X	X	X	X	X	X	X	X	X	X	
010	Field Blank	03/10/22 15:23		1	3	X		X	X	X	X	X	X	X	X	X	X	
Relinquished By	Date/Time				Received By				Date/Time									
<i>J. RELEY</i>	3-9-22 0800				<i>Royce</i>				3/9/22 0800									

The individual signing this agreement on behalf of the client, acknowledges that he/she has read and understands the terms and conditions of this agreement, and that he/she has the authority to sign on behalf of the client. See [www.teklabinc.com](http://www.teklabinc.com) for terms and conditions.

BottleOrder: 70999



*PAT 3/9/22*

# **CHAIN OF CUSTODY**

pg. 2 of 2 Work order # 22021140

TEKLAB, INC. 5445 Horseshoe Lake Road - Collinsville, IL 62234 - Phone: (618) 344-1004 - Fax: (618) 344-1005

The individual signing this agreement on behalf of the client, acknowledges that he/she has read and understands the terms and conditions of this agreement, and that he/she has the authority to sign on behalf of the client. See [www.teklabinc.com](http://www.teklabinc.com) for terms and conditions.

BottleOrder: 70999





# ANALYTICAL REPORT

March 25, 2022

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

<sup>7</sup>GI

<sup>8</sup>AI

<sup>9</sup>SC

## TEKLAB, Inc.

Sample Delivery Group: L1470373

Samples Received: 03/11/2022

Project Number: 22021140

Description:

Report To: Elizabeth Hurley  
5445 Horseshoe Lake Road  
Collinsville, IL 62234

Entire Report Reviewed By:

Mark W. Beasley  
Project Manager

Results relate only to the items tested or calibrated and are reported as rounded values. This test report shall not be reproduced, except in full, without written approval of the laboratory. Where applicable, sampling conducted by Pace Analytical National is performed per guidance provided in laboratory standard operating procedures ENV-SOP-MTJL-0067 and ENV-SOP-MTJL-0068. Where sampling conducted by the customer, results relate to the accuracy of the information provided, and as the samples are received.

Pace Analytical National

12065 Lebanon Rd Mount Juliet, TN 37122 615-758-5858 800-767-5859 [www.pacenational.com](http://www.pacenational.com)

ACCOUNT:

TEKLAB, Inc.

PROJECT:

22021140

SDG:

L1470373

DATE/TIME:

03/25/22 14:09

PAGE:


1 of 22

# TABLE OF CONTENTS

Cp: Cover Page	1	 1 Cp
Tc: Table of Contents	2	 2 Tc
Ss: Sample Summary	3	 3 Ss
Cn: Case Narrative	5	 4 Cn
Sr: Sample Results	6	 5 Sr
22021140-001B L1470373-01	6	 6 Qc
22021140-002B L1470373-02	7	 7 Gl
22021140-003B L1470373-03	8	 8 Al
22021140-004B L1470373-04	9	 9 Sc
22021140-005B L1470373-05	10	
22021140-006B L1470373-06	11	
22021140-007B L1470373-07	12	
22021140-008B L1470373-08	13	
22021140-009B L1470373-09	14	
22021140-010B L1470373-10	15	
22021140-011B L1470373-11	16	
Qc: Quality Control Summary	17	
Radiochemistry by Method 904/9320	17	
Radiochemistry by Method SM7500Ra B M	18	
Gl: Glossary of Terms	19	
Al: Accreditations & Locations	20	
Sc: Sample Chain of Custody	21	


# SAMPLE SUMMARY

			Collected by	Collected date/time	Received date/time	
				03/07/22 11:42	03/11/22 09:00	
22021140-001B L1470373-01 Non-Potable Water	Method	Batch	Dilution	Preparation date/time	Analysis date/time	Analyst Location
Radiochemistry by Method 904/9320		WG1830859	1	03/15/22 12:48	03/23/22 15:00	JMR Mt. Juliet, TN
Radiochemistry by Method Calculation		WG1831801	1	03/15/22 15:00	03/23/22 15:00	JMR Mt. Juliet, TN
Radiochemistry by Method SM7500Ra B M		WG1831801	1	03/15/22 15:00	03/16/22 13:34	RGT Mt. Juliet, TN
22021140-002B L1470373-02 Non-Potable Water				Collected by	Collected date/time	Received date/time
					03/07/22 14:11	03/11/22 09:00
Method	Batch	Dilution	Preparation date/time	Analysis date/time	Analyst	Location
Radiochemistry by Method 904/9320	WG1830859	1	03/15/22 12:48	03/23/22 15:00	JMR	Mt. Juliet, TN
Radiochemistry by Method Calculation	WG1831801	1	03/15/22 15:00	03/23/22 15:00	JMR	Mt. Juliet, TN
Radiochemistry by Method SM7500Ra B M	WG1831801	1	03/15/22 15:00	03/16/22 13:34	RGT	Mt. Juliet, TN
22021140-003B L1470373-03 Non-Potable Water				Collected by	Collected date/time	Received date/time
					03/07/22 15:25	03/11/22 09:00
Method	Batch	Dilution	Preparation date/time	Analysis date/time	Analyst	Location
Radiochemistry by Method 904/9320	WG1830859	1	03/15/22 12:48	03/23/22 15:00	JMR	Mt. Juliet, TN
Radiochemistry by Method Calculation	WG1831801	1	03/15/22 15:00	03/23/22 15:00	JMR	Mt. Juliet, TN
Radiochemistry by Method SM7500Ra B M	WG1831801	1	03/15/22 15:00	03/16/22 13:34	RGT	Mt. Juliet, TN
22021140-004B L1470373-04 Non-Potable Water				Collected by	Collected date/time	Received date/time
					03/08/22 13:08	03/11/22 09:00
Method	Batch	Dilution	Preparation date/time	Analysis date/time	Analyst	Location
Radiochemistry by Method 904/9320	WG1830859	1	03/15/22 12:48	03/23/22 15:00	JMR	Mt. Juliet, TN
Radiochemistry by Method Calculation	WG1831801	1	03/15/22 15:00	03/23/22 15:00	JMR	Mt. Juliet, TN
Radiochemistry by Method SM7500Ra B M	WG1831801	1	03/15/22 15:00	03/16/22 13:34	RGT	Mt. Juliet, TN
22021140-005B L1470373-05 Non-Potable Water				Collected by	Collected date/time	Received date/time
					03/08/22 14:35	03/11/22 09:00
Method	Batch	Dilution	Preparation date/time	Analysis date/time	Analyst	Location
Radiochemistry by Method 904/9320	WG1830859	1	03/15/22 12:48	03/23/22 15:00	JMR	Mt. Juliet, TN
Radiochemistry by Method Calculation	WG1831801	1	03/15/22 15:00	03/23/22 15:00	JMR	Mt. Juliet, TN
Radiochemistry by Method SM7500Ra B M	WG1831801	1	03/15/22 15:00	03/16/22 13:34	RGT	Mt. Juliet, TN
22021140-006B L1470373-06 Non-Potable Water				Collected by	Collected date/time	Received date/time
					03/07/22 12:49	03/11/22 09:00
Method	Batch	Dilution	Preparation date/time	Analysis date/time	Analyst	Location
Radiochemistry by Method 904/9320	WG1830859	1	03/15/22 12:48	03/24/22 12:30	JMR	Mt. Juliet, TN
Radiochemistry by Method Calculation	WG1831801	1	03/15/22 15:00	03/24/22 12:30	JMR	Mt. Juliet, TN
Radiochemistry by Method SM7500Ra B M	WG1831801	1	03/15/22 15:00	03/16/22 13:34	RGT	Mt. Juliet, TN



# SAMPLE SUMMARY

			Collected by	Collected date/time	Received date/time
				03/08/22 08:36	03/11/22 09:00
22021140-007B L1470373-07 Non-Potable Water	Method	Batch	Dilution	Preparation date/time	Analysis date/time
					Analyst
Radiochemistry by Method 904/9320		WG1830859	1	03/15/22 12:48	03/24/22 12:30
Radiochemistry by Method Calculation		WG1831801	1	03/15/22 15:00	03/24/22 12:30
Radiochemistry by Method SM7500Ra B M		WG1831801	1	03/15/22 15:00	03/16/22 13:34
22021140-008B L1470373-08 Non-Potable Water	Method	Batch	Dilution	Preparation date/time	Analysis date/time
					Analyst
Radiochemistry by Method 904/9320		WG1830859	1	03/15/22 12:48	03/24/22 12:30
Radiochemistry by Method Calculation		WG1831801	1	03/15/22 15:00	03/24/22 12:30
Radiochemistry by Method SM7500Ra B M		WG1831801	1	03/15/22 15:00	03/16/22 13:34
22021140-009B L1470373-09 Non-Potable Water	Method	Batch	Dilution	Preparation date/time	Analysis date/time
					Analyst
Radiochemistry by Method 904/9320		WG1830859	1	03/15/22 12:48	03/24/22 12:30
Radiochemistry by Method Calculation		WG1831801	1	03/15/22 15:00	03/24/22 12:30
Radiochemistry by Method SM7500Ra B M		WG1831801	1	03/15/22 15:00	03/17/22 08:45
22021140-010B L1470373-10 Non-Potable Water	Method	Batch	Dilution	Preparation date/time	Analysis date/time
					Analyst
Radiochemistry by Method 904/9320		WG1830859	1	03/15/22 12:48	03/24/22 12:30
Radiochemistry by Method Calculation		WG1831801	1	03/15/22 15:00	03/24/22 12:30
Radiochemistry by Method SM7500Ra B M		WG1831801	1	03/15/22 15:00	03/17/22 08:45
22021140-011B L1470373-11 Non-Potable Water	Method	Batch	Dilution	Preparation date/time	Analysis date/time
					Analyst
Radiochemistry by Method 904/9320		WG1830859	1	03/15/22 12:48	03/24/22 12:30
Radiochemistry by Method Calculation		WG1831801	1	03/15/22 15:00	03/24/22 12:30
Radiochemistry by Method SM7500Ra B M		WG1831801	1	03/15/22 15:00	03/17/22 08:45



# CASE NARRATIVE

All sample aliquots were received at the correct temperature, in the proper containers, with the appropriate preservatives, and within method specified holding times, unless qualified or notated within the report. Where applicable, all MDL (LOD) and RDL (LOQ) values reported for environmental samples have been corrected for the dilution factor used in the analysis. All radiochemical sample results for solids are reported on a dry weight basis with the exception of tritium, carbon-14 and radon, unless wet weight was requested by the client. All Method and Batch Quality Control are within established criteria except where addressed in this case narrative, a non-conformance form or properly qualified within the sample results. By my digital signature below, I affirm to the best of my knowledge, all problems/anomalies observed by the laboratory as having the potential to affect the quality of the data have been identified by the laboratory, and no information or data have been knowingly withheld that would affect the quality of the data.



Mark W. Beasley  
Project Manager

- <sup>1</sup> Cp
- <sup>2</sup> Tc
- <sup>3</sup> Ss
- <sup>4</sup> Cn
- <sup>5</sup> Sr
- <sup>6</sup> Qc
- <sup>7</sup> GI
- <sup>8</sup> AI
- <sup>9</sup> Sc

22021140-001B

Collected date/time: 03/07/22 11:42

## SAMPLE RESULTS - 01

L1470373

## Radiochemistry by Method 904/9320

Analyte	Result pCi/l	<u>Qualifier</u> + / -	Uncertainty 0.406	MDA 0.720	Analysis Date date / time 03/23/2022 15:00	<u>Batch</u> <a href="#">WG1830859</a>
RADIUM-228	1.18			62.0-143	03/23/2022 15:00	<a href="#">WG1830859</a>
( <i>T</i> ) Barium	96.4					
( <i>T</i> ) Yttrium	96.8			79.0-136	03/23/2022 15:00	<a href="#">WG1830859</a>

<sup>1</sup>Cp<sup>2</sup>Tc<sup>3</sup>Ss<sup>4</sup>Cn<sup>5</sup>Sr<sup>6</sup>Qc<sup>7</sup>Gl<sup>8</sup>Al<sup>9</sup>Sc

## Radiochemistry by Method Calculation

Analyte	Result pCi/l	<u>Qualifier</u> + / -	Uncertainty 0.452	MDA 0.746	Analysis Date date / time 03/23/2022 15:00	<u>Batch</u> <a href="#">WG1831801</a>
Combined Radium	1.40					

## Radiochemistry by Method SM7500Ra B M

Analyte	Result pCi/l	<u>Qualifier</u> + / -	Uncertainty 0.198	MDA 0.194	Analysis Date date / time 03/16/2022 13:34	<u>Batch</u> <a href="#">WG1831801</a>
RADIUM-226	0.215					
( <i>T</i> ) Barium-133	95.8			30.0-143	03/16/2022 13:34	<a href="#">WG1831801</a>

<sup>6</sup>Qc<sup>7</sup>Gl<sup>8</sup>Al<sup>9</sup>Sc

22021140-002B

Collected date/time: 03/07/22 14:11

## SAMPLE RESULTS - 02

L1470373

## Radiochemistry by Method 904/9320

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	Batch
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-228	0.439	J	0.330	0.606	03/23/2022 15:00	WG1830859
(T) Barium	87.9			62.0-143	03/23/2022 15:00	WG1830859
(T) Yttrium	99.1			79.0-136	03/23/2022 15:00	WG1830859

<sup>1</sup>Cp<sup>2</sup>Tc<sup>3</sup>Ss<sup>4</sup>Cn<sup>5</sup>Sr<sup>6</sup>Qc<sup>7</sup>Gl<sup>8</sup>Al<sup>9</sup>Sc

## Radiochemistry by Method Calculation

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	Batch
	pCi/l		+ / -	pCi/l	date / time	
Combined Radium	0.699		0.410	0.671	03/23/2022 15:00	WG1831801

## Radiochemistry by Method SM7500Ra B M

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	Batch
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-226	0.260	J	0.243	0.289	03/16/2022 13:34	WG1831801
(T) Barium-133	95.5			30.0-143	03/16/2022 13:34	WG1831801

22021140-003B

Collected date/time: 03/07/22 15:25

## SAMPLE RESULTS - 03

L1470373

## Radiochemistry by Method 904/9320

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	Batch
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-228	0.426	J	0.334	0.614	03/23/2022 15:00	WG1830859
(T) Barium	91.9			62.0-143	03/23/2022 15:00	WG1830859
(T) Yttrium	98.6			79.0-136	03/23/2022 15:00	WG1830859

<sup>1</sup>Cp<sup>2</sup>Tc<sup>3</sup>Ss<sup>4</sup>Cn<sup>5</sup>Sr<sup>6</sup>Qc<sup>7</sup>Gl<sup>8</sup>Al<sup>9</sup>Sc

## Radiochemistry by Method Calculation

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	Batch
	pCi/l		+ / -	pCi/l	date / time	
Combined Radium	0.458	J	0.377	0.704	03/23/2022 15:00	WG1831801

## Radiochemistry by Method SM7500Ra B M

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	Batch
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-226	0.0315	U	0.174	0.344	03/16/2022 13:34	WG1831801
(T) Barium-133	95.3			30.0-143	03/16/2022 13:34	WG1831801

22021140-004B

Collected date/time: 03/08/22 13:08

## SAMPLE RESULTS - 04

L1470373

## Radiochemistry by Method 904/9320

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-228	0.765		0.315	0.565	03/23/2022 15:00	<u>WG1830859</u>
( <i>T</i> ) Barium	97.5			62.0-143	03/23/2022 15:00	<u>WG1830859</u>
( <i>T</i> ) Yttrium	101			79.0-136	03/23/2022 15:00	<u>WG1830859</u>

<sup>1</sup>Cp<sup>2</sup>Tc<sup>3</sup>Ss<sup>4</sup>Cn<sup>5</sup>Sr<sup>6</sup>Qc<sup>7</sup>Gl<sup>8</sup>Al<sup>9</sup>Sc

## Radiochemistry by Method Calculation

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
Combined Radium	1.13		0.407	0.610	03/23/2022 15:00	<u>WG1831801</u>

## Radiochemistry by Method SM7500Ra B M

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-226	0.365		0.257	0.229	03/16/2022 13:34	<u>WG1831801</u>
( <i>T</i> ) Barium-133	93.2			30.0-143	03/16/2022 13:34	<u>WG1831801</u>

22021140-005B

Collected date/time: 03/08/22 14:35

## SAMPLE RESULTS - 05

L1470373

## Radiochemistry by Method 904/9320

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-228	0.658		0.335	0.608	03/23/2022 15:00	<u>WG1830859</u>
( <i>T</i> ) Barium	89.6			62.0-143	03/23/2022 15:00	<u>WG1830859</u>
( <i>T</i> ) Yttrium	103			79.0-136	03/23/2022 15:00	<u>WG1830859</u>

<sup>1</sup>Cp<sup>2</sup>Tc<sup>3</sup>Ss<sup>4</sup>Cn<sup>5</sup>Sr<sup>6</sup>Qc<sup>7</sup>Gl<sup>8</sup>Al<sup>9</sup>Sc

## Radiochemistry by Method Calculation

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
Combined Radium	0.893		0.388	0.633	03/23/2022 15:00	<u>WG1831801</u>

## Radiochemistry by Method SM7500Ra B M

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-226	0.234		0.195	0.175	03/16/2022 13:34	<u>WG1831801</u>
( <i>T</i> ) Barium-133	99.5			30.0-143	03/16/2022 13:34	<u>WG1831801</u>

22021140-006B

Collected date/time: 03/07/22 12:49

## SAMPLE RESULTS - 06

L1470373

## Radiochemistry by Method 904/9320

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	Batch
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-228	0.474	J	0.306	0.542	03/24/2022 12:30	WG1830859
(T) Barium	92.3			62.0-143	03/24/2022 12:30	WG1830859
(T) Yttrium	95.7			79.0-136	03/24/2022 12:30	WG1830859

<sup>1</sup>Cp<sup>2</sup>Tc<sup>3</sup>Ss<sup>4</sup>Cn<sup>5</sup>Sr<sup>6</sup>Qc<sup>7</sup>Gl<sup>8</sup>Al<sup>9</sup>Sc

## Radiochemistry by Method Calculation

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	Batch
	pCi/l		+ / -	pCi/l	date / time	
Combined Radium	0.630		0.346	0.570	03/24/2022 12:30	WG1831801

## Radiochemistry by Method SM7500Ra B M

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	Batch
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-226	0.157	J	0.162	0.178	03/16/2022 13:34	WG1831801
(T) Barium-133	99.2			30.0-143	03/16/2022 13:34	WG1831801

22021140-007B

Collected date/time: 03/08/22 08:36

## SAMPLE RESULTS - 07

L1470373

## Radiochemistry by Method 904/9320

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-228	1.01		0.324	0.555	03/24/2022 12:30	<u>WG1830859</u>
(T) Barium	98.3			62.0-143	03/24/2022 12:30	<u>WG1830859</u>
(T) Yttrium	98.3			79.0-136	03/24/2022 12:30	<u>WG1830859</u>

<sup>1</sup>Cp<sup>2</sup>Tc<sup>3</sup>Ss<sup>4</sup>Cn<sup>5</sup>Sr<sup>6</sup>Qc<sup>7</sup>Gl<sup>8</sup>Al<sup>9</sup>Sc

## Radiochemistry by Method Calculation

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
Combined Radium	1.13		0.357	0.586	03/24/2022 12:30	<u>WG1831801</u>

## Radiochemistry by Method SM7500Ra B M

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-226	0.123	J	0.150	0.188	03/16/2022 13:34	<u>WG1831801</u>
(T) Barium-133	97.7			30.0-143	03/16/2022 13:34	<u>WG1831801</u>

22021140-008B

Collected date/time: 03/08/22 11:03

## SAMPLE RESULTS - 08

L1470373

## Radiochemistry by Method 904/9320

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	Batch
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-228	0.954		0.384	0.666	03/24/2022 12:30	<a href="#">WG1830859</a>
( <i>T</i> ) Barium	83.4			62.0-143	03/24/2022 12:30	<a href="#">WG1830859</a>
( <i>T</i> ) Yttrium	95.8			79.0-136	03/24/2022 12:30	<a href="#">WG1830859</a>

<sup>1</sup>Cp<sup>2</sup>Tc<sup>3</sup>Ss<sup>4</sup>Cn<sup>5</sup>Sr<sup>6</sup>Qc<sup>7</sup>Gl<sup>8</sup>Al<sup>9</sup>Sc

## Radiochemistry by Method Calculation

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	Batch
	pCi/l		+ / -	pCi/l	date / time	
Combined Radium	1.03		0.420	0.727	03/24/2022 12:30	<a href="#">WG1831801</a>

## Radiochemistry by Method SM7500Ra B M

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	Batch
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-226	0.0766	<u>U</u>	0.171	0.292	03/16/2022 13:34	<a href="#">WG1831801</a>
( <i>T</i> ) Barium-133	99.0			30.0-143	03/16/2022 13:34	<a href="#">WG1831801</a>

22021140-009B

Collected date/time: 03/08/22 14:38

## SAMPLE RESULTS - 09

L1470373

## Radiochemistry by Method 904/9320

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-228	-0.0407	<u>U</u>	0.385	0.703	03/24/2022 12:30	<u>WG1830859</u>
( <i>T</i> ) Barium	95.5			62.0-143	03/24/2022 12:30	<u>WG1830859</u>
( <i>T</i> ) Yttrium	96.7			79.0-136	03/24/2022 12:30	<u>WG1830859</u>

<sup>1</sup>Cp<sup>2</sup>Tc<sup>3</sup>Ss<sup>4</sup>Cn<sup>5</sup>Sr<sup>6</sup>Qc<sup>7</sup>Gl<sup>8</sup>Al<sup>9</sup>Sc

## Radiochemistry by Method Calculation

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
Combined Radium	0.0841	<u>U</u>	0.421	0.759	03/24/2022 12:30	<u>WG1831801</u>

## Radiochemistry by Method SM7500Ra B M

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-226	0.0841	<u>U</u>	0.170	0.285	03/17/2022 08:45	<u>WG1831801</u>
( <i>T</i> ) Barium-133	99.7			30.0-143	03/17/2022 08:45	<u>WG1831801</u>

22021140-010B

Collected date/time: 03/07/22 15:28

## SAMPLE RESULTS - 10

L1470373

## Radiochemistry by Method 904/9320

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-228	0.195	<u>U</u>	0.401	0.722	03/24/2022 12:30	<u>WG1830859</u>
( <i>T</i> ) Barium	105			62.0-143	03/24/2022 12:30	<u>WG1830859</u>
( <i>T</i> ) Yttrium	97.9			79.0-136	03/24/2022 12:30	<u>WG1830859</u>

<sup>1</sup>Cp<sup>2</sup>Tc<sup>3</sup>Ss<sup>4</sup>Cn<sup>5</sup>Sr<sup>6</sup>Qc<sup>7</sup>Gl<sup>8</sup>Al<sup>9</sup>Sc

## Radiochemistry by Method Calculation

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
Combined Radium	0.241	<u>U</u>	0.434	0.791	03/24/2022 12:30	<u>WG1831801</u>

## Radiochemistry by Method SM7500Ra B M

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-226	0.0463	<u>U</u>	0.167	0.322	03/17/2022 08:45	<u>WG1831801</u>
( <i>T</i> ) Barium-133	102			30.0-143	03/17/2022 08:45	<u>WG1831801</u>

22021140-011B

Collected date/time: 03/07/22 15:25

## SAMPLE RESULTS - 11

L1470373

## Radiochemistry by Method 904/9320

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-228	1.57		0.349	0.580	03/24/2022 12:30	<u>WG1830859</u>
( <i>T</i> ) Barium	89.2			62.0-143	03/24/2022 12:30	<u>WG1830859</u>
( <i>T</i> ) Yttrium	94.8			79.0-136	03/24/2022 12:30	<u>WG1830859</u>

<sup>1</sup>Cp<sup>2</sup>Tc<sup>3</sup>Ss<sup>4</sup>Cn<sup>5</sup>Sr<sup>6</sup>Qc<sup>7</sup>Gl<sup>8</sup>Al<sup>9</sup>Sc

## Radiochemistry by Method Calculation

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
Combined Radium	1.60		0.381	0.652	03/24/2022 12:30	<u>WG1831801</u>

## Radiochemistry by Method SM7500Ra B M

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-226	0.0347	<u>U</u>	0.152	0.297	03/17/2022 08:45	<u>WG1831801</u>
( <i>T</i> ) Barium-133	98.3			30.0-143	03/17/2022 08:45	<u>WG1831801</u>

## QUALITY CONTROL SUMMARY

[L1470373-01,02,03,04,05,06,07,08,09,10,11](#)

## Method Blank (MB)

(MB) R3774012-1 03/23/22 15:00

Analyte	MB Result pCi/l	<u>MB Qualifier</u>	MB Uncertainty + / -	MB MDA pCi/l
Radium-228	0.252	J	0.232	0.427
(T) Barium	103		103	
(T) Yttrium	97.2		97.2	

<sup>1</sup>Cp<sup>2</sup>Tc<sup>3</sup>Ss<sup>4</sup>Cn<sup>5</sup>Sr<sup>6</sup>Qc<sup>7</sup>Gl<sup>8</sup>Al<sup>9</sup>Sc

## L1467310-06 Original Sample (OS) • Duplicate (DUP)

(OS) L1467310-06 03/23/22 15:00 • (DUP) R3774012-5 03/23/22 15:00

Analyte	Original Result pCi/l	Original Uncertainty + / -	Original MDA pCi/l	DUP Result pCi/l	DUP Uncertainty + / -	DUP MDA pCi/l	Dilution	DUP RPD %	DUP RER	<u>DUP Qualifier</u>	DUP RPD Limits %	DUP RER Limit
Radium-228	1.46	0.303	0.518	1.21	0.562	0.518	1	19.2	0.401		20	3
(T) Barium	101			103	103							
(T) Yttrium	107			99.7	99.7							

## Laboratory Control Sample (LCS)

(LCS) R3774012-2 03/23/22 15:00

Analyte	Spike Amount pCi/l	LCS Result pCi/l	LCS Rec. %	Rec. Limits %	<u>LCS Qualifier</u>
Radium-228	5.00	5.16	103	80.0-120	
(T) Barium			102		
(T) Yttrium			93.8		

## L1467310-05 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1467310-05 03/23/22 15:00 • (MS) R3774012-3 03/23/22 15:00 • (MSD) R3774012-4 03/23/22 15:00

Analyte	Spike Amount pCi/l	Original Result pCi/l	MS Result pCi/l	MSD Result pCi/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	<u>MS Qualifier</u>	<u>MSD Qualifier</u>	RPD %	MS RER	RPD Limits %
Radium-228	10.0	-0.222	10.7	9.93	107	99.3	1	70.0-130			7.64		20
(T) Barium		105		105	108								
(T) Yttrium		112		102	101								

## QUALITY CONTROL SUMMARY

[L1470373-01,02,03,04,05,06,07,08,09,10,11](#)

## Method Blank (MB)

(MB) R3771020-1 03/16/22 13:34

Analyte	MB Result pCi/l	<u>MB Qualifier</u> + / -	MB Uncertainty pCi/l	MB MDA pCi/l
Radium-226	-0.000572	<u>U</u>	0.0321	0.0757
(T) Barium-133	93.9		93.9	

<sup>1</sup>Cp<sup>2</sup>Tc<sup>3</sup>Ss<sup>4</sup>Cn<sup>5</sup>Sr<sup>6</sup>Qc<sup>7</sup>Gl<sup>8</sup>Al<sup>9</sup>Sc

## L1470373-11 Original Sample (OS) • Duplicate (DUP)

(OS) L1470373-11 03/17/22 08:45 • (DUP) R3771020-5 03/16/22 13:34

Analyte	Original Result pCi/l	Original Uncertainty + / -	Original MDA pCi/l	DUP Result pCi/l	DUP Uncertainty + / -	DUP MDA pCi/l	Dilution	DUP RPD %	DUP RER	<u>DUP Qualifier</u>	DUP RPD Limits %	DUP RER Limit
Radium-226	0.0347	0.152	0.297	0.0572	0.129	0.297	1	49.1	0.113	<u>U</u>	20	3
(T) Barium-133	98.3			98.8	98.8							

## Laboratory Control Sample (LCS)

(LCS) R3771020-2 03/16/22 13:34

Analyte	Spike Amount pCi/l	LCS Result pCi/l	LCS Rec. %	Rec. Limits %	<u>LCS Qualifier</u>
Radium-226	5.02	4.84	96.4	80.0-120	
(T) Barium-133			99.8		

## L1467820-01 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1467820-01 03/16/22 13:34 • (MS) R3771020-3 03/16/22 13:34 • (MSD) R3771020-4 03/16/22 13:34

Analyte	Spike Amount pCi/l	Original Result pCi/l	MS Result pCi/l	MSD Result pCi/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	<u>MS Qualifier</u>	<u>MSD Qualifier</u>	RPD %	MS RER	RPD Limits %
Radium-226	20.1	0.164	19.6	19.0	96.6	93.6	1	75.0-125			3.16		20
(T) Barium-133		93.6			94.9	95.3							

# GLOSSARY OF TERMS

## Guide to Reading and Understanding Your Laboratory Report

The information below is designed to better explain the various terms used in your report of analytical results from the Laboratory. This is not intended as a comprehensive explanation, and if you have additional questions please contact your project representative.

**Results Disclaimer -** Information that may be provided by the customer, and contained within this report, include Permit Limits, Project Name, Sample ID, Sample Matrix, Sample Preservation, Field Blanks, Field Spikes, Field Duplicates, On-Site Data, Sampling Collection Dates/Times, and Sampling Location. Results relate to the accuracy of this information provided, and as the samples are received.

### Abbreviations and Definitions

MDA	Minimum Detectable Activity.
Rec.	Recovery.
RER	Replicate Error Ratio.
RPD	Relative Percent Difference.
SDG	Sample Delivery Group.
(T)	Tracer - A radioisotope of known concentration added to a solution of chemically equivalent radioisotopes at a known concentration to assist in monitoring the yield of the chemical separation.
Analyte	The name of the particular compound or analysis performed. Some Analyses and Methods will have multiple analytes reported.
Dilution	If the sample matrix contains an interfering material, the sample preparation volume or weight values differ from the standard, or if concentrations of analytes in the sample are higher than the highest limit of concentration that the laboratory can accurately report, the sample may be diluted for analysis. If a value different than 1 is used in this field, the result reported has already been corrected for this factor.
Limits	These are the target % recovery ranges or % difference value that the laboratory has historically determined as normal for the method and analyte being reported. Successful QC Sample analysis will target all analytes recovered or duplicated within these ranges.
Original Sample	The non-spiked sample in the prep batch used to determine the Relative Percent Difference (RPD) from a quality control sample. The Original Sample may not be included within the reported SDG.
Qualifier	This column provides a letter and/or number designation that corresponds to additional information concerning the result reported. If a Qualifier is present, a definition per Qualifier is provided within the Glossary and Definitions page and potentially a discussion of possible implications of the Qualifier in the Case Narrative if applicable.
Result	The actual analytical final result (corrected for any sample specific characteristics) reported for your sample. If there was no measurable result returned for a specific analyte, the result in this column may state "ND" (Not Detected) or "BDL" (Below Detectable Levels). The information in the results column should always be accompanied by either an MDL (Method Detection Limit) or RDL (Reporting Detection Limit) that defines the lowest value that the laboratory could detect or report for this analyte.
Uncertainty (Radiochemistry)	Confidence level of 2 sigma.
Case Narrative (Cn)	A brief discussion about the included sample results, including a discussion of any non-conformances to protocol observed either at sample receipt by the laboratory from the field or during the analytical process. If present, there will be a section in the Case Narrative to discuss the meaning of any data qualifiers used in the report.
Quality Control Summary (Qc)	This section of the report includes the results of the laboratory quality control analyses required by procedure or analytical methods to assist in evaluating the validity of the results reported for your samples. These analyses are not being performed on your samples typically, but on laboratory generated material.
Sample Chain of Custody (Sc)	This is the document created in the field when your samples were initially collected. This is used to verify the time and date of collection, the person collecting the samples, and the analyses that the laboratory is requested to perform. This chain of custody also documents all persons (excluding commercial shippers) that have had control or possession of the samples from the time of collection until delivery to the laboratory for analysis.
Sample Results (Sr)	This section of your report will provide the results of all testing performed on your samples. These results are provided by sample ID and are separated by the analyses performed on each sample. The header line of each analysis section for each sample will provide the name and method number for the analysis reported.
Sample Summary (Ss)	This section of the Analytical Report defines the specific analyses performed for each sample ID, including the dates and times of preparation and/or analysis.

### Qualifier      Description

J	The identification of the analyte is acceptable; the reported value is an estimate.
U	Below Detectable Limits: Indicates that the analyte was not detected.

<sup>1</sup> Cp

<sup>2</sup> Tc

<sup>3</sup> Ss

<sup>4</sup> Cn

<sup>5</sup> Sr

<sup>6</sup> Qc

<sup>7</sup> GI

<sup>8</sup> AI

<sup>9</sup> Sc

# ACCREDITATIONS & LOCATIONS

Pace Analytical National 12065 Lebanon Rd Mount Juliet, TN 37122

Alabama	40660	Nebraska	NE-OS-15-05
Alaska	17-026	Nevada	TN000032021-1
Arizona	AZ0612	New Hampshire	2975
Arkansas	88-0469	New Jersey—NELAP	TN002
California	2932	New Mexico <sup>1</sup>	TN00003
Colorado	TN00003	New York	11742
Connecticut	PH-0197	North Carolina	Env375
Florida	E87487	North Carolina <sup>1</sup>	DW21704
Georgia	NELAP	North Carolina <sup>3</sup>	41
Georgia <sup>1</sup>	923	North Dakota	R-140
Idaho	TN00003	Ohio—VAP	CL0069
Illinois	200008	Oklahoma	9915
Indiana	C-TN-01	Oregon	TN200002
Iowa	364	Pennsylvania	68-02979
Kansas	E-10277	Rhode Island	LA000356
Kentucky <sup>1,6</sup>	KY90010	South Carolina	84004002
Kentucky <sup>2</sup>	16	South Dakota	n/a
Louisiana	AI30792	Tennessee <sup>1,4</sup>	2006
Louisiana	LA018	Texas	T104704245-20-18
Maine	TN00003	Texas <sup>5</sup>	LAB0152
Maryland	324	Utah	TN000032021-11
Massachusetts	M-TN003	Vermont	VT2006
Michigan	9958	Virginia	110033
Minnesota	047-999-395	Washington	C847
Mississippi	TN00003	West Virginia	233
Missouri	340	Wisconsin	998093910
Montana	CERT0086	Wyoming	A2LA
A2LA – ISO 17025	1461.01	AIHA-LAP,LLC EMLAP	100789
A2LA – ISO 17025 <sup>5</sup>	1461.02	DOD	1461.01
Canada	1461.01	USDA	P330-15-00234
EPA-Crypto	TN00003		

<sup>1</sup> Drinking Water <sup>2</sup> Underground Storage Tanks <sup>3</sup> Aquatic Toxicity <sup>4</sup> Chemical/Microbiological <sup>5</sup> Mold <sup>6</sup> Wastewater n/a Accreditation not applicable

\* Not all certifications held by the laboratory are applicable to the results reported in the attached report.

\* Accreditation is only applicable to the test methods specified on each scope of accreditation held by Pace Analytical.

<sup>1</sup> Cp

<sup>2</sup> Tc

<sup>3</sup> Ss

<sup>4</sup> Cn

<sup>5</sup> Sr

<sup>6</sup> Qc

<sup>7</sup> Gl

<sup>8</sup> Al

<sup>9</sup> Sc

**TEKLAB, INC. Chain of Custody**

5445 Horseshoe Lake Road, Collinsville, IL 62234 Phone (618) 344-1004 Fax (618) 344-1005

Are the samples chilled? YES  NO  With:  Ice  Blue Ice Preserved in:  Lab  Field

**Teklab Inc**  
**5445 Horseshoe Lake Road**  
**Collinsville, IL 62234**

Cooler Temp: [ ] Sampler: J. Riley A. Bridges

Sampler: J. Riley A. Bridges

OC Level: 3

Project# 22021140

— 1 —

Sampler: J. Riley A. Bridges

OC Level:

Contact: Elizabeth A. Hurley

Email: [ehurley@teklabinc.com](mailto:ehurley@teklabinc.com)

Requested Due Date: **10-15 day TAT**

Billing/RO: 32548

Comments: Please Issue reports and invoices via email only

Please analyze for Radium 22/228 per methods specified for Vistra/Ramboll projects.

Collected at an IL site

Batch QC is required for all analyses requested. EDD requested

Phone: (618) 344-1004 ext 33

**PLEASE NOTE:**

NELAP accreditation is required on the requested analytes and must be documented as such on the final report. If your laboratory does not currently hold a NELAP accreditation for the requested method and/or analytes, please contact Teklab immediately. If your laboratory loses accreditation or is suspended for any analyte/method during the life of the contract, you must contact Teklab immediately.

Any changes to analysis/methods must be approved by Teklab Inc.

*Relinquished By Many Kemp	Date/Time 3/9/22 1600	Received By J. C.	Date/Time 3/11/22 0900

Teklab maintains a strict policy of client confidentiality and as such does not provide client/sampler information without proper authorization, and proprietary rights.  
Teklab, Inc. protects clients' confidential information as directed by local, state or federal laws. (Teklab QAM Section 9.1, TNLV1/M2, Section 4.1.5.c.)

	<u>Sample</u>	<u>Receipt</u>	<u>Checklist</u>
COC Seal Present/Intact:	<input checked="" type="checkbox"/>	<input type="checkbox"/> N	IF Applicable
COC Signed/Accurate:	<input checked="" type="checkbox"/>	<input type="checkbox"/> N	VOA Zero Headspace: <input checked="" type="checkbox"/> Y
Bottles arrive intact:	<input checked="" type="checkbox"/>	<input type="checkbox"/> N	Pres.Correct/Check: <input checked="" type="checkbox"/> Y
Correct bottles used:	<input checked="" type="checkbox"/>	<input type="checkbox"/> N	
Sufficient volume sent:	<input checked="" type="checkbox"/>	<input type="checkbox"/> N	
RAD Screen <0.5 mR/hr:	<input checked="" type="checkbox"/>	<input type="checkbox"/> N	

**3/11-NCF-L1470373 TEKLABIL****R5****Time estimate:** oh      **Time spent:** oh**Members****HM** Hailey Melson (responsible)**MB** Mark BeasleyDue on **15 March 2022 8:00 AM** for target Done

- Login Clarification needed  
 Chain of custody is incomplete  
 Please specify Metals requested  
 Please specify TCLP requested  
 Received additional samples not listed on COC  
 Sample IDs on containers do not match IDs on COC  
 Client did not "X" analysis  
 Chain of Custody is missing  
 If no COC; Received by: \_\_\_\_\_  
 If no COC; Date/Time: \_\_\_\_\_  
 If no COC; Temp./Cont.Rec./pH: \_\_\_\_\_  
 If no COC; Carrier: \_\_\_\_\_  
 If no COC; Tracking #: \_\_\_\_\_  
 Client informed by call  
 Client informed by Email  
 Client informed by Voicemail  
 Date/Time: 3/13/22  
 PM initials: MB  
 Client Contact: Elizabeth H

**Comments**

<i>Hailey Melson</i>	<i>11 March 2022 1:02 PM</i>
Missing ID: 22021140-011B	
<i>Mark Beasley</i>	<i>13 March 2022 3:11 PM</i>
Client notified	
<i>Hailey Melson</i>	<i>14 March 2022 9:24 AM</i>
Done	

July 08, 2022

Jason McLaurin  
Southern Illinois Power Cooperation  
11543 Lake of Egypt Road  
Marion, IL 62959  
TEL: (618) 964-1448  
FAX:



Illinois	100226
Kansas	E-10374
Louisiana	05002
Louisiana	05003
Oklahoma	9978

**RE:** Groundwater Monitoring

**WorkOrder:** 22050087

Dear Jason McLaurin:

TEKLAB, INC received 11 samples on 5/26/2022 07:35:00 for the analysis presented in the following report.

Samples are analyzed on an as received basis unless otherwise requested and documented. The sample results contained in this report relate only to the requested analytes of interest as directed on the chain of custody. NELAP accredited fields of testing are indicated by the letters NELAP under the Certification column. Unless otherwise documented within this report, Teklab Inc. analyzes samples utilizing the most current methods in compliance with 40CFR. All tests are performed in the Collinsville, IL laboratory unless otherwise noted in the Case Narrative.

All quality control criteria applicable to the test methods employed for this project have been satisfactorily met and are in accordance with NELAP except where noted. The following report shall not be reproduced, except in full, without the written approval of Teklab, Inc.

If you have any questions regarding these tests results, please feel free to call.

Sincerely,



Aaron Renner  
Project Manager  
(630)324-6855  
[arenner@teklabinc.com](mailto:arenner@teklabinc.com)

**Client:** Southern Illinois Power Cooperation

**Work Order:** 22050087

**Client Project:** Groundwater Monitoring

**Report Date:** 08-Jul-22

---

This reporting package includes the following:

Cover Letter	1
Report Contents	2
Definitions	3
Case Narrative	5
Accreditations	6
Laboratory Results	7
Quality Control Results	27
Receiving Check List	40
Chain of Custody	Appended

**Client:** Southern Illinois Power Cooperation

**Work Order:** 22050087

**Client Project:** Groundwater Monitoring

**Report Date:** 08-Jul-22

### Abbr Definition

\* Analytes on report marked with an asterisk are not NELAP accredited

CCV Continuing calibration verification is a check of a standard to determine the state of calibration of an instrument between recalibration.

CRQL A Client Requested Quantitation Limit is a reporting limit that varies according to customer request. The CRQL may not be less than the MDL.

DF Dilution factor is the dilution performed during analysis only and does not take into account any dilutions made during sample preparation. The reported result is final and includes all dilution factors.

DNI Did not ignite

DUP Laboratory duplicate is a replicate aliquot prepared under the same laboratory conditions and independently analyzed to obtain a measure of precision.

ICV Initial calibration verification is a check of a standard to determine the state of calibration of an instrument before sample analysis is initiated.

IDPH IL Dept. of Public Health

LCS Laboratory control sample is a sample matrix, free from the analytes of interest, spiked with verified known amounts of analytes and analyzed exactly like a sample to establish intra-laboratory or analyst specific precision and bias or to assess the performance of all or a portion of the measurement system.

LCSD Laboratory control sample duplicate is a replicate laboratory control sample that is prepared and analyzed in order to determine the precision of the approved test method. The acceptable recovery range is listed in the QC Package (provided upon request).

MBLK Method blank is a sample of a matrix similar to the batch of associated sample (when available) that is free from the analytes of interest and is processed simultaneously with and under the same conditions as samples through all steps of the analytical procedures, and in which no target analytes or interferences should present at concentrations that impact the analytical results for sample analyses.

MDL "The method detection limit is defined as the minimum measured concentration of a substance that can be reported with 99% confidence that the measured concentration is distinguishable from method blank results."

MS Matrix spike is an aliquot of matrix fortified (spiked) with known quantities of specific analytes that is subjected to the entire analytical procedures in order to determine the effect of the matrix on an approved test method's recovery system. The acceptable recovery range is listed in the QC Package (provided upon request).

MSD Matrix spike duplicate means a replicate matrix spike that is prepared and analyzed in order to determine the precision of the approved test method. The acceptable recovery range is listed in the QC Package (provided upon request).

MW Molecular weight

NC Data is not acceptable for compliance purposes

ND Not Detected at the Reporting Limit

NELAP NELAP Accredited

PQL Practical quantitation limit means the lowest level that can be reliably achieved within specified limits of precision and accuracy during routine laboratory operation conditions.

RL The reporting limit the lowest level that the data is displayed in the final report. The reporting limit may vary according to customer request or sample dilution. The reporting limit may not be less than the MDL.

RPD Relative percent difference is a calculated difference between two recoveries (ie. MS/MSD). The acceptable recovery limit is listed in the QC Package (provided upon request).

SPK The spike is a known mass of target analyte added to a blank sample or sub-sample; used to determine recovery deficiency or for other quality control purposes.

Surr Surrogates are compounds which are similar to the analytes of interest in chemical composition and behavior in the analytical process, but which are not normally found in environmental samples.

TIC Tentatively identified compound: Analytes tentatively identified in the sample by using a library search. Only results not in the calibration standard will be reported as tentatively identified compounds. Results for tentatively identified compounds that are not present in the calibration standard, but are assigned a specific chemical name based upon the library search, are calculated using total peak areas from reconstructed ion chromatograms and a response factor of one. The nearest Internal Standard is used for the calculation. The results of any TICs must be considered estimated, and are flagged with a "T". If the estimated result is above the calibration range it is flagged "ET"

TNTC Too numerous to count (> 200 CFU)

## Definitions

<http://www.teklabinc.com/>

**Client:** Southern Illinois Power Cooperation

**Work Order:** 22050087

**Client Project:** Groundwater Monitoring

**Report Date:** 08-Jul-22

### Qualifiers

- |   |  |
|---|--|
| # - Unknown hydrocarbon                               | B - Analyte detected in associated Method Blank              |
| C - RL shown is a Client Requested Quantitation Limit | E - Value above quantitation range                           |
| H - Holding times exceeded                            | I - Associated internal standard was outside method criteria |
| J - Analyte detected below quantitation limits        | M - Manual Integration used to determine area response       |
| ND - Not Detected at the Reporting Limit              | R - RPD outside accepted recovery limits                     |
| S - Spike Recovery outside recovery limits            | T - TIC(Tentatively identified compound)                     |
| X - Value exceeds Maximum Contaminant Level           |  |



## Case Narrative

<http://www.teklabinc.com/>

**Client:** Southern Illinois Power Cooperation

**Work Order:** 22050087

**Client Project:** Groundwater Monitoring

**Report Date:** 08-Jul-22

**Cooler Receipt Temp:** 4.8 °C

An employee of Teklab, Inc. collected the sample(s).

Radium-226 and Radium-228 analysis was performed by Pace Analytical Services, LLC. See attached report for results.

### Locations

<b>Collinsville</b>	
<b>Address</b>	5445 Horseshoe Lake Road Collinsville, IL 62234-7425
<b>Phone</b>	(618) 344-1004
<b>Fax</b>	(618) 344-1005
<b>Email</b>	jhriley@teklabinc.com

<b>Collinsville Air</b>	
<b>Address</b>	5445 Horseshoe Lake Road Collinsville, IL 62234-7425
<b>Phone</b>	(618) 344-1004
<b>Fax</b>	(618) 344-1005
<b>Email</b>	EHurley@teklabinc.com

<b>Springfield</b>	
<b>Address</b>	3920 Pintail Dr Springfield, IL 62711-9415
<b>Phone</b>	(217) 698-1004
<b>Fax</b>	(217) 698-1005
<b>Email</b>	KKlostermann@teklabinc.com

<b>Chicago</b>	
<b>Address</b>	1319 Butterfield Rd. Downers Grove, IL 60515
<b>Phone</b>	(630) 324-6855
<b>Fax</b>	
<b>Email</b>	arenner@teklabinc.com

<b>Kansas City</b>	
<b>Address</b>	8421 Nieman Road Lenexa, KS 66214
<b>Phone</b>	(913) 541-1998
<b>Fax</b>	(913) 541-1998
<b>Email</b>	jhriley@teklabinc.com

**Client:** Southern Illinois Power Cooperation

**Work Order:** 22050087

**Client Project:** Groundwater Monitoring

**Report Date:** 08-Jul-22

<b>State</b>	<b>Dept</b>	<b>Cert #</b>	<b>NELAP</b>	<b>Exp Date</b>	<b>Lab</b>
Illinois	IEPA	100226	NELAP	1/31/2023	Collinsville
Kansas	KDHE	E-10374	NELAP	4/30/2023	Collinsville
Louisiana	LDEQ	05002	NELAP	6/30/2023	Collinsville
Louisiana	LDEQ	05003	NELAP	6/30/2023	Collinsville
Oklahoma	ODEQ	9978	NELAP	8/31/2022	Collinsville
Arkansas	ADEQ	88-0966		3/14/2023	Collinsville
Illinois	IDPH	17584		5/31/2023	Collinsville
Iowa	IDNR	430		6/1/2024	Collinsville
Kentucky	UST	0073		1/31/2023	Collinsville
Missouri	MDNR	00930		5/31/2023	Collinsville
Missouri	MDNR	930		1/31/2025	Collinsville

**Client:** Southern Illinois Power Cooperation  
**Client Project:** Groundwater Monitoring

**Work Order:** 22050087  
**Report Date:** 08-Jul-22

**Lab ID:** 22050087-001

**Client Sample ID:** EBG

**Matrix:** GROUNDWATER

**Collection Date:** 05/24/2022 11:15

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>FIELD ELEVATION MEASUREMENTS</b>									
Depth to water from measuring point	*	0	0		8.21	ft	1	05/24/2022 11:15	R312769
Elevation of groundwater surface	*	0	0		516.66	ft	1	05/24/2022 11:15	R312769
Measuring Point Elevation	*	0	0		524.87	ft	1	05/24/2022 11:15	R312769
<b>FIELD PURGE VOLUME</b>									
Purge Volume	*	0	0		3.12	gal	1	05/24/2022 11:15	R312769
<b>STANDARD METHODS 2130 B FIELD</b>									
Turbidity	*	1.0	1.0		15	NTU	1	05/24/2022 11:15	R312769
<b>STANDARD METHODS 18TH ED. 2580 B FIELD</b>									
Oxidation-Reduction Potential	*	-300	-300		149	mV	1	05/24/2022 11:15	R312769
<b>STANDARD METHODS 2510 B FIELD</b>									
Spec. Conductance, Field	*	0	0		0.544	mS/cm	1	05/24/2022 11:15	R312769
<b>STANDARD METHODS 2550 B FIELD</b>									
Temperature	*	0	0		15.0	°C	1	05/24/2022 11:15	R312769
<b>STANDARD METHODS 4500-O G FIELD</b>									
Oxygen, Dissolved	*	0	0		4.59	mg/L	1	05/24/2022 11:15	R312769
<b>SW-846 9040B FIELD</b>									
pH	*	0	1.00		6.55		1	05/24/2022 11:15	R312769
<b>STANDARD METHODS 2540 C (TOTAL) 1997, 2011</b>									
Total Dissolved Solids	NELAP	16	20		344	mg/L	1	05/27/2022 09:46	R312622
<b>STANDARD METHODS 4500-CL E (TOTAL) 1997, 2011</b>									
Chloride	NELAP	1	1		18	mg/L	1	05/31/2022 17:48	R312644
<b>SW-846 9036 (TOTAL)</b>									
Sulfate	NELAP	31	50		90	mg/L	5	05/31/2022 17:59	R312636
<b>SW-846 9214 (TOTAL)</b>									
Fluoride	NELAP	0.04	0.10		0.52	mg/L	1	06/03/2022 13:18	R312788
<b>SW-846 3005A, 6010B, METALS BY ICP (TOTAL)</b>									
Barium	NELAP	0.0007	0.0025		0.0506	mg/L	1	06/02/2022 00:36	193106
Boron	NELAP	0.0090	0.020	J	0.019	mg/L	1	06/02/2022 00:36	193106
Calcium	NELAP	0.0350	0.100		13.1	mg/L	1	06/02/2022 00:36	193106
<b>SW-846 3005A, 6020A, METALS BY ICPMS (TOTAL)</b>									
Antimony	NELAP	0.0004	0.0010		< 0.0010	mg/L	5	05/27/2022 11:14	193106
Arsenic	NELAP	0.0004	0.0010	J	0.0005	mg/L	5	05/27/2022 11:14	193106
Beryllium	NELAP	0.0002	0.0010		< 0.0010	mg/L	5	05/27/2022 11:14	193106
Cadmium	NELAP	0.0002	0.0010		< 0.0010	mg/L	5	05/27/2022 11:14	193106
Chromium	NELAP	0.0007	0.0015	J	0.0007	mg/L	5	05/27/2022 11:14	193106
Cobalt	NELAP	0.0001	0.0010	J	0.0003	mg/L	5	05/27/2022 11:14	193106
Lead	NELAP	0.0006	0.0010		< 0.0010	mg/L	5	05/27/2022 11:14	193106
Lithium	*	0.0015	0.0030		0.0166	mg/L	5	06/03/2022 13:52	193229
Molybdenum	NELAP	0.0006	0.0015		0.0021	mg/L	5	05/27/2022 11:14	193106
Selenium	NELAP	0.0006	0.0010	J	0.0007	mg/L	5	05/27/2022 11:14	193106
Thallium	NELAP	0.0010	0.0020		< 0.0020	mg/L	5	05/27/2022 11:14	193106
<b>SW-846 7470A (TOTAL)</b>									
Mercury	NELAP	0.00006	0.00020		< 0.00020	mg/L	1	05/31/2022 15:31	193178
<b>EPA 903.0/904.0, RADIUM 226/228</b>									
Radium-226	*	0	0		See Attached	pci/L	1	06/10/2022 00:00	R314163



## Laboratory Results

<http://www.teklabinc.com/>

**Client:** Southern Illinois Power Cooperation

**Work Order:** 22050087

**Client Project:** Groundwater Monitoring

**Report Date:** 08-Jul-22

**Lab ID:** 22050087-001

**Client Sample ID:** EBG

**Matrix:** GROUNDWATER

**Collection Date:** 05/24/2022 11:15

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>EPA 903.0/904.0, RADIUM 226/228</b>									
Radium-228	*	0	0		See Attached	pCi/L	1	06/10/2022 00:00	R314163

**Client:** Southern Illinois Power Cooperation  
**Client Project:** Groundwater Monitoring

**Work Order:** 22050087  
**Report Date:** 08-Jul-22

**Lab ID:** 22050087-002

**Client Sample ID:** EP-1

**Matrix:** GROUNDWATER

**Collection Date:** 05/24/2022 13:00

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>FIELD ELEVATION MEASUREMENTS</b>									
Depth to water from measuring point	*	0	0		6.51	ft	1	05/24/2022 13:00	R312769
Elevation of groundwater surface	*	0	0		513.21	ft	1	05/24/2022 13:00	R312769
Measuring Point Elevation	*	0	0		519.72	ft	1	05/24/2022 13:00	R312769
<b>FIELD PURGE VOLUME</b>									
Purge Volume	*	0	0		0.65	gal	1	05/24/2022 13:00	R312769
<b>STANDARD METHODS 2130 B FIELD</b>									
Turbidity	*	1.0	1.0		< 1.0	NTU	1	05/24/2022 13:00	R312769
<b>STANDARD METHODS 18TH ED. 2580 B FIELD</b>									
Oxidation-Reduction Potential	*	-300	-300		166	mV	1	05/24/2022 13:00	R312769
<b>STANDARD METHODS 2510 B FIELD</b>									
Spec. Conductance, Field	*	0	0		2.80	mS/cm	1	05/24/2022 13:00	R312769
<b>STANDARD METHODS 2550 B FIELD</b>									
Temperature	*	0	0		15.0	°C	1	05/24/2022 13:00	R312769
<b>STANDARD METHODS 4500-O G FIELD</b>									
Oxygen, Dissolved	*	0	0		0.56	mg/L	1	05/24/2022 13:00	R312769
<b>SW-846 9040B FIELD</b>									
pH	*	0	1.00		6.20		1	05/24/2022 13:00	R312769
<b>STANDARD METHODS 2540 C (TOTAL) 1997, 2011</b>									
Total Dissolved Solids	NELAP	16	20		2530	mg/L	1	05/27/2022 09:46	R312622
<b>STANDARD METHODS 4500-CL E (TOTAL) 1997, 2011</b>									
Chloride	NELAP	2	5		38	mg/L	5	05/31/2022 18:10	R312644
<b>SW-846 9036 (TOTAL)</b>									
Sulfate	NELAP	307	500		1470	mg/L	50	05/31/2022 18:14	R312636
<b>SW-846 9214 (TOTAL)</b>									
Fluoride	NELAP	0.04	0.10		0.18	mg/L	1	06/03/2022 13:20	R312788
<b>SW-846 3005A, 6010B, METALS BY ICP (TOTAL)</b>									
Barium	NELAP	0.0007	0.0025		0.0170	mg/L	1	06/02/2022 00:40	193106
Boron	NELAP	0.0090	0.0200		0.991	mg/L	1	06/02/2022 00:40	193106
Calcium	NELAP	0.0350	0.100		508	mg/L	1	06/02/2022 00:40	193106
<b>SW-846 3005A, 6020A, METALS BY ICPMS (TOTAL)</b>									
Antimony	NELAP	0.0004	0.0010		< 0.0010	mg/L	5	05/27/2022 11:20	193106
Arsenic	NELAP	0.0004	0.0010		< 0.0010	mg/L	5	05/27/2022 11:20	193106
Beryllium	NELAP	0.0002	0.0010		< 0.0010	mg/L	5	05/27/2022 11:20	193106
Cadmium	NELAP	0.0002	0.0010		< 0.0010	mg/L	5	05/27/2022 11:20	193106
Chromium	NELAP	0.0007	0.0015		< 0.0015	mg/L	5	05/27/2022 11:20	193106
Cobalt	NELAP	0.0001	0.0010	J	0.0002	mg/L	5	05/27/2022 11:20	193106
Lead	NELAP	0.0006	0.0010		< 0.0010	mg/L	5	05/27/2022 11:20	193106
Lithium	*	0.0015	0.0030		0.0103	mg/L	5	06/03/2022 13:58	193229
Molybdenum	NELAP	0.0006	0.0015		< 0.0015	mg/L	5	05/27/2022 11:20	193106
Selenium	NELAP	0.0006	0.0010		0.0026	mg/L	5	05/27/2022 11:20	193106
Thallium	NELAP	0.0010	0.0020		< 0.0020	mg/L	5	05/27/2022 11:20	193106
<b>SW-846 7470A (TOTAL)</b>									
Mercury	NELAP	0.00006	0.00020		< 0.00020	mg/L	1	06/01/2022 08:57	193178
<b>EPA 903.0/904.0, RADIUM 226/228</b>									
Radium-226	*	0	0		See Attached	pci/L	1	06/10/2022 00:00	R314163



## Laboratory Results

<http://www.teklabinc.com/>

**Client:** Southern Illinois Power Cooperation

**Work Order:** 22050087

**Client Project:** Groundwater Monitoring

**Report Date:** 08-Jul-22

**Lab ID:** 22050087-002

**Client Sample ID:** EP-1

**Matrix:** GROUNDWATER

**Collection Date:** 05/24/2022 13:00

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>EPA 903.0/904.0, RADIUM 226/228</b>									
Radium-228	*	0	0		See Attached	pCi/L	1	06/10/2022 00:00	R314163

**Client:** Southern Illinois Power Cooperation  
**Client Project:** Groundwater Monitoring

**Work Order:** 22050087  
**Report Date:** 08-Jul-22

**Lab ID:** 22050087-003

**Client Sample ID:** EP-2

**Matrix:** GROUNDWATER

**Collection Date:** 05/24/2022 15:20

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>FIELD ELEVATION MEASUREMENTS</b>									
Depth to water from measuring point	*	0	0		5.99	ft	1	05/24/2022 15:20	R312769
Elevation of groundwater surface	*	0	0		507.80	ft	1	05/24/2022 15:20	R312769
Measuring Point Elevation	*	0	0		513.79	ft	1	05/24/2022 15:20	R312769
<b>FIELD PURGE VOLUME</b>									
Purge Volume	*	0	0		0.65	gal	1	05/24/2022 15:20	R312769
<b>STANDARD METHODS 2130 B FIELD</b>									
Turbidity	*	1.0	1.0		4.3	NTU	1	05/24/2022 15:20	R312769
<b>STANDARD METHODS 18TH ED. 2580 B FIELD</b>									
Oxidation-Reduction Potential	*	-300	-300		184	mV	1	05/24/2022 15:20	R312769
<b>STANDARD METHODS 2510 B FIELD</b>									
Spec. Conductance, Field	*	0	0		2.84	mS/cm	1	05/24/2022 15:20	R312769
<b>STANDARD METHODS 2550 B FIELD</b>									
Temperature	*	0	0		16.3	°C	1	05/24/2022 15:20	R312769
<b>STANDARD METHODS 4500-O G FIELD</b>									
Oxygen, Dissolved	*	0	0		0.96	mg/L	1	05/24/2022 15:20	R312769
<b>SW-846 9040B FIELD</b>									
pH	*	0	1.00		5.97		1	05/24/2022 15:20	R312769
<b>STANDARD METHODS 2540 C (TOTAL) 1997, 2011</b>									
Total Dissolved Solids	NELAP	16	20		2460	mg/L	1	05/27/2022 09:47	R312622
<b>STANDARD METHODS 4500-CL E (TOTAL) 1997, 2011</b>									
Chloride	NELAP	1	1		33	mg/L	1	05/31/2022 18:34	R312644
<b>SW-846 9036 (TOTAL)</b>									
Sulfate	NELAP	307	500		1700	mg/L	50	05/31/2022 18:39	R312636
<b>SW-846 9214 (TOTAL)</b>									
Fluoride	NELAP	0.04	0.10		0.92	mg/L	1	06/03/2022 13:22	R312788
<b>SW-846 3005A, 6010B, METALS BY ICP (TOTAL)</b>									
Barium	NELAP	0.0007	0.0025		0.0208	mg/L	1	06/02/2022 00:43	193106
Boron	NELAP	0.0090	0.0200		0.480	mg/L	1	06/02/2022 00:43	193106
Calcium	NELAP	0.0350	0.100		347	mg/L	1	06/02/2022 00:43	193106
<b>SW-846 3005A, 6020A, METALS BY ICPMS (TOTAL)</b>									
Antimony	NELAP	0.0004	0.0010		< 0.0010	mg/L	5	06/06/2022 14:11	193229
Arsenic	NELAP	0.0004	0.0010		0.0013	mg/L	5	05/27/2022 11:26	193106
Beryllium	NELAP	0.0002	0.0010		0.0056	mg/L	5	05/27/2022 11:26	193106
Cadmium	NELAP	0.0002	0.0010	J	0.0003	mg/L	5	05/27/2022 11:26	193106
Chromium	NELAP	0.0007	0.0015		< 0.0015	mg/L	5	05/27/2022 11:26	193106
Cobalt	NELAP	0.0001	0.0010		0.211	mg/L	5	05/27/2022 11:26	193106
Lead	NELAP	0.0012	0.0020		< 0.0020	mg/L	10	05/31/2022 13:44	193106
Lithium	*	0.0015	0.0030		0.0381	mg/L	5	06/03/2022 14:04	193229
Molybdenum	NELAP	0.0006	0.0015		< 0.0015	mg/L	5	05/27/2022 11:26	193106
Selenium	NELAP	0.0006	0.0010		< 0.0010	mg/L	5	05/27/2022 11:26	193106
Thallium	NELAP	0.0019	0.0040		< 0.0040	mg/L	10	05/31/2022 13:44	193106
<b>SW-846 7470A (TOTAL)</b>									
Mercury	NELAP	0.00006	0.00020		< 0.00020	mg/L	1	06/01/2022 09:00	193178
<b>EPA 903.0/904.0, RADIUM 226/228</b>									
Radium-226	*	0	0		See Attached	pci/L	1	06/10/2022 00:00	R314163



## Laboratory Results

<http://www.teklabinc.com/>

**Client:** Southern Illinois Power Cooperation

**Work Order:** 22050087

**Client Project:** Groundwater Monitoring

**Report Date:** 08-Jul-22

**Lab ID:** 22050087-003

**Client Sample ID:** EP-2

**Matrix:** GROUNDWATER

**Collection Date:** 05/24/2022 15:20

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>EPA 903.0/904.0, RADIUM 226/228</b>									
Radium-228	*	0	0		See Attached	pCi/L	1	06/10/2022 00:00	R314163

**Client:** Southern Illinois Power Cooperation  
**Client Project:** Groundwater Monitoring

**Work Order:** 22050087  
**Report Date:** 08-Jul-22

**Lab ID:** 22050087-004

**Client Sample ID:** EP-3

**Matrix:** GROUNDWATER

**Collection Date:** 05/25/2022 10:28

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>FIELD ELEVATION MEASUREMENTS</b>									
Depth to water from measuring point	*	0	0		16.22	ft	1	05/25/2022 10:28	R312769
Elevation of groundwater surface	*	0	0		502.73	ft	1	05/25/2022 10:28	R312769
Measuring Point Elevation	*	0	0		518.95	ft	1	05/25/2022 10:28	R312769
<b>FIELD PURGE VOLUME</b>									
Purge Volume	*	0	0		1.56	gal	1	05/25/2022 10:28	R312769
<b>STANDARD METHODS 2130 B FIELD</b>									
Turbidity	*	1.0	1.0		1.7	NTU	1	05/25/2022 10:28	R312769
<b>STANDARD METHODS 18TH ED. 2580 B FIELD</b>									
Oxidation-Reduction Potential	*	-300	-300		-62	mV	1	05/25/2022 10:28	R312769
<b>STANDARD METHODS 2510 B FIELD</b>									
Spec. Conductance, Field	*	0	0		1.40	mS/cm	1	05/25/2022 10:28	R312769
<b>STANDARD METHODS 2550 B FIELD</b>									
Temperature	*	0	0		18.1	°C	1	05/25/2022 10:28	R312769
<b>STANDARD METHODS 4500-O G FIELD</b>									
Oxygen, Dissolved	*	0	0		0.29	mg/L	1	05/25/2022 10:28	R312769
<b>SW-846 9040B FIELD</b>									
pH	*	0	1.00		6.04		1	05/25/2022 10:28	R312769
<b>STANDARD METHODS 2540 C (TOTAL) 1997, 2011</b>									
Total Dissolved Solids	NELAP	16	20		728	mg/L	1	05/27/2022 09:47	R312622
<b>STANDARD METHODS 4500-CL E (TOTAL) 1997, 2011</b>									
Chloride	NELAP	2	5		157	mg/L	5	05/31/2022 18:42	R312644
<b>SW-846 9036 (TOTAL)</b>									
Sulfate	NELAP	31	50		160	mg/L	5	05/31/2022 18:41	R312636
<b>SW-846 9214 (TOTAL)</b>									
Fluoride	NELAP	0.04	0.10		0.19	mg/L	1	06/03/2022 13:24	R312788
<b>SW-846 3005A, 6010B, METALS BY ICP (TOTAL)</b>									
Barium	NELAP	0.0007	0.0025		0.0846	mg/L	1	06/02/2022 01:31	193106
Boron	NELAP	0.0090	0.0200		0.0670	mg/L	1	06/02/2022 01:31	193106
Calcium	NELAP	0.0350	0.100	S	40.1	mg/L	1	06/02/2022 01:31	193106
Matrix spike control limits for Ca are not applicable due to high sample/spike ratio.									
<b>SW-846 3005A, 6020A, METALS BY ICPMS (TOTAL)</b>									
Antimony	NELAP	0.0004	0.0010		< 0.0010	mg/L	5	05/27/2022 11:44	193106
Arsenic	NELAP	0.0004	0.0010		0.0075	mg/L	5	05/27/2022 11:44	193106
Beryllium	NELAP	0.0002	0.0010		< 0.0010	mg/L	5	05/27/2022 11:44	193106
Cadmium	NELAP	0.0002	0.0010		< 0.0010	mg/L	5	05/27/2022 11:44	193106
Chromium	NELAP	0.0007	0.0015		< 0.0015	mg/L	5	05/27/2022 11:44	193106
Cobalt	NELAP	0.0001	0.0010		0.121	mg/L	5	05/27/2022 11:44	193106
Lead	NELAP	0.0006	0.0010		< 0.0010	mg/L	5	05/27/2022 11:44	193106
Lithium	*	0.0015	0.0030		0.0321	mg/L	5	06/03/2022 14:20	193229
Molybdenum	NELAP	0.0006	0.0015		< 0.0015	mg/L	5	05/27/2022 11:44	193106
Selenium	NELAP	0.0006	0.0010		< 0.0010	mg/L	5	05/27/2022 11:44	193106
Thallium	NELAP	0.0010	0.0020		< 0.0020	mg/L	5	05/27/2022 11:44	193106
<b>SW-846 7470A (TOTAL)</b>									
Mercury	NELAP	0.00006	0.00020		< 0.00020	mg/L	1	06/01/2022 09:02	193178



## Laboratory Results

<http://www.teklabinc.com/>

**Client:** Southern Illinois Power Cooperation

**Work Order:** 22050087

**Client Project:** Groundwater Monitoring

**Report Date:** 08-Jul-22

**Lab ID:** 22050087-004

**Client Sample ID:** EP-3

**Matrix:** GROUNDWATER

**Collection Date:** 05/25/2022 10:28

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>EPA 903.0/904.0, RADIUM 226/228</b>									
Radium-226	*	0	0		See Attached	pCi/L	1	06/10/2022 00:00	R314163
Radium-228	*	0	0		See Attached	pCi/L	1	06/10/2022 00:00	R314163

**Client:** Southern Illinois Power Cooperation  
**Client Project:** Groundwater Monitoring

**Work Order:** 22050087  
**Report Date:** 08-Jul-22

**Lab ID:** 22050087-005

**Client Sample ID:** EP-4

**Matrix:** GROUNDWATER

**Collection Date:** 05/25/2022 11:30

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>FIELD ELEVATION MEASUREMENTS</b>									
Depth to water from measuring point	*	0	0		7.16	ft	1	05/25/2022 11:30	R312769
Elevation of groundwater surface	*	0	0		512.58	ft	1	05/25/2022 11:30	R312769
Measuring Point Elevation	*	0	0		519.74	ft	1	05/25/2022 11:30	R312769
<b>FIELD PURGE VOLUME</b>									
Purge Volume	*	0	0		0.78	gal	1	05/25/2022 11:30	R312769
<b>STANDARD METHODS 2130 B FIELD</b>									
Turbidity	*	1.0	1.0		1.5	NTU	1	05/25/2022 11:30	R312769
<b>STANDARD METHODS 18TH ED. 2580 B FIELD</b>									
Oxidation-Reduction Potential	*	-300	-300		-39	mV	1	05/25/2022 11:30	R312769
<b>STANDARD METHODS 2510 B FIELD</b>									
Spec. Conductance, Field	*	0	0		2.84	mS/cm	1	05/25/2022 11:30	R312769
<b>STANDARD METHODS 2550 B FIELD</b>									
Temperature	*	0	0		16.7	°C	1	05/25/2022 11:30	R312769
<b>STANDARD METHODS 4500-O G FIELD</b>									
Oxygen, Dissolved	*	0	0		0.29	mg/L	1	05/25/2022 11:30	R312769
<b>SW-846 9040B FIELD</b>									
pH	*	0	1.00		5.88		1	05/25/2022 11:30	R312769
<b>STANDARD METHODS 2540 C (TOTAL) 1997, 2011</b>									
Total Dissolved Solids	NELAP	16	20		1730	mg/L	1	05/27/2022 09:47	R312622
<b>STANDARD METHODS 4500-CL E (TOTAL) 1997, 2011</b>									
Chloride	NELAP	5	10		460	mg/L	10	05/31/2022 18:50	R312644
<b>SW-846 9036 (TOTAL)</b>									
Sulfate	NELAP	123	200		531	mg/L	20	05/31/2022 18:55	R312636
<b>SW-846 9214 (TOTAL)</b>									
Fluoride	NELAP	0.04	0.10		0.12	mg/L	1	06/03/2022 13:26	R312788
<b>SW-846 3005A, 6010B, METALS BY ICP (TOTAL)</b>									
Barium	NELAP	0.0007	0.0025		0.0329	mg/L	1	06/02/2022 01:46	193106
Boron	NELAP	0.0090	0.0200		11.8	mg/L	1	06/02/2022 01:46	193106
Calcium	NELAP	0.0350	0.100		188	mg/L	1	06/02/2022 01:46	193106
<b>SW-846 3005A, 6020A, METALS BY ICPMS (TOTAL)</b>									
Antimony	NELAP	0.0004	0.0010		< 0.0010	mg/L	5	05/27/2022 11:32	193106
Arsenic	NELAP	0.0004	0.0010		0.0071	mg/L	5	05/27/2022 11:32	193106
Beryllium	NELAP	0.0002	0.0010		< 0.0010	mg/L	5	05/27/2022 11:32	193106
Cadmium	NELAP	0.0002	0.0010		< 0.0010	mg/L	5	05/27/2022 11:32	193106
Chromium	NELAP	0.0007	0.0015		< 0.0015	mg/L	5	05/27/2022 11:32	193106
Cobalt	NELAP	0.0001	0.0010		0.205	mg/L	5	05/27/2022 11:32	193106
Lead	NELAP	0.0006	0.0010		< 0.0010	mg/L	5	05/27/2022 11:32	193106
Lithium	*	0.0015	0.0030	J	0.0025	mg/L	5	06/03/2022 14:09	193229
Molybdenum	NELAP	0.0006	0.0015		< 0.0015	mg/L	5	05/27/2022 11:32	193106
Selenium	NELAP	0.0006	0.0010		< 0.0010	mg/L	5	05/27/2022 11:32	193106
Thallium	NELAP	0.0010	0.0020		< 0.0020	mg/L	5	05/27/2022 11:32	193106
<b>SW-846 7470A (TOTAL)</b>									
Mercury	NELAP	0.00006	0.00020		< 0.00020	mg/L	1	06/01/2022 09:04	193178
<b>EPA 903.0/904.0, RADIUM 226/228</b>									
Radium-226	*	0	0		See Attached	pci/L	1	06/10/2022 00:00	R314163



## Laboratory Results

<http://www.teklabinc.com/>

**Client:** Southern Illinois Power Cooperation

**Work Order:** 22050087

**Client Project:** Groundwater Monitoring

**Report Date:** 08-Jul-22

**Lab ID:** 22050087-005

**Client Sample ID:** EP-4

**Matrix:** GROUNDWATER

**Collection Date:** 05/25/2022 11:30

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>EPA 903.0/904.0, RADIUM 226/228</b>									
Radium-228	*	0	0		See Attached	pCi/L	1	06/10/2022 00:00	R314163

**Client:** Southern Illinois Power Cooperation  
**Client Project:** Groundwater Monitoring

**Work Order:** 22050087  
**Report Date:** 08-Jul-22

**Lab ID:** 22050087-006

**Client Sample ID:** EP-5

**Matrix:** GROUNDWATER

**Collection Date:** 05/24/2022 12:07

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>FIELD ELEVATION MEASUREMENTS</b>									
Depth to water from measuring point	*	0	0		10.95	ft	1	05/24/2022 12:07	R312769
Elevation of groundwater surface	*	0	0		516.64	ft	1	05/24/2022 12:07	R312769
Measuring Point Elevation	*	0	0		527.59	ft	1	05/24/2022 12:07	R312769
<b>FIELD PURGE VOLUME</b>									
Purge Volume	*	0	0		0.65	gal	1	05/24/2022 12:07	R312769
<b>STANDARD METHODS 2130 B FIELD</b>									
Turbidity	*	1.0	1.0		< 1.0	NTU	1	05/24/2022 12:07	R312769
<b>STANDARD METHODS 18TH ED. 2580 B FIELD</b>									
Oxidation-Reduction Potential	*	-300	-300		147	mV	1	05/24/2022 12:07	R312769
<b>STANDARD METHODS 2510 B FIELD</b>									
Spec. Conductance, Field	*	0	0		0.473	mS/cm	1	05/24/2022 12:07	R312769
<b>STANDARD METHODS 2550 B FIELD</b>									
Temperature	*	0	0		13.9	°C	1	05/24/2022 12:07	R312769
<b>STANDARD METHODS 4500-O G FIELD</b>									
Oxygen, Dissolved	*	0	0		4.46	mg/L	1	05/24/2022 12:07	R312769
<b>SW-846 9040B FIELD</b>									
pH	*	0	1.00		6.55		1	05/24/2022 12:07	R312769
<b>STANDARD METHODS 2540 C (TOTAL) 1997, 2011</b>									
Total Dissolved Solids	NELAP	16	20		322	mg/L	1	05/27/2022 09:47	R312622
<b>STANDARD METHODS 4500-CL E (TOTAL) 1997, 2011</b>									
Chloride	NELAP	1	1		3	mg/L	1	05/31/2022 18:58	R312644
<b>SW-846 9036 (TOTAL)</b>									
Sulfate	NELAP	31	50		132	mg/L	5	05/31/2022 19:02	R312636
<b>SW-846 9214 (TOTAL)</b>									
Fluoride	NELAP	0.04	0.10		0.38	mg/L	1	06/03/2022 13:29	R312788
<b>SW-846 3005A, 6010B, METALS BY ICP (TOTAL)</b>									
Barium	NELAP	0.0007	0.0025		0.0529	mg/L	1	06/02/2022 01:24	193106
Boron	NELAP	0.0090	0.0200		0.0254	mg/L	1	06/02/2022 01:24	193106
Calcium	NELAP	0.0350	0.100		21.0	mg/L	1	06/02/2022 01:24	193106
<b>SW-846 3005A, 6020A, METALS BY ICPMS (TOTAL)</b>									
Antimony	NELAP	0.0004	0.0010		< 0.0010	mg/L	5	05/27/2022 11:38	193106
Arsenic	NELAP	0.0004	0.0010		< 0.0010	mg/L	5	05/27/2022 11:38	193106
Beryllium	NELAP	0.0002	0.0010		< 0.0010	mg/L	5	05/27/2022 11:38	193106
Cadmium	NELAP	0.0002	0.0010		< 0.0010	mg/L	5	05/27/2022 11:38	193106
Chromium	NELAP	0.0007	0.0015		< 0.0015	mg/L	5	05/27/2022 11:38	193106
Cobalt	NELAP	0.0001	0.0010		< 0.0010	mg/L	5	05/27/2022 11:38	193106
Lead	NELAP	0.0006	0.0010		< 0.0010	mg/L	5	05/27/2022 11:38	193106
Lithium	*	0.0015	0.0030	J	0.0023	mg/L	5	06/03/2022 14:15	193229
Molybdenum	NELAP	0.0006	0.0015		0.0027	mg/L	5	05/27/2022 11:38	193106
Selenium	NELAP	0.0006	0.0010		0.0015	mg/L	5	05/27/2022 11:38	193106
Thallium	NELAP	0.0010	0.0020		< 0.0020	mg/L	5	05/27/2022 11:38	193106
<b>SW-846 7470A (TOTAL)</b>									
Mercury	NELAP	0.00006	0.00020		< 0.00020	mg/L	1	06/01/2022 09:11	193178
<b>EPA 903.0/904.0, RADIUM 226/228</b>									
Radium-226	*	0	0		See Attached	pci/L	1	06/10/2022 00:00	R314163



## Laboratory Results

<http://www.teklabinc.com/>

**Client:** Southern Illinois Power Cooperation

**Work Order:** 22050087

**Client Project:** Groundwater Monitoring

**Report Date:** 08-Jul-22

**Lab ID:** 22050087-006

**Client Sample ID:** EP-5

**Matrix:** GROUNDWATER

**Collection Date:** 05/24/2022 12:07

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>EPA 903.0/904.0, RADIUM 226/228</b>									
Radium-228	*	0	0		See Attached	pCi/L	1	06/10/2022 00:00	R314163

**Client:** Southern Illinois Power Cooperation  
**Client Project:** Groundwater Monitoring

**Work Order:** 22050087  
**Report Date:** 08-Jul-22

**Lab ID:** 22050087-007

**Client Sample ID:** EP-6

**Matrix:** GROUNDWATER

**Collection Date:** 05/24/2022 14:15

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>FIELD ELEVATION MEASUREMENTS</b>									
Depth to water from measuring point	*	0	0		2.69	ft	1	05/24/2022 14:15	R312769
Elevation of groundwater surface	*	0	0		502.42	ft	1	05/24/2022 14:15	R312769
Measuring Point Elevation	*	0	0		505.11	ft	1	05/24/2022 14:15	R312769
<b>FIELD PURGE VOLUME</b>									
Purge Volume	*	0	0		1.30	gal	1	05/24/2022 14:15	R312769
<b>STANDARD METHODS 2130 B FIELD</b>									
Turbidity	*	1.0	1.0		3.3	NTU	1	05/24/2022 14:15	R312769
<b>STANDARD METHODS 18TH ED. 2580 B FIELD</b>									
Oxidation-Reduction Potential	*	-300	-300		182	mV	1	05/24/2022 14:15	R312769
<b>STANDARD METHODS 2510 B FIELD</b>									
Spec. Conductance, Field	*	0	0		0.301	mS/cm	1	05/24/2022 14:15	R312769
<b>STANDARD METHODS 2550 B FIELD</b>									
Temperature	*	0	0		15.4	°C	1	05/24/2022 14:15	R312769
<b>STANDARD METHODS 4500-O G FIELD</b>									
Oxygen, Dissolved	*	0	0		1.05	mg/L	1	05/24/2022 14:15	R312769
<b>SW-846 9040B FIELD</b>									
pH	*	0	1.00		5.07		1	05/24/2022 14:15	R312769
<b>STANDARD METHODS 2540 C (TOTAL) 1997, 2011</b>									
Total Dissolved Solids	NELAP	16	20		238	mg/L	1	05/27/2022 09:48	R312622
<b>STANDARD METHODS 4500-CL E (TOTAL) 1997, 2011</b>									
Chloride	NELAP	1	1		24	mg/L	1	05/31/2022 19:08	R312644
<b>SW-846 9036 (TOTAL)</b>									
Sulfate	NELAP	12	20		63	mg/L	2	05/31/2022 19:35	R312636
<b>SW-846 9214 (TOTAL)</b>									
Fluoride	NELAP	0.04	0.10	J	0.06	mg/L	1	06/03/2022 13:31	R312788
<b>SW-846 3005A, 6010B, METALS BY ICP (TOTAL)</b>									
Barium	NELAP	0.0007	0.0025		0.0340	mg/L	1	06/02/2022 01:28	193106
Boron	NELAP	0.0090	0.0200		< 0.0200	mg/L	1	06/02/2022 01:28	193106
Calcium	NELAP	0.0350	0.100		1.65	mg/L	1	06/02/2022 01:28	193106
<b>SW-846 3005A, 6020A, METALS BY ICPMS (TOTAL)</b>									
Antimony	NELAP	0.0004	0.0010		< 0.0010	mg/L	5	05/27/2022 13:18	193106
Arsenic	NELAP	0.0004	0.0010		< 0.0010	mg/L	5	05/27/2022 13:18	193106
Beryllium	NELAP	0.0002	0.0010		< 0.0010	mg/L	5	05/27/2022 13:18	193106
Cadmium	NELAP	0.0002	0.0010		< 0.0010	mg/L	5	05/27/2022 13:18	193106
Chromium	NELAP	0.0007	0.0015	J	0.0008	mg/L	5	05/27/2022 13:18	193106
Cobalt	NELAP	0.0001	0.0010	J	0.0007	mg/L	5	05/27/2022 13:18	193106
Lead	NELAP	0.0006	0.0010		< 0.0010	mg/L	5	05/27/2022 13:18	193106
Lithium	*	0.0015	0.0030		0.0110	mg/L	5	06/03/2022 15:11	193229
Molybdenum	NELAP	0.0006	0.0015		< 0.0015	mg/L	5	05/27/2022 13:18	193106
Selenium	NELAP	0.0006	0.0010		< 0.0010	mg/L	5	05/27/2022 13:18	193106
Thallium	NELAP	0.0010	0.0020		< 0.0020	mg/L	5	05/27/2022 13:18	193106
<b>SW-846 7470A (TOTAL)</b>									
Mercury	NELAP	0.00006	0.00020		< 0.00020	mg/L	1	05/31/2022 15:50	193178
<b>EPA 903.0/904.0, RADIUM 226/228</b>									
Radium-226	*	0	0		See Attached	pci/L	1	06/10/2022 00:00	R314163



## Laboratory Results

<http://www.teklabinc.com/>

**Client:** Southern Illinois Power Cooperation

**Work Order:** 22050087

**Client Project:** Groundwater Monitoring

**Report Date:** 08-Jul-22

**Lab ID:** 22050087-007

**Client Sample ID:** EP-6

**Matrix:** GROUNDWATER

**Collection Date:** 05/24/2022 14:15

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>EPA 903.0/904.0, RADIUM 226/228</b>									
Radium-228	*	0	0		See Attached	pCi/L	1	06/10/2022 00:00	R314163

**Client:** Southern Illinois Power Cooperation  
**Client Project:** Groundwater Monitoring

**Work Order:** 22050087  
**Report Date:** 08-Jul-22

**Lab ID:** 22050087-008

**Client Sample ID:** EP-7

**Matrix:** GROUNDWATER

**Collection Date:** 05/25/2022 08:48

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>FIELD ELEVATION MEASUREMENTS</b>									
Depth to water from measuring point	*	0	0		13.73	ft	1	05/25/2022 08:48	R312769
Elevation of groundwater surface	*	0	0		501.71	ft	1	05/25/2022 08:48	R312769
Measuring Point Elevation	*	0	0		515.44	ft	1	05/25/2022 08:48	R312769
<b>FIELD PURGE VOLUME</b>									
Purge Volume	*	0	0		1.95	gal	1	05/25/2022 08:48	R312769
<b>STANDARD METHODS 2130 B FIELD</b>									
Turbidity	*	1.0	1.0		1.8	NTU	1	05/25/2022 08:48	R312769
<b>STANDARD METHODS 18TH ED. 2580 B FIELD</b>									
Oxidation-Reduction Potential	*	-300	-300		-11	mV	1	05/25/2022 08:48	R312769
<b>STANDARD METHODS 2510 B FIELD</b>									
Spec. Conductance, Field	*	0	0		2.03	mS/cm	1	05/25/2022 08:48	R312769
<b>STANDARD METHODS 2550 B FIELD</b>									
Temperature	*	0	0		16.0	°C	1	05/25/2022 08:48	R312769
<b>STANDARD METHODS 4500-O G FIELD</b>									
Oxygen, Dissolved	*	0	0		0.31	mg/L	1	05/25/2022 08:48	R312769
<b>SW-846 9040B FIELD</b>									
pH	*	0	1.00		5.74		1	05/25/2022 08:48	R312769
<b>STANDARD METHODS 2540 C (TOTAL) 1997, 2011</b>									
Total Dissolved Solids	NELAP	16	20		1210	mg/L	1	05/27/2022 09:48	R312622
<b>STANDARD METHODS 4500-CL E (TOTAL) 1997, 2011</b>									
Chloride	NELAP	10	20		254	mg/L	20	05/31/2022 19:51	R312644
<b>SW-846 9036 (TOTAL)</b>									
Sulfate	NELAP	123	200		400	mg/L	20	05/31/2022 19:51	R312636
<b>SW-846 9214 (TOTAL)</b>									
Fluoride	NELAP	0.04	0.10		0.22	mg/L	1	06/03/2022 13:33	R312788
<b>SW-846 3005A, 6010B, METALS BY ICP (TOTAL)</b>									
Barium	NELAP	0.0007	0.0025		0.0325	mg/L	1	06/01/2022 23:59	193127
Boron	NELAP	0.0090	0.0200		0.682	mg/L	1	06/01/2022 23:59	193127
Calcium	NELAP	0.0350	0.100		128	mg/L	1	06/01/2022 23:59	193127
<b>SW-846 3005A, 6020A, METALS BY ICPMS (TOTAL)</b>									
Antimony	NELAP	0.0004	0.0010		< 0.0010	mg/L	5	05/31/2022 20:05	193127
Arsenic	NELAP	0.0004	0.0010		0.0139	mg/L	5	05/31/2022 20:05	193127
Beryllium	NELAP	0.0002	0.0010		< 0.0010	mg/L	5	05/31/2022 20:05	193127
Cadmium	NELAP	0.0002	0.0010		< 0.0010	mg/L	5	05/31/2022 20:05	193127
Chromium	NELAP	0.0007	0.0015		0.0017	mg/L	5	06/06/2022 14:16	193229
Cobalt	NELAP	0.0001	0.0010		0.161	mg/L	5	05/31/2022 20:05	193127
Lead	NELAP	0.0006	0.0010	J	0.0008	mg/L	5	05/31/2022 20:05	193127
Lithium	*	0.0015	0.0030	J	0.0019	mg/L	5	06/03/2022 15:17	193229
Molybdenum	NELAP	0.0006	0.0015	J	0.0007	mg/L	5	05/31/2022 20:05	193127
Selenium	NELAP	0.0006	0.0010		< 0.0010	mg/L	5	05/31/2022 20:05	193127
Thallium	NELAP	0.0010	0.0020		< 0.0020	mg/L	5	05/31/2022 20:05	193127
<b>SW-846 7470A (TOTAL)</b>									
Mercury	NELAP	0.00006	0.00020		< 0.00020	mg/L	1	06/01/2022 09:14	193178
<b>EPA 903.0/904.0, RADIUM 226/228</b>									
Radium-226	*	0	0		See Attached	pci/L	1	06/10/2022 00:00	R314163



## Laboratory Results

<http://www.teklabinc.com/>

**Client:** Southern Illinois Power Cooperation

**Work Order:** 22050087

**Client Project:** Groundwater Monitoring

**Report Date:** 08-Jul-22

**Lab ID:** 22050087-008

**Client Sample ID:** EP-7

**Matrix:** GROUNDWATER

**Collection Date:** 05/25/2022 08:48

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>EPA 903.0/904.0, RADIUM 226/228</b>									
Radium-228	*	0	0		See Attached	pCi/L	1	06/10/2022 00:00	R314163

**Client:** Southern Illinois Power Cooperation

**Work Order:** 22050087

**Client Project:** Groundwater Monitoring

**Report Date:** 08-Jul-22

**Lab ID:** 22050087-009

**Client Sample ID:** Equipment Blank

**Matrix:** AQUEOUS

**Collection Date:** 05/25/2022 11:34

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>STANDARD METHODS 2540 C (TOTAL) 1997, 2011</b>									
Total Dissolved Solids	NELAP	16	20		< 20	mg/L	1	05/27/2022 09:48	R312622
<b>STANDARD METHODS 4500-CL E (TOTAL) 1997, 2011</b>									
Chloride	NELAP	1	1		< 1	mg/L	1	05/31/2022 19:54	R312644
<b>SW-846 9036 (TOTAL)</b>									
Sulfate	NELAP	6	10		< 10	mg/L	1	05/31/2022 19:53	R312636
<b>SW-846 9214 (TOTAL)</b>									
Fluoride	NELAP	0.04	0.10		< 0.10	mg/L	1	06/03/2022 13:49	R312788
<b>SW-846 3005A, 6010B, METALS BY ICP (TOTAL)</b>									
Barium	NELAP	0.0007	0.0025		< 0.0025	mg/L	1	06/02/2022 00:03	193127
Boron	NELAP	0.0090	0.0200		< 0.0200	mg/L	1	06/02/2022 00:03	193127
Calcium	NELAP	0.0350	0.100		< 0.100	mg/L	1	06/02/2022 00:03	193127
<b>SW-846 3005A, 6020A, METALS BY ICPMS (TOTAL)</b>									
Antimony	NELAP	0.0004	0.0010		< 0.0010	mg/L	5	05/31/2022 20:11	193127
Arsenic	NELAP	0.0004	0.0010		< 0.0010	mg/L	5	05/31/2022 20:11	193127
Beryllium	NELAP	0.0002	0.0010		< 0.0010	mg/L	5	05/31/2022 20:11	193127
Cadmium	NELAP	0.0002	0.0010		< 0.0010	mg/L	5	05/31/2022 20:11	193127
Chromium	NELAP	0.0007	0.0015		< 0.0015	mg/L	5	06/01/2022 10:54	193127
Cobalt	NELAP	0.0001	0.0010		< 0.0010	mg/L	5	05/31/2022 20:11	193127
Lead	NELAP	0.0006	0.0010		< 0.0010	mg/L	5	05/31/2022 20:11	193127
Lithium	*	0.0015	0.0030		< 0.0030	mg/L	5	06/03/2022 15:23	193229
Molybdenum	NELAP	0.0006	0.0015		< 0.0015	mg/L	5	05/31/2022 20:11	193127
Selenium	NELAP	0.0006	0.0010		< 0.0010	mg/L	5	05/31/2022 20:11	193127
Thallium	NELAP	0.0010	0.0020		< 0.0020	mg/L	5	05/31/2022 20:11	193127
<b>SW-846 7470A (TOTAL)</b>									
Mercury	NELAP	0.00006	0.00020		< 0.00020	mg/L	1	06/01/2022 09:16	193178
<b>EPA 903.0/904.0, RADIUM 226/228</b>									
Radium-226	*	0	0		See Attached	pci/L	1	06/10/2022 00:00	R314163
Radium-228	*	0	0		See Attached	pci/L	1	06/10/2022 00:00	R314163

**Client:** Southern Illinois Power Cooperation

**Work Order:** 22050087

**Client Project:** Groundwater Monitoring

**Report Date:** 08-Jul-22

**Lab ID:** 22050087-010

**Client Sample ID:** Field Blank

**Matrix:** AQUEOUS

**Collection Date:** 05/24/2022 15:24

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>STANDARD METHODS 2540 C (TOTAL) 1997, 2011</b>									
Total Dissolved Solids	NELAP	16	20		< 20	mg/L	1	05/27/2022 09:49	R312622
<b>STANDARD METHODS 4500-CL E (TOTAL) 1997, 2011</b>									
Chloride	NELAP	1	1		< 1	mg/L	1	05/31/2022 19:59	R312644
<b>SW-846 9036 (TOTAL)</b>									
Sulfate	NELAP	6	10		< 10	mg/L	1	05/31/2022 19:59	R312636
<b>SW-846 9214 (TOTAL)</b>									
Fluoride	NELAP	0.04	0.10		< 0.10	mg/L	1	06/03/2022 13:52	R312788
<b>SW-846 3005A, 6010B, METALS BY ICP (TOTAL)</b>									
Barium	NELAP	0.0007	0.0025		< 0.0025	mg/L	1	06/02/2022 00:06	193127
Boron	NELAP	0.0090	0.0200		< 0.0200	mg/L	1	06/02/2022 00:06	193127
Calcium	NELAP	0.0350	0.100		< 0.100	mg/L	1	06/02/2022 00:06	193127
<b>SW-846 3005A, 6020A, METALS BY ICPMS (TOTAL)</b>									
Antimony	NELAP	0.0004	0.0010		< 0.0010	mg/L	5	05/31/2022 20:17	193127
Arsenic	NELAP	0.0004	0.0010		< 0.0010	mg/L	5	05/31/2022 20:17	193127
Beryllium	NELAP	0.0002	0.0010		< 0.0010	mg/L	5	05/31/2022 20:17	193127
Cadmium	NELAP	0.0002	0.0010		< 0.0010	mg/L	5	05/31/2022 20:17	193127
Chromium	NELAP	0.0007	0.0015		< 0.0015	mg/L	5	06/01/2022 11:00	193127
Cobalt	NELAP	0.0001	0.0010		< 0.0010	mg/L	5	05/31/2022 20:17	193127
Lead	NELAP	0.0006	0.0010		< 0.0010	mg/L	5	05/31/2022 20:17	193127
Lithium	*	0.0015	0.0030		< 0.0030	mg/L	5	06/03/2022 15:28	193229
Molybdenum	NELAP	0.0006	0.0015		< 0.0015	mg/L	5	05/31/2022 20:17	193127
Selenium	NELAP	0.0006	0.0010		< 0.0010	mg/L	5	05/31/2022 20:17	193127
Thallium	NELAP	0.0010	0.0020		< 0.0020	mg/L	5	05/31/2022 20:17	193127
<b>SW-846 7470A (TOTAL)</b>									
Mercury	NELAP	0.00006	0.00020		< 0.00020	mg/L	1	05/31/2022 16:02	193178
<b>EPA 903.0/904.0, RADIUM 226/228</b>									
Radium-226	*	0	0		See Attached	pci/L	1	06/10/2022 00:00	R314163
Radium-228	*	0	0		See Attached	pci/L	1	06/10/2022 00:00	R314163

**Client:** Southern Illinois Power Cooperation  
**Client Project:** Groundwater Monitoring

**Work Order:** 22050087  
**Report Date:** 08-Jul-22

**Lab ID:** 22050087-011

**Client Sample ID:** Field Duplicate

**Matrix:** GROUNDWATER

**Collection Date:** 05/24/2022 14:15

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>FIELD ELEVATION MEASUREMENTS</b>									
Depth to water from measuring point	*	0	0		2.69	ft	1	05/24/2022 14:15	R312769
Elevation of groundwater surface	*	0	0		502.42	ft	1	05/24/2022 14:15	R312769
Measuring Point Elevation	*	0	0		505.11	ft	1	05/24/2022 14:15	R312769
<b>FIELD PURGE VOLUME</b>									
Purge Volume	*	0	0		1.30	gal	1	05/24/2022 14:15	R312769
<b>STANDARD METHODS 2130 B FIELD</b>									
Turbidity	*	1.0	1.0		3.3	NTU	1	05/24/2022 14:15	R312769
<b>STANDARD METHODS 18TH ED. 2580 B FIELD</b>									
Oxidation-Reduction Potential	*	-300	-300		182	mV	1	05/24/2022 14:15	R312769
<b>STANDARD METHODS 2510 B FIELD</b>									
Spec. Conductance, Field	*	0	0		0.301	mS/cm	1	05/24/2022 14:15	R312769
<b>STANDARD METHODS 2550 B FIELD</b>									
Temperature	*	0	0		15.4	°C	1	05/24/2022 14:15	R312769
<b>STANDARD METHODS 4500-O G FIELD</b>									
Oxygen, Dissolved	*	0	0		1.05	mg/L	1	05/24/2022 14:15	R312769
<b>SW-846 9040B FIELD</b>									
pH	*	0	1.00		5.07		1	05/24/2022 14:15	R312769
<b>STANDARD METHODS 2540 C (TOTAL) 1997, 2011</b>									
Total Dissolved Solids	NELAP	16	20		230	mg/L	1	05/27/2022 09:49	R312622
<b>STANDARD METHODS 4500-CL E (TOTAL) 1997, 2011</b>									
Chloride	NELAP	1	1		24	mg/L	1	05/31/2022 20:23	R312644
<b>SW-846 9036 (TOTAL)</b>									
Sulfate	NELAP	31	50		72	mg/L	5	06/02/2022 12:36	R312712
<b>SW-846 9214 (TOTAL)</b>									
Fluoride	NELAP	0.04	0.10	J	0.06	mg/L	1	06/03/2022 13:54	R312788
<b>SW-846 3005A, 6010B, METALS BY ICP (TOTAL)</b>									
Barium	NELAP	0.0007	0.0025		0.0366	mg/L	1	06/02/2022 00:10	193127
Boron	NELAP	0.0090	0.0200		< 0.0200	mg/L	1	06/02/2022 00:10	193127
Calcium	NELAP	0.0350	0.100		1.79	mg/L	1	06/02/2022 00:10	193127
<b>SW-846 3005A, 6020A, METALS BY ICPMS (TOTAL)</b>									
Antimony	NELAP	0.0004	0.0010		< 0.0010	mg/L	5	05/31/2022 20:23	193127
Arsenic	NELAP	0.0004	0.0010		< 0.0010	mg/L	5	05/31/2022 20:23	193127
Beryllium	NELAP	0.0002	0.0010		< 0.0010	mg/L	5	05/31/2022 20:23	193127
Cadmium	NELAP	0.0002	0.0010		< 0.0010	mg/L	5	05/31/2022 20:23	193127
Chromium	NELAP	0.0007	0.0015		0.0021	mg/L	5	06/01/2022 11:05	193127
Cobalt	NELAP	0.0001	0.0010	J	0.0010	mg/L	5	06/01/2022 11:05	193127
Lead	NELAP	0.0006	0.0010		< 0.0010	mg/L	5	05/31/2022 20:23	193127
Lithium	*	0.0015	0.0030		0.0101	mg/L	5	06/03/2022 15:34	193229
Molybdenum	NELAP	0.0006	0.0015		< 0.0015	mg/L	5	05/31/2022 20:23	193127
Selenium	NELAP	0.0006	0.0010		< 0.0010	mg/L	5	05/31/2022 20:23	193127
Thallium	NELAP	0.0010	0.0020		< 0.0020	mg/L	5	05/31/2022 20:23	193127
<b>SW-846 7470A (TOTAL)</b>									
Mercury	NELAP	0.00006	0.00020		< 0.00020	mg/L	1	05/31/2022 16:04	193178
<b>EPA 903.0/904.0, RADIUM 226/228</b>									
Radium-226	*	0	0		See Attached	pci/L	1	06/10/2022 00:00	R314163



## Laboratory Results

<http://www.teklabinc.com/>

**Client:** Southern Illinois Power Cooperation

**Work Order:** 22050087

**Client Project:** Groundwater Monitoring

**Report Date:** 08-Jul-22

**Lab ID:** 22050087-011

**Client Sample ID:** Field Duplicate

**Matrix:** GROUNDWATER

**Collection Date:** 05/24/2022 14:15

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>EPA 903.0/904.0, RADIUM 226/228</b>									
Radium-228	*	0	0		See Attached	pCi/L	1	06/10/2022 00:00	R314163



## Quality Control Results

<http://www.teklabinc.com/>

Client: Southern Illinois Power Cooperation

Work Order: 22050087

Client Project: Groundwater Monitoring

Report Date: 08-Jul-22

### STANDARD METHODS 2510 B FIELD

Batch R312769	SampType: LCS	Units $\mu\text{S}/\text{cm}$								
SampID: LCS-R312769										Date Analyzed
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Spec. Conductance, Field	*	0		1510	1409	0	106.9	90	110	05/24/2022
Spec. Conductance, Field	*	0		1400	1409	0	99.2	90	110	05/25/2022

### SW-846 9040B FIELD

Batch R312769	SampType: LCS	Units								
SampID: LCS-R312769										Date Analyzed
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
pH	*	1.00		7.02	7.000	0	100.3	98.57	101.4	05/24/2022
pH	*	1.00		7.06	7.000	0	100.9	98.57	101.4	05/25/2022

### STANDARD METHODS 2540 C (TOTAL) 1997, 2011

Batch R312622	SampType: MBLK	Units $\text{mg}/\text{L}$								
SampID: MBLK										Date Analyzed
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Total Dissolved Solids		20		< 20	16.00	0	0	-100	100	05/27/2022

### Batch R312622 SampType: LCS Units $\text{mg}/\text{L}$

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Total Dissolved Solids		20		972	1000	0	97.2	90	110	05/27/2022

### Batch R312622 SampType: DUP Units $\text{mg}/\text{L}$

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Total Dissolved Solids		20		2520				2530	0.40	05/27/2022

### Batch R312622 SampType: DUP Units $\text{mg}/\text{L}$

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Total Dissolved Solids		20		316				322.0	1.88	05/27/2022

### STANDARD METHODS 4500-CL E (TOTAL) 1997, 2011

Batch R312644	SampType: MBLK	Units $\text{mg}/\text{L}$								
SampID: ICB/MBLK										Date Analyzed
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Chloride		1		< 1	0.5000	0	0	-100	100	05/31/2022



## Quality Control Results

<http://www.teklabinc.com/>

Client: Southern Illinois Power Cooperation

Work Order: 22050087

Client Project: Groundwater Monitoring

Report Date: 08-Jul-22

### STANDARD METHODS 4500-CL E (TOTAL) 1997, 2011

Batch R312644	SampType:	LCS	Units mg/L							
SampID:		ICV/LCS							Date Analyzed	
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Chloride		1		21	20.00	0	106.3	90	110	05/31/2022

Batch R312644	SampType:	MS	Units mg/L							
SampID:		22050087-001AMS							Date Analyzed	
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Chloride		1		36	20.00	17.63	92.8	85	115	05/31/2022

Batch R312644	SampType:	MSD	Units mg/L		RPD Limit 15					
SampID:		22050087-001AMSD							Date Analyzed	
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Chloride		1		36	20.00	17.63	92.2	36.19	0.33	05/31/2022

Batch R312644	SampType:	MS	Units mg/L							
SampID:		22050087-007AMS							Date Analyzed	
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Chloride		1		41	20.00	23.81	86.4	85	115	05/31/2022

Batch R312644	SampType:	MSD	Units mg/L		RPD Limit 15					
SampID:		22050087-007AMSD							Date Analyzed	
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Chloride		1		42	20.00	23.81	89.8	41.08	1.69	05/31/2022

Batch R312644	SampType:	MS	Units mg/L							
SampID:		22050087-010AMS							Date Analyzed	
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Chloride		1		20	20.00	0	100.2	85	115	05/31/2022

Batch R312644	SampType:	MSD	Units mg/L		RPD Limit 15					
SampID:		22050087-010AMSD							Date Analyzed	
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Chloride		1		20	20.00	0	99.8	20.03	0.35	05/31/2022

Batch R312644	SampType:	MS	Units mg/L							
SampID:		22051671-004DMS							Date Analyzed	
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Chloride		5		156	100.0	61.45	94.7	85	115	05/31/2022



## Quality Control Results

<http://www.teklabinc.com/>

Client: Southern Illinois Power Cooperation

Work Order: 22050087

Client Project: Groundwater Monitoring

Report Date: 08-Jul-22

### STANDARD METHODS 4500-CL E (TOTAL) 1997, 2011

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Chloride		5		155	100.0	61.45	93.2	156.2	0.95	05/31/2022

### Batch R312644 SampType: MS Units mg/L

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Chloride		1		22	20.00	1.950	100.3	85	115	05/31/2022

### Batch R312644 SampType: MSD Units mg/L

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Chloride		1		22	20.00	1.950	100.8	22.01	0.50	05/31/2022

### SW-846 9036 (TOTAL)

#### Batch R312636 SampType: MBLK Units mg/L

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Sulfate		10		< 10	6.140	0	0	-100	100	05/31/2022

#### Batch R312636 SampType: LCS Units mg/L

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Sulfate		10		19	20.00	0	96.8	90	110	05/31/2022

#### Batch R312636 SampType: MS Units mg/L

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Sulfate		50		186	100.0	89.58	96.7	85	115	05/31/2022

#### Batch R312636 SampType: MSD Units mg/L

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Sulfate		50		191	100.0	89.58	101.4	186.2	2.51	05/31/2022



## Quality Control Results

<http://www.teklabinc.com/>

Client: Southern Illinois Power Cooperation

Work Order: 22050087

Client Project: Groundwater Monitoring

Report Date: 08-Jul-22

### SW-846 9036 (TOTAL)

Batch R312636 SampType: MS		Units mg/L								
SampID: 22050087-007AMS										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Sulfate		20		100	40.00	63.18	91.1	85	115	05/31/2022

Batch R312636 SampType: MSD		Units mg/L		RPD Limit 10						
SampID: 22050087-007AMSD										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Sulfate		20	E	103	40.00	63.18	99.8	99.63	3.44	05/31/2022

Batch R312636 SampType: MS		Units mg/L								
SampID: 22050087-010AMS										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Sulfate		10		18	20.00	0	91.4	85	115	05/31/2022

Batch R312636 SampType: MSD		Units mg/L		RPD Limit 10						
SampID: 22050087-010AMSD										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Sulfate		10		20	20.00	0	98.0	18.27	6.97	05/31/2022

Batch R312636 SampType: MS		Units mg/L								
SampID: 22051774-003CMS										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Sulfate		10	E	56	20.00	35.98	98.4	85	115	05/31/2022

Batch R312636 SampType: MSD		Units mg/L		RPD Limit 10						
SampID: 22051774-003CMSD										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Sulfate		10	E	56	20.00	35.98	100.6	55.67	0.75	05/31/2022

Batch R312712 SampType: MBLK		Units mg/L								
SampID: ICB/MBLK										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Sulfate		10		< 10	6.140	0	0	-100	100	06/02/2022

Batch R312712 SampType: LCS		Units mg/L								
SampID: ICV/LCS										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Sulfate		10		20	20.00	0	98.6	90	110	06/02/2022



## Quality Control Results

<http://www.teklabinc.com/>

Client: Southern Illinois Power Cooperation

Work Order: 22050087

Client Project: Groundwater Monitoring

Report Date: 08-Jul-22

### SW-846 9036 (TOTAL)

Batch R312712 SampType: MS		Units mg/L								
SampID: 22051671-004DMS										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Sulfate		20	E	101	40.00	64.23	92.0	90	110	06/02/2022

Batch R312712 SampType: MSD		Units mg/L		RPD Limit 10						
SampID: 22051671-004DMSD										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Sulfate		20	E	102	40.00	64.23	95.3	101.0	1.29	06/02/2022

Batch R312712 SampType: MS		Units mg/L								
SampID: 22051771-002AMS										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Sulfate		10	S	34	20.00	17.29	84.7	85	115	06/02/2022

Batch R312712 SampType: MSD		Units mg/L		RPD Limit 10						
SampID: 22051771-002AMSD										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Sulfate		10	S	34	20.00	17.29	82.9	34.23	1.06	06/02/2022

Batch R312712 SampType: MS		Units mg/L								
SampID: 22051771-010AMS										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Sulfate		10		49	20.00	30.00	95.6	85	115	06/02/2022

Batch R312712 SampType: MSD		Units mg/L		RPD Limit 10						
SampID: 22051771-010AMSD										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Sulfate		10		49	20.00	30.00	95.9	49.12	0.12	06/02/2022

SW-846 9214 (TOTAL)										
Batch R312788 SampType: MBLK		Units mg/L								
SampID: MBLK										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Fluoride		0.10		< 0.10	0.0370	0	0	-100	100	06/03/2022



## Quality Control Results

<http://www.teklabinc.com/>

Client: Southern Illinois Power Cooperation

Work Order: 22050087

Client Project: Groundwater Monitoring

Report Date: 08-Jul-22

### SW-846 9214 (TOTAL)

Batch R312788	SampType: LCS	Units mg/L								
SampID: LCS										Date Analyzed
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Fluoride		0.10		0.95	1.000	0	95.4	90	110	06/03/2022

### Batch R312788 SampType: MS

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Fluoride		0.10		2.15	2.000	0.2230	96.2	75	125	06/03/2022

### Batch R312788 SampType: MSD

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Fluoride		0.10		2.16	2.000	0.2230	96.8	2.148	0.56	06/03/2022

### Batch R312788 SampType: MS

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Fluoride		0.10		2.12	2.000	0.08000	101.8	75	125	06/03/2022

### Batch R312788 SampType: MSD

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Fluoride		0.10		2.18	2.000	0.08000	105.2	2.117	3.16	06/03/2022

### Batch R312788 SampType: MS

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Fluoride		0.10		2.11	2.000	0.1290	99.2	75	125	06/03/2022

### Batch R312788 SampType: MSD

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Fluoride		0.10		2.12	2.000	0.1290	99.7	2.114	0.38	06/03/2022

### Batch R312788 SampType: MS

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Fluoride		0.10		2.02	2.000	0.07300	97.6	75	125	06/03/2022

## Quality Control Results

<http://www.teklabinc.com/>
**Client:** Southern Illinois Power Cooperation

**Work Order:** 22050087

**Client Project:** Groundwater Monitoring

**Report Date:** 08-Jul-22

**SW-846 9214 (TOTAL)**

Batch R312788 SampType: MSD		Units mg/L						RPD Limit 15		Date Analyzed	
SampID: 22051774-018AMSD		Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	
Analyses	Fluoride		0.10		<b>2.05</b>	2.000	0.07300	98.9	2.024	1.33	06/03/2022

**Batch R312788 SampType: MS**

Batch R312788 SampType: MS		Units mg/L						RPD Limit 15		Date Analyzed	
SampID: 22060095-004AMS		Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	
Analyses	Fluoride		0.10		<b>2.27</b>	2.000	0.2560	100.8	75	125	06/03/2022

**Batch R312788 SampType: MSD**

Batch R312788 SampType: MSD		Units mg/L						RPD Limit 15		Date Analyzed	
SampID: 22060095-004AMSD		Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	
Analyses	Fluoride		0.10		<b>2.32</b>	2.000	0.2560	103.4	2.273	2.26	06/03/2022

**SW-846 3005A, 6010B, METALS BY ICP (TOTAL)**

Batch 193106 SampType: MBLK		Units mg/L						RPD Limit 15		Date Analyzed	
SampID: MBLK-193106		Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	
Analyses	Barium		0.0025		<b>&lt; 0.0025</b>	0.0007	0	0	-100	100	05/27/2022
	Boron		0.0200		<b>&lt; 0.0200</b>	0.0090	0	0	-100	100	05/27/2022
	Calcium		0.100		<b>&lt; 0.100</b>	0.0350	0	0	-100	100	05/27/2022

**Batch 193106 SampType: LCS**

Batch 193106 SampType: LCS		Units mg/L						RPD Limit 15		Date Analyzed	
SampID: LCS-193106		Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	
Analyses	Barium		0.0025		<b>2.23</b>	2.000	0	111.4	85	115	05/27/2022
	Boron		0.0200		<b>0.558</b>	0.5000	0	111.7	85	115	05/27/2022
	Calcium		0.100		<b>2.80</b>	2.500	0	112.0	85	115	05/27/2022

**Batch 193106 SampType: MS**

Batch 193106 SampType: MS		Units mg/L						RPD Limit 15		Date Analyzed	
SampID: 22050087-004CMS		Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	
Analyses	Barium		0.0025		<b>2.25</b>	2.000	0.08460	108.4	75	125	06/02/2022
	Boron		0.0200		<b>0.595</b>	0.5000	0.06700	105.5	75	125	06/02/2022
	Calcium		0.100	S	<b>42.0</b>	2.500	40.13	74.0	75	125	06/02/2022



## Quality Control Results

<http://www.teklabinc.com/>

Client: Southern Illinois Power Cooperation

Work Order: 22050087

Client Project: Groundwater Monitoring

Report Date: 08-Jul-22

### SW-846 3005A, 6010B, METALS BY ICP (TOTAL)

Batch	193106	SampType:	MSD	Units	mg/L	RPD Limit 20				Date				
SampID: 22050087-004CMSD														
Analyses														
Barium				0.0025	<b>2.25</b>	2.000	0.08460	108.5	2.252	0.09				
Boron				0.0200	<b>0.597</b>	0.5000	0.06700	105.9	0.5946	0.34				
Calcium				0.100	<b>42.3</b>	2.500	40.13	85.6	41.98	0.69				

### Batch 193106 SampType: MS

Batch	193106	SampType:	MS	Units	mg/L	RPD Limit 20				Date				
SampID: 22051687-019CMS														
Analyses														
Calcium				0.100	S	<b>249</b>	2.500	247.5	48.0	75	125	06/01/2022		

### Batch 193106 SampType: MSD

Batch	193106	SampType:	MSD	Units	mg/L	RPD Limit 20				Date				
SampID: 22051687-019CMSP														
Analyses														
Calcium				0.100	S	<b>252</b>	2.500	247.5	188.0	248.7	1.40	06/01/2022		

### Batch 193127 SampType: MBLK

Batch	193127	SampType:	MBLK	Units	mg/L	RPD Limit 20				Date				
SampID: MBLK-193127														
Analyses														
Barium				0.0025	<b>&lt; 0.0025</b>	0.0007	0	0	-100	100	06/01/2022			
Boron				0.0200	<b>&lt; 0.0200</b>	0.0090	0	0	-100	100	06/01/2022			
Calcium				0.100	<b>&lt; 0.100</b>	0.0350	0	0	-100	100	06/01/2022			

### Batch 193127 SampType: LCS

Batch	193127	SampType:	LCS	Units	mg/L	RPD Limit 20				Date				
SampID: LCS-193127														
Analyses														
Barium				0.0025	<b>2.07</b>	2.000	0	103.4	85	115	06/01/2022			
Boron				0.0200	<b>0.517</b>	0.5000	0	103.4	85	115	06/01/2022			
Calcium				0.100	<b>2.62</b>	2.500	0	104.7	85	115	06/01/2022			

### Batch 193229 SampType: MBLK

Batch	193229	SampType:	MBLK	Units	mg/L	RPD Limit 20				Date				
SampID: MBLK-193229														
Analyses														
Barium				0.0025	<b>&lt; 0.0025</b>	0.0007	0	0	-100	100	06/02/2022			
Boron				0.0200	<b>&lt; 0.0200</b>	0.0090	0	0	-100	100	06/02/2022			
Calcium				0.100	<b>&lt; 0.100</b>	0.0350	0	0	-100	100	06/02/2022			



## Quality Control Results

<http://www.teklabinc.com/>

Client: Southern Illinois Power Cooperation

Work Order: 22050087

Client Project: Groundwater Monitoring

Report Date: 08-Jul-22

### SW-846 3005A, 6010B, METALS BY ICP (TOTAL)

Batch	193229	SampType:	LCS	Units	mg/L						
SampID: LCS-193229											
Analyses	Cert	RL	Qual	Result	Spike	SPK	Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Barium		0.0025		<b>2.14</b>	2.000	0		107.2	85	115	06/02/2022
Boron		0.0200		<b>0.530</b>	0.5000	0		106.0	85	115	06/02/2022
Calcium		0.100		<b>2.69</b>	2.500	0		107.4	85	115	06/02/2022

### SW-846 3005A, 6020A, METALS BY ICPMS (TOTAL)

Batch	193106	SampType:	MBLK	Units	mg/L						
SampID: MBLK-193106											
Analyses	Cert	RL	Qual	Result	Spike	SPK	Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Antimony		0.0010		<b>&lt; 0.0010</b>	0.0004	0		0	-100	100	05/27/2022
Arsenic		0.0010		<b>&lt; 0.0010</b>	0.0004	0		0	-100	100	05/27/2022
Beryllium		0.0010		<b>&lt; 0.0010</b>	0.0002	0		0	-100	100	05/27/2022
Cadmium		0.0010		<b>&lt; 0.0010</b>	0.0001	0		0	-100	100	05/27/2022
Chromium		0.0015		<b>&lt; 0.0015</b>	0.0007	0		0	-100	100	05/27/2022
Cobalt		0.0010		<b>&lt; 0.0010</b>	0.0001	0		0	-100	100	05/27/2022
Lead		0.0010		<b>&lt; 0.0010</b>	0.0006	0		0	-100	100	05/27/2022
Lithium	*	0.0030		<b>&lt; 0.0030</b>	0.0015	0		0	-100	100	05/27/2022
Molybdenum		0.0015		<b>&lt; 0.0015</b>	0.0006	0		0	-100	100	05/27/2022
Selenium		0.0010		<b>&lt; 0.0010</b>	0.0006	0		0	-100	100	05/27/2022
Thallium		0.0020		<b>&lt; 0.0020</b>	0.0010	0		0	-100	100	05/27/2022

### Batch 193106 SampType: LCS Units mg/L

SampID: LCS-193106											
Analyses	Cert	RL	Qual	Result	Spike	SPK	Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Antimony		0.0010		<b>0.510</b>	0.5000	0		102.1	80	120	05/27/2022
Arsenic		0.0010		<b>0.545</b>	0.5000	0		109.0	80	120	05/27/2022
Beryllium		0.0010		<b>0.0543</b>	0.0500	0		108.6	80	120	05/27/2022
Cadmium		0.0010		<b>0.0516</b>	0.0500	0		103.1	80	120	05/27/2022
Chromium		0.0015		<b>0.206</b>	0.2000	0		103.2	80	120	05/27/2022
Cobalt		0.0010		<b>0.535</b>	0.5000	0		107.0	80	120	05/27/2022
Lead		0.0010		<b>0.522</b>	0.5000	0		104.4	80	120	05/27/2022
Molybdenum		0.0015		<b>0.505</b>	0.5000	0		101.1	80	120	05/27/2022
Selenium		0.0010		<b>0.522</b>	0.5000	0		104.5	80	120	05/27/2022
Thallium		0.0020		<b>0.244</b>	0.2500	0		97.5	80	120	05/27/2022

## Quality Control Results

<http://www.teklabinc.com/>

**Client:** Southern Illinois Power Cooperation

**Work Order:** 22050087

**Client Project:** Groundwater Monitoring

**Report Date:** 08-Jul-22

### SW-846 3005A, 6020A, METALS BY ICPMS (TOTAL)

Batch	193106	SampType:	MS	Units	mg/L						
SampID: 22050087-004CMS								Date Analyzed			
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit		
Antimony		0.0010		<b>0.485</b>	0.5000	0	97.0	75	125	05/27/2022	
Arsenic		0.0010		<b>0.524</b>	0.5000	0.007459	103.3	75	125	05/27/2022	
Beryllium		0.0010		<b>0.0522</b>	0.0500	0	104.3	75	125	05/27/2022	
Cadmium		0.0010		<b>0.0487</b>	0.0500	0	97.3	75	125	05/27/2022	
Chromium		0.0015		<b>0.190</b>	0.2000	0	94.8	75	125	05/27/2022	
Cobalt		0.0010		<b>0.596</b>	0.5000	0.1215	94.9	75	125	05/27/2022	
Lead		0.0010		<b>0.501</b>	0.5000	0	100.2	75	125	05/27/2022	
Molybdenum		0.0015		<b>0.489</b>	0.5000	0	97.8	75	125	05/27/2022	
Selenium		0.0010		<b>0.495</b>	0.5000	0	99.1	75	125	05/27/2022	
Thallium		0.0020		<b>0.247</b>	0.2500	0	98.8	75	125	05/27/2022	

Batch	193106	SampType:	MSD	Units	mg/L	RPD Limit 20					
SampID: 22050087-004CMSD								Date Analyzed			
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD		
Antimony		0.0010		<b>0.496</b>	0.5000	0	99.3	0.4848	2.36	05/27/2022	
Arsenic		0.0010		<b>0.529</b>	0.5000	0.007459	104.2	0.5240	0.89	05/27/2022	
Beryllium		0.0010		<b>0.0530</b>	0.0500	0	106.1	0.05216	1.67	05/27/2022	
Cadmium		0.0010		<b>0.0505</b>	0.0500	0	100.9	0.04867	3.64	05/27/2022	
Chromium		0.0015		<b>0.190</b>	0.2000	0	95.1	0.1896	0.35	05/27/2022	
Cobalt		0.0010		<b>0.609</b>	0.5000	0.1215	97.6	0.5958	2.22	05/27/2022	
Lead		0.0010		<b>0.496</b>	0.5000	0	99.2	0.5010	0.98	05/27/2022	
Molybdenum		0.0015		<b>0.507</b>	0.5000	0	101.5	0.4892	3.64	05/27/2022	
Selenium		0.0010		<b>0.493</b>	0.5000	0	98.6	0.4954	0.46	05/27/2022	
Thallium		0.0020		<b>0.235</b>	0.2500	0	94.0	0.2469	4.91	05/27/2022	

## Quality Control Results

<http://www.teklabinc.com/>
**Client:** Southern Illinois Power Cooperation

**Work Order:** 22050087

**Client Project:** Groundwater Monitoring

**Report Date:** 08-Jul-22

**SW-846 3005A, 6020A, METALS BY ICPMS (TOTAL)**
**Batch 193127 SampType: MBLK Units mg/L**

SampID: MBLK-193127

Analyses	Cert	RL	Qual	Result	Spike	SPK	Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Antimony		0.0010		< 0.0010	0.0004	0	0	0	-100	100	05/31/2022
Arsenic		0.0010		< 0.0010	0.0004	0	0	0	-100	100	05/31/2022
Beryllium		0.0010		< 0.0010	0.0002	0	0	0	-100	100	05/31/2022
Cadmium		0.0010		< 0.0010	0.0001	0	0	0	-100	100	05/31/2022
Chromium		0.0015		< 0.0015	0.0007	0	0	0	-100	100	06/01/2022
Cobalt		0.0010		< 0.0010	0.0001	0	0	0	-100	100	05/31/2022
Lead		0.0010		< 0.0010	0.0006	0	0	0	-100	100	05/31/2022
Lithium	*	0.0030		< 0.0030	0.0015	0	0	0	-100	100	05/31/2022
Molybdenum		0.0015		< 0.0015	0.0006	0	0	0	-100	100	05/31/2022
Selenium		0.0010		< 0.0010	0.0006	0	0	0	-100	100	05/31/2022
Thallium		0.0020		< 0.0020	0.0010	0	0	0	-100	100	05/31/2022

**Batch 193127 SampType: LCS Units mg/L**

SampID: LCS-193127

Analyses	Cert	RL	Qual	Result	Spike	SPK	Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Antimony		0.0010		0.521	0.5000	0	104.1	85	115	115	05/31/2022
Arsenic		0.0010		0.555	0.5000	0	111.0	85	115	115	05/31/2022
Beryllium		0.0010		0.0540	0.0500	0	108.0	85	115	115	05/31/2022
Cadmium		0.0010		0.0538	0.0500	0	107.6	85	115	115	05/31/2022
Chromium		0.0015		0.210	0.2000	0	105.2	85	115	115	06/01/2022
Cobalt		0.0010		0.529	0.5000	0	105.8	85	115	115	05/31/2022
Lead		0.0010		0.537	0.5000	0	107.4	85	115	115	05/31/2022
Lithium	*	0.0030		0.554	0.5000	0	110.9	85	115	115	06/03/2022
Molybdenum		0.0015		0.506	0.5000	0	101.2	85	115	115	05/31/2022
Selenium		0.0010		0.536	0.5000	0	107.1	85	115	115	05/31/2022
Thallium		0.0020		0.270	0.2500	0	107.8	85	115	115	05/31/2022

**Batch 193229 SampType: MBLK Units mg/L**

SampID: MBLK-193229

Analyses	Cert	RL	Qual	Result	Spike	SPK	Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Cadmium		0.0010		< 0.0010	0.0001	0	0	0	-100	100	06/02/2022
Lithium	*	0.0030		< 0.0030	0.0015	0	0	0	-100	100	06/03/2022
Selenium		0.0010		< 0.0010	0.0006	0	0	0	-100	100	06/03/2022



## Quality Control Results

<http://www.teklabinc.com/>

Client: Southern Illinois Power Cooperation

Work Order: 22050087

Client Project: Groundwater Monitoring

Report Date: 08-Jul-22

### SW-846 3005A, 6020A, METALS BY ICPMS (TOTAL)

Batch	193229	SampType:	LCS	Units	mg/L						
SampID: LCS-193229										Date Analyzed	
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit		
Cadmium		0.0010		<b>0.0524</b>	0.0500	0	104.8	85	115	06/02/2022	
Lithium	*	0.0030		<b>0.570</b>	0.5000	0	114.0	85	115	06/03/2022	
Selenium		0.0010		<b>0.567</b>	0.5000	0	113.4	85	115	06/03/2022	

### Batch 193229 SampType: MS Units mg/L

Batch	193229	SampType:	MS	Units	mg/L						
SampID: 22050087-004CMS										Date Analyzed	
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit		
Lithium	*	0.0030		<b>0.572</b>	0.5000	0.03210	107.9	75	125	06/03/2022	

### Batch 193229 SampType: MSD Units mg/L

Batch	193229	SampType:	MSD	Units	mg/L	RPD Limit 20					
SampID: 22050087-004CMSD										Date Analyzed	
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD		
Lithium	*	0.0030		<b>0.596</b>	0.5000	0.03210	112.7	0.5718	4.09	06/03/2022	

### SW-846 7470A (TOTAL)

Batch	193178	SampType:	MBLK	Units	mg/L						
SampID: MBLK-193178										Date Analyzed	
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit		
Mercury		0.00020		<b>&lt; 0.00020</b>	0.0001	0	0	-100	100	05/31/2022	

### Batch 193178 SampType: LCS Units mg/L

Batch	193178	SampType:	LCS	Units	mg/L						
SampID: LCS-193178										Date Analyzed	
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit		
Mercury		0.00020		<b>0.00523</b>	0.0050	0	104.5	85	115	05/31/2022	

### Batch 193178 SampType: MS Units mg/L

Batch	193178	SampType:	MS	Units	mg/L						
SampID: 22050087-005CMS										Date Analyzed	
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit		
Mercury		0.00020		<b>0.00436</b>	0.0050	0	87.2	75	125	06/01/2022	

### Batch 193178 SampType: MSD Units mg/L

Batch	193178	SampType:	MSD	Units	mg/L	RPD Limit 15					
SampID: 22050087-005CMDS										Date Analyzed	
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD		
Mercury		0.00020		<b>0.00429</b>	0.0050	0	85.7	0.004362	1.76	06/01/2022	



## Quality Control Results

<http://www.teklabinc.com/>

**Client:** Southern Illinois Power Cooperation

**Work Order:** 22050087

**Client Project:** Groundwater Monitoring

**Report Date:** 08-Jul-22

### SW-846 7470A (TOTAL)

Batch 193178 SampType: MS		Units mg/L								
SampID: 22051687-003CMS										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Mercury		0.00020		<b>0.00485</b>	0.0050	0	97.1	75	125	05/31/2022

### Batch 193178 SampType: MSD Units mg/L RPD Limit 15

SampID: 22051687-003CMSD										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Mercury		0.00020		<b>0.00478</b>	0.0050	0	95.6	0.004854	1.52	05/31/2022

## Receiving Check List

<http://www.teklabinc.com/>

**Client:** Southern Illinois Power Cooperation

**Work Order:** 22050087

**Client Project:** Groundwater Monitoring

**Report Date:** 08-Jul-22

**Carrier:** Joe Riley

**Received By:** EAH

**Completed by:**

**On:**

26-May-22



Payton Yoch

**Reviewed by:**

**On:**

26-May-22



Elizabeth A. Hurley

**Pages to follow:** Chain of custody

2

Extra pages included

21

	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>	Not Present <input type="checkbox"/>	Temp °C <b>4.8</b>	Dry Ice <input type="checkbox"/>
	None <input type="checkbox"/>	Ice <input checked="" type="checkbox"/>	Blue Ice <input type="checkbox"/>		
Shipping container/cooler in good condition?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>	Not Present <input type="checkbox"/>		
Type of thermal preservation?	None <input type="checkbox"/>	Ice <input checked="" type="checkbox"/>	Blue Ice <input type="checkbox"/>		Dry Ice <input type="checkbox"/>
Chain of custody present?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>			
Chain of custody signed when relinquished and received?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>			
Chain of custody agrees with sample labels?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>			
Samples in proper container/bottle?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>			
Sample containers intact?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>			
Sufficient sample volume for indicated test?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>			
All samples received within holding time?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>			
Reported field parameters measured:	Field <input checked="" type="checkbox"/>	Lab <input type="checkbox"/>	NA <input type="checkbox"/>		
Container/Temp Blank temperature in compliance?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>			
<i>When thermal preservation is required, samples are compliant with a temperature between 0.1°C - 6.0°C, or when samples are received on ice the same day as collected.</i>					
Water – at least one vial per sample has zero headspace?	Yes <input type="checkbox"/>	No <input type="checkbox"/>	No VOA vials <input checked="" type="checkbox"/>		
Water - TOX containers have zero headspace?	Yes <input type="checkbox"/>	No <input type="checkbox"/>	No TOX containers <input checked="" type="checkbox"/>		
Water - pH acceptable upon receipt?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>	NA <input type="checkbox"/>		
NPDES/CWA TCN interferences checked/treated in the field?	Yes <input type="checkbox"/>	No <input type="checkbox"/>	NA <input checked="" type="checkbox"/>		

**Any No responses must be detailed below or on the COC.**

pH strip 78198 - pyoch - 5/26/2022 9:08:00 AM

# CHAIN OF CUSTODY

pg. 1 of 2 Work order # 22050087

TEKLAB, INC. 5445 Horseshoe Lake Road - Collinsville, IL 62234 - Phone: (618) 344-1004 - Fax: (618) 344-1005

Client:	Southern Illinois Power Cooperation		
Address:	11543 Lake of Egypt Road		
City / State / Zip	Marion, IL 62959		
Contact:	Jason McLaurin	Phone:	(618) 964-1448
E-Mail:	jmclaurin@sipower.org		

Are these samples known to be involved in litigation? If yes, a surcharge will apply  Yes  No

Are these samples known to be hazardous?  Yes  No

Are there any required reporting limits to be met on the requested analysis?. If yes, please provide limits in the comment section.  Yes  No

Samples on:  ICE  BLUE ICE  NO ICE 4.8 °C LTG# 5  
 Preserved in:  LAB  FIELD FOR LAB USE ONLY  
 Lab Notes: PH 7.8198, PN 5126122

## Client Comments \*DUP

ICP: Ba B Ca

ICP/MS: Sb As Be Cd Cr Co Pb Li Mo Se Ti

Field Parameters = elevations, pH, temp., conductivity, DO, purge volume, ORP, and turbidity

Project Name/Number			Sample Collector's Name			MATRIX	INDICATE ANALYSIS REQUESTED								
Groundwater Monitoring			J.RILEY A.BRIDGES					Field Parameters	Chloride	Fluoride	ICP Metals	Mercury	Sulfate	TDS	
Results Requested		Billing Instructions		# and Type of Containers		UNP	HNO3								
<input checked="" type="checkbox"/> Standard	<input type="checkbox"/> 1-2 Day (100% Surcharge)							X	X	X	X	X	X	X	
<input type="checkbox"/> Other	<input type="checkbox"/> 3 Day (50% Surcharge)							X	X	X	X	X	X	X	
Lab Use Only		Sample Identification		Date/Time Sampled				X	X	X	X	X	X	X	
22050087-001		EBG		05/24/22 1115		1	3	X	X	X	X	X	X	X	
-002		EP-1		05/24/22 1300		1	3	X	X	X	X	X	X	X	
-003		EP-2		05/24/22 1520		1	3	X	X	X	X	X	X	X	
-004		EP-3		05/25/22 1020		1	3	X	X	X	X	X	X	X	
-005		EP-4		05/25/22 1130		1	3	X	X	X	X	X	X	X	
-006		EP-5		05/24/22 1207		1	3	X	X	X	X	X	X	X	
-007		EP-6		05/24/22 1415		1	3	X	X	X	X	X	X	X	
-008		EP-7		3K 05/25/22 0840		1	3	X	X	X	X	X	X	X	
-009		Equipment Blank		05/26/22 1134		1	3	X	X	X	X	X	X	X	
-010		Field Blank		05/24/22 1524		1	3	X	X	X	X	X	X	X	
Relandished By				Date/Time		Received By				Date/Time					
				05/26/22 0735						05/26/22 0735					
<p>The individual signing this agreement on behalf of the client, acknowledges that he/she has read and understands the terms and conditions of this agreement, and that he/she has the authority to sign on behalf of the client. See <a href="http://www.teklabinc.com">www.teklabinc.com</a> for terms and conditions.</p>															
BottleOrder: 72475															

RAT S/26/22

**CHAIN OF CUSTODY** pg. 2 of 2 Work order # 22050087

TEKLAB, INC. 5445 Horseshoe Lake Road - Collinsville, IL 62234 - Phone: (618) 344-1004 - Fax: (618) 344-1005

The individual signing this agreement on behalf of the client, acknowledges that he/she has read and understands the terms and conditions of this agreement, and that he/she has the authority to sign on behalf of the client. See [www.teklabinc.com](http://www.teklabinc.com) for terms and conditions.

BottleOrder: 72475





# ANALYTICAL REPORT

July 06, 2022

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

<sup>7</sup>GI

<sup>8</sup>AI

<sup>9</sup>SC

## TEKLAB, Inc.

Sample Delivery Group: L1499879

Samples Received: 05/31/2022

Project Number:

Description:

Report To: Elizabeth Hurley  
5445 Horseshoe Lake Road  
Collinsville, IL 62234

Entire Report Reviewed By:

Mark W. Beasley  
Project Manager

Results relate only to the items tested or calibrated and are reported as rounded values. This test report shall not be reproduced, except in full, without written approval of the laboratory. Where applicable, sampling conducted by Pace Analytical National is performed per guidance provided in laboratory standard operating procedures ENV-SOP-MTJL-0067 and ENV-SOP-MTJL-0068. Where sampling conducted by the customer, results relate to the accuracy of the information provided, and as the samples are received.

Pace Analytical National

12065 Lebanon Rd Mount Juliet, TN 37122 615-758-5858 800-767-5859 [www.pacenational.com](http://www.pacenational.com)

ACCOUNT:

TEKLAB, Inc.

PROJECT:

SDG:

L1499879

DATE/TIME:

07/06/22 14:09

PAGE:


1 of 21

# TABLE OF CONTENTS

Cp: Cover Page	1	<sup>1</sup> Cp
Tc: Table of Contents	2	<sup>2</sup> Tc
Ss: Sample Summary	3	<sup>3</sup> Ss
Cn: Case Narrative	5	<sup>4</sup> Cn
Sr: Sample Results	6	<sup>5</sup> Sr
22050087-001 L1499879-01	6	<sup>6</sup> Qc
22050087-002 L1499879-02	7	<sup>7</sup> Gl
22050087-003 L1499879-03	8	<sup>8</sup> Al
22050087-004 L1499879-04	9	<sup>9</sup> Sc
22050087-005 L1499879-05	10	
22050087-006 L1499879-06	11	
22050087-007 L1499879-07	12	
22050087-008 L1499879-08	13	
22050087-009 L1499879-09	14	
22050087-010 L1499879-10	15	
22050087-011 L1499879-11	16	
Qc: Quality Control Summary	17	
Radiochemistry by Method 904/9320	17	
Radiochemistry by Method SM7500Ra B M	18	
Gl: Glossary of Terms	19	
Al: Accreditations & Locations	20	
Sc: Sample Chain of Custody	21	


# SAMPLE SUMMARY

			Collected by	Collected date/time	Received date/time	
			J.R. / A.B.	05/24/22 11:15	05/31/22 10:00	
Method	Batch	Dilution	Preparation date/time	Analysis date/time	Analyst	Location
Radiochemistry by Method 904/9320	WG1879107	1	06/15/22 08:30	06/22/22 10:34	SWM	Mt. Juliet, TN
Radiochemistry by Method Calculation	WG1872769	1	06/09/22 14:00	06/22/22 10:34	SWM	Mt. Juliet, TN
Radiochemistry by Method SM7500Ra B M	WG1872769	1	06/09/22 14:00	06/10/22 18:10	RGT	Mt. Juliet, TN
			Collected by	Collected date/time	Received date/time	
			J.R. / A.B.	05/24/22 13:00	05/31/22 10:00	
Method	Batch	Dilution	Preparation date/time	Analysis date/time	Analyst	Location
Radiochemistry by Method 904/9320	WG1879107	1	06/15/22 08:30	06/22/22 10:34	SWM	Mt. Juliet, TN
Radiochemistry by Method Calculation	WG1872769	1	06/09/22 14:00	06/22/22 10:34	SWM	Mt. Juliet, TN
Radiochemistry by Method SM7500Ra B M	WG1872769	1	06/09/22 14:00	06/10/22 18:10	RGT	Mt. Juliet, TN
			Collected by	Collected date/time	Received date/time	
			J.R. / A.B.	05/24/22 15:20	05/31/22 10:00	
Method	Batch	Dilution	Preparation date/time	Analysis date/time	Analyst	Location
Radiochemistry by Method 904/9320	WG1879107	1	06/15/22 08:30	06/22/22 10:34	SWM	Mt. Juliet, TN
Radiochemistry by Method Calculation	WG1872769	1	06/09/22 14:00	06/22/22 10:34	SWM	Mt. Juliet, TN
Radiochemistry by Method SM7500Ra B M	WG1872769	1	06/09/22 14:00	06/10/22 18:10	RGT	Mt. Juliet, TN
			Collected by	Collected date/time	Received date/time	
			J.R. / A.B.	05/24/22 10:28	05/31/22 10:00	
Method	Batch	Dilution	Preparation date/time	Analysis date/time	Analyst	Location
Radiochemistry by Method 904/9320	WG1879107	1	06/15/22 08:30	06/22/22 10:34	SWM	Mt. Juliet, TN
Radiochemistry by Method Calculation	WG1872769	1	06/09/22 14:00	06/22/22 10:34	SWM	Mt. Juliet, TN
Radiochemistry by Method SM7500Ra B M	WG1872769	1	06/09/22 14:00	06/10/22 18:10	RGT	Mt. Juliet, TN
			Collected by	Collected date/time	Received date/time	
			J.R. / A.B.	05/24/22 11:30	05/31/22 10:00	
Method	Batch	Dilution	Preparation date/time	Analysis date/time	Analyst	Location
Radiochemistry by Method 904/9320	WG1879107	1	06/15/22 08:30	06/22/22 10:34	SWM	Mt. Juliet, TN
Radiochemistry by Method Calculation	WG1872769	1	06/09/22 14:00	06/22/22 10:34	SWM	Mt. Juliet, TN
Radiochemistry by Method SM7500Ra B M	WG1872769	1	06/09/22 14:00	06/10/22 18:10	RGT	Mt. Juliet, TN
			Collected by	Collected date/time	Received date/time	
			J.R. / A.B.	05/24/22 12:07	05/31/22 10:00	
Method	Batch	Dilution	Preparation date/time	Analysis date/time	Analyst	Location
Radiochemistry by Method 904/9320	WG1879107	1	06/15/22 08:30	06/22/22 10:34	SWM	Mt. Juliet, TN
Radiochemistry by Method Calculation	WG1872769	1	06/09/22 14:00	06/22/22 10:34	SWM	Mt. Juliet, TN
Radiochemistry by Method SM7500Ra B M	WG1872769	1	06/09/22 14:00	06/10/22 18:10	RGT	Mt. Juliet, TN



# SAMPLE SUMMARY

			Collected by	Collected date/time	Received date/time	
			J.R. / A.B.	05/24/22 14:15	05/31/22 10:00	
Method	Batch	Dilution	Preparation date/time	Analysis date/time	Analyst	Location
Radiochemistry by Method 904/9320	WG1879107	1	06/15/22 08:30	06/22/22 10:34	SWM	Mt. Juliet, TN
Radiochemistry by Method Calculation	WG1872769	1	06/09/22 14:00	06/22/22 10:34	SWM	Mt. Juliet, TN
Radiochemistry by Method SM7500Ra B M	WG1872769	1	06/09/22 14:00	06/10/22 18:10	RGT	Mt. Juliet, TN
			Collected by	Collected date/time	Received date/time	
			J.R. / A.B.	05/24/22 08:48	05/31/22 10:00	
Method	Batch	Dilution	Preparation date/time	Analysis date/time	Analyst	Location
Radiochemistry by Method 904/9320	WG1879107	1	06/15/22 08:30	06/22/22 10:34	SWM	Mt. Juliet, TN
Radiochemistry by Method Calculation	WG1872769	1	06/09/22 14:00	06/22/22 10:34	SWM	Mt. Juliet, TN
Radiochemistry by Method SM7500Ra B M	WG1872769	1	06/09/22 14:00	06/10/22 18:10	RGT	Mt. Juliet, TN
			Collected by	Collected date/time	Received date/time	
			J.R. / A.B.	05/25/22 11:34	05/31/22 10:00	
Method	Batch	Dilution	Preparation date/time	Analysis date/time	Analyst	Location
Radiochemistry by Method 904/9320	WG1879107	1	06/15/22 08:30	06/22/22 10:34	SWM	Mt. Juliet, TN
Radiochemistry by Method Calculation	WG1872769	1	06/09/22 14:00	06/22/22 10:34	SWM	Mt. Juliet, TN
Radiochemistry by Method SM7500Ra B M	WG1872769	1	06/09/22 14:00	06/10/22 18:10	RGT	Mt. Juliet, TN
			Collected by	Collected date/time	Received date/time	
			J.R. / A.B.	05/24/22 15:24	05/31/22 10:00	
Method	Batch	Dilution	Preparation date/time	Analysis date/time	Analyst	Location
Radiochemistry by Method 904/9320	WG1879107	1	06/15/22 08:30	06/22/22 10:34	SWM	Mt. Juliet, TN
Radiochemistry by Method Calculation	WG1872769	1	06/09/22 14:00	06/22/22 10:34	SWM	Mt. Juliet, TN
Radiochemistry by Method SM7500Ra B M	WG1872769	1	06/09/22 14:00	06/10/22 18:10	RGT	Mt. Juliet, TN
			Collected by	Collected date/time	Received date/time	
			J.R. / A.B.	05/24/22 14:15	05/31/22 10:00	
Method	Batch	Dilution	Preparation date/time	Analysis date/time	Analyst	Location
Radiochemistry by Method 904/9320	WG1879107	1	06/15/22 08:30	06/22/22 10:34	SWM	Mt. Juliet, TN
Radiochemistry by Method Calculation	WG1872769	1	06/09/22 14:00	06/22/22 10:34	SWM	Mt. Juliet, TN
Radiochemistry by Method SM7500Ra B M	WG1872769	1	06/09/22 14:00	06/10/22 18:10	RGT	Mt. Juliet, TN



# CASE NARRATIVE

All sample aliquots were received at the correct temperature, in the proper containers, with the appropriate preservatives, and within method specified holding times, unless qualified or notated within the report. Where applicable, all MDL (LOD) and RDL (LOQ) values reported for environmental samples have been corrected for the dilution factor used in the analysis. All radiochemical sample results for solids are reported on a dry weight basis with the exception of tritium, carbon-14 and radon, unless wet weight was requested by the client. All Method and Batch Quality Control are within established criteria except where addressed in this case narrative, a non-conformance form or properly qualified within the sample results. By my digital signature below, I affirm to the best of my knowledge, all problems/anomalies observed by the laboratory as having the potential to affect the quality of the data have been identified by the laboratory, and no information or data have been knowingly withheld that would affect the quality of the data.



Mark W. Beasley  
Project Manager

- <sup>1</sup> Cp
- <sup>2</sup> Tc
- <sup>3</sup> Ss
- <sup>4</sup> Cn
- <sup>5</sup> Sr
- <sup>6</sup> Qc
- <sup>7</sup> GI
- <sup>8</sup> AI
- <sup>9</sup> SC

22050087-001

Collected date/time: 05/24/22 11:15

## SAMPLE RESULTS - 01

L1499879

## Radiochemistry by Method 904/9320

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-228	2.63		0.226	0.528	06/22/2022 10:34	<a href="#">WG1879107</a>
( <i>T</i> ) Barium	112			62.0-143	06/22/2022 10:34	<a href="#">WG1879107</a>
( <i>T</i> ) Yttrium	92.2			79.0-136	06/22/2022 10:34	<a href="#">WG1879107</a>

<sup>1</sup>Cp<sup>2</sup>Tc<sup>3</sup>Ss<sup>4</sup>Cn<sup>5</sup>Sr<sup>6</sup>Qc<sup>7</sup>Gl<sup>8</sup>Al<sup>9</sup>Sc

## Radiochemistry by Method Calculation

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
Combined Radium	2.68		0.271	0.592	06/22/2022 10:34	<a href="#">WG1872769</a>

## Radiochemistry by Method SM7500Ra B M

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-226	0.0495	<u>U</u>	0.149	0.267	06/10/2022 18:10	<a href="#">WG1872769</a>
( <i>T</i> ) Barium-133	94.2			30.0-143	06/10/2022 18:10	<a href="#">WG1872769</a>

22050087-002

Collected date/time: 05/24/22 13:00

## SAMPLE RESULTS - 02

L1499879

## Radiochemistry by Method 904/9320

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-228	0.888		0.208	0.563	06/22/2022 10:34	<u>WG1879107</u>
( <i>T</i> ) Barium	88.6			62.0-143	06/22/2022 10:34	<u>WG1879107</u>
( <i>T</i> ) Yttrium	100			79.0-136	06/22/2022 10:34	<u>WG1879107</u>

<sup>1</sup>Cp<sup>2</sup>Tc<sup>3</sup>Ss<sup>4</sup>Cn<sup>5</sup>Sr<sup>6</sup>Qc<sup>7</sup>Gl<sup>8</sup>Al<sup>9</sup>Sc

## Radiochemistry by Method Calculation

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
Combined Radium	0.950		0.242	0.600	06/22/2022 10:34	<u>WG1872769</u>

## Radiochemistry by Method SM7500Ra B M

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-226	0.0628	<u>U</u>	0.123	0.207	06/10/2022 18:10	<u>WG1872769</u>
( <i>T</i> ) Barium-133	87.8			30.0-143	06/10/2022 18:10	<u>WG1872769</u>

22050087-003

Collected date/time: 05/24/22 15:20

## SAMPLE RESULTS - 03

L1499879

## Radiochemistry by Method 904/9320

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-228	0.933		0.202	0.546	06/22/2022 10:34	<a href="#">WG1879107</a>
( <i>T</i> ) Barium	94.4			62.0-143	06/22/2022 10:34	<a href="#">WG1879107</a>
( <i>T</i> ) Yttrium	95.9			79.0-136	06/22/2022 10:34	<a href="#">WG1879107</a>

<sup>1</sup>Cp<sup>2</sup>Tc<sup>3</sup>Ss<sup>4</sup>Cn<sup>5</sup>Sr<sup>6</sup>Qc<sup>7</sup>Gl<sup>8</sup>Al<sup>9</sup>Sc

## Radiochemistry by Method Calculation

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
Combined Radium	0.965		0.230	0.586	06/22/2022 10:34	<a href="#">WG1872769</a>

## Radiochemistry by Method SM7500Ra B M

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-226	0.0325	<u>U</u>	0.110	0.214	06/10/2022 18:10	<a href="#">WG1872769</a>
( <i>T</i> ) Barium-133	94.3			30.0-143	06/10/2022 18:10	<a href="#">WG1872769</a>

22050087-004

Collected date/time: 05/24/22 10:28

## SAMPLE RESULTS - 04

L1499879

## Radiochemistry by Method 904/9320

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-228	1.47		0.182	0.455	06/22/2022 10:34	<a href="#">WG1879107</a>
(T) Barium	103			62.0-143	06/22/2022 10:34	<a href="#">WG1879107</a>
(T) Yttrium	101			79.0-136	06/22/2022 10:34	<a href="#">WG1879107</a>

<sup>1</sup>Cp<sup>2</sup>Tc<sup>3</sup>Ss<sup>4</sup>Cn<sup>5</sup>Sr<sup>6</sup>Qc<sup>7</sup>Gl<sup>8</sup>Al<sup>9</sup>Sc

## Radiochemistry by Method Calculation

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
Combined Radium	1.60		0.257	0.527	06/22/2022 10:34	<a href="#">WG1872769</a>

## Radiochemistry by Method SM7500Ra B M

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-226	0.132	J	0.181	0.266	06/10/2022 18:10	<a href="#">WG1872769</a>
(T) Barium-133	87.0			30.0-143	06/10/2022 18:10	<a href="#">WG1872769</a>

22050087-005

Collected date/time: 05/24/22 11:30

## SAMPLE RESULTS - 05

L1499879

## Radiochemistry by Method 904/9320

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-228	1.25		0.186	0.477	06/22/2022 10:34	<a href="#">WG1879107</a>
(T) Barium	91.5			62.0-143	06/22/2022 10:34	<a href="#">WG1879107</a>
(T) Yttrium	104			79.0-136	06/22/2022 10:34	<a href="#">WG1879107</a>

<sup>1</sup>Cp<sup>2</sup>Tc<sup>3</sup>Ss<sup>4</sup>Cn<sup>5</sup>Sr<sup>6</sup>Qc<sup>7</sup>Gl<sup>8</sup>Al<sup>9</sup>Sc

## Radiochemistry by Method Calculation

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
Combined Radium	1.39		0.283	0.574	06/22/2022 10:34	<a href="#">WG1872769</a>

## Radiochemistry by Method SM7500Ra B M

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-226	0.144	J	0.213	0.319	06/10/2022 18:10	<a href="#">WG1872769</a>
(T) Barium-133	85.5			30.0-143	06/10/2022 18:10	<a href="#">WG1872769</a>

22050087-006

Collected date/time: 05/24/22 12:07

## SAMPLE RESULTS - 06

L1499879

## Radiochemistry by Method 904/9320

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-228	0.287	<u>U</u>	0.166	0.477	06/22/2022 10:34	<u>WG1879107</u>
( <i>T</i> ) Barium	106			62.0-143	06/22/2022 10:34	<u>WG1879107</u>
( <i>T</i> ) Yttrium	103			79.0-136	06/22/2022 10:34	<u>WG1879107</u>

<sup>1</sup>Cp<sup>2</sup>Tc<sup>3</sup>Ss<sup>4</sup>Cn<sup>5</sup>Sr<sup>6</sup>Qc<sup>7</sup>Gl<sup>8</sup>Al<sup>9</sup>Sc

## Radiochemistry by Method Calculation

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
Combined Radium	0.519	<u>J</u>	0.272	0.538	06/22/2022 10:34	<u>WG1872769</u>

## Radiochemistry by Method SM7500Ra B M

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-226	0.232	<u>J</u>	0.216	0.249	06/10/2022 18:10	<u>WG1872769</u>
( <i>T</i> ) Barium-133	84.0			30.0-143	06/10/2022 18:10	<u>WG1872769</u>

22050087-007

Collected date/time: 05/24/22 14:15

## SAMPLE RESULTS - 07

L1499879

## Radiochemistry by Method 904/9320

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-228	0.183	<u>U</u>	0.237	0.682	06/22/2022 10:34	<u>WG1879107</u>
( <i>T</i> ) Barium	102			62.0-143	06/22/2022 10:34	<u>WG1879107</u>
( <i>T</i> ) Yttrium	98.7			79.0-136	06/22/2022 10:34	<u>WG1879107</u>

<sup>1</sup>Cp<sup>2</sup>Tc<sup>3</sup>Ss<sup>4</sup>Cn<sup>5</sup>Sr<sup>6</sup>Qc<sup>7</sup>Gl<sup>8</sup>Al<sup>9</sup>Sc

## Radiochemistry by Method Calculation

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
Combined Radium	0.295	<u>U</u>	0.288	0.725	06/22/2022 10:34	<u>WG1872769</u>

## Radiochemistry by Method SM7500Ra B M

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-226	0.112	<u>J</u>	0.164	0.246	06/10/2022 18:10	<u>WG1872769</u>
( <i>T</i> ) Barium-133	95.7			30.0-143	06/10/2022 18:10	<u>WG1872769</u>

22050087-008

Collected date/time: 05/24/22 08:48

## SAMPLE RESULTS - 08

L1499879

## Radiochemistry by Method 904/9320

Analyte	Result pCi/l	<u>Qualifier</u>	Uncertainty + / -	MDA pCi/l	Analysis Date date / time	<u>Batch</u>
RADIUM-228	1.23		0.319	0.874	06/22/2022 10:34	<a href="#">WG1879107</a>
( <i>T</i> ) Barium	82.6			62.0-143	06/22/2022 10:34	<a href="#">WG1879107</a>
( <i>T</i> ) Yttrium	98.5			79.0-136	06/22/2022 10:34	<a href="#">WG1879107</a>

<sup>1</sup>Cp<sup>2</sup>Tc<sup>3</sup>Ss<sup>4</sup>Cn<sup>5</sup>Sr<sup>6</sup>Qc<sup>7</sup>Gl<sup>8</sup>Al<sup>9</sup>Sc

## Radiochemistry by Method Calculation

Analyte	Result pCi/l	<u>Qualifier</u>	Uncertainty + / -	MDA pCi/l	Analysis Date date / time	<u>Batch</u>
Combined Radium	1.47		0.389	0.914	06/22/2022 10:34	<a href="#">WG1872769</a>

## Radiochemistry by Method SM7500Ra B M

Analyte	Result pCi/l	<u>Qualifier</u>	Uncertainty + / -	MDA pCi/l	Analysis Date date / time	<u>Batch</u>
RADIUM-226	0.242	J	0.223	0.266	06/10/2022 18:10	<a href="#">WG1872769</a>
( <i>T</i> ) Barium-133	80.8			30.0-143	06/10/2022 18:10	<a href="#">WG1872769</a>

22050087-009

Collected date/time: 05/25/22 11:34

## SAMPLE RESULTS - 09

L1499879

## Radiochemistry by Method 904/9320

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-228	0.657	J	0.236	0.657	06/22/2022 10:34	<a href="#">WG1879107</a>
(T) Barium	109			62.0-143	06/22/2022 10:34	<a href="#">WG1879107</a>
(T) Yttrium	102			79.0-136	06/22/2022 10:34	<a href="#">WG1879107</a>

<sup>1</sup>Cp<sup>2</sup>Tc<sup>3</sup>Ss<sup>4</sup>Cn<sup>5</sup>Sr<sup>6</sup>Qc<sup>7</sup>Gl<sup>8</sup>Al<sup>9</sup>Sc

## Radiochemistry by Method Calculation

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
Combined Radium	0.698	J	0.274	0.710	06/22/2022 10:34	<a href="#">WG1872769</a>

## Radiochemistry by Method SM7500Ra B M

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-226	0.0409	U	0.139	0.270	06/10/2022 18:10	<a href="#">WG1872769</a>
(T) Barium-133	85.9			30.0-143	06/10/2022 18:10	<a href="#">WG1872769</a>

22050087-010

Collected date/time: 05/24/22 15:24

## SAMPLE RESULTS - 10

L1499879

## Radiochemistry by Method 904/9320

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-228	0.365	<u>U</u>	0.285	0.806	06/22/2022 10:34	<u>WG1879107</u>
( <i>T</i> ) Barium	109			62.0-143	06/22/2022 10:34	<u>WG1879107</u>
( <i>T</i> ) Yttrium	99.9			79.0-136	06/22/2022 10:34	<u>WG1879107</u>

<sup>1</sup>Cp<sup>2</sup>Tc<sup>3</sup>Ss<sup>4</sup>Cn<sup>5</sup>Sr<sup>6</sup>Qc<sup>7</sup>Gl<sup>8</sup>Al<sup>9</sup>Sc

## Radiochemistry by Method Calculation

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
Combined Radium	0.365	<u>U</u>	0.294	0.838	06/22/2022 10:34	<u>WG1872769</u>

## Radiochemistry by Method SM7500Ra B M

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-226	-0.0400	<u>U</u>	0.0715	0.231	06/10/2022 18:10	<u>WG1872769</u>
( <i>T</i> ) Barium-133	91.3			30.0-143	06/10/2022 18:10	<u>WG1872769</u>

22050087-011

Collected date/time: 05/24/22 14:15

## SAMPLE RESULTS - 11

L1499879

## Radiochemistry by Method 904/9320

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-228	2.19		0.361	0.956	06/22/2022 10:34	<a href="#">WG1879107</a>
( <i>T</i> ) Barium	96.7			62.0-143	06/22/2022 10:34	<a href="#">WG1879107</a>
( <i>T</i> ) Yttrium	91.5			79.0-136	06/22/2022 10:34	<a href="#">WG1879107</a>

<sup>1</sup>Cp<sup>2</sup>Tc<sup>3</sup>Ss<sup>4</sup>Cn<sup>5</sup>Sr<sup>6</sup>Qc<sup>7</sup>Gl<sup>8</sup>Al<sup>9</sup>Sc

## Radiochemistry by Method Calculation

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
Combined Radium	2.37		0.389	0.964	06/22/2022 10:34	<a href="#">WG1872769</a>

## Radiochemistry by Method SM7500Ra B M

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-226	0.188		0.145	0.127	06/10/2022 18:10	<a href="#">WG1872769</a>
( <i>T</i> ) Barium-133	108			30.0-143	06/10/2022 18:10	<a href="#">WG1872769</a>

## QUALITY CONTROL SUMMARY

[L1499879-01,02,03,04,05,06,07,08,09,10,11](#)

## Method Blank (MB)

(MB) R3811243-1 06/20/22 16:20

Analyte	MB Result pCi/l	<u>MB Qualifier</u>	MB Uncertainty + / -	MB MDA pCi/l
Radium-228	0.239	J	0.178	0.334
(T) Barium	107		107	
(T) Yttrium	94.8		94.8	

<sup>1</sup>Cp<sup>2</sup>Tc<sup>3</sup>Ss<sup>4</sup>Cn<sup>5</sup>Sr<sup>6</sup>Qc<sup>7</sup>Gl<sup>8</sup>Al<sup>9</sup>Sc

## L1494363-07 Original Sample (OS) • Duplicate (DUP)

(OS) L1494363-07 06/24/22 15:08 • (DUP) R3811243-5 06/24/22 15:08

Analyte	Original Result pCi/l	Original Uncertainty + / -	Original MDA pCi/l	DUP Result pCi/l	DUP Uncertainty + / -	DUP MDA pCi/l	Dilution	DUP RPD %	DUP RER	<u>DUP Qualifier</u>	DUP RPD Limits %	DUP RER Limit
Radium-228	0.770	0.199	0.357	0.197	0.435	0.357	1	118	1.20	U	20	3
(T) Barium	103			104	104							
(T) Yttrium	109			107	107							

## Laboratory Control Sample (LCS)

(LCS) R3811243-2 06/20/22 16:20

Analyte	Spike Amount pCi/l	LCS Result pCi/l	LCS Rec. %	Rec. Limits %	<u>LCS Qualifier</u>
Radium-228	5.00	4.41	88.1	80.0-120	
(T) Barium			93.1		
(T) Yttrium			99.4		

## L1494363-05 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1494363-05 06/22/22 10:34 • (MS) R3811243-3 06/20/22 16:20 • (MSD) R3811243-4 06/20/22 16:20

Analyte	Spike Amount pCi/l	Original Result pCi/l	MS Result pCi/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	<u>MS Qualifier</u>	<u>MSD Qualifier</u>	RPD %	MS RER	RPD Limits %
Radium-228	16.7	1.59	18.9	17.8	104	97.1	1	70.0-130		5.99		20
(T) Barium		95.0			99.1	109						
(T) Yttrium		108			94.3	97.1						

## QUALITY CONTROL SUMMARY

[L1499879-01,02,03,04,05,06,07,08,09,10,11](#)

## Method Blank (MB)

(MB) R3803155-1 06/10/22 18:09

Analyte	MB Result pCi/l	<u>MB Qualifier</u> + / -	MB Uncertainty pCi/l	MB MDA pCi/l
Radium-226	0.0176	<span style="color: orange;">U</span>	0.0489	0.0800
(T) Barium-133	106		106	

<sup>1</sup>Cp<sup>2</sup>Tc<sup>3</sup>Ss<sup>4</sup>Cn<sup>5</sup>Sr<sup>6</sup>Qc<sup>7</sup>Gl<sup>8</sup>Al<sup>9</sup>Sc

## L1491809-13 Original Sample (OS) • Duplicate (DUP)

(OS) L1491809-13 06/10/22 18:09 • (DUP) R3803155-5 06/10/22 18:09

Analyte	Original Result pCi/l	Original Uncertainty + / -	Original MDA pCi/l	DUP Result pCi/l	DUP Uncertainty + / -	DUP MDA pCi/l	Dilution	DUP RPD %	DUP RER	<u>DUP Qualifier</u>	DUP RPD Limits %	DUP RER Limit
Radium-226	0.203	0.193	0.240	0.341	0.279	0.240	1	50.7	0.407	<span style="color: orange;">J</span>	20	3
(T) Barium-133	108			100	100							

## Laboratory Control Sample (LCS)

(LCS) R3803155-2 06/10/22 18:09

Analyte	Spike Amount pCi/l	LCS Result pCi/l	LCS Rec. %	Rec. Limits %	<u>LCS Qualifier</u>
Radium-226	5.02	5.53	110	80.0-120	
(T) Barium-133			103		

## L1499879-11 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1499879-11 06/10/22 18:10 • (MS) R3803155-3 06/10/22 18:09 • (MSD) R3803155-4 06/10/22 18:09

Analyte	Spike Amount pCi/l	Original Result pCi/l	MS Result pCi/l	MSD Result pCi/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	<u>MS Qualifier</u>	<u>MSD Qualifier</u>	RPD %	MS RER	RPD Limits %
Radium-226	20.0	0.188	18.0	19.8	88.8	98.0	1	75.0-125			9.75		20
(T) Barium-133		108			95.7	87.1							

# GLOSSARY OF TERMS

## Guide to Reading and Understanding Your Laboratory Report

The information below is designed to better explain the various terms used in your report of analytical results from the Laboratory. This is not intended as a comprehensive explanation, and if you have additional questions please contact your project representative.

**Results Disclaimer -** Information that may be provided by the customer, and contained within this report, include Permit Limits, Project Name, Sample ID, Sample Matrix, Sample Preservation, Field Blanks, Field Spikes, Field Duplicates, On-Site Data, Sampling Collection Dates/Times, and Sampling Location. Results relate to the accuracy of this information provided, and as the samples are received.

### Abbreviations and Definitions

MDA	Minimum Detectable Activity.	<sup>1</sup> Cp
Rec.	Recovery.	<sup>2</sup> Tc
RER	Replicate Error Ratio.	<sup>3</sup> Ss
RPD	Relative Percent Difference.	<sup>4</sup> Cn
SDG	Sample Delivery Group.	<sup>5</sup> Sr
(T)	Tracer - A radioisotope of known concentration added to a solution of chemically equivalent radioisotopes at a known concentration to assist in monitoring the yield of the chemical separation.	<sup>6</sup> Qc
Analyte	The name of the particular compound or analysis performed. Some Analyses and Methods will have multiple analytes reported.	<sup>7</sup> GI
Dilution	If the sample matrix contains an interfering material, the sample preparation volume or weight values differ from the standard, or if concentrations of analytes in the sample are higher than the highest limit of concentration that the laboratory can accurately report, the sample may be diluted for analysis. If a value different than 1 is used in this field, the result reported has already been corrected for this factor.	<sup>8</sup> AI
Limits	These are the target % recovery ranges or % difference value that the laboratory has historically determined as normal for the method and analyte being reported. Successful QC Sample analysis will target all analytes recovered or duplicated within these ranges.	<sup>9</sup> Sc
Original Sample	The non-spiked sample in the prep batch used to determine the Relative Percent Difference (RPD) from a quality control sample. The Original Sample may not be included within the reported SDG.	
Qualifier	This column provides a letter and/or number designation that corresponds to additional information concerning the result reported. If a Qualifier is present, a definition per Qualifier is provided within the Glossary and Definitions page and potentially a discussion of possible implications of the Qualifier in the Case Narrative if applicable.	
Result	The actual analytical final result (corrected for any sample specific characteristics) reported for your sample. If there was no measurable result returned for a specific analyte, the result in this column may state "ND" (Not Detected) or "BDL" (Below Detectable Levels). The information in the results column should always be accompanied by either an MDL (Method Detection Limit) or RDL (Reporting Detection Limit) that defines the lowest value that the laboratory could detect or report for this analyte.	
Uncertainty (Radiochemistry)	Confidence level of 2 sigma.	
Case Narrative (Cn)	A brief discussion about the included sample results, including a discussion of any non-conformances to protocol observed either at sample receipt by the laboratory from the field or during the analytical process. If present, there will be a section in the Case Narrative to discuss the meaning of any data qualifiers used in the report.	
Quality Control Summary (Qc)	This section of the report includes the results of the laboratory quality control analyses required by procedure or analytical methods to assist in evaluating the validity of the results reported for your samples. These analyses are not being performed on your samples typically, but on laboratory generated material.	
Sample Chain of Custody (Sc)	This is the document created in the field when your samples were initially collected. This is used to verify the time and date of collection, the person collecting the samples, and the analyses that the laboratory is requested to perform. This chain of custody also documents all persons (excluding commercial shippers) that have had control or possession of the samples from the time of collection until delivery to the laboratory for analysis.	
Sample Results (Sr)	This section of your report will provide the results of all testing performed on your samples. These results are provided by sample ID and are separated by the analyses performed on each sample. The header line of each analysis section for each sample will provide the name and method number for the analysis reported.	
Sample Summary (Ss)	This section of the Analytical Report defines the specific analyses performed for each sample ID, including the dates and times of preparation and/or analysis.	

### Qualifier      Description

J	The identification of the analyte is acceptable; the reported value is an estimate.
U	Below Detectable Limits: Indicates that the analyte was not detected.

# ACCREDITATIONS & LOCATIONS

Pace Analytical National 12065 Lebanon Rd Mount Juliet, TN 37122

Alabama	40660	Nebraska	NE-OS-15-05
Alaska	17-026	Nevada	TN000032021-1
Arizona	AZ0612	New Hampshire	2975
Arkansas	88-0469	New Jersey—NELAP	TN002
California	2932	New Mexico <sup>1</sup>	TN00003
Colorado	TN00003	New York	11742
Connecticut	PH-0197	North Carolina	Env375
Florida	E87487	North Carolina <sup>1</sup>	DW21704
Georgia	NELAP	North Carolina <sup>3</sup>	41
Georgia <sup>1</sup>	923	North Dakota	R-140
Idaho	TN00003	Ohio—VAP	CL0069
Illinois	200008	Oklahoma	9915
Indiana	C-TN-01	Oregon	TN200002
Iowa	364	Pennsylvania	68-02979
Kansas	E-10277	Rhode Island	LA000356
Kentucky <sup>1,6</sup>	KY90010	South Carolina	84004002
Kentucky <sup>2</sup>	16	South Dakota	n/a
Louisiana	AI30792	Tennessee <sup>1,4</sup>	2006
Louisiana	LA018	Texas	T104704245-20-18
Maine	TN00003	Texas <sup>5</sup>	LAB0152
Maryland	324	Utah	TN000032021-11
Massachusetts	M-TN003	Vermont	VT2006
Michigan	9958	Virginia	110033
Minnesota	047-999-395	Washington	C847
Mississippi	TN00003	West Virginia	233
Missouri	340	Wisconsin	998093910
Montana	CERT0086	Wyoming	A2LA
A2LA – ISO 17025	1461.01	AIHA-LAP,LLC EMLAP	100789
A2LA – ISO 17025 <sup>5</sup>	1461.02	DOD	1461.01
Canada	1461.01	USDA	P330-15-00234
EPA-Crypto	TN00003		

<sup>1</sup> Drinking Water <sup>2</sup> Underground Storage Tanks <sup>3</sup> Aquatic Toxicity <sup>4</sup> Chemical/Microbiological <sup>5</sup> Mold <sup>6</sup> Wastewater n/a Accreditation not applicable

\* Not all certifications held by the laboratory are applicable to the results reported in the attached report.

\* Accreditation is only applicable to the test methods specified on each scope of accreditation held by Pace Analytical.

<sup>1</sup> Cp

<sup>2</sup> Tc

<sup>3</sup> Ss

<sup>4</sup> Cn

<sup>5</sup> Sr

<sup>6</sup> Qc

<sup>7</sup> Gl

<sup>8</sup> Al

<sup>9</sup> Sc

## **TEKLAB, INC. Chain of Custody**

5445 Horseshoe Lake Road, Collinsville, IL 62234 Phone (618) 344-1004 Fax (618) 344-1005

Are the samples chilled? YES  NO  With:  Ice  Blue Ice Preserved in:  Lab  Field

**Teklab Inc**  
**5445 Horseshoe Lake Road**  
**Collinsville, IL 62234**

Cooler Temp:  Sampler: Joseph Riley

Sampler: Joseph Riley/Adam Bridges

QC Level:  2

1

Project# 22050087

Comments: Please Issue reports and invoices via email only

Please analyze for Radium 226/228 on your standard turn around time.

Samples collected from an IL site.

Batch QC is required for all analyses requested. EDD requested..

Contact: Elizabeth Hu  
Requested Due Date: Standard TA

Email: EHurley@TekLabInc.com  
Billing/PO: 32866

Phone: (618) 344-1004

**PLEASE NOTE:**

NELAP accreditation is required on the requested analytes and must be documented as such on the final report. If your laboratory does not currently hold a NELAP accreditation for the requested method and/or analytes, please contact Teklab immediately. If your laboratory loses accreditation or is suspended for any analyte/method during the life of the contract, you must contact Teklab immediately.

Any changes to analysis/methods must be approved by Teklab, Inc.

\*Relinquished By

Date/Time

Received By

Date/Time

5/31/22 10<sup>0</sup>

Teklab maintains a strict policy of client confidentiality and as such does not provide client/sampler  
Teklab, Inc. protects clients' confidential information as directed by local, state or federal law.

<b>SMP</b>	<b>Sample Receipt Checklist</b>	<b>5821</b>	<b>5897</b>	<b>6961</b>
COC Seal Present/Intact:	<input checked="" type="checkbox"/>	<input type="checkbox"/> N	If Applicable	
COC Signed/Accurate:	<input checked="" type="checkbox"/>	<input type="checkbox"/> N	VOA Zero Headspace:	<input checked="" type="checkbox"/> Y
Bottles arrive intact:	<input checked="" type="checkbox"/>	<input type="checkbox"/> N	Pres.Correct/Check:	<input checked="" type="checkbox"/> Y
Correct bottles used:	<input checked="" type="checkbox"/>	<input type="checkbox"/> N	<i>AMB</i>	
Sufficient volume sent:	<input checked="" type="checkbox"/>	<input type="checkbox"/> N		
Spec. No. 10-5-1-B/1	<input checked="" type="checkbox"/>	<input type="checkbox"/> N		

October 10, 2022

Jason McLaurin  
Southern Illinois Power Cooperation  
11543 Lake of Egypt Road  
Marion, IL 62959  
TEL: (618) 964-1448  
FAX:



Illinois	100226
Kansas	E-10374
Louisiana	05002
Louisiana	05003
Oklahoma	9978

**RE:** Groundwater Monitoring

**WorkOrder:** 22080134

Dear Jason McLaurin:

TEKLAB, INC received 11 samples on 9/8/2022 8:45:00 AM for the analysis presented in the following report.

Samples are analyzed on an as received basis unless otherwise requested and documented. The sample results contained in this report relate only to the requested analytes of interest as directed on the chain of custody. NELAP accredited fields of testing are indicated by the letters NELAP under the Certification column. Unless otherwise documented within this report, Teklab Inc. analyzes samples utilizing the most current methods in compliance with 40CFR. All tests are performed in the Collinsville, IL laboratory unless otherwise noted in the Case Narrative.

All quality control criteria applicable to the test methods employed for this project have been satisfactorily met and are in accordance with NELAP except where noted. The following report shall not be reproduced, except in full, without the written approval of Teklab, Inc.

If you have any questions regarding these tests results, please feel free to call.

Sincerely,



Elizabeth A. Hurley  
Director of Customer Service  
(618)344-1004 ex 33  
[ehurley@teklabinc.com](mailto:ehurley@teklabinc.com)

**Client:** Southern Illinois Power Cooperation

**Work Order:** 22080134

**Client Project:** Groundwater Monitoring

**Report Date:** 10-Oct-22

---

This reporting package includes the following:

Cover Letter	1
Report Contents	2
Definitions	3
Case Narrative	5
Accreditations	6
Laboratory Results	7
Quality Control Results	27
Receiving Check List	39
Chain of Custody	Appended

## Definitions

<http://www.teklabinc.com/>

**Client:** Southern Illinois Power Cooperation

**Work Order:** 22080134

**Client Project:** Groundwater Monitoring

**Report Date:** 10-Oct-22

### Abbr Definition

\* Analytes on report marked with an asterisk are not NELAP accredited

CCV Continuing calibration verification is a check of a standard to determine the state of calibration of an instrument between recalibration.

CRQL A Client Requested Quantitation Limit is a reporting limit that varies according to customer request. The CRQL may not be less than the MDL.

DF Dilution factor is the dilution performed during analysis only and does not take into account any dilutions made during sample preparation. The reported result is final and includes all dilution factors.

DNI Did not ignite

DUP Laboratory duplicate is a replicate aliquot prepared under the same laboratory conditions and independently analyzed to obtain a measure of precision.

ICV Initial calibration verification is a check of a standard to determine the state of calibration of an instrument before sample analysis is initiated.

IDPH IL Dept. of Public Health

LCS Laboratory control sample is a sample matrix, free from the analytes of interest,spiked with verified known amounts of analytes and analyzed exactly like a sample to establish intra-laboratory or analyst specific precision and bias or to assess the performance of all or a portion of the measurement system.

LCSD Laboratory control sample duplicate is a replicate laboratory control sample that is prepared and analyzed in order to determine the precision of the approved test method. The acceptable recovery range is listed in the QC Package (provided upon request).

MBLK Method blank is a sample of a matrix similar to the batch of associated sample (when available) that is free from the analytes of interest and is processed simultaneously with and under the same conditions as samples through all steps of the analytical procedures, and in which no target analytes or interferences should present at concentrations that impact the analytical results for sample analyses.

MDL "The method detection limit is defined as the minimum measured concentration of a substance that can be reported with 99% confidence that the measured concentration is distinguishable from method blank results."

MS Matrix spike is an aliquot of matrix fortified (spiked) with known quantities of specific analytes that is subjected to the entire analytical procedures in order to determine the effect of the matrix on an approved test method's recovery system. The acceptable recovery range is listed in the QC Package (provided upon request).

MSD Matrix spike duplicate means a replicate matrix spike that is prepared and analyzed in order to determine the precision of the approved test method. The acceptable recovery range is listed in the QC Package (provided upon request).

MW Molecular weight

NC Data is not acceptable for compliance purposes

ND Not Detected at the Reporting Limit

NELAP NELAP Accredited

PQL Practical quantitation limit means the lowest level that can be reliably achieved within specified limits of precision and accuracy during routine laboratory operation conditions.

RL The reporting limit the lowest level that the data is displayed in the final report. The reporting limit may vary according to customer request or sample dilution. The reporting limit may not be less than the MDL.

RPD Relative percent difference is a calculated difference between two recoveries (ie. MS/MSD). The acceptable recovery limit is listed in the QC Package (provided upon request).

SPK The spike is a known mass of target analyte added to a blank sample or sub-sample; used to determine recovery deficiency or for other quality control purposes.

Surr Surrogates are compounds which are similar to the analytes of interest in chemical composition and behavior in the analytical process, but which are not normally found in environmental samples.

TIC Tentatively identified compound: Analytes tentatively identified in the sample by using a library search. Only results not in the calibration standard will be reported as tentatively identified compounds. Results for tentatively identified compounds that are not present in the calibration standard, but are assigned a specific chemical name based upon the library search, are calculated using total peak areas from reconstructed ion chromatograms and a response factor of one. The nearest Internal Standard is used for the calculation. The results of any TICs must be considered estimated, and are flagged with a "T". If the estimated result is above the calibration range it is flagged "ET"

TNTC Too numerous to count ( > 200 CFU )

## Definitions

<http://www.teklabinc.com/>

**Client:** Southern Illinois Power Cooperation

**Work Order:** 22080134

**Client Project:** Groundwater Monitoring

**Report Date:** 10-Oct-22

### Qualifiers

- |   |  |
|---|--|
| # - Unknown hydrocarbon                               | B - Analyte detected in associated Method Blank              |
| C - RL shown is a Client Requested Quantitation Limit | E - Value above quantitation range                           |
| H - Holding times exceeded                            | I - Associated internal standard was outside method criteria |
| J - Analyte detected below quantitation limits        | M - Manual Integration used to determine area response       |
| ND - Not Detected at the Reporting Limit              | R - RPD outside accepted recovery limits                     |
| S - Spike Recovery outside recovery limits            | T - TIC(Tentatively identified compound)                     |
| X - Value exceeds Maximum Contaminant Level           |  |



## Case Narrative

<http://www.teklabinc.com/>

**Client:** Southern Illinois Power Cooperation

**Work Order:** 22080134

**Client Project:** Groundwater Monitoring

**Report Date:** 10-Oct-22

**Cooler Receipt Temp:** 0.6 °C

An employee of Teklab, Inc. collected the sample(s).

Radium-226 and Radium-228 analysis was performed by Pace Analytical Services, LLC. See attached report for results.

### Locations

<b>Collinsville</b>	
<b>Address</b>	5445 Horseshoe Lake Road Collinsville, IL 62234-7425
<b>Phone</b>	(618) 344-1004
<b>Fax</b>	(618) 344-1005
<b>Email</b>	jhriley@teklabinc.com

<b>Collinsville Air</b>	
<b>Address</b>	5445 Horseshoe Lake Road Collinsville, IL 62234-7425
<b>Phone</b>	(618) 344-1004
<b>Fax</b>	(618) 344-1005
<b>Email</b>	EHurley@teklabinc.com

<b>Springfield</b>	
<b>Address</b>	3920 Pintail Dr Springfield, IL 62711-9415
<b>Phone</b>	(217) 698-1004
<b>Fax</b>	(217) 698-1005
<b>Email</b>	KKlostermann@teklabinc.com

<b>Chicago</b>	
<b>Address</b>	1319 Butterfield Rd. Downers Grove, IL 60515
<b>Phone</b>	(630) 324-6855
<b>Fax</b>	
<b>Email</b>	arenner@teklabinc.com

<b>Kansas City</b>	
<b>Address</b>	8421 Nieman Road Lenexa, KS 66214
<b>Phone</b>	(913) 541-1998
<b>Fax</b>	(913) 541-1998
<b>Email</b>	jhriley@teklabinc.com

## Accreditations

<http://www.teklabinc.com/>

**Client:** Southern Illinois Power Cooperation

**Work Order:** 22080134

**Client Project:** Groundwater Monitoring

**Report Date:** 10-Oct-22

<b>State</b>	<b>Dept</b>	<b>Cert #</b>	<b>NELAP</b>	<b>Exp Date</b>	<b>Lab</b>
Illinois	IEPA	100226	NELAP	1/31/2023	Collinsville
Kansas	KDHE	E-10374	NELAP	4/30/2023	Collinsville
Louisiana	LDEQ	05002	NELAP	6/30/2023	Collinsville
Louisiana	LDEQ	05003	NELAP	6/30/2023	Collinsville
Oklahoma	ODEQ	9978	NELAP	8/31/2023	Collinsville
Arkansas	ADEQ	88-0966		3/14/2023	Collinsville
Illinois	IDPH	17584		5/31/2023	Collinsville
Iowa	IDNR	430		6/1/2024	Collinsville
Kentucky	UST	0073		1/31/2023	Collinsville
Missouri	MDNR	00930		5/31/2023	Collinsville
Missouri	MDNR	930		1/31/2025	Collinsville

**Client:** Southern Illinois Power Cooperation  
**Client Project:** Groundwater Monitoring

**Work Order:** 22080134  
**Report Date:** 10-Oct-22

**Lab ID:** 22080134-001

**Client Sample ID:** EBG

**Matrix:** GROUNDWATER

**Collection Date:** 09/06/2022 12:19

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>FIELD ELEVATION MEASUREMENTS</b>									
Depth to water from measuring point	*	0	0		8.45	ft	1	09/06/2022 12:19	R318074
Elevation of groundwater surface	*	0	0		516.42	ft	1	09/06/2022 12:19	R318074
Measuring Point Elevation	*	0	0		524.87	ft	1	09/06/2022 12:19	R318074
<b>FIELD PURGE VOLUME</b>									
Purge Volume	*	0	0		1.56	gal	1	09/06/2022 12:19	R318074
<b>STANDARD METHODS 2130 B FIELD</b>									
Turbidity	*	1.0	1.0		3.5	NTU	1	09/06/2022 12:19	R318074
<b>STANDARD METHODS 18TH ED. 2580 B FIELD</b>									
Oxidation-Reduction Potential	*	-300	-300		180	mV	1	09/06/2022 12:19	R318074
<b>STANDARD METHODS 2510 B FIELD</b>									
Spec. Conductance, Field	*	0	0		0.530	mS/cm	1	09/06/2022 12:19	R318074
<b>STANDARD METHODS 2550 B FIELD</b>									
Temperature	*	0	0		19.4	°C	1	09/06/2022 12:19	R318074
<b>STANDARD METHODS 4500-O G FIELD</b>									
Oxygen, Dissolved	*	0	0		4.23	mg/L	1	09/06/2022 12:19	R318074
<b>SW-846 9040B FIELD</b>									
pH	*	0	1.00		6.60		1	09/06/2022 12:19	R318074
<b>STANDARD METHODS 2540 C (TOTAL) 1997, 2011</b>									
Total Dissolved Solids	NELAP	16	20	H	322	mg/L	1	10/06/2022 11:11	R319177
Sample required re-analysis out of hold time.									
<b>STANDARD METHODS 4500-CL E (TOTAL) 1997, 2011</b>									
Chloride	NELAP	1	4		10	mg/L	1	09/14/2022 12:51	R318019
<b>SW-846 9036 (TOTAL)</b>									
Sulfate	NELAP	31	50		101	mg/L	5	09/14/2022 12:58	R318056
<b>SW-846 9214 (TOTAL)</b>									
Fluoride	NELAP	0.04	0.10		0.61	mg/L	1	09/12/2022 14:57	R317927
<b>SW-846 3005A, 6010B, METALS BY ICP (TOTAL)</b>									
Barium	NELAP	0.0007	0.0025		0.0491	mg/L	1	09/09/2022 10:52	196431
Boron	NELAP	0.0090	0.020	J	0.012	mg/L	1	09/09/2022 10:52	196431
Calcium	NELAP	0.0350	0.100		10.9	mg/L	1	09/09/2022 10:52	196431
<b>SW-846 3005A, 6020A, METALS BY ICPMS (TOTAL)</b>									
Antimony	NELAP	0.0004	0.0010		< 0.0010	mg/L	5	09/12/2022 12:09	196431
Arsenic	NELAP	0.0004	0.0010		< 0.0010	mg/L	5	09/12/2022 12:09	196431
Beryllium	NELAP	0.0002	0.0010		< 0.0010	mg/L	5	09/14/2022 6:27	196431
Cadmium	NELAP	0.0002	0.0010		< 0.0010	mg/L	5	09/12/2022 12:09	196431
Chromium	NELAP	0.0007	0.0015		< 0.0015	mg/L	5	09/15/2022 2:41	196431
Cobalt	NELAP	0.0001	0.0010	J	0.0002	mg/L	5	09/14/2022 6:27	196431
Lead	NELAP	0.0006	0.0010		< 0.0010	mg/L	5	09/12/2022 12:09	196431
Lithium	*	0.0015	0.0030		0.0141	mg/L	5	09/12/2022 12:09	196431
Molybdenum	NELAP	0.0006	0.0015	J	0.0012	mg/L	5	09/12/2022 12:09	196431
Selenium	NELAP	0.0006	0.0010	J	0.0006	mg/L	5	09/12/2022 12:09	196431
Thallium	NELAP	0.0010	0.0020		< 0.0020	mg/L	5	09/14/2022 6:27	196431
PQL recovered outside the upper control limits for Cr. Sample results are below the reporting limit. Data is reportable per the TNI standard.									
<b>SW-846 7470A (TOTAL)</b>									
Mercury	NELAP	0.00006	0.00020		< 0.00020	mg/L	1	09/15/2022 11:23	196576

## Laboratory Results

<http://www.teklabinc.com/>

**Client:** Southern Illinois Power Cooperation

**Work Order:** 22080134

**Client Project:** Groundwater Monitoring

**Report Date:** 10-Oct-22

**Lab ID:** 22080134-001

**Client Sample ID:** EBG

**Matrix:** GROUNDWATER

**Collection Date:** 09/06/2022 12:19

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>EPA 903.0/904.0, RADIUM 226/228</b>									
Radium-226	*	0	0		See Attached	pCi/L	1	09/16/2022 0:00	R318593
Radium-228	*	0	0		See Attached	pCi/L	1	09/16/2022 0:00	R318593

**Client:** Southern Illinois Power Cooperation  
**Client Project:** Groundwater Monitoring

**Work Order:** 22080134  
**Report Date:** 10-Oct-22

**Lab ID:** 22080134-002

**Client Sample ID:** EP-1

**Matrix:** GROUNDWATER

**Collection Date:** 09/06/2022 14:37

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>FIELD ELEVATION MEASUREMENTS</b>									
Depth to water from measuring point	*	0	0		8.32	ft	1	09/06/2022 14:37	R318074
Elevation of groundwater surface	*	0	0		511.40	ft	1	09/06/2022 14:37	R318074
Measuring Point Elevation	*	0	0		519.72	ft	1	09/06/2022 14:37	R318074
<b>FIELD PURGE VOLUME</b>									
Purge Volume	*	0	0		0.91	gal	1	09/06/2022 14:37	R318074
<b>STANDARD METHODS 2130 B FIELD</b>									
Turbidity	*	1.0	1.0		< 1.0	NTU	1	09/06/2022 14:37	R318074
<b>STANDARD METHODS 18TH ED. 2580 B FIELD</b>									
Oxidation-Reduction Potential	*	-300	-300		201	mV	1	09/06/2022 14:37	R318074
<b>STANDARD METHODS 2510 B FIELD</b>									
Spec. Conductance, Field	*	0	0		2.80	mS/cm	1	09/06/2022 14:37	R318074
<b>STANDARD METHODS 2550 B FIELD</b>									
Temperature	*	0	0		17.6	°C	1	09/06/2022 14:37	R318074
<b>STANDARD METHODS 4500-O G FIELD</b>									
Oxygen, Dissolved	*	0	0		0.22	mg/L	1	09/06/2022 14:37	R318074
<b>SW-846 9040B FIELD</b>									
pH	*	0	1.00		6.21		1	09/06/2022 14:37	R318074
<b>STANDARD METHODS 2540 C (TOTAL) 1997, 2011</b>									
Total Dissolved Solids	NELAP	16	20	H	2600	mg/L	1	10/06/2022 11:11	R319177
Sample required re-analysis out of hold time.									
<b>STANDARD METHODS 4500-CL E (TOTAL) 1997, 2011</b>									
Chloride	NELAP	1	4		35	mg/L	1	09/14/2022 12:59	R318019
<b>SW-846 9036 (TOTAL)</b>									
Sulfate	NELAP	307	500		1570	mg/L	50	09/14/2022 13:19	R318056
<b>SW-846 9214 (TOTAL)</b>									
Fluoride	NELAP	0.04	0.10		0.21	mg/L	1	09/12/2022 15:02	R317927
<b>SW-846 3005A, 6010B, METALS BY ICP (TOTAL)</b>									
Barium	NELAP	0.0007	0.0025		0.0170	mg/L	1	09/09/2022 11:02	196431
Boron	NELAP	0.0090	0.0200		1.16	mg/L	1	09/09/2022 11:02	196431
Calcium	NELAP	0.0350	0.100		476	mg/L	1	09/09/2022 11:02	196431
<b>SW-846 3005A, 6020A, METALS BY ICPMS (TOTAL)</b>									
Antimony	NELAP	0.0004	0.0010		< 0.0010	mg/L	5	09/12/2022 12:15	196431
Arsenic	NELAP	0.0004	0.0010	J	0.0004	mg/L	5	09/12/2022 12:15	196431
Beryllium	NELAP	0.0002	0.0010		< 0.0010	mg/L	5	09/14/2022 6:33	196431
Cadmium	NELAP	0.0002	0.0010		< 0.0010	mg/L	5	09/12/2022 12:15	196431
Chromium	NELAP	0.0007	0.0015		< 0.0015	mg/L	5	09/15/2022 2:48	196431
Cobalt	NELAP	0.0001	0.0010		< 0.0010	mg/L	5	09/14/2022 6:33	196431
Lead	NELAP	0.0006	0.0010		< 0.0010	mg/L	5	09/12/2022 12:15	196431
Lithium	*	0.0015	0.0030		0.0120	mg/L	5	09/12/2022 12:15	196431
Molybdenum	NELAP	0.0006	0.0015		< 0.0015	mg/L	5	09/12/2022 12:15	196431
Selenium	NELAP	0.0006	0.0010		0.0015	mg/L	5	09/12/2022 12:15	196431
Thallium	NELAP	0.0010	0.0020		< 0.0020	mg/L	5	09/14/2022 6:33	196431
PQL recovered outside the upper control limits for Cr. Sample results are below the reporting limit. Data is reportable per the TNI standard.									
<b>SW-846 7470A (TOTAL)</b>									
Mercury	NELAP	0.00006	0.00020		< 0.00020	mg/L	1	09/15/2022 11:26	196576

## Laboratory Results

<http://www.teklabinc.com/>

**Client:** Southern Illinois Power Cooperation

**Work Order:** 22080134

**Client Project:** Groundwater Monitoring

**Report Date:** 10-Oct-22

**Lab ID:** 22080134-002

**Client Sample ID:** EP-1

**Matrix:** GROUNDWATER

**Collection Date:** 09/06/2022 14:37

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>EPA 903.0/904.0, RADIUM 226/228</b>									
Radium-226	*	0	0		See Attached	pCi/L	1	09/16/2022 0:00	R318593
Radium-228	*	0	0		See Attached	pCi/L	1	09/16/2022 0:00	R318593

**Client:** Southern Illinois Power Cooperation  
**Client Project:** Groundwater Monitoring

**Work Order:** 22080134  
**Report Date:** 10-Oct-22

**Lab ID:** 22080134-003

**Client Sample ID:** EP-2

**Matrix:** GROUNDWATER

**Collection Date:** 09/07/2022 11:25

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>FIELD ELEVATION MEASUREMENTS</b>									
Depth to water from measuring point	*	0	0		10.40	ft	1	09/07/2022 11:25	R318074
Elevation of groundwater surface	*	0	0		503.39	ft	1	09/07/2022 11:25	R318074
Measuring Point Elevation	*	0	0		513.79	ft	1	09/07/2022 11:25	R318074
<b>FIELD PURGE VOLUME</b>									
Purge Volume	*	0	0		0.65	gal	1	09/07/2022 11:25	R318074
<b>STANDARD METHODS 2130 B FIELD</b>									
Turbidity	*	1.0	1.0		< 1.0	NTU	1	09/07/2022 11:25	R318074
<b>STANDARD METHODS 18TH ED. 2580 B FIELD</b>									
Oxidation-Reduction Potential	*	-300	-300		123	mV	1	09/07/2022 11:25	R318074
<b>STANDARD METHODS 2510 B FIELD</b>									
Spec. Conductance, Field	*	0	0		3.02	mS/cm	1	09/07/2022 11:25	R318074
<b>STANDARD METHODS 2550 B FIELD</b>									
Temperature	*	0	0		20.2	°C	1	09/07/2022 11:25	R318074
<b>STANDARD METHODS 4500-O G FIELD</b>									
Oxygen, Dissolved	*	0	0		1.76	mg/L	1	09/07/2022 11:25	R318074
<b>SW-846 9040B FIELD</b>									
pH	*	0	1.00		6.19		1	09/07/2022 11:25	R318074
<b>STANDARD METHODS 2540 C (TOTAL) 1997, 2011</b>									
Total Dissolved Solids	NELAP	16	20		2580	mg/L	1	09/12/2022 11:56	R317996
<b>STANDARD METHODS 4500-CL E (TOTAL) 1997, 2011</b>									
Chloride	NELAP	1	4		44	mg/L	1	09/14/2022 13:21	R318019
<b>SW-846 9036 (TOTAL)</b>									
Sulfate	NELAP	307	500		1760	mg/L	50	09/14/2022 13:26	R318056
<b>SW-846 9214 (TOTAL)</b>									
Fluoride	NELAP	0.04	0.10		0.47	mg/L	1	09/14/2022 9:09	R318011
<b>SW-846 3005A, 6010B, METALS BY ICP (TOTAL)</b>									
Barium	NELAP	0.0007	0.0025		0.0205	mg/L	1	09/09/2022 11:06	196431
Boron	NELAP	0.0090	0.0200		0.408	mg/L	1	09/09/2022 11:06	196431
Calcium	NELAP	0.0350	0.100		349	mg/L	1	09/09/2022 11:06	196431
<b>SW-846 3005A, 6020A, METALS BY ICPMS (TOTAL)</b>									
Antimony	NELAP	0.0004	0.0010		< 0.0010	mg/L	5	09/12/2022 12:21	196431
Arsenic	NELAP	0.0004	0.0010		0.0016	mg/L	5	09/12/2022 12:21	196431
Beryllium	NELAP	0.0002	0.0010		< 0.0010	mg/L	5	09/15/2022 2:54	196431
Cadmium	NELAP	0.0002	0.0010	J	0.0003	mg/L	5	09/12/2022 12:21	196431
Chromium	NELAP	0.0007	0.0015		< 0.0015	mg/L	5	09/15/2022 10:19	196431
Cobalt	NELAP	0.0001	0.0010		0.0325	mg/L	5	09/15/2022 2:54	196431
Lead	NELAP	0.0006	0.0010		< 0.0010	mg/L	5	09/12/2022 12:21	196431
Lithium	*	0.0015	0.0030		0.0123	mg/L	5	09/12/2022 12:21	196431
Molybdenum	NELAP	0.0006	0.0015	J	0.0009	mg/L	5	09/12/2022 12:21	196431
Selenium	NELAP	0.0006	0.0010		< 0.0010	mg/L	5	09/12/2022 12:21	196431
Thallium	NELAP	0.0010	0.0020		< 0.0020	mg/L	5	09/14/2022 7:24	196431
<b>SW-846 7470A (TOTAL)</b>									
Mercury	NELAP	0.00006	0.00020		< 0.00020	mg/L	1	09/15/2022 11:28	196576
<b>EPA 903.0/904.0, RADIUM 226/228</b>									
Radium-226	*	0	0		See Attached	pci/L	1	09/16/2022 0:00	R318593

**Laboratory Results**<http://www.teklabinc.com/>**Client:** Southern Illinois Power Cooperation**Work Order:** 22080134**Client Project:** Groundwater Monitoring**Report Date:** 10-Oct-22**Lab ID:** 22080134-003**Client Sample ID:** EP-2**Matrix:** GROUNDWATER**Collection Date:** 09/07/2022 11:25

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>EPA 903.0/904.0, RADIUM 226/228</b>									
Radium-228	*	0	0		See Attached	pCi/L	1	09/16/2022 0:00	R318593

Client: Southern Illinois Power Cooperation  
 Client Project: Groundwater Monitoring

Work Order: 22080134  
 Report Date: 10-Oct-22

Lab ID: 22080134-004

Client Sample ID: EP-3

Matrix: GROUNDWATER

Collection Date: 09/07/2022 12:27

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>FIELD ELEVATION MEASUREMENTS</b>									
Depth to water from measuring point	*	0	0		17.00	ft	1	09/07/2022 12:27	R318074
Elevation of groundwater surface	*	0	0		501.95	ft	1	09/07/2022 12:27	R318074
Measuring Point Elevation	*	0	0		518.95	ft	1	09/07/2022 12:27	R318074
<b>FIELD PURGE VOLUME</b>									
Purge Volume	*	0	0		1.17	gal	1	09/07/2022 12:27	R318074
<b>STANDARD METHODS 2130 B FIELD</b>									
Turbidity	*	1.0	1.0		0.42	NTU	1	09/07/2022 12:27	R318074
<b>STANDARD METHODS 18TH ED. 2580 B FIELD</b>									
Oxidation-Reduction Potential	*	-300	-300		36	mV	1	09/07/2022 12:27	R318074
<b>STANDARD METHODS 2510 B FIELD</b>									
Spec. Conductance, Field	*	0	0		1.34	mS/cm	1	09/07/2022 12:27	R318074
<b>STANDARD METHODS 2550 B FIELD</b>									
Temperature	*	0	0		20.0	°C	1	09/07/2022 12:27	R318074
<b>STANDARD METHODS 4500-O G FIELD</b>									
Oxygen, Dissolved	*	0	0		0.11	mg/L	1	09/07/2022 12:27	R318074
<b>SW-846 9040B FIELD</b>									
pH	*	0	1.00		6.05		1	09/07/2022 12:27	R318074
<b>STANDARD METHODS 2540 C (TOTAL) 1997, 2011</b>									
Total Dissolved Solids	NELAP	40	50		670	mg/L	2.5	09/12/2022 11:56	R317996
<b>STANDARD METHODS 4500-CL E (TOTAL) 1997, 2011</b>									
Chloride	NELAP	2	20		147	mg/L	5	09/14/2022 13:29	R318019
<b>SW-846 9036 (TOTAL)</b>									
Sulfate	NELAP	31	50		151	mg/L	5	09/14/2022 13:29	R318056
<b>SW-846 9214 (TOTAL)</b>									
Fluoride	NELAP	0.04	0.10		0.21	mg/L	1	09/14/2022 9:11	R318011
<b>SW-846 3005A, 6010B, METALS BY ICP (TOTAL)</b>									
Barium	NELAP	0.0007	0.0025		0.0855	mg/L	1	09/09/2022 11:28	196431
Boron	NELAP	0.0090	0.0200		0.0708	mg/L	1	09/09/2022 11:28	196431
Calcium	NELAP	0.0350	0.100		36.2	mg/L	1	09/09/2022 11:28	196431
<b>SW-846 3005A, 6020A, METALS BY ICPMS (TOTAL)</b>									
Antimony	NELAP	0.0004	0.0010		< 0.0010	mg/L	5	09/12/2022 12:28	196431
Arsenic	NELAP	0.0004	0.0010		0.0070	mg/L	5	09/12/2022 12:28	196431
Beryllium	NELAP	0.0002	0.0010		< 0.0010	mg/L	5	09/15/2022 3:00	196431
Cadmium	NELAP	0.0002	0.0010		< 0.0010	mg/L	5	09/12/2022 12:28	196431
Chromium	NELAP	0.0007	0.0015		< 0.0015	mg/L	5	09/15/2022 3:00	196431
Cobalt	NELAP	0.0001	0.0010		0.104	mg/L	5	09/15/2022 3:00	196431
Lead	NELAP	0.0006	0.0010		< 0.0010	mg/L	5	09/12/2022 12:28	196431
Lithium	*	0.0015	0.0030		0.0270	mg/L	5	09/12/2022 12:28	196431
Molybdenum	NELAP	0.0006	0.0015		< 0.0015	mg/L	5	09/12/2022 12:28	196431
Selenium	NELAP	0.0006	0.0010		< 0.0010	mg/L	5	09/12/2022 12:28	196431
Thallium	NELAP	0.0010	0.0020		< 0.0020	mg/L	5	09/14/2022 7:30	196431
PQL recovered outside the upper control limits for Cr. Sample results are below the reporting limit. Data is reportable per the TNI standard.									
<b>SW-846 7470A (TOTAL)</b>									
Mercury	NELAP	0.00006	0.00020		< 0.00020	mg/L	1	09/15/2022 11:30	196576

## Laboratory Results

<http://www.teklabinc.com/>

**Client:** Southern Illinois Power Cooperation

**Work Order:** 22080134

**Client Project:** Groundwater Monitoring

**Report Date:** 10-Oct-22

**Lab ID:** 22080134-004

**Client Sample ID:** EP-3

**Matrix:** GROUNDWATER

**Collection Date:** 09/07/2022 12:27

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>EPA 903.0/904.0, RADIUM 226/228</b>									
Radium-226	*	0	0		See Attached	pCi/L	1	09/16/2022 0:00	R318593
Radium-228	*	0	0		See Attached	pCi/L	1	09/16/2022 0:00	R318593

Client: Southern Illinois Power Cooperation  
 Client Project: Groundwater Monitoring

Work Order: 22080134  
 Report Date: 10-Oct-22

Lab ID: 22080134-005

Client Sample ID: EP-4

Matrix: GROUNDWATER

Collection Date: 09/07/2022 13:02

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>FIELD ELEVATION MEASUREMENTS</b>									
Depth to water from measuring point	*	0	0		7.02	ft	1	09/07/2022 13:02	R318074
Elevation of groundwater surface	*	0	0		512.72	ft	1	09/07/2022 13:02	R318074
Measuring Point Elevation	*	0	0		519.74	ft	1	09/07/2022 13:02	R318074
<b>FIELD PURGE VOLUME</b>									
Purge Volume	*	0	0		0.65	gal	1	09/07/2022 13:02	R318074
<b>STANDARD METHODS 2130 B FIELD</b>									
Turbidity	*	1.0	1.0		< 1.0	NTU	1	09/07/2022 13:02	R318074
<b>STANDARD METHODS 18TH ED. 2580 B FIELD</b>									
Oxidation-Reduction Potential	*	-300	-300		77	mV	1	09/07/2022 13:02	R318074
<b>STANDARD METHODS 2510 B FIELD</b>									
Spec. Conductance, Field	*	0	0		2.74	mS/cm	1	09/07/2022 13:02	R318074
<b>STANDARD METHODS 2550 B FIELD</b>									
Temperature	*	0	0		20.9	°C	1	09/07/2022 13:02	R318074
<b>STANDARD METHODS 4500-O G FIELD</b>									
Oxygen, Dissolved	*	0	0		0.21	mg/L	1	09/07/2022 13:02	R318074
<b>SW-846 9040B FIELD</b>									
pH	*	0	1.00		5.70		1	09/07/2022 13:02	R318074
<b>STANDARD METHODS 2540 C (TOTAL) 1997, 2011</b>									
Total Dissolved Solids	NELAP	40	50		1640	mg/L	2.5	09/12/2022 11:57	R317996
<b>STANDARD METHODS 4500-CL E (TOTAL) 1997, 2011</b>									
Chloride	NELAP	5	40		478	mg/L	10	09/14/2022 13:37	R318019
<b>SW-846 9036 (TOTAL)</b>									
Sulfate	NELAP	123	200		673	mg/L	20	09/14/2022 13:42	R318056
<b>SW-846 9214 (TOTAL)</b>									
Fluoride	NELAP	0.04	0.10	J	0.10	mg/L	1	09/14/2022 9:13	R318011
<b>SW-846 3005A, 6010B, METALS BY ICP (TOTAL)</b>									
Barium	NELAP	0.0007	0.0025		0.0236	mg/L	1	09/09/2022 11:33	196431
Boron	NELAP	0.0090	0.0200		11.8	mg/L	1	09/09/2022 11:33	196431
Calcium	NELAP	0.0350	0.100		147	mg/L	1	09/09/2022 11:33	196431
<b>SW-846 3005A, 6020A, METALS BY ICPMS (TOTAL)</b>									
Antimony	NELAP	0.0004	0.0010		< 0.0010	mg/L	5	09/12/2022 12:34	196431
Arsenic	NELAP	0.0004	0.0010		0.0068	mg/L	5	09/12/2022 12:34	196431
Beryllium	NELAP	0.0002	0.0010		< 0.0010	mg/L	5	09/15/2022 3:52	196431
Cadmium	NELAP	0.0002	0.0010		< 0.0010	mg/L	5	09/12/2022 12:34	196431
Chromium	NELAP	0.0007	0.0015		< 0.0015	mg/L	5	09/15/2022 3:52	196431
Cobalt	NELAP	0.0001	0.0010		0.471	mg/L	5	09/15/2022 3:52	196431
Lead	NELAP	0.0006	0.0010		< 0.0010	mg/L	5	09/12/2022 12:34	196431
Lithium	*	0.0015	0.0030	J	0.0021	mg/L	5	09/12/2022 12:34	196431
Molybdenum	NELAP	0.0006	0.0015		< 0.0015	mg/L	5	09/12/2022 12:34	196431
Selenium	NELAP	0.0006	0.0010	J	0.0006	mg/L	5	09/12/2022 12:34	196431
Thallium	NELAP	0.0010	0.0020		< 0.0020	mg/L	5	09/14/2022 7:36	196431
PQL recovered outside the upper control limits for Cr. Sample results are below the reporting limit. Data is reportable per the TNI standard.									
<b>SW-846 7470A (TOTAL)</b>									
Mercury	NELAP	0.00006	0.00020		< 0.00020	mg/L	1	09/15/2022 11:32	196576

## Laboratory Results

<http://www.teklabinc.com/>

**Client:** Southern Illinois Power Cooperation

**Work Order:** 22080134

**Client Project:** Groundwater Monitoring

**Report Date:** 10-Oct-22

**Lab ID:** 22080134-005

**Client Sample ID:** EP-4

**Matrix:** GROUNDWATER

**Collection Date:** 09/07/2022 13:02

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>EPA 903.0/904.0, RADIUM 226/228</b>									
Radium-226	*	0	0		See Attached	pCi/L	1	09/16/2022 0:00	R318593
Radium-228	*	0	0		See Attached	pCi/L	1	09/16/2022 0:00	R318593

Client: Southern Illinois Power Cooperation  
 Client Project: Groundwater Monitoring

Work Order: 22080134  
 Report Date: 10-Oct-22

Lab ID: 22080134-006

Client Sample ID: EP-5

Matrix: GROUNDWATER

Collection Date: 09/06/2022 13:33

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>FIELD ELEVATION MEASUREMENTS</b>									
Depth to water from measuring point	*	0	0		12.90	ft	1	09/06/2022 13:33	R318074
Elevation of groundwater surface	*	0	0		514.69	ft	1	09/06/2022 13:33	R318074
Measuring Point Elevation	*	0	0		527.59	ft	1	09/06/2022 13:33	R318074
<b>FIELD PURGE VOLUME</b>									
Purge Volume	*	0	0		0.95	gal	1	09/06/2022 13:33	R318074
<b>STANDARD METHODS 2130 B FIELD</b>									
Turbidity	*	1.0	1.0		< 1.0	NTU	1	09/06/2022 13:33	R318074
<b>STANDARD METHODS 18TH ED. 2580 B FIELD</b>									
Oxidation-Reduction Potential	*	-300	-300		188	mV	1	09/06/2022 13:33	R318074
<b>STANDARD METHODS 2510 B FIELD</b>									
Spec. Conductance, Field	*	0	0		0.441	mS/cm	1	09/06/2022 13:33	R318074
<b>STANDARD METHODS 2550 B FIELD</b>									
Temperature	*	0	0		18.4	°C	1	09/06/2022 13:33	R318074
<b>STANDARD METHODS 4500-O G FIELD</b>									
Oxygen, Dissolved	*	0	0		3.78	mg/L	1	09/06/2022 13:33	R318074
<b>SW-846 9040B FIELD</b>									
pH	*	0	1.00		6.44		1	09/06/2022 13:33	R318074
<b>STANDARD METHODS 2540 C (TOTAL) 1997, 2011</b>									
Total Dissolved Solids	NELAP	16	20		282	mg/L	1	09/12/2022 11:57	R317996
<b>STANDARD METHODS 4500-CL E (TOTAL) 1997, 2011</b>									
Chloride	NELAP	1	4	J	3	mg/L	1	09/14/2022 13:44	R318019
<b>SW-846 9036 (TOTAL)</b>									
Sulfate	NELAP	31	50		114	mg/L	5	09/14/2022 13:50	R318056
<b>SW-846 9214 (TOTAL)</b>									
Fluoride	NELAP	0.04	0.10		0.38	mg/L	1	09/14/2022 9:15	R318011
<b>SW-846 3005A, 6010B, METALS BY ICP (TOTAL)</b>									
Barium	NELAP	0.0007	0.0025		0.0506	mg/L	1	09/09/2022 11:37	196431
Boron	NELAP	0.0090	0.0200		0.0222	mg/L	1	09/09/2022 12:28	196431
Calcium	NELAP	0.0350	0.100		16.7	mg/L	1	09/09/2022 11:37	196431
<b>SW-846 3005A, 6020A, METALS BY ICPMS (TOTAL)</b>									
Antimony	NELAP	0.0004	0.0010		< 0.0010	mg/L	5	09/12/2022 13:25	196431
Arsenic	NELAP	0.0004	0.0010		< 0.0010	mg/L	5	09/12/2022 13:25	196431
Beryllium	NELAP	0.0002	0.0010		< 0.0010	mg/L	5	09/15/2022 3:58	196431
Cadmium	NELAP	0.0002	0.0010		< 0.0010	mg/L	5	09/12/2022 13:25	196431
Chromium	NELAP	0.0007	0.0015		< 0.0015	mg/L	5	09/15/2022 3:58	196431
Cobalt	NELAP	0.0001	0.0010		< 0.0010	mg/L	5	09/15/2022 3:58	196431
Lead	NELAP	0.0006	0.0010		< 0.0010	mg/L	5	09/12/2022 13:25	196431
Lithium	*	0.0015	0.0030	J	0.0023	mg/L	5	09/12/2022 13:25	196431
Molybdenum	NELAP	0.0006	0.0015		0.0017	mg/L	5	09/12/2022 13:25	196431
Selenium	NELAP	0.0006	0.0010		0.0012	mg/L	5	09/12/2022 13:25	196431
Thallium	NELAP	0.0010	0.0020		< 0.0020	mg/L	5	09/14/2022 7:42	196431
PQL recovered outside the upper control limits for Cr. Sample results are below the reporting limit. Data is reportable per the TNI standard.									
<b>SW-846 7470A (TOTAL)</b>									
Mercury	NELAP	0.00006	0.00020		< 0.00020	mg/L	1	09/15/2022 11:35	196576

## Laboratory Results

<http://www.teklabinc.com/>

**Client:** Southern Illinois Power Cooperation

**Work Order:** 22080134

**Client Project:** Groundwater Monitoring

**Report Date:** 10-Oct-22

**Lab ID:** 22080134-006

**Client Sample ID:** EP-5

**Matrix:** GROUNDWATER

**Collection Date:** 09/06/2022 13:33

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>EPA 903.0/904.0, RADIUM 226/228</b>									
Radium-226	*	0	0		See Attached	pCi/L	1	09/16/2022 0:00	R318593
Radium-228	*	0	0		See Attached	pCi/L	1	09/16/2022 0:00	R318593

Client: Southern Illinois Power Cooperation  
 Client Project: Groundwater Monitoring

Work Order: 22080134  
 Report Date: 10-Oct-22

Lab ID: 22080134-007

Client Sample ID: EP-6

Matrix: GROUNDWATER

Collection Date: 09/06/2022 15:44

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>FIELD ELEVATION MEASUREMENTS</b>									
Depth to water from measuring point	*	0	0		4.32	ft	1	09/06/2022 15:44	R318074
Elevation of groundwater surface	*	0	0		500.79	ft	1	09/06/2022 15:44	R318074
Measuring Point Elevation	*	0	0		505.11	ft	1	09/06/2022 15:44	R318074
<b>FIELD PURGE VOLUME</b>									
Purge Volume	*	0	0		0.65	gal	1	09/06/2022 15:44	R318074
<b>STANDARD METHODS 2130 B FIELD</b>									
Turbidity	*	1.0	1.0		< 1.0	NTU	1	09/06/2022 15:44	R318074
<b>STANDARD METHODS 18TH ED. 2580 B FIELD</b>									
Oxidation-Reduction Potential	*	-300	-300		234	mV	1	09/06/2022 15:44	R318074
<b>STANDARD METHODS 2510 B FIELD</b>									
Spec. Conductance, Field	*	0	0		0.298	mS/cm	1	09/06/2022 15:44	R318074
<b>STANDARD METHODS 2550 B FIELD</b>									
Temperature	*	0	0		21.0	°C	1	09/06/2022 15:44	R318074
<b>STANDARD METHODS 4500-O G FIELD</b>									
Oxygen, Dissolved	*	0	0		0.78	mg/L	1	09/06/2022 15:44	R318074
<b>SW-846 9040B FIELD</b>									
pH	*	0	1.00		5.09		1	09/06/2022 15:44	R318074
<b>STANDARD METHODS 2540 C (TOTAL) 1997, 2011</b>									
Total Dissolved Solids	NELAP	16	20		216	mg/L	1	09/12/2022 11:57	R317996
<b>STANDARD METHODS 4500-CL E (TOTAL) 1997, 2011</b>									
Chloride	NELAP	1	4		23	mg/L	1	09/14/2022 13:53	R318019
<b>SW-846 9036 (TOTAL)</b>									
Sulfate	NELAP	31	50		64	mg/L	5	09/14/2022 14:11	R318056
<b>SW-846 9214 (TOTAL)</b>									
Fluoride	NELAP	0.04	0.10	J	0.07	mg/L	1	09/14/2022 9:26	R318011
<b>SW-846 3005A, 6010B, METALS BY ICP (TOTAL)</b>									
Barium	NELAP	0.0007	0.0025		0.0366	mg/L	1	09/09/2022 12:32	196431
Boron	NELAP	0.0090	0.0200		< 0.0200	mg/L	1	09/09/2022 12:32	196431
Calcium	NELAP	0.0350	0.100		1.86	mg/L	1	09/09/2022 12:32	196431
<b>SW-846 3005A, 6020A, METALS BY ICPMS (TOTAL)</b>									
Antimony	NELAP	0.0004	0.0010		< 0.0010	mg/L	5	09/12/2022 13:32	196431
Arsenic	NELAP	0.0004	0.0010		< 0.0010	mg/L	5	09/12/2022 13:32	196431
Beryllium	NELAP	0.0002	0.0010		< 0.0010	mg/L	5	09/15/2022 4:04	196431
Cadmium	NELAP	0.0002	0.0010		< 0.0010	mg/L	5	09/12/2022 13:32	196431
Chromium	NELAP	0.0007	0.0015		< 0.0015	mg/L	5	09/15/2022 4:04	196431
Cobalt	NELAP	0.0001	0.0010		0.0018	mg/L	5	09/15/2022 4:04	196431
Lead	NELAP	0.0006	0.0010		< 0.0010	mg/L	5	09/12/2022 13:32	196431
Lithium	*	0.0015	0.0030		0.0094	mg/L	5	09/12/2022 13:32	196431
Molybdenum	NELAP	0.0006	0.0015		< 0.0015	mg/L	5	09/12/2022 13:32	196431
Selenium	NELAP	0.0006	0.0010		< 0.0010	mg/L	5	09/12/2022 13:32	196431
Thallium	NELAP	0.0010	0.0020		< 0.0020	mg/L	5	09/14/2022 7:49	196431
PQL recovered outside the upper control limits for Cr. Sample results are below the reporting limit. Data is reportable per the TNI standard.									
<b>SW-846 7470A (TOTAL)</b>									
Mercury	NELAP	0.00006	0.00020		< 0.00020	mg/L	1	09/15/2022 11:37	196576

## Laboratory Results

<http://www.teklabinc.com/>

**Client:** Southern Illinois Power Cooperation

**Work Order:** 22080134

**Client Project:** Groundwater Monitoring

**Report Date:** 10-Oct-22

**Lab ID:** 22080134-007

**Client Sample ID:** EP-6

**Matrix:** GROUNDWATER

**Collection Date:** 09/06/2022 15:44

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>EPA 903.0/904.0, RADIUM 226/228</b>									
Radium-226	*	0	0		See Attached	pCi/L	1	09/16/2022 0:00	R318593
Radium-228	*	0	0		See Attached	pCi/L	1	09/16/2022 0:00	R318593

Client: Southern Illinois Power Cooperation  
 Client Project: Groundwater Monitoring

Work Order: 22080134  
 Report Date: 10-Oct-22

Lab ID: 22080134-008

Client Sample ID: EP-7

Matrix: GROUNDWATER

Collection Date: 09/07/2022 10:42

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>FIELD ELEVATION MEASUREMENTS</b>									
Depth to water from measuring point	*	0	0		14.42	ft	1	09/07/2022 10:42	R318074
Elevation of groundwater surface	*	0	0		501.02	ft	1	09/07/2022 10:42	R318074
Measuring Point Elevation	*	0	0		515.44	ft	1	09/07/2022 10:42	R318074
<b>FIELD PURGE VOLUME</b>									
Purge Volume	*	0	0		1.04	gal	1	09/07/2022 10:42	R318074
<b>STANDARD METHODS 2130 B FIELD</b>									
Turbidity	*	1.0	1.0		< 1.0	NTU	1	09/07/2022 10:42	R318074
<b>STANDARD METHODS 18TH ED. 2580 B FIELD</b>									
Oxidation-Reduction Potential	*	-300	-300		87	mV	1	09/07/2022 10:42	R318074
<b>STANDARD METHODS 2510 B FIELD</b>									
Spec. Conductance, Field	*	0	0		1.79	mS/cm	1	09/07/2022 10:42	R318074
<b>STANDARD METHODS 2550 B FIELD</b>									
Temperature	*	0	0		19.5	°C	1	09/07/2022 10:42	R318074
<b>STANDARD METHODS 4500-O G FIELD</b>									
Oxygen, Dissolved	*	0	0		0.14	mg/L	1	09/07/2022 10:42	R318074
<b>SW-846 9040B FIELD</b>									
pH	*	0	1.00		5.66		1	09/07/2022 10:42	R318074
<b>STANDARD METHODS 2540 C (TOTAL) 1997, 2011</b>									
Total Dissolved Solids	NELAP	40	50		800	mg/L	2.5	09/12/2022 11:58	R317996
<b>STANDARD METHODS 4500-CL E (TOTAL) 1997, 2011</b>									
Chloride	NELAP	5	40		249	mg/L	10	09/14/2022 14:14	R318019
<b>SW-846 9036 (TOTAL)</b>									
Sulfate	NELAP	61	100		326	mg/L	10	09/14/2022 14:14	R318056
<b>SW-846 9214 (TOTAL)</b>									
Fluoride	NELAP	0.04	0.10		0.20	mg/L	1	09/14/2022 9:28	R318011
<b>SW-846 3005A, 6010B, METALS BY ICP (TOTAL)</b>									
Barium	NELAP	0.0007	0.0025		0.0360	mg/L	1	09/09/2022 12:38	196431
Boron	NELAP	0.0090	0.0200		0.667	mg/L	1	09/09/2022 12:38	196431
Calcium	NELAP	0.0350	0.100		93.5	mg/L	1	09/09/2022 12:38	196431
<b>SW-846 3005A, 6020A, METALS BY ICPMS (TOTAL)</b>									
Antimony	NELAP	0.0004	0.0010		< 0.0010	mg/L	5	09/12/2022 13:38	196431
Arsenic	NELAP	0.0004	0.0010		0.0086	mg/L	5	09/12/2022 13:38	196431
Beryllium	NELAP	0.0002	0.0010		< 0.0010	mg/L	5	09/15/2022 4:11	196431
Cadmium	NELAP	0.0002	0.0010		< 0.0010	mg/L	5	09/12/2022 13:38	196431
Chromium	NELAP	0.0007	0.0015		< 0.0015	mg/L	5	09/15/2022 4:11	196431
Cobalt	NELAP	0.0001	0.0010		0.190	mg/L	5	09/15/2022 4:11	196431
Lead	NELAP	0.0006	0.0010		< 0.0010	mg/L	5	09/12/2022 13:38	196431
Lithium	*	0.0015	0.0030		< 0.0030	mg/L	5	09/12/2022 13:38	196431
Molybdenum	NELAP	0.0006	0.0015		< 0.0015	mg/L	5	09/12/2022 13:38	196431
Selenium	NELAP	0.0006	0.0010	J	0.0007	mg/L	5	09/12/2022 13:38	196431
Thallium	NELAP	0.0010	0.0020		< 0.0020	mg/L	5	09/14/2022 7:55	196431
PQL recovered outside the upper control limits for Cr. Sample results are below the reporting limit. Data is reportable per the TNI standard.									
<b>SW-846 7470A (TOTAL)</b>									
Mercury	NELAP	0.00006	0.00020		< 0.00020	mg/L	1	09/15/2022 11:44	196576

## Laboratory Results

<http://www.teklabinc.com/>

**Client:** Southern Illinois Power Cooperation

**Work Order:** 22080134

**Client Project:** Groundwater Monitoring

**Report Date:** 10-Oct-22

**Lab ID:** 22080134-008

**Client Sample ID:** EP-7

**Matrix:** GROUNDWATER

**Collection Date:** 09/07/2022 10:42

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>EPA 903.0/904.0, RADIUM 226/228</b>									
Radium-226	*	0	0		See Attached	pCi/L	1	09/16/2022 0:00	R318593
Radium-228	*	0	0		See Attached	pCi/L	1	09/16/2022 0:00	R318593

## Laboratory Results

<http://www.teklabinc.com/>

**Client:** Southern Illinois Power Cooperation

**Work Order:** 22080134

**Client Project:** Groundwater Monitoring

**Report Date:** 10-Oct-22

**Lab ID:** 22080134-009

**Client Sample ID:** Equipment Blank

**Matrix:** AQUEOUS

**Collection Date:** 09/07/2022 13:05

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>STANDARD METHODS 2540 C (TOTAL) 1997, 2011</b>									
Total Dissolved Solids	NELAP	16	20	H	< 20	mg/L	1	10/06/2022 11:11	R319177
Sample required re-analysis out of hold time.									
<b>STANDARD METHODS 4500-CL E (TOTAL) 1997, 2011</b>									
Chloride	NELAP	1	4		< 4	mg/L	1	09/14/2022 14:24	R318019
<b>SW-846 9036 (TOTAL)</b>									
Sulfate	NELAP	6	10		< 10	mg/L	1	09/14/2022 14:24	R318056
<b>SW-846 9214 (TOTAL)</b>									
Fluoride	NELAP	0.04	0.10		< 0.10	mg/L	1	09/14/2022 9:30	R318011
<b>SW-846 3005A, 6010B, METALS BY ICP (TOTAL)</b>									
Barium	NELAP	0.0007	0.0025		< 0.0025	mg/L	1	09/09/2022 12:49	196431
Boron	NELAP	0.0090	0.0200		< 0.0200	mg/L	1	09/09/2022 12:49	196431
Calcium	NELAP	0.0350	0.100		< 0.100	mg/L	1	09/09/2022 12:49	196431
<b>SW-846 3005A, 6020A, METALS BY ICPMS (TOTAL)</b>									
Antimony	NELAP	0.0004	0.0010		< 0.0010	mg/L	5	09/12/2022 14:04	196431
Arsenic	NELAP	0.0004	0.0010		< 0.0010	mg/L	5	09/12/2022 14:04	196431
Beryllium	NELAP	0.0002	0.0010		< 0.0010	mg/L	5	09/14/2022 6:40	196431
Cadmium	NELAP	0.0002	0.0010		< 0.0010	mg/L	5	09/12/2022 14:04	196431
Chromium	NELAP	0.0007	0.0015	S	< 0.0015	mg/L	5	09/15/2022 4:30	196431
Cobalt	NELAP	0.0001	0.0010		< 0.0010	mg/L	5	09/14/2022 6:40	196431
Lead	NELAP	0.0006	0.0010		< 0.0010	mg/L	5	09/12/2022 14:04	196431
Lithium	*	0.0015	0.0030		< 0.0030	mg/L	5	09/12/2022 14:04	196431
Molybdenum	NELAP	0.0006	0.0015		< 0.0015	mg/L	5	09/12/2022 14:04	196431
Selenium	NELAP	0.0006	0.0010		< 0.0010	mg/L	5	09/12/2022 14:04	196431
Thallium	NELAP	0.0010	0.0020		< 0.0020	mg/L	5	09/14/2022 6:40	196431
PQL recovered outside the upper control limits for Cr. Sample results are below the reporting limit. Data is reportable per the TNI standard.									
Matrix spike recovered outside upper control limits for Cr. Sample results are below the reporting limit. Data is reportable.									
<b>SW-846 7470A (TOTAL)</b>									
Mercury	NELAP	0.00006	0.00020		< 0.00020	mg/L	1	09/15/2022 11:46	196576
<b>EPA 903.0/904.0, RADIUM 226/228</b>									
Radium-226	*	0	0		See Attached	pCi/L	1	09/16/2022 0:00	R318593
Radium-228	*	0	0		See Attached	pCi/L	1	09/16/2022 0:00	R318593

**Client:** Southern Illinois Power Cooperation  
**Client Project:** Groundwater Monitoring

**Work Order:** 22080134  
**Report Date:** 10-Oct-22

**Lab ID:** 22080134-010

**Client Sample ID:** Field Blank

**Matrix:** AQUEOUS

**Collection Date:** 09/06/2022 15:54

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>STANDARD METHODS 2540 C (TOTAL) 1997, 2011</b>									
Total Dissolved Solids	NELAP	16	20	H	< 20	mg/L	1	10/06/2022 11:11	R319177
Sample required re-analysis out of hold time.									
<b>STANDARD METHODS 4500-CL E (TOTAL) 1997, 2011</b>									
Chloride	NELAP	1	4		< 4	mg/L	1	09/14/2022 14:27	R318019
<b>SW-846 9036 (TOTAL)</b>									
Sulfate	NELAP	6	10		< 10	mg/L	1	09/14/2022 14:26	R318056
<b>SW-846 9214 (TOTAL)</b>									
Fluoride	NELAP	0.04	0.10		< 0.10	mg/L	1	09/14/2022 9:33	R318011
<b>SW-846 3005A, 6010B, METALS BY ICP (TOTAL)</b>									
Barium	NELAP	0.0007	0.0025		< 0.0025	mg/L	1	09/09/2022 13:08	196431
Boron	NELAP	0.0090	0.0200		< 0.0200	mg/L	1	09/09/2022 13:08	196431
Calcium	NELAP	0.0350	0.100		< 0.100	mg/L	1	09/09/2022 13:08	196431
<b>SW-846 3005A, 6020A, METALS BY ICPMS (TOTAL)</b>									
Antimony	NELAP	0.0004	0.0010		< 0.0010	mg/L	5	09/12/2022 13:44	196431
Arsenic	NELAP	0.0004	0.0010		< 0.0010	mg/L	5	09/12/2022 13:44	196431
Beryllium	NELAP	0.0002	0.0010		< 0.0010	mg/L	5	09/15/2022 4:17	196431
Cadmium	NELAP	0.0002	0.0010		< 0.0010	mg/L	5	09/12/2022 13:44	196431
Chromium	NELAP	0.0007	0.0015		< 0.0015	mg/L	5	09/15/2022 4:17	196431
Cobalt	NELAP	0.0001	0.0010		< 0.0010	mg/L	5	09/15/2022 4:17	196431
Lead	NELAP	0.0006	0.0010		< 0.0010	mg/L	5	09/12/2022 13:44	196431
Lithium	*	0.0015	0.0030		< 0.0030	mg/L	5	09/12/2022 13:44	196431
Molybdenum	NELAP	0.0006	0.0015		< 0.0015	mg/L	5	09/12/2022 13:44	196431
Selenium	NELAP	0.0006	0.0010		< 0.0010	mg/L	5	09/12/2022 13:44	196431
Thallium	NELAP	0.0010	0.0020		< 0.0020	mg/L	5	09/14/2022 8:01	196431
PQL recovered outside the upper control limits for Cr. Sample results are below the reporting limit. Data is reportable per the TNI standard.									
<b>SW-846 7470A (TOTAL)</b>									
Mercury	NELAP	0.00006	0.00020		< 0.00020	mg/L	1	09/15/2022 11:48	196576
<b>EPA 903.0/904.0, RADIUM 226/228</b>									
Radium-226	*	0	0		See Attached	pci/L	1	09/16/2022 0:00	R318593
Radium-228	*	0	0		See Attached	pci/L	1	09/16/2022 0:00	R318593

**Client:** Southern Illinois Power Cooperation  
**Client Project:** Groundwater Monitoring

**Work Order:** 22080134  
**Report Date:** 10-Oct-22

**Lab ID:** 22080134-011

**Client Sample ID:** Field Duplicate

**Matrix:** GROUNDWATER

**Collection Date:** 09/06/2022 14:37

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>FIELD ELEVATION MEASUREMENTS</b>									
Depth to water from measuring point	*	0	0		8.32	ft	1	09/06/2022 14:37	R318074
Elevation of groundwater surface	*	0	0		511.40	ft	1	09/06/2022 14:37	R318074
Measuring Point Elevation	*	0	0		519.72	ft	1	09/06/2022 14:37	R318074
<b>FIELD PURGE VOLUME</b>									
Purge Volume	*	0	0		0.91	gal	1	09/06/2022 14:37	R318074
<b>STANDARD METHODS 2130 B FIELD</b>									
Turbidity	*	1.0	1.0		< 1.0	NTU	1	09/06/2022 14:37	R318074
<b>STANDARD METHODS 18TH ED. 2580 B FIELD</b>									
Oxidation-Reduction Potential	*	-300	-300		201	mV	1	09/06/2022 14:37	R318074
<b>STANDARD METHODS 2510 B FIELD</b>									
Spec. Conductance, Field	*	0	0		2.80	mS/cm	1	09/06/2022 14:37	R318074
<b>STANDARD METHODS 2550 B FIELD</b>									
Temperature	*	0	0		17.6	°C	1	09/06/2022 14:37	R318074
<b>STANDARD METHODS 4500-O G FIELD</b>									
Oxygen, Dissolved	*	0	0		0.22	mg/L	1	09/06/2022 14:37	R318074
<b>SW-846 9040B FIELD</b>									
pH	*	0	1.00		6.21		1	09/06/2022 14:37	R318074
<b>STANDARD METHODS 2540 C (TOTAL) 1997, 2011</b>									
Total Dissolved Solids	NELAP	16	20	H	2570	mg/L	1	10/06/2022 11:12	R319177
Sample required re-analysis out of hold time.									
<b>STANDARD METHODS 4500-CL E (TOTAL) 1997, 2011</b>									
Chloride	NELAP	1	4		34	mg/L	1	09/14/2022 14:30	R318019
<b>SW-846 9036 (TOTAL)</b>									
Sulfate	NELAP	307	500		1590	mg/L	50	09/16/2022 9:49	R318144
<b>SW-846 9214 (TOTAL)</b>									
Fluoride	NELAP	0.04	0.10		0.22	mg/L	1	09/14/2022 9:36	R318011
<b>SW-846 3005A, 6010B, METALS BY ICP (TOTAL)</b>									
Barium	NELAP	0.0007	0.0025		0.0173	mg/L	1	09/09/2022 13:50	196431
Boron	NELAP	0.0090	0.0200		1.18	mg/L	1	09/09/2022 13:50	196431
Calcium	NELAP	0.0350	0.100		481	mg/L	1	09/09/2022 13:50	196431
<b>SW-846 3005A, 6020A, METALS BY ICPMS (TOTAL)</b>									
Antimony	NELAP	0.0004	0.0010		< 0.0010	mg/L	5	09/12/2022 13:51	196431
Arsenic	NELAP	0.0004	0.0010	J	0.0004	mg/L	5	09/12/2022 13:51	196431
Beryllium	NELAP	0.0002	0.0010		< 0.0010	mg/L	5	09/15/2022 4:23	196431
Cadmium	NELAP	0.0002	0.0010		< 0.0010	mg/L	5	09/12/2022 13:51	196431
Chromium	NELAP	0.0007	0.0015		< 0.0015	mg/L	5	09/15/2022 4:23	196431
Cobalt	NELAP	0.0001	0.0010		< 0.0010	mg/L	5	09/15/2022 4:23	196431
Lead	NELAP	0.0006	0.0010		< 0.0010	mg/L	5	09/12/2022 13:51	196431
Lithium	*	0.0015	0.0030		0.0119	mg/L	5	09/12/2022 13:51	196431
Molybdenum	NELAP	0.0006	0.0015		< 0.0015	mg/L	5	09/12/2022 13:51	196431
Selenium	NELAP	0.0006	0.0010		0.0013	mg/L	5	09/12/2022 13:51	196431
Thallium	NELAP	0.0010	0.0020	J	0.0010	mg/L	5	09/14/2022 9:34	196431
PQL recovered outside the upper control limits for Cr. Sample results are below the reporting limit. Data is reportable per the TNI standard.									
<b>SW-846 7470A (TOTAL)</b>									
Mercury	NELAP	0.00006	0.00020	J	0.00006	mg/L	1	09/15/2022 11:50	196576

## Laboratory Results

<http://www.teklabinc.com/>

**Client:** Southern Illinois Power Cooperation

**Work Order:** 22080134

**Client Project:** Groundwater Monitoring

**Report Date:** 10-Oct-22

**Lab ID:** 22080134-011

**Client Sample ID:** Field Duplicate

**Matrix:** GROUNDWATER

**Collection Date:** 09/06/2022 14:37

Analyses	Certification	MDL	RL	Qual	Result	Units	DF	Date Analyzed	Batch
<b>EPA 903.0/904.0, RADIUM 226/228</b>									
Radium-226	*	0	0		See Attached	pCi/L	1	09/16/2022 0:00	R318593
Radium-228	*	0	0		See Attached	pCi/L	1	09/16/2022 0:00	R318593



## Quality Control Results

<http://www.teklabinc.com/>

Client: Southern Illinois Power Cooperation

Work Order: 22080134

Client Project: Groundwater Monitoring

Report Date: 10-Oct-22

### STANDARD METHODS 2510 B FIELD

Batch	R318074	SampType:	LCS	Units	µS/cm					
SampID: LCS-R318074										Date Analyzed
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	
Spec. Conductance, Field	*	0		1400	1409	0	99.5	90	110	09/07/2022
Spec. Conductance, Field	*	0		1430	1409	0	101.6	90	110	09/06/2022

### SW-846 9040B FIELD

Batch	R318074	SampType:	LCS	Units						
SampID: LCS-R318074										Date Analyzed
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	
pH	*	1.00		6.96	7.000	0	99.4	98.57	101.4	09/06/2022
pH	*	1.00		7.05	7.000	0	100.7	98.57	101.4	09/07/2022

### STANDARD METHODS 2540 C (TOTAL) 1997, 2011

Batch	R317996	SampType:	MBLK	Units	mg/L					
SampID: MBLK										Date Analyzed
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	
Total Dissolved Solids		20		< 20	16.00	0	0	-100	100	09/12/2022

Batch	R317996	SampType:	LCS	Units	mg/L					
SampID: LCS										Date Analyzed
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	
Total Dissolved Solids		20		954	1000	0	95.4	90	110	09/12/2022

Batch	R317996	SampType:	DUP	Units	mg/L					
RPD Limit: 5										Date Analyzed
SampID: 22090535-001ADUP										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	
Total Dissolved Solids		20		2760				2736	0.95	09/12/2022

Batch	R319177	SampType:	MBLK	Units	mg/L					
SampID: MBLK										Date Analyzed
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	
Total Dissolved Solids		20		< 20	16.00	0	0	-100	100	10/06/2022
Total Dissolved Solids		20		< 20	16.00	0	0	-100	100	10/06/2022



## Quality Control Results

<http://www.teklabinc.com/>

Client: Southern Illinois Power Cooperation

Work Order: 22080134

Client Project: Groundwater Monitoring

Report Date: 10-Oct-22

### STANDARD METHODS 2540 C (TOTAL) 1997, 2011

Batch	R319177	SampType:	LCS	Units	mg/L						
Analyses										Date Analyzed	
		Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	
Total Dissolved Solids			20		968	1000	0	96.8	90	110	10/06/2022
Total Dissolved Solids			20		972	1000	0	97.2	90	110	10/06/2022

### Batch R319177 SampType: DUP Units mg/L RPD Limit: 5

Batch	R319177	SampType:	DUP	Units	mg/L						Date Analyzed
Analyses										Date Analyzed	
		Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	
Total Dissolved Solids			20		706				698.0	1.14	10/06/2022

### Batch R319177 SampType: DUP Units mg/L RPD Limit: 5

Batch	R319177	SampType:	DUP	Units	mg/L						Date Analyzed
Analyses										Date Analyzed	
		Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	
Total Dissolved Solids			20		3330				3320	0.30	10/06/2022

### Batch R319177 SampType: DUP Units mg/L RPD Limit: 5

Batch	R319177	SampType:	DUP	Units	mg/L						Date Analyzed
Analyses										Date Analyzed	
		Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	
Total Dissolved Solids			20	H	784				782.0	0.26	10/06/2022

### Batch R319177 SampType: DUP Units mg/L RPD Limit: 5

Batch	R319177	SampType:	DUP	Units	mg/L						Date Analyzed
Analyses										Date Analyzed	
		Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	
Total Dissolved Solids			50		1870				1835	1.89	10/06/2022

### STANDARD METHODS 4500-CL E (TOTAL) 1997, 2011

Batch	R318019	SampType:	MBLK	Units	mg/L						Date Analyzed
Analyses										Date Analyzed	
		Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	
Chloride			4		< 4	0.5000	0	0	-100	100	09/14/2022

### Batch R318019 SampType: LCS Units mg/L

Batch	R318019	SampType:	LCS	Units	mg/L						Date Analyzed
Analyses										Date Analyzed	
		Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	
Chloride			4		20	20.00	0	98.0	90	110	09/14/2022



## Quality Control Results

<http://www.teklabinc.com/>

Client: Southern Illinois Power Cooperation

Work Order: 22080134

Client Project: Groundwater Monitoring

Report Date: 10-Oct-22

### STANDARD METHODS 4500-CL E (TOTAL) 1997, 2011

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Chloride		20		161	100.0	72.00	88.9	85	115	09/14/2022

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Chloride		20		162	100.0	72.00	90.3	160.9	0.88	09/14/2022

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Chloride		200		1980	1000	1087	89.6	85	115	09/14/2022

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Chloride		200		1980	1000	1087	88.9	1982	0.32	09/14/2022

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Chloride		2000		18500	10000	9784	87.3	85	115	09/14/2022

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Chloride		2000		18600	10000	9784	87.8	18510	0.31	09/14/2022

### SW-846 9036 (TOTAL)

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Sulfate		10		< 10	6.140	0	0	-100	100	09/14/2022

## Quality Control Results

<http://www.teklabinc.com/>
**Client:** Southern Illinois Power Cooperation

**Work Order:** 22080134

**Client Project:** Groundwater Monitoring

**Report Date:** 10-Oct-22

**SW-846 9036 (TOTAL)**

Batch R318056 SampType: LCS		Units mg/L								
SampID: ICV/LCS										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Sulfate		10		19	20.00	0	94.0	90	110	09/14/2022

**Batch R318056 SampType: MS**

Batch R318056 SampType: MS		Units mg/L								
SampID: 22080632-003AMS										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Sulfate		10		29	20.00	11.39	90.4	85	115	09/14/2022

**Batch R318056 SampType: MSD**

Batch R318056 SampType: MSD		Units mg/L		RPD Limit: 10						
SampID: 22080632-003AMSD										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Sulfate		10		32	20.00	11.39	103.6	29.48	8.51	09/14/2022

**Batch R318144 SampType: MBLK**

Batch R318144 SampType: MBLK		Units mg/L								
SampID: ICB/MBLK										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Sulfate		10		< 10	6.140	0	0	-100	100	09/16/2022

**Batch R318144 SampType: LCS**

Batch R318144 SampType: LCS		Units mg/L								
SampID: ICV/LCS										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Sulfate		10		19	20.00	0	94.4	90	110	09/16/2022

**Batch R318144 SampType: MS**

Batch R318144 SampType: MS		Units mg/L								
SampID: 22090533-001AMS										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Sulfate		1000		3710	2000	1787	95.9	90	110	09/16/2022

**Batch R318144 SampType: MSD**

Batch R318144 SampType: MSD		Units mg/L		RPD Limit: 10						
SampID: 22090533-001AMSD										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Sulfate		1000		3880	2000	1787	104.8	3705	4.68	09/16/2022

**Batch R318144 SampType: MS**

Batch R318144 SampType: MS		Units mg/L								
SampID: 22090537-003AMS										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Sulfate		10000		30000	20000	10220	98.9	90	110	09/16/2022

## Quality Control Results

<http://www.teklabinc.com/>
**Client:** Southern Illinois Power Cooperation

**Work Order:** 22080134

**Client Project:** Groundwater Monitoring

**Report Date:** 10-Oct-22

**SW-846 9036 (TOTAL)**

Batch R318144 SampType: MSD		Units mg/L		RPD Limit: 10					Date Analyzed			
SampID:	R32090537-003AMSD	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD		
Analyses					10000	30400	20000	10220	100.9	30000	1.32	09/16/2022
Sulfate												

**Batch R318144 SampType: MS**

Batch R318144 SampType: MS		Units mg/L		RPD Limit: 10					Date Analyzed			
SampID:	R32090712-001AMS	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit		
Analyses					100	449	200.0	268.1	90.3	85	115	09/16/2022
Sulfate												

**Batch R318144 SampType: MSD**

Batch R318144 SampType: MSD		Units mg/L		RPD Limit: 10					Date Analyzed			
SampID:	R32090712-001AMSD	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD		
Analyses					100	482	200.0	268.1	107.1	448.8	7.21	09/16/2022
Sulfate												

**SW-846 9214 (TOTAL)**

Batch R317927 SampType: MBLK		Units mg/L		RPD Limit: 10					Date Analyzed			
SampID:	MBLK	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit		
Analyses					0.10	< 0.10	0.0370	0	0	-100	100	09/12/2022
Fluoride												

**Batch R317927 SampType: LCS**

Batch R317927 SampType: LCS		Units mg/L		RPD Limit: 10					Date Analyzed			
SampID:	LCS	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit		
Analyses					0.10	0.99	1.000	0	98.9	90	110	09/12/2022
Fluoride												

**Batch R317927 SampType: MS**

Batch R317927 SampType: MS		Units mg/L		RPD Limit: 10					Date Analyzed			
SampID:	R32080111-008AMS	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit		
Analyses					0.10	2.41	2.000	0.2150	109.6	75	125	09/12/2022
Fluoride												

**Batch R317927 SampType: MSD**

Batch R317927 SampType: MSD		Units mg/L		RPD Limit: 15					Date Analyzed			
SampID:	R32080111-008AMSD	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD		
Analyses					0.10	2.39	2.000	0.2150	108.6	2.408	0.92	09/12/2022
Fluoride												



## Quality Control Results

<http://www.teklabinc.com/>

Client: Southern Illinois Power Cooperation

Work Order: 22080134

Client Project: Groundwater Monitoring

Report Date: 10-Oct-22

### SW-846 9214 (TOTAL)

Batch R317927 SampType: MS		Units mg/L								
SampID: 22080111-016AMS										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Fluoride		0.10		2.08	2.000	0	104.2	75	125	09/12/2022

Batch R317927 SampType: MSD		Units mg/L		RPD Limit: 15						
SampID: 22080111-016AMSD										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Fluoride		0.10		2.13	2.000	0	106.4	2.085	2.04	09/12/2022

Batch R317927 SampType: MS		Units mg/L								
SampID: 22090111-008BMS										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Fluoride		0.10		2.13	2.000	0.1060	101.2	75	125	09/12/2022

Batch R317927 SampType: MSD		Units mg/L		RPD Limit: 15						
SampID: 22090111-008BMSD										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Fluoride		0.10		2.21	2.000	0.1060	105.3	2.130	3.78	09/12/2022

Batch R317927 SampType: MS		Units mg/L								
SampID: 22090111-015BMS										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Fluoride		0.10		2.44	2.000	0.3180	106.0	75	125	09/12/2022

Batch R317927 SampType: MSD		Units mg/L		RPD Limit: 15						
SampID: 22090111-015BMSD										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Fluoride		0.10		2.69	2.000	0.3180	118.6	2.438	9.79	09/12/2022

Batch R317927 SampType: MS		Units mg/L								
SampID: 22090111-016BMS										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Fluoride		0.10		2.28	2.000	0.2080	103.5	75	125	09/12/2022

Batch R317927 SampType: MSD		Units mg/L		RPD Limit: 15						
SampID: 22090111-016BMSD										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Fluoride		0.10		2.36	2.000	0.2080	107.8	2.278	3.66	09/12/2022



## Quality Control Results

<http://www.teklabinc.com/>

Client: Southern Illinois Power Cooperation

Work Order: 22080134

Client Project: Groundwater Monitoring

Report Date: 10-Oct-22

### SW-846 9214 (TOTAL)

Batch R317927 SampType: MS		Units mg/L								
SampID: 22090111-024BMS									Date Analyzed	
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Fluoride		0.10		1.97	2.000	0.05300	95.9	75	125	09/12/2022

Batch R317927 SampType: MSD		Units mg/L		RPD Limit: 15						
SampID: 22090111-024BMSD									Date Analyzed	
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Fluoride		0.10		1.93	2.000	0.05300	93.6	1.971	2.31	09/12/2022

Batch R317927 SampType: MS		Units mg/L								
SampID: 22090111-030BMS									Date Analyzed	
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Fluoride		0.10		2.34	2.000	0.2470	104.7	75	125	09/12/2022

Batch R317927 SampType: MSD		Units mg/L		RPD Limit: 15						
SampID: 22090111-030BMSD									Date Analyzed	
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Fluoride		0.10		2.39	2.000	0.2470	107.0	2.341	1.99	09/12/2022

Batch R318011 SampType: MBLK		Units mg/L								
SampID: MBLK									Date Analyzed	
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Fluoride		0.10		< 0.10	0.0370	0	0	-100	100	09/14/2022

Batch R318011 SampType: LCS		Units mg/L								
SampID: LCS									Date Analyzed	
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Fluoride		0.10		1.06	1.000	0	106.1	90	110	09/14/2022

Batch R318011 SampType: MS		Units mg/L								
SampID: 22080134-006AMS									Date Analyzed	
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Fluoride		0.10		2.48	2.000	0.3750	105.4	75	125	09/14/2022

Batch R318011 SampType: MSD		Units mg/L		RPD Limit: 15						
SampID: 22080134-006AMSD								Date Analyzed		Date Analyzed
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Fluoride		0.10		2.49	2.000	0.3750	106.0	2.482	0.48	09/14/2022



## Quality Control Results

<http://www.teklabinc.com/>

Client: Southern Illinois Power Cooperation

Work Order: 22080134

Client Project: Groundwater Monitoring

Report Date: 10-Oct-22

### SW-846 9214 (TOTAL)

Batch R318011 SampType: MS		Units mg/L								
SampID: 22090392-002AMS										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Fluoride		0.10		2.66	2.000	0.4610	109.8	75	125	09/14/2022

Batch R318011 SampType: MSD		Units mg/L		RPD Limit: 15						
SampID: 22090392-002AMSD										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Fluoride		0.10		2.60	2.000	0.4610	106.9	2.658	2.24	09/14/2022

Batch R318011 SampType: MS		Units mg/L								
SampID: 22090533-001AMSD										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Fluoride		0.10		2.57	2.000	0.5040	103.2	75	125	09/14/2022

Batch R318011 SampType: MSD		Units mg/L		RPD Limit: 15						
SampID: 22090533-001AMSD										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Fluoride		0.10		2.48	2.000	0.5040	99.0	2.567	3.25	09/14/2022

Batch R318011 SampType: MS		Units mg/L								
SampID: 22090537-003AMSD										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Fluoride		1.00		40.6	20.00	21.92	93.2	75	125	09/14/2022

Batch R318011 SampType: MSD		Units mg/L		RPD Limit: 15						
SampID: 22090537-003AMSD										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Fluoride		1.00		40.8	20.00	21.92	94.2	40.55	0.49	09/14/2022

Batch R318011 SampType: MS		Units mg/L								
SampID: 22090769-001AMSD										
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Fluoride		0.10		2.59	2.000	0.4760	105.6	75	125	09/14/2022

Batch R318011 SampType: MSD		Units mg/L		RPD Limit: 15						
SampID: 22090769-001AMSD										Date Analyzed
Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Fluoride		0.10		2.60	2.000	0.4760	106.2	2.588	0.42	09/14/2022



## Quality Control Results

<http://www.teklabinc.com/>

Client: Southern Illinois Power Cooperation

Work Order: 22080134

Client Project: Groundwater Monitoring

Report Date: 10-Oct-22

### SW-846 3005A, 6010B, METALS BY ICP (TOTAL)

Batch 196431 SampType: MBLK Units mg/L

SampID: MBLK-196431

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Barium		0.0025		< 0.0025	0.0007	0	0	-100	100	09/09/2022
Boron		0.0200		< 0.0200	0.0090	0	0	-100	100	09/09/2022
Calcium		0.100		< 0.100	0.0350	0	0	-100	100	09/09/2022

Batch 196431 SampType: LCS Units mg/L

SampID: LCS-196431

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Barium		0.0025		2.05	2.000	0	102.3	85	115	09/09/2022
Boron		0.0200		0.526	0.5000	0	105.1	85	115	09/09/2022
Calcium		0.100		2.60	2.500	0	103.8	85	115	09/09/2022

Batch 196431 SampType: MS Units mg/L

SampID: 22080134-009CMS

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Barium		0.0025		2.09	2.000	0	104.3	75	125	09/09/2022
Boron		0.0200		0.536	0.5000	0	107.3	75	125	09/09/2022
Calcium		0.100		2.62	2.500	0	105.0	75	125	09/09/2022

Batch 196431 SampType: MSD Units mg/L

SampID: 22080134-009CMSD

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Barium		0.0025		2.05	2.000	0	102.7	2.086	1.55	09/09/2022
Boron		0.0200		0.530	0.5000	0	105.9	0.5365	1.29	09/09/2022
Calcium		0.100		2.59	2.500	0	103.6	2.625	1.38	09/09/2022

Batch 196431 SampType: MS Units mg/L

SampID: 22090292-005BMS

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Calcium		0.100		29.7	2.500	27.21	98.0	75	125	09/09/2022

Batch 196431 SampType: MSD Units mg/L

SampID: 22090292-005BMSD

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Calcium		0.100		29.3	2.500	27.21	85.2	29.66	1.08	09/09/2022



## Quality Control Results

<http://www.teklabinc.com/>

Client: Southern Illinois Power Cooperation

Work Order: 22080134

Client Project: Groundwater Monitoring

Report Date: 10-Oct-22

### SW-846 3005A, 6020A, METALS BY ICPMS (TOTAL)

Batch 196431 SampType: MBLK Units mg/L

SampID: MBLK-196431

Analyses	Cert	RL	Qual	Result	Spike	SPK	Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Antimony		0.0010		< 0.0010	0.0004	0	0	0	-100	100	09/09/2022
Arsenic		0.0010		< 0.0010	0.0004	0	0	0	-100	100	09/09/2022
Beryllium		0.0010		< 0.0010	0.0002	0	0	0	-100	100	09/09/2022
Cadmium		0.0010		< 0.0010	0.0001	0	0	0	-100	100	09/09/2022
Chromium		0.0015		< 0.0015	0.0007	0	0	0	-100	100	09/15/2022
Cobalt		0.0010		< 0.0010	0.0001	0	0	0	-100	100	09/09/2022
Lead		0.0010		< 0.0010	0.0006	0	0	0	-100	100	09/09/2022
Lithium	*	0.0030		< 0.0030	0.0015	0	0	0	-100	100	09/09/2022
Molybdenum		0.0015		< 0.0015	0.0006	0	0	0	-100	100	09/09/2022
Selenium		0.0010		< 0.0010	0.0006	0	0	0	-100	100	09/09/2022
Thallium		0.0020		< 0.0020	0.0010	0	0	0	-100	100	09/09/2022

Batch 196431 SampType: LCS Units mg/L

SampID: LCS-196431

Analyses	Cert	RL	Qual	Result	Spike	SPK	Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Antimony		0.0010		0.442	0.5000	0	88.4	85	115	115	09/12/2022
Arsenic		0.0010		0.463	0.5000	0	92.6	85	115	115	09/12/2022
Beryllium		0.0010		0.0454	0.0500	0	90.8	85	115	115	09/14/2022
Cadmium		0.0010		0.0482	0.0500	0	96.5	85	115	115	09/12/2022
Chromium		0.0015		0.187	0.2000	0	93.3	80	120	120	09/15/2022
Cobalt		0.0010		0.466	0.5000	0	93.2	85	115	115	09/14/2022
Lead		0.0010		0.434	0.5000	0	86.8	85	115	115	09/12/2022
Lithium	*	0.0030		0.460	0.5000	0	92.0	85	115	115	09/12/2022
Molybdenum		0.0015		0.425	0.5000	0	85.1	85	115	115	09/12/2022
Selenium		0.0010		0.448	0.5000	0	89.6	85	115	115	09/12/2022
Thallium		0.0020		0.228	0.2500	0	91.1	85	115	115	09/14/2022

## Quality Control Results

<http://www.teklabinc.com/>
**Client:** Southern Illinois Power Cooperation

**Work Order:** 22080134

**Client Project:** Groundwater Monitoring

**Report Date:** 10-Oct-22

**SW-846 3005A, 6020A, METALS BY ICPMS (TOTAL)**

Batch	196431	SampType:	MS	Units	mg/L							
SampID:	22080134-009CMS											
<b>Analyses</b>		Cert	RL	Qual	<b>Result</b>	Spike	SPK	Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Antimony			0.0010		<b>0.453</b>	0.5000	0		90.5	75	125	09/12/2022
Arsenic			0.0010		<b>0.464</b>	0.5000	0		92.9	75	125	09/12/2022
Beryllium			0.0010		<b>0.0500</b>	0.0500	0		99.9	75	125	09/14/2022
Cadmium			0.0010		<b>0.0470</b>	0.0500	0		94.0	75	125	09/12/2022
Chromium			0.0015		<b>0.248</b>	0.2000	0		124.1	75	125	09/15/2022
Cobalt			0.0010		<b>0.484</b>	0.5000	0		96.7	75	125	09/14/2022
Lead			0.0010		<b>0.452</b>	0.5000	0		90.3	75	125	09/12/2022
Lithium		*	0.0030		<b>0.458</b>	0.5000	0		91.7	75	125	09/12/2022
Molybdenum			0.0015		<b>0.420</b>	0.5000	0		83.9	75	125	09/12/2022
Selenium			0.0010		<b>0.448</b>	0.5000	0		89.6	75	125	09/12/2022
Thallium			0.0020		<b>0.225</b>	0.2500	0		90.0	75	125	09/14/2022

**Batch 196431 SampType: MSD Units mg/L**
**RPD Limit: 20**

Batch	196431	SampType:	MSD	Units	mg/L							Date Analyzed
SampID:	22080134-009CMSD											
<b>Analyses</b>		Cert	RL	Qual	<b>Result</b>	Spike	SPK	Ref Val	%REC	RPD Ref Val	%RPD	
Antimony			0.0010		<b>0.475</b>	0.5000	0		94.9	0.4527	4.76	09/12/2022
Arsenic			0.0010		<b>0.515</b>	0.5000	0		103.0	0.4643	10.35	09/12/2022
Beryllium			0.0010		<b>0.0543</b>	0.0500	0		108.6	0.04997	8.33	09/14/2022
Cadmium			0.0010		<b>0.0512</b>	0.0500	0		102.4	0.04700	8.50	09/12/2022
Chromium			0.0015	S	<b>0.268</b>	0.2000	0		134.0	0.2482	7.64	09/15/2022
Cobalt			0.0010		<b>0.538</b>	0.5000	0		107.6	0.4837	10.64	09/14/2022
Lead			0.0010		<b>0.480</b>	0.5000	0		96.0	0.4515	6.06	09/12/2022
Lithium		*	0.0030		<b>0.484</b>	0.5000	0		96.8	0.4584	5.43	09/12/2022
Molybdenum			0.0015		<b>0.460</b>	0.5000	0		92.1	0.4196	9.25	09/12/2022
Selenium			0.0010		<b>0.494</b>	0.5000	0		98.8	0.4479	9.81	09/12/2022
Thallium			0.0020		<b>0.255</b>	0.2500	0		102.1	0.2251	12.59	09/14/2022

**SW-846 7470A (TOTAL)**

Batch	196576	SampType:	MBLK	Units	mg/L							Date Analyzed
SampID:	MBLK-196576											
<b>Analyses</b>		Cert	RL	Qual	<b>Result</b>	Spike	SPK	Ref Val	%REC	Low Limit	High Limit	
Mercury			0.00020		<b>&lt; 0.00020</b>	0.0001	0		0	-100	100	09/15/2022



## Quality Control Results

<http://www.teklabinc.com/>

Client: Southern Illinois Power Cooperation

Work Order: 22080134

Client Project: Groundwater Monitoring

Report Date: 10-Oct-22

### SW-846 7470A (TOTAL)

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Mercury		0.00020		<b>0.00553</b>	0.0050	0	110.5	85	115	09/15/2022

### Batch 196576 SampType: MS Units mg/L

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Mercury		0.00020		<b>0.00546</b>	0.0050	0	109.3	75	125	09/15/2022

### Batch 196576 SampType: MSD Units mg/L

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Mercury		0.00020		<b>0.00531</b>	0.0050	0	106.3	0.005463	2.79	09/15/2022

### Batch 196576 SampType: MS Units mg/L

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	Low Limit	High Limit	Date Analyzed
Mercury		0.00020		<b>0.00577</b>	0.0050	0	115.4	75	125	09/15/2022

### Batch 196576 SampType: MSD Units mg/L

Analyses	Cert	RL	Qual	Result	Spike	SPK Ref Val	%REC	RPD Ref Val	%RPD	Date Analyzed
Mercury		0.00020		<b>0.00581</b>	0.0050	0	116.1	0.005770	0.62	09/15/2022

## Receiving Check List

<http://www.teklabinc.com/>

**Client:** Southern Illinois Power Cooperation

**Work Order:** 22080134

**Client Project:** Groundwater Monitoring

**Report Date:** 10-Oct-22

**Carrier:** Joseph Riley

**Received By:** RMW

**Completed by:**

On:

08-Sep-22

*Ellie Hopkins*  
Ellie Hopkins

**Reviewed by:**

On:

08-Sep-22

*Elizabeth A. Hurley*

Elizabeth A. Hurley

**Pages to follow:** Chain of custody 2

Extra pages included 21

Shipping container/cooler in good condition?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>	Not Present <input type="checkbox"/>	Temp °C <b>0.6</b>
Type of thermal preservation?	None <input type="checkbox"/>	Ice <input checked="" type="checkbox"/>	Blue Ice <input type="checkbox"/>	Dry Ice <input type="checkbox"/>
Chain of custody present?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>		
Chain of custody signed when relinquished and received?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>		
Chain of custody agrees with sample labels?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>		
Samples in proper container/bottle?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>		
Sample containers intact?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>		
Sufficient sample volume for indicated test?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>		
All samples received within holding time?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>		
Reported field parameters measured:	Field <input checked="" type="checkbox"/>	Lab <input type="checkbox"/>	NA <input type="checkbox"/>	
Container/Temp Blank temperature in compliance?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>		
<i>When thermal preservation is required, samples are compliant with a temperature between 0.1°C - 6.0°C, or when samples are received on ice the same day as collected.</i>				
Water – at least one vial per sample has zero headspace?	Yes <input type="checkbox"/>	No <input type="checkbox"/>	No VOA vials <input checked="" type="checkbox"/>	
Water - TOX containers have zero headspace?	Yes <input type="checkbox"/>	No <input type="checkbox"/>	No TOX containers <input checked="" type="checkbox"/>	
Water - pH acceptable upon receipt?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>	NA <input type="checkbox"/>	
NPDES/CWA TCN interferences checked/treated in the field?	Yes <input type="checkbox"/>	No <input type="checkbox"/>	NA <input checked="" type="checkbox"/>	

**Any No responses must be detailed below or on the COC.**

pH strip #82999. - PRY/ehurley - 9/8/2022 11:45:07 AM

# CHAIN OF CUSTODY

pg. 1 of 2 Work order # 22080134

TEKLAB, INC. 5445 Horseshoe Lake Road - Collinsville, IL 62234 - Phone: (618) 344-1004 - Fax: (618) 344-1005

<b>Client:</b> Southern Illinois Power Cooperation  <b>Address:</b> 11543 Lake of Egypt Road  <b>City / State / Zip</b> Marion, IL 62959  <b>Contact:</b> Jason McLaurin Phone: (618) 964-1448  <b>E-Mail:</b> jmclaurin@sipower.org Fax:	Samples on: <input checked="" type="checkbox"/> ICE <input type="checkbox"/> BLUE ICE <input type="checkbox"/> NO ICE <span style="float: right;"><u>0.16</u> °C LTG# 1</span> Preserved in: <input type="checkbox"/> LAB <input checked="" type="checkbox"/> FIELD Lab Notes: PH✓ 82949, PNT 9/8/22
--	--

Are these samples known to be involved in litigation? If yes, a surcharge will apply  Yes  No

Are these samples known to be hazardous?  Yes  No

Are there any required reporting limits to be met on the requested analysis?. If yes, please provide limits in the comment section.  Yes  No

Client Comments \*DVR  
 ICP: Ba B Ca  
 ICP/MS: Sb As Be Cd Cr Co Pb Li Mo Se Ti  
 Field Parameters = Elevations, Purge Volume, pH, Conductivity, Temperature, DO, ORP, and Turbidity

Project Name/Number			Sample Collector's Name			MATRIX	INDICATE ANALYSIS REQUESTED												
Groundwater Monitoring			<i>J. RILEY</i>					Chloride	Fluoride	Field Parameters	ICP Metals	ICP/MS Metals	Mercury	Sulfate	TDS				
<b>Results Requested</b> <input checked="" type="checkbox"/> Standard <input type="checkbox"/> 1-2 Day (100% Surcharge) <input type="checkbox"/> Other <input type="checkbox"/> 3 Day (50% Surcharge)			<b>Billing Instructions</b> UNP HNO3			<b>Aqueous</b> <b>Groundwater</b>	X			X	X	X	X	X	X	X	X		
<b>Lab Use Only</b> 22080134-001 EBG 002 EP-1 003 EP-2 004 EP-3 005 EP-4 006 EP-5 007 EP-6 008 EP-7 009 Equipment Blank 010 Field Blank			09/06/22 1219 09/06/22 1437 09/07/22 1125 09/07/22 1227 09/07/22 1302 09/06/22 1333 09/06/22 1544 09/07/22 1042 09/07/22 1305 09/06/22 1539				1 3	1 3	1 3	1 3	1 3	1 3	1 3	1 3	1 3	1 3	1 3	1 3	1 3
X			X	X	X		X	X	X	X	X	X	X	X	X	X	X	X	X
X			X	X	X		X	X	X	X	X	X	X	X	X	X	X	X	X
X			X	X	X		X	X	X	X	X	X	X	X	X	X	X	X	X
X			X	X	X		X	X	X	X	X	X	X	X	X	X	X	X	X
X			X	X	X		X	X	X	X	X	X	X	X	X	X	X	X	X
X			X	X	X		X	X	X	X	X	X	X	X	X	X	X	X	X
X			X	X	X		X	X	X	X	X	X	X	X	X	X	X	X	X
X			X	X	X		X	X	X	X	X	X	X	X	X	X	X	X	X
X			X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	

Relinquished By	Date/Time	Received By
<i>S. Riley</i>	09/08/22 0845	<i>R. Williams</i>
		Date/Time
		09/08/22 0845

The individual signing this agreement on behalf of the client, acknowledges that he/she has read and understands the terms and conditions of this agreement, and that he/she has the authority to sign on behalf of the client. See [www.teklabinc.com](http://www.teklabinc.com) for terms and conditions.

BottleOrder: 74389



*Pmt 010121*

## **CHAIN OF CUSTODY**

pg. 2 of 2 Work order # 22080134

**TEKLAB, INC. 5445 Horseshoe Lake Road - Collinsville, IL 62234 - Phone: (618) 344-1004 - Fax: (618) 344-1005**

The individual signing this agreement on behalf of the client, acknowledges that he/she has read and understands the terms and conditions of this agreement, and that he/she has the authority to sign on behalf of the client. See [www.teklabinc.com](http://www.teklabinc.com) for terms and conditions.

BottleOrder: 74389





# ANALYTICAL REPORT

September 26, 2022

<sup>1</sup>Cp

<sup>2</sup>Tc

<sup>3</sup>Ss

<sup>4</sup>Cn

<sup>5</sup>Sr

<sup>6</sup>Qc

<sup>7</sup>GI

<sup>8</sup>AI

<sup>9</sup>SC

## TEKLAB, Inc.

Sample Delivery Group: L1535048

Samples Received: 09/12/2022

Project Number: 22080134

Description:

Report To: Elizabeth Hurley  
5445 Horseshoe Lake Road  
Collinsville, IL 62234

Entire Report Reviewed By:

Mark W. Beasley  
Project Manager

Results relate only to the items tested or calibrated and are reported as rounded values. This test report shall not be reproduced, except in full, without written approval of the laboratory. Where applicable, sampling conducted by Pace Analytical National is performed per guidance provided in laboratory standard operating procedures ENV-SOP-MTJL-0067 and ENV-SOP-MTJL-0068. Where sampling conducted by the customer, results relate to the accuracy of the information provided, and as the samples are received.

Pace Analytical National

12065 Lebanon Rd Mount Juliet, TN 37122 615-758-5858 800-767-5859 [www.pacenational.com](http://www.pacenational.com)

ACCOUNT:

TEKLAB, Inc.

PROJECT:

22080134

SDG:

L1535048

DATE/TIME:

09/26/22 18:46

PAGE:


1 of 21

# TABLE OF CONTENTS

Cp: Cover Page	1	<sup>1</sup> Cp
Tc: Table of Contents	2	<sup>2</sup> Tc
Ss: Sample Summary	3	<sup>3</sup> Ss
Cn: Case Narrative	5	<sup>4</sup> Cn
Sr: Sample Results	6	<sup>5</sup> Sr
22080134-001 L1535048-01	6	<sup>6</sup> Qc
22080134-002 L1535048-02	7	<sup>7</sup> Gl
22080134-003 L1535048-03	8	<sup>8</sup> Al
22080134-004 L1535048-04	9	<sup>9</sup> Sc
22080134-005 L1535048-05	10	
22080134-006 L1535048-06	11	
22080134-007 L1535048-07	12	
22080134-008 L1535048-08	13	
22080134-009 L1535048-09	14	
22080134-010 L1535048-10	15	
22080134-011 L1535048-11	16	
Qc: Quality Control Summary	17	
Radiochemistry by Method 904/9320	17	
Radiochemistry by Method SM7500Ra B M	18	
Gl: Glossary of Terms	19	
Al: Accreditations & Locations	20	
Sc: Sample Chain of Custody	21	

# SAMPLE SUMMARY

			Collected by	Collected date/time	Received date/time	
			JR / AB	09/06/22 12:19	09/12/22 09:45	
Method	Batch	Dilution	Preparation date/time	Analysis date/time	Analyst	Location
Radiochemistry by Method 904/9320	WG1926427	1	09/15/22 09:57	09/23/22 10:29	SWM	Mt. Juliet, TN
Radiochemistry by Method Calculation	WG1925714	1	09/15/22 15:00	09/23/22 10:29	SWM	Mt. Juliet, TN
Radiochemistry by Method SM7500Ra B M	WG1925714	1	09/15/22 15:00	09/16/22 12:44	RGT	Mt. Juliet, TN
<b>22080134-002 L1535048-02 Non-Potable Water</b>			Collected by	Collected date/time	Received date/time	
			JR / AB	09/06/22 14:37	09/12/22 09:45	
Method	Batch	Dilution	Preparation date/time	Analysis date/time	Analyst	Location
Radiochemistry by Method 904/9320	WG1926427	1	09/15/22 09:57	09/23/22 10:29	SWM	Mt. Juliet, TN
Radiochemistry by Method Calculation	WG1925714	1	09/15/22 15:00	09/23/22 10:29	SWM	Mt. Juliet, TN
Radiochemistry by Method SM7500Ra B M	WG1925714	1	09/15/22 15:00	09/16/22 12:44	RGT	Mt. Juliet, TN
<b>22080134-003 L1535048-03 Non-Potable Water</b>			Collected by	Collected date/time	Received date/time	
			JR / AB	09/07/22 11:25	09/12/22 09:45	
Method	Batch	Dilution	Preparation date/time	Analysis date/time	Analyst	Location
Radiochemistry by Method 904/9320	WG1926427	1	09/15/22 09:57	09/23/22 10:29	SWM	Mt. Juliet, TN
Radiochemistry by Method Calculation	WG1925714	1	09/15/22 15:00	09/23/22 10:29	SWM	Mt. Juliet, TN
Radiochemistry by Method SM7500Ra B M	WG1925714	1	09/15/22 15:00	09/16/22 12:44	RGT	Mt. Juliet, TN
<b>22080134-004 L1535048-04 Non-Potable Water</b>			Collected by	Collected date/time	Received date/time	
			JR / AB	09/07/22 12:27	09/12/22 09:45	
Method	Batch	Dilution	Preparation date/time	Analysis date/time	Analyst	Location
Radiochemistry by Method 904/9320	WG1926427	1	09/15/22 09:57	09/23/22 10:29	SWM	Mt. Juliet, TN
Radiochemistry by Method Calculation	WG1925714	1	09/15/22 15:00	09/23/22 10:29	SWM	Mt. Juliet, TN
Radiochemistry by Method SM7500Ra B M	WG1925714	1	09/15/22 15:00	09/16/22 12:44	RGT	Mt. Juliet, TN
<b>22080134-005 L1535048-05 Non-Potable Water</b>			Collected by	Collected date/time	Received date/time	
			JR / AB	09/07/22 13:02	09/12/22 09:45	
Method	Batch	Dilution	Preparation date/time	Analysis date/time	Analyst	Location
Radiochemistry by Method 904/9320	WG1926427	1	09/15/22 09:57	09/23/22 10:29	SWM	Mt. Juliet, TN
Radiochemistry by Method Calculation	WG1925714	1	09/15/22 15:00	09/23/22 10:29	SWM	Mt. Juliet, TN
Radiochemistry by Method SM7500Ra B M	WG1925714	1	09/15/22 15:00	09/16/22 12:44	RGT	Mt. Juliet, TN
<b>22080134-006 L1535048-06 Non-Potable Water</b>			Collected by	Collected date/time	Received date/time	
			JR / AB	09/06/22 13:33	09/12/22 09:45	
Method	Batch	Dilution	Preparation date/time	Analysis date/time	Analyst	Location
Radiochemistry by Method 904/9320	WG1926427	1	09/15/22 09:57	09/23/22 10:29	SWM	Mt. Juliet, TN
Radiochemistry by Method Calculation	WG1925714	1	09/15/22 15:00	09/23/22 10:29	SWM	Mt. Juliet, TN
Radiochemistry by Method SM7500Ra B M	WG1925714	1	09/15/22 15:00	09/16/22 12:44	RGT	Mt. Juliet, TN



# SAMPLE SUMMARY

			Collected by	Collected date/time	Received date/time	
			JR / AB	09/06/22 15:44	09/12/22 09:45	
22080134-007 L1535048-07 Non-Potable Water	Method	Batch	Dilution	Preparation date/time	Analysis date/time	Analyst
Radiochemistry by Method 904/9320		WG1926427	1	09/15/22 09:57	09/23/22 10:29	SWM
Radiochemistry by Method Calculation		WG1925714	1	09/15/22 15:00	09/23/22 10:29	SWM
Radiochemistry by Method SM7500Ra B M		WG1925714	1	09/15/22 15:00	09/16/22 12:44	RGT
22080134-008 L1535048-08 Non-Potable Water	Method	Batch	Dilution	Preparation date/time	Analysis date/time	Analyst
Radiochemistry by Method 904/9320		WG1926427	1	09/15/22 09:57	09/23/22 10:29	SWM
Radiochemistry by Method Calculation		WG1925714	1	09/15/22 15:00	09/23/22 10:29	SWM
Radiochemistry by Method SM7500Ra B M		WG1925714	1	09/15/22 15:00	09/16/22 12:44	RGT
22080134-009 L1535048-09 Non-Potable Water	Method	Batch	Dilution	Preparation date/time	Analysis date/time	Analyst
Radiochemistry by Method 904/9320		WG1926427	1	09/15/22 09:57	09/23/22 10:29	SWM
Radiochemistry by Method Calculation		WG1925714	1	09/15/22 15:00	09/23/22 10:29	SWM
Radiochemistry by Method SM7500Ra B M		WG1925714	1	09/15/22 15:00	09/16/22 12:44	RGT
22080134-010 L1535048-10 Non-Potable Water	Method	Batch	Dilution	Preparation date/time	Analysis date/time	Analyst
Radiochemistry by Method 904/9320		WG1926427	1	09/15/22 09:57	09/23/22 10:29	SWM
Radiochemistry by Method Calculation		WG1925714	1	09/15/22 15:00	09/23/22 10:29	SWM
Radiochemistry by Method SM7500Ra B M		WG1925714	1	09/15/22 15:00	09/16/22 12:44	RGT
22080134-011 L1535048-11 Non-Potable Water	Method	Batch	Dilution	Preparation date/time	Analysis date/time	Analyst
Radiochemistry by Method 904/9320		WG1926427	1	09/15/22 09:57	09/23/22 10:29	SWM
Radiochemistry by Method Calculation		WG1925714	1	09/15/22 15:00	09/23/22 10:29	SWM
Radiochemistry by Method SM7500Ra B M		WG1925714	1	09/15/22 15:00	09/16/22 12:44	RGT

1 Cp

2 Tc

3 Ss

4 Cn

5 Sr

6 Qc

7 Gl

8 Al

9 Sc

# CASE NARRATIVE

All sample aliquots were received at the correct temperature, in the proper containers, with the appropriate preservatives, and within method specified holding times, unless qualified or notated within the report. Where applicable, all MDL (LOD) and RDL (LOQ) values reported for environmental samples have been corrected for the dilution factor used in the analysis. All radiochemical sample results for solids are reported on a dry weight basis with the exception of tritium, carbon-14 and radon, unless wet weight was requested by the client. All Method and Batch Quality Control are within established criteria except where addressed in this case narrative, a non-conformance form or properly qualified within the sample results. By my digital signature below, I affirm to the best of my knowledge, all problems/anomalies observed by the laboratory as having the potential to affect the quality of the data have been identified by the laboratory, and no information or data have been knowingly withheld that would affect the quality of the data.



Mark W. Beasley  
Project Manager

- <sup>1</sup> Cp
- <sup>2</sup> Tc
- <sup>3</sup> Ss
- <sup>4</sup> Cn
- <sup>5</sup> Sr
- <sup>6</sup> Qc
- <sup>7</sup> GI
- <sup>8</sup> AI
- <sup>9</sup> SC

22080134-001

Collected date/time: 09/06/22 12:19

## SAMPLE RESULTS - 01

L1535048

## Radiochemistry by Method 904/9320

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-228	0.315	<u>J</u>	0.166	0.479	09/23/2022 10:29	<u>WG1926427</u>
( <i>T</i> ) Barium	92.1			30.0-143	09/23/2022 10:29	<u>WG1926427</u>
( <i>T</i> ) Yttrium	103			30.0-136	09/23/2022 10:29	<u>WG1926427</u>

<sup>1</sup>Cp<sup>2</sup>Tc<sup>3</sup>Ss<sup>4</sup>Cn<sup>5</sup>Sr<sup>6</sup>Qc<sup>7</sup>Gl<sup>8</sup>Al<sup>9</sup>Sc

## Radiochemistry by Method Calculation

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
Combined Radium	0.328	<u>U</u>	0.224	0.557	09/23/2022 10:29	<u>WG1925714</u>

## Radiochemistry by Method SM7500Ra B M

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-226	0.0129	<u>U</u>	0.150	0.284	09/16/2022 12:44	<u>WG1925714</u>
( <i>T</i> ) Barium-133	100			30.0-143	09/16/2022 12:44	<u>WG1925714</u>

22080134-002

Collected date/time: 09/06/22 14:37

## SAMPLE RESULTS - 02

L1535048

## Radiochemistry by Method 904/9320

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-228	-0.449	<u>U</u>	0.232	0.708	09/23/2022 10:29	<u>WG1926427</u>
( <i>T</i> ) Barium	78.7			30.0-143	09/23/2022 10:29	<u>WG1926427</u>
( <i>T</i> ) Yttrium	108			30.0-136	09/23/2022 10:29	<u>WG1926427</u>

<sup>1</sup>Cp<sup>2</sup>Tc<sup>3</sup>Ss<sup>4</sup>Cn<sup>5</sup>Sr<sup>6</sup>Qc<sup>7</sup>Gl<sup>8</sup>Al<sup>9</sup>Sc

## Radiochemistry by Method Calculation

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
Combined Radium	0.265	<u>U</u>	0.338	0.771	09/23/2022 10:29	<u>WG1925714</u>

## Radiochemistry by Method SM7500Ra B M

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-226	0.265	<u>J</u>	0.246	0.306	09/16/2022 12:44	<u>WG1925714</u>
( <i>T</i> ) Barium-133	96.5			30.0-143	09/16/2022 12:44	<u>WG1925714</u>

<sup>6</sup>Qc<sup>7</sup>Gl<sup>8</sup>Al<sup>9</sup>Sc

22080134-003

Collected date/time: 09/07/22 11:25

## SAMPLE RESULTS - 03

L1535048

## Radiochemistry by Method 904/9320

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-228	0.899		0.188	0.505	09/23/2022 10:29	<a href="#">WG1926427</a>
( <i>T</i> ) Barium	90.7			30.0-143	09/23/2022 10:29	<a href="#">WG1926427</a>
( <i>T</i> ) Yttrium	106			30.0-136	09/23/2022 10:29	<a href="#">WG1926427</a>

<sup>1</sup>Cp<sup>2</sup>Tc<sup>3</sup>Ss<sup>4</sup>Cn<sup>5</sup>Sr<sup>6</sup>Qc<sup>7</sup>Gl<sup>8</sup>Al<sup>9</sup>Sc

## Radiochemistry by Method Calculation

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
Combined Radium	1.26		0.325	0.585	09/23/2022 10:29	<a href="#">WG1925714</a>

## Radiochemistry by Method SM7500Ra B M

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-226	0.365		0.265	0.296	09/16/2022 12:44	<a href="#">WG1925714</a>
( <i>T</i> ) Barium-133	93.1			30.0-143	09/16/2022 12:44	<a href="#">WG1925714</a>

22080134-004

Collected date/time: 09/07/22 12:27

## SAMPLE RESULTS - 04

L1535048

## Radiochemistry by Method 904/9320

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-228	0.000	<u>U</u>	0.214	0.642	09/23/2022 10:29	<u>WG1926427</u>
( <i>T</i> ) Barium	69.9			30.0-143	09/23/2022 10:29	<u>WG1926427</u>
( <i>T</i> ) Yttrium	102			30.0-136	09/23/2022 10:29	<u>WG1926427</u>

<sup>1</sup>Cp<sup>2</sup>Tc<sup>3</sup>Ss<sup>4</sup>Cn<sup>5</sup>Sr<sup>6</sup>Qc<sup>7</sup>Gl<sup>8</sup>Al<sup>9</sup>Sc

## Radiochemistry by Method Calculation

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
Combined Radium	0.141	<u>U</u>	0.273	0.683	09/23/2022 10:29	<u>WG1925714</u>

## Radiochemistry by Method SM7500Ra B M

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-226	0.141	<u>J</u>	0.170	0.233	09/16/2022 12:44	<u>WG1925714</u>
( <i>T</i> ) Barium-133	94.7			30.0-143	09/16/2022 12:44	<u>WG1925714</u>

22080134-005

Collected date/time: 09/07/22 13:02

## SAMPLE RESULTS - 05

L1535048

## Radiochemistry by Method 904/9320

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-228	1.22		0.255	0.681	09/23/2022 10:29	<a href="#">WG1926427</a>
( <i>T</i> ) Barium	88.0			30.0-143	09/23/2022 10:29	<a href="#">WG1926427</a>
( <i>T</i> ) Yttrium	110			30.0-136	09/23/2022 10:29	<a href="#">WG1926427</a>

<sup>1</sup>Cp<sup>2</sup>Tc<sup>3</sup>Ss<sup>4</sup>Cn<sup>5</sup>Sr<sup>6</sup>Qc<sup>7</sup>Gl<sup>8</sup>Al<sup>9</sup>Sc

## Radiochemistry by Method Calculation

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
Combined Radium	1.49		0.336	0.725	09/23/2022 10:29	<a href="#">WG1925714</a>

## Radiochemistry by Method SM7500Ra B M

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-226	0.276		0.219	0.248	09/16/2022 12:44	<a href="#">WG1925714</a>
( <i>T</i> ) Barium-133	92.4			30.0-143	09/16/2022 12:44	<a href="#">WG1925714</a>

22080134-006

Collected date/time: 09/06/22 13:33

## SAMPLE RESULTS - 06

L1535048

## Radiochemistry by Method 904/9320

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-228	-0.235	<u>U</u>	0.261	0.779	09/23/2022 10:29	<u>WG1926427</u>
( <i>T</i> ) Barium	92.1			30.0-143	09/23/2022 10:29	<u>WG1926427</u>
( <i>T</i> ) Yttrium	109			30.0-136	09/23/2022 10:29	<u>WG1926427</u>

<sup>1</sup>Cp<sup>2</sup>Tc<sup>3</sup>Ss<sup>4</sup>Cn<sup>5</sup>Sr<sup>6</sup>Qc<sup>7</sup>Gl<sup>8</sup>Al<sup>9</sup>Sc

## Radiochemistry by Method Calculation

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
Combined Radium	0.214	<u>U</u>	0.322	0.808	09/23/2022 10:29	<u>WG1925714</u>

## Radiochemistry by Method SM7500Ra B M

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-226	0.214	<u>J</u>	0.189	0.215	09/16/2022 12:44	<u>WG1925714</u>
( <i>T</i> ) Barium-133	97.2			30.0-143	09/16/2022 12:44	<u>WG1925714</u>

22080134-007

Collected date/time: 09/06/22 15:44

## SAMPLE RESULTS - 07

L1535048

## Radiochemistry by Method 904/9320

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-228	0.702		0.219	0.605	09/23/2022 10:29	<a href="#">WG1926427</a>
(T) Barium	91.4			30.0-143	09/23/2022 10:29	<a href="#">WG1926427</a>
(T) Yttrium	112			30.0-136	09/23/2022 10:29	<a href="#">WG1926427</a>

<sup>1</sup>Cp<sup>2</sup>Tc<sup>3</sup>Ss<sup>4</sup>Cn<sup>5</sup>Sr<sup>6</sup>Qc<sup>7</sup>Gl<sup>8</sup>Al<sup>9</sup>Sc

## Radiochemistry by Method Calculation

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
Combined Radium	0.791		0.250	0.629	09/23/2022 10:29	<a href="#">WG1925714</a>

## Radiochemistry by Method SM7500Ra B M

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-226	0.0891	J	0.120	0.173	09/16/2022 12:44	<a href="#">WG1925714</a>
(T) Barium-133	99.5			30.0-143	09/16/2022 12:44	<a href="#">WG1925714</a>

22080134-008

Collected date/time: 09/07/22 10:42

## SAMPLE RESULTS - 08

L1535048

## Radiochemistry by Method 904/9320

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-228	0.731		0.251	0.700	09/23/2022 10:29	<a href="#">WG1926427</a>
(T) Barium	80.2			30.0-143	09/23/2022 10:29	<a href="#">WG1926427</a>
(T) Yttrium	101			30.0-136	09/23/2022 10:29	<a href="#">WG1926427</a>

<sup>1</sup>Cp<sup>2</sup>Tc<sup>3</sup>Ss<sup>4</sup>Cn<sup>5</sup>Sr<sup>6</sup>Qc<sup>7</sup>Gl<sup>8</sup>Al<sup>9</sup>Sc

## Radiochemistry by Method Calculation

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
Combined Radium	0.785		0.266	0.713	09/23/2022 10:29	<a href="#">WG1925714</a>

## Radiochemistry by Method SM7500Ra B M

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-226	0.0538	J	0.0869	0.138	09/16/2022 12:44	<a href="#">WG1925714</a>
(T) Barium-133	99.7			30.0-143	09/16/2022 12:44	<a href="#">WG1925714</a>

22080134-009

Collected date/time: 09/07/22 13:05

## SAMPLE RESULTS - 09

L1535048

## Radiochemistry by Method 904/9320

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-228	0.407	J	0.207	0.589	09/23/2022 10:29	<a href="#">WG1926427</a>
(T) Barium	95.6			30.0-143	09/23/2022 10:29	<a href="#">WG1926427</a>
(T) Yttrium	105			30.0-136	09/23/2022 10:29	<a href="#">WG1926427</a>

<sup>1</sup>Cp<sup>2</sup>Tc<sup>3</sup>Ss<sup>4</sup>Cn<sup>5</sup>Sr<sup>6</sup>Qc<sup>7</sup>Gl<sup>8</sup>Al<sup>9</sup>Sc

## Radiochemistry by Method Calculation

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
Combined Radium	0.490	J	0.243	0.621	09/23/2022 10:29	<a href="#">WG1925714</a>

## Radiochemistry by Method SM7500Ra B M

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-226	0.0821	J	0.127	0.198	09/16/2022 12:44	<a href="#">WG1925714</a>
(T) Barium-133	97.3			30.0-143	09/16/2022 12:44	<a href="#">WG1925714</a>

22080134-010

Collected date/time: 09/06/22 15:54

## SAMPLE RESULTS - 10

L1535048

## Radiochemistry by Method 904/9320

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-228	0.149	<u>U</u>	0.187	0.545	09/23/2022 10:29	<u>WG1926427</u>
( <i>T</i> ) Barium	105			30.0-143	09/23/2022 10:29	<u>WG1926427</u>
( <i>T</i> ) Yttrium	106			30.0-136	09/23/2022 10:29	<u>WG1926427</u>

<sup>1</sup>Cp<sup>2</sup>Tc<sup>3</sup>Ss<sup>4</sup>Cn<sup>5</sup>Sr<sup>6</sup>Qc<sup>7</sup>Gl<sup>8</sup>Al<sup>9</sup>Sc

## Radiochemistry by Method Calculation

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
Combined Radium	0.225	<u>U</u>	0.224	0.577	09/23/2022 10:29	<u>WG1925714</u>

## Radiochemistry by Method SM7500Ra B M

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-226	0.0768	<u>J</u>	0.123	0.190	09/16/2022 12:44	<u>WG1925714</u>
( <i>T</i> ) Barium-133	105			30.0-143	09/16/2022 12:44	<u>WG1925714</u>

22080134-011

Collected date/time: 09/06/22 14:37

## SAMPLE RESULTS - 11

L1535048

## Radiochemistry by Method 904/9320

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-228	0.362	<u>U</u>	0.274	0.783	09/23/2022 10:29	<u>WG1926427</u>
( <i>T</i> ) Barium	82.4			30.0-143	09/23/2022 10:29	<u>WG1926427</u>
( <i>T</i> ) Yttrium	102			30.0-136	09/23/2022 10:29	<u>WG1926427</u>

<sup>1</sup>Cp<sup>2</sup>Tc<sup>3</sup>Ss<sup>4</sup>Cn<sup>5</sup>Sr<sup>6</sup>Qc<sup>7</sup>Gl<sup>8</sup>Al<sup>9</sup>Sc

## Radiochemistry by Method Calculation

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
Combined Radium	0.484	<u>U</u>	0.311	0.809	09/23/2022 10:29	<u>WG1925714</u>

## Radiochemistry by Method SM7500Ra B M

Analyte	Result	<u>Qualifier</u>	Uncertainty	MDA	Analysis Date	<u>Batch</u>
	pCi/l		+ / -	pCi/l	date / time	
RADIUM-226	0.123	<u>J</u>	0.147	0.202	09/16/2022 12:44	<u>WG1925714</u>
( <i>T</i> ) Barium-133	102			30.0-143	09/16/2022 12:44	<u>WG1925714</u>

## QUALITY CONTROL SUMMARY

[L1535048-01,02,03,04,05,06,07,08,09,10,11](#)

## Method Blank (MB)

(MB) R3841523-1 09/23/22 10:29

Analyte	MB Result pCi/l	<u>MB Qualifier</u>	MB Uncertainty + / -	MB MDA pCi/l
Radium-228	0.101	<u>U</u>	0.132	0.387
(T) Barium	97.5		97.5	
(T) Yttrium	88.2		88.2	

<sup>1</sup>Cp<sup>2</sup>Tc<sup>3</sup>Ss<sup>4</sup>Cn<sup>5</sup>Sr<sup>6</sup>Qc<sup>7</sup>Gl<sup>8</sup>Al<sup>9</sup>Sc

## L1529884-05 Original Sample (OS) • Duplicate (DUP)

(OS) L1529884-05 09/26/22 10:42 • (DUP) R3841523-5 09/26/22 10:42

Analyte	Original Result pCi/l	Original Uncertainty + / -	Original MDA pCi/l	DUP Result pCi/l	DUP Uncertainty + / -	DUP MDA pCi/l	Dilution	DUP RPD %	DUP RER	<u>DUP Qualifier</u>	DUP RPD Limits %	DUP RER Limit
Radium-228	1.57	0.302	0.506	1.91	0.347	0.506	1	19.8	0.748		20	3
(T) Barium	89.7			103	103							
(T) Yttrium	108			103	103							

## Laboratory Control Sample (LCS)

(LCS) R3841523-2 09/23/22 10:29

Analyte	Spike Amount pCi/l	LCS Result pCi/l	LCS Rec. %	Rec. Limits %	<u>LCS Qualifier</u>
Radium-228	5.00	4.06	81.1	80.0-120	
(T) Barium			98.4		
(T) Yttrium			105		

## L1529884-06 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1529884-06 09/23/22 10:29 • (MS) R3841523-3 09/23/22 10:29 • (MSD) R3841523-4 09/23/22 10:29

Analyte	Spike Amount pCi/l	Original Result pCi/l	MS Result pCi/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	<u>MS Qualifier</u>	<u>MSD Qualifier</u>	RPD %	MS RER	RPD Limits %
Radium-228	16.7	0.929	15.1	17.7	84.9	100	1	70.0-130		15.9		20
(T) Barium		97.0		100	98.5							
(T) Yttrium		96.7		100	106							

## QUALITY CONTROL SUMMARY

[L1535048-01,02,03,04,05,06,07,08,09,10,11](#)

## Method Blank (MB)

(MB) R3840156-4 09/17/22 16:37

Analyte	MB Result pCi/l	<u>MB Qualifier</u> + / -	MB Uncertainty pCi/l	MB MDA pCi/l
Radium-226	0.00759	<u>U</u>	0.0258	0.0501
(T) Barium-133	91.5		91.5	

<sup>1</sup>Cp<sup>2</sup>Tc<sup>3</sup>Ss<sup>4</sup>Cn<sup>5</sup>Sr<sup>6</sup>Qc<sup>7</sup>Gl<sup>8</sup>Al<sup>9</sup>Sc

## L1535051-02 Original Sample (OS) • Duplicate (DUP)

(OS) L1535051-02 09/16/22 12:44 • (DUP) R3840156-3 09/16/22 12:44

Analyte	Original Result pCi/l	Original Uncertainty + / -	Original MDA pCi/l	DUP Result pCi/l	DUP Uncertainty + / -	DUP MDA pCi/l	Dilution	DUP RPD %	DUP RER	<u>DUP Qualifier</u>	DUP RPD Limits %	DUP RER Limit
Radium-226	0.192	0.215	0.290	0.368	0.225	0.290	1	62.8	0.566		20	3
(T) Barium-133	97.3			96.9	96.9							

## Laboratory Control Sample (LCS)

(LCS) R3840156-5 09/17/22 16:37

Analyte	Spike Amount pCi/l	LCS Result pCi/l	LCS Rec. %	Rec. Limits %	<u>LCS Qualifier</u>
Radium-226	5.02	5.20	104	80.0-120	
(T) Barium-133			91.3		

## L1534094-10 Original Sample (OS) • Matrix Spike (MS) • Matrix Spike Duplicate (MSD)

(OS) L1534094-10 09/16/22 12:44 • (MS) R3840156-1 09/16/22 12:44 • (MSD) R3840156-2 09/16/22 12:44

Analyte	Spike Amount pCi/l	Original Result pCi/l	MS Result pCi/l	MSD Result pCi/l	MS Rec. %	MSD Rec. %	Dilution	Rec. Limits %	<u>MS Qualifier</u>	<u>MSD Qualifier</u>	RPD %	MS RER	RPD Limits %
Radium-226	20.0	0.271	16.3	18.9	80.3	93.0	1	75.0-125			14.4		20
(T) Barium-133		94.7			94.2	91.5							

# GLOSSARY OF TERMS

## Guide to Reading and Understanding Your Laboratory Report

The information below is designed to better explain the various terms used in your report of analytical results from the Laboratory. This is not intended as a comprehensive explanation, and if you have additional questions please contact your project representative.

**Results Disclaimer -** Information that may be provided by the customer, and contained within this report, include Permit Limits, Project Name, Sample ID, Sample Matrix, Sample Preservation, Field Blanks, Field Spikes, Field Duplicates, On-Site Data, Sampling Collection Dates/Times, and Sampling Location. Results relate to the accuracy of this information provided, and as the samples are received.

### Abbreviations and Definitions

MDA	Minimum Detectable Activity.
Rec.	Recovery.
RER	Replicate Error Ratio.
RPD	Relative Percent Difference.
SDG	Sample Delivery Group.
(T)	Tracer - A radioisotope of known concentration added to a solution of chemically equivalent radioisotopes at a known concentration to assist in monitoring the yield of the chemical separation.
Analyte	The name of the particular compound or analysis performed. Some Analyses and Methods will have multiple analytes reported.
Dilution	If the sample matrix contains an interfering material, the sample preparation volume or weight values differ from the standard, or if concentrations of analytes in the sample are higher than the highest limit of concentration that the laboratory can accurately report, the sample may be diluted for analysis. If a value different than 1 is used in this field, the result reported has already been corrected for this factor.
Limits	These are the target % recovery ranges or % difference value that the laboratory has historically determined as normal for the method and analyte being reported. Successful QC Sample analysis will target all analytes recovered or duplicated within these ranges.
Original Sample	The non-spiked sample in the prep batch used to determine the Relative Percent Difference (RPD) from a quality control sample. The Original Sample may not be included within the reported SDG.
Qualifier	This column provides a letter and/or number designation that corresponds to additional information concerning the result reported. If a Qualifier is present, a definition per Qualifier is provided within the Glossary and Definitions page and potentially a discussion of possible implications of the Qualifier in the Case Narrative if applicable.
Result	The actual analytical final result (corrected for any sample specific characteristics) reported for your sample. If there was no measurable result returned for a specific analyte, the result in this column may state "ND" (Not Detected) or "BDL" (Below Detectable Levels). The information in the results column should always be accompanied by either an MDL (Method Detection Limit) or RDL (Reporting Detection Limit) that defines the lowest value that the laboratory could detect or report for this analyte.
Uncertainty (Radiochemistry)	Confidence level of 2 sigma.
Case Narrative (Cn)	A brief discussion about the included sample results, including a discussion of any non-conformances to protocol observed either at sample receipt by the laboratory from the field or during the analytical process. If present, there will be a section in the Case Narrative to discuss the meaning of any data qualifiers used in the report.
Quality Control Summary (Qc)	This section of the report includes the results of the laboratory quality control analyses required by procedure or analytical methods to assist in evaluating the validity of the results reported for your samples. These analyses are not being performed on your samples typically, but on laboratory generated material.
Sample Chain of Custody (Sc)	This is the document created in the field when your samples were initially collected. This is used to verify the time and date of collection, the person collecting the samples, and the analyses that the laboratory is requested to perform. This chain of custody also documents all persons (excluding commercial shippers) that have had control or possession of the samples from the time of collection until delivery to the laboratory for analysis.
Sample Results (Sr)	This section of your report will provide the results of all testing performed on your samples. These results are provided by sample ID and are separated by the analyses performed on each sample. The header line of each analysis section for each sample will provide the name and method number for the analysis reported.
Sample Summary (Ss)	This section of the Analytical Report defines the specific analyses performed for each sample ID, including the dates and times of preparation and/or analysis.

### Qualifier      Description

J	The identification of the analyte is acceptable; the reported value is an estimate.
U	Below Detectable Limits: Indicates that the analyte was not detected.

<sup>1</sup> Cp

<sup>2</sup> Tc

<sup>3</sup> Ss

<sup>4</sup> Cn

<sup>5</sup> Sr

<sup>6</sup> Qc

<sup>7</sup> GI

<sup>8</sup> AI

<sup>9</sup> Sc

# ACCREDITATIONS & LOCATIONS

Pace Analytical National 12065 Lebanon Rd Mount Juliet, TN 37122

Alabama	40660	Nebraska	NE-OS-15-05
Alaska	17-026	Nevada	TN000032021-1
Arizona	AZ0612	New Hampshire	2975
Arkansas	88-0469	New Jersey—NELAP	TN002
California	2932	New Mexico <sup>1</sup>	TN00003
Colorado	TN00003	New York	11742
Connecticut	PH-0197	North Carolina	Env375
Florida	E87487	North Carolina <sup>1</sup>	DW21704
Georgia	NELAP	North Carolina <sup>3</sup>	41
Georgia <sup>1</sup>	923	North Dakota	R-140
Idaho	TN00003	Ohio—VAP	CL0069
Illinois	200008	Oklahoma	9915
Indiana	C-TN-01	Oregon	TN200002
Iowa	364	Pennsylvania	68-02979
Kansas	E-10277	Rhode Island	LA000356
Kentucky <sup>1,6</sup>	KY90010	South Carolina	84004002
Kentucky <sup>2</sup>	16	South Dakota	n/a
Louisiana	AI30792	Tennessee <sup>1,4</sup>	2006
Louisiana	LA018	Texas	T104704245-20-18
Maine	TN00003	Texas <sup>5</sup>	LAB0152
Maryland	324	Utah	TN000032021-11
Massachusetts	M-TN003	Vermont	VT2006
Michigan	9958	Virginia	110033
Minnesota	047-999-395	Washington	C847
Mississippi	TN00003	West Virginia	233
Missouri	340	Wisconsin	998093910
Montana	CERT0086	Wyoming	A2LA
A2LA – ISO 17025	1461.01	AIHA-LAP,LLC EMLAP	100789
A2LA – ISO 17025 <sup>5</sup>	1461.02	DOD	1461.01
Canada	1461.01	USDA	P330-15-00234
EPA-Crypto	TN00003		

<sup>1</sup> Drinking Water <sup>2</sup> Underground Storage Tanks <sup>3</sup> Aquatic Toxicity <sup>4</sup> Chemical/Microbiological <sup>5</sup> Mold <sup>6</sup> Wastewater n/a Accreditation not applicable

\* Not all certifications held by the laboratory are applicable to the results reported in the attached report.

\* Accreditation is only applicable to the test methods specified on each scope of accreditation held by Pace Analytical.

<sup>1</sup> Cp

<sup>2</sup> Tc

<sup>3</sup> Ss

<sup>4</sup> Cn

<sup>5</sup> Sr

<sup>6</sup> Qc

<sup>7</sup> Gl

<sup>8</sup> Al

<sup>9</sup> Sc

**TEKLAB, INC. Chain of Custody**

K042

5445 Horseshoe Lake Road, Collinsville, IL 62234 Phone (618) 344-1004 Fax (618) 344-1005

Are the samples chilled? YES  NO  With:  Ice  Blue Ice Preserved in:  Lab  Field

**Teklab Inc**  
**5445 Horseshoe Lake Road**  
**Collinsville, IL 62234**

Cooler Temp:  Sampler: Joseph Riley/Adam Bridges

QC Level:  3

Project# 22080134

100

Comments: Please Issue reports and invoices via email only

Please analyze for Radium 226/228 on your standard turn around time.

Samples collected from an IL site.

Batch QC is required for all analyses requested. EDD requested..

Phone: (618) 344-1004

**PLEASE NOTE:**

NELAP accreditation is required on the requested analytes and must be documented as such on the final report. If your laboratory does not currently hold a NELAP accreditation for the requested method and/or analytes, please contact Teklab immediately. If your laboratory loses accreditation or is suspended for any analyte/method during the life of the contract, you must contact Teklab immediately.

Any changes to analysis/methods must be approved by Teklab, Inc.

Lab Use	Sample ID	Sample Date/Time	Preservative	Matrix
	22080134 - 001	9/6/22 1219	HNO3	Groundwater
	22080134 - 002	9/6/22 1437	HNO3	Groundwater
	22080134 - 003	9/7/22 1125	HNO3	Groundwater
	22080134 - 004	9/7/22 1227	HNO3	Groundwater
	22080134 - 005	9/7/22 1302	HNO3	Groundwater
	22080134 - 006	9/6/22 1333	HNO3	Groundwater
	22080134 - 007	9/6/22 1544	HNO3	Groundwater
	22080134 - 008	9/7/22 1042	HNO3	Groundwater
	22080134 - 009	9/7/22 1305	HNO3	Groundwater
	22080134 - 010	9/6/22 1554	HNO3	Groundwater
	22080134 - 011	9/6/22 1437	HNO3	Groundwater

\*Relinquished By

Date/Time

Received By

Date/Time

9/12/22 945

Teklab maintains a strict policy of client confidentiality and as such doe  
Teklab, Inc. protects clients' confidential information, as directed.

<u>Sample Receipt Checklist</u>		
COC Seal Present/Intact:	<input checked="" type="checkbox"/> Y <input type="checkbox"/> N	If Applicable
COC Signed/Accurate:	<input checked="" type="checkbox"/> Y <input type="checkbox"/> N	VOA Zero Headspace: <input checked="" type="checkbox"/> Y <input type="checkbox"/> N
Bottles arrive intact:	<input checked="" type="checkbox"/> Y <input type="checkbox"/> N	Pres.Correct/Check: <input checked="" type="checkbox"/> Y <input type="checkbox"/> N
Correct bottles used:	<input checked="" type="checkbox"/> Y <input type="checkbox"/> N	
Sufficient volume sent:	<input checked="" type="checkbox"/> Y <input type="checkbox"/> N	
UV Screen <0.5 mR/hr:	<input checked="" type="checkbox"/> Y <input type="checkbox"/> N	

**APPENDIX C**

**2022 Data Usability  
Assessment Report**

## QA LEVEL I - DATA VERIFICATION CHECKLIST

---

**Project Name:** SIPC CCR Groundwater Monitoring  
**Reviewing Company:** Golder Associates USA  
**Data Evaluator:** Victor Garcia  
**Checked by:** Danielle Sylvia Cofelice  
**Laboratory:** Teklab, Inc., Pace Analytical Services, LLC  
**Matrix:**  Water  Soil  Sed.  Waste  Other:

**Project Number:** GL21767997  
**Project Manager:** Danielle Sylvia Cofelice  
**Data Evaluation Date:** May 9, 2022  
**Review Date:** May 24, 2022  
**Lab Job #:** 21110629

**Analytical Methods (type and no.):** Total dissolved solids by SM 2540C; chloride by 4500-CL E; sulfate by SW-846 9036; fluoride by SW-846 9214; total metals by SW-846 3005A, 6010B and 6020A; mercury by SW-846 7470A; Radium226/228 by EPA 903.0/904.0

**Sample Information:** See Table 1

**Applicable Data Validation Guidance:** EPA Guidance on Environmental Data Verification and Data Validation (EPA QA/G-8)

<b>COC and Sample Receipt</b>	<b>YES</b>	<b>NO</b>	<b>NA</b>	<b>COMMENTS</b>
a) COC complete and correct?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
	(Project location, project contacts, sample IDs, sample dates, field QC samples identified, analyses identified, etc.)			
b) COC signed and dated by both field and lab staff?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
c) Field QC samples provided (note types)?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	EB, FB, FD
d) Did the cooler contents match the COC?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
e) Were samples received in good condition?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
f) Were the correct preservatives used?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
g) Was the cooler temperature within QC limits?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	

<b>Data Package Information</b>	<b>YES</b>	<b>NO</b>	<b>NA</b>	<b>COMMENTS</b>
a) Laboratory name and location documented?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
b) All samples reported in data package?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
c) Requested analytical methods used?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
d) Requested analyte list reported?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
e) Requested units reported?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
f) Solid samples reported on a dry-weight basis?	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	
g) Solid samples met %moisture criteria (>_____%)	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	
h) Were any sample dilutions noted?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
i) Results below the RL appropriately qualified?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
j) Did the laboratory define the qualifiers used?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	

<b>Laboratory Case Narrative</b>	<b>YES</b>	<b>NO</b>	<b>NA</b>	<b>COMMENTS</b>
a) Does the laboratory narrative indicate deficiencies?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	

<b>Holding Times</b>	<b>YES</b>	<b>NO</b>	<b>NA</b>	<b>COMMENTS</b>
a) Were holding times met for sample extraction?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
b) Were holding times met for sample analysis?	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	See Note 2

## QA LEVEL I - DATA VERIFICATION CHECKLIST

---

<b>Blanks</b>	<b>YES</b>	<b>NO</b>	<b>NA</b>	<b>COMMENTS</b>
c) Were analytes detected in the trip blank(s)?	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	_____
d) Were analytes detected in the field blank(s)?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	See Note 3_____
e) Were analytes detected in the equipment blank(s)?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	See Note 3_____
f) Were analytes detected in the method blank(s)?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	See Note 3_____

<b>Duplicates</b>	<b>YES</b>	<b>NO</b>	<b>NA</b>	<b>COMMENTS</b>
a) Were field duplicates collected?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	_____
b) Field dup. met precision criteria (RPD 30%)?	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	See Note 4_____

<b>Overall Evaluation</b>	<b>YES</b>	<b>NO</b>	<b>NA</b>	<b>COMMENTS</b>
a) Were there any other technical problems not previously addressed?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	See Notes 5-8_____
b) Data are acceptable and usable except as noted?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	_____

### Comments/Notes:

- 1) The data was evaluated for precision, accuracy, representativeness, completeness, and comparability. Data usability was evaluated following the EPA Guidance on Environmental Data Verification and Data Validation (EPA QA/G-8).
- 2) Samples Field Blank, EP-6, EP-5, and EBG for total dissolved solids were analyzed outside of holding time. The holding time for total dissolved solids is 7 days, the samples were analyzed 8-9 days after sample collection. The laboratory qualified the samples "H" to indicate the problem.
- 3) Analytes were detected in the method, field, and equipment blanks, as shown in the table below. Field and equipment blanks are compared to primary samples collected on the same day. Associated detected results are considered potentially biased high.

Sample Name	Parameter	Analyte	Blank Result	RL/MDA	Units
Equipment Blank	Radium	Radium-226	0.108 J	0.161	pCi/L
Equipment Blank	Radium	Radium-228	3.06	0.353	pCi/L
Equipment Blank	Radium	Combined Radium	3.16	0.595	pCi/L
Field Blank	Radium	Radium-228	0.465	0.374	pCi/L
Field Blank	Radium	Combined Radium	0.482 J	0.586	pCi/L
MB-R304392	TDS 2540C	Total Dissolved Solids	38	20	mg/L
MB R3774012-1	Radium	Radium-228	0.252 J	0.427	pCi/L

- 4) Field duplicate RPDs did not meet acceptance criteria. Reporting limits were used to calculate RPDs for non-detect results. Using professional judgment, RPDs were first calculated, and analytes with RPDs above 30% were evaluated. The affected results are considered potentially biased.

Primary Sample Name	Parameter	Analyte	Primary Sample Result	Duplicate Sample Result	MDC Primary Sample	MDC Duplicate Sample	Unit	RPD (%)
EP-2	Radiological	Radium-228	0.145 U	1.13	0.529	0.316	pCi/L	72.5
EP-2	Radiological	Combined Radium	0.374 J	1.13	0.813	0.618	pCi/L	101

- 5) Chloride matrix spike and matrix spike duplicate recoveries, associated with batch R304397, are below QC limits. The associated relative percent difference are within QC limits. The spiked sample was not collected from the project site. Data usability is not affected.

## QA LEVEL I - DATA VERIFICATION CHECKLIST

---

- 6) Sulfate matrix spike and matrix spike duplicate recoveries, associated with batch R304397 and R304396, are below QC limits. The associated relative percent difference are within QC limits. The spiked samples were not collected from the project site. Data usability is not affected.
- 7) Boron matrix spike and matrix spike duplicate recoveries, associated with batch 186250, are below QC limits. The associated relative percent difference are within QC limits. The associated results are considered to have potential low bias.
- 8) A calcium matrix spike duplicate recovery, associated with batch 186250, is above QC limits. The associated matrix spike duplicate recovery and relative percent difference are within QC limits. Data usability is not affected.

### Definitions:

COC: Chain of Custody

QC: Quality Control

LCS: Laboratory Control Sample

QL: Quantitation Limit

LCS: Laboratory Control Sample

RL: Reporting Limit

MDL: Method Detection Limit

RPD: Relative Percent Difference

MS/MSD: Matrix Spike/Matrix Spike Duplicate

SDG: Sample Delivery Group

**TABLE 1**

**Sample Collection and Analysis Summary**  
**SIPC CCR Groundwater Monitoring**

<b>Lab ID</b>	<b>Field Identification</b>	<b>Collection Date</b>	<b>Location</b>	<b>Matrix</b>	<b>QC Samples</b>						
						<b>Anions</b>	<b>Total Dissolved Solids</b>	<b>Total Metals</b>	<b>Mercury</b>	<b>Total Hardness</b>	<b>Radium-226/228</b>
21110629-001	EBG	12/21/2021	EBG	GW	-	X	X	X	X	X	X
21110629-002	EP-1	12/21/2021	EP-1	GW	-	X	X	X	X	X	X
21110629-003	EP-2	12/22/2021	EP-2	GW	-	X	X	X	X	X	X
21110629-004	EP-3	12/22/2021	EP-3	GW	-	X	X	X	X	X	X
21110629-005	EP-4	12/22/2021	EP-4	GW	-	X	X	X	X	X	X
21110629-006	EP-5	12/21/2021	EP-5	GW	-	X	X	X	X	X	X
21110629-007	EP-6	12/22/2021	EP-6	GW	-	X	X	X	X	X	X
21110629-008	EP-7	12/22/2021	EP-7	GW	-	X	X	X	X	X	X
21110629-009	Equipment Blank	12/22/2021	-	WQ	EB	X	X	X	X	X	X
21110629-010	Field Blank	12/22/2021	-	WQ	FB	X	X	X	X	X	X
21110629-011	Field Duplicate	12/22/2021	EP-2	GW	FD	X	X	X	X	X	X

**Notes:**

All analyses performed by Teklab in Collinsville, IL and PACE Mount Juliet, TN laboratories.

**Abbreviations:**

FB: Field Blank

FD: Field Duplicate

GW: Ground Water

WQ: Water Quality

QC: Quality Control

## QA LEVEL I - DATA VERIFICATION CHECKLIST

---

**Project Name:** SIPC CCR Groundwater Monitoring  
**Reviewing Company:** Golder Associates USA  
**Data Evaluator:** Danielle Sylvia Cofelice  
**Checked by:** Michael Shadle  
**Laboratory:** Teklab, Inc., Pace Analytical Services, LLC  
**Matrix:**  Water  Soil  Sed.  Waste  Other:

**Project Number:** GL21767997  
**Project Manager:** Danielle Sylvia Cofelice  
**Data Evaluation Date:** May 3, 2022  
**Review Date:** May 4, 2022  
**Lab Job #:** 22021140

**Analytical Methods (type and no.):** Total dissolved solids by SM 2540C; chloride by 4500-CL E; sulfate by SW-846 9036; fluoride by SW-846 9214; total metals by SW-846 3005A, 6010B and 6020A; mercury by SW-846 7470A; Radium226/228 by EPA 903.0/904.0

**Sample Information:** See Table 1

**Applicable Data Validation Guidance:** EPA Guidance on Environmental Data Verification and Data Validation (EPA QA/G-8)

<b>COC and Sample Receipt</b>	<b>YES</b>	<b>NO</b>	<b>NA</b>	<b>COMMENTS</b>
a) COC complete and correct?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
(Project location, project contacts, sample IDs, sample dates, field QC samples identified, analyses identified, etc.)				
b) COC signed and dated by both field and lab staff?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
c) Field QC samples provided (note types)?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	EB, FB, FD
d) Did the cooler contents match the COC?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
e) Were samples received in good condition?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
f) Were the correct preservatives used?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
g) Was the cooler temperature within QC limits?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	

<b>Data Package Information</b>	<b>YES</b>	<b>NO</b>	<b>NA</b>	<b>COMMENTS</b>
a) Laboratory name and location documented?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
b) All samples reported in data package?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
c) Requested analytical methods used?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
d) Requested analyte list reported?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
e) Requested units reported?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
f) Solid samples reported on a dry-weight basis?	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	
g) Solid samples met %moisture criteria (>_____%)	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	
h) Were any sample dilutions noted?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
i) Results below the RL appropriately qualified?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
j) Did the laboratory define the qualifiers used?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	

<b>Laboratory Case Narrative</b>	<b>YES</b>	<b>NO</b>	<b>NA</b>	<b>COMMENTS</b>
a) Does the laboratory narrative indicate deficiencies?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	

<b>Holding Times</b>	<b>YES</b>	<b>NO</b>	<b>NA</b>	<b>COMMENTS</b>
a) Were holding times met for sample extraction?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
b) Were holding times met for sample analysis?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	

## QA LEVEL I - DATA VERIFICATION CHECKLIST

---

<b>Blanks</b>	<b>YES</b>	<b>NO</b>	<b>NA</b>	<b>COMMENTS</b>
a) Were analytes detected in the trip blank(s)?	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	_____
b) Were analytes detected in the field blank(s)?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	See Note 2_____
c) Were analytes detected in the equipment blank(s)?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	See Note 2_____
d) Were analytes detected in the method blank(s)?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	See Note 2_____
<b>Duplicates</b>	<b>YES</b>	<b>NO</b>	<b>NA</b>	<b>COMMENTS</b>
a) Were field duplicates collected?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	_____
b) Field dup. met precision criteria (RPD 30%)?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	_____
<b>Overall Evaluation</b>	<b>YES</b>	<b>NO</b>	<b>NA</b>	<b>COMMENTS</b>
a) Were there any other technical problems not previously addressed?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	See Notes 3-5_____
b) Data are acceptable and usable except as noted?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	_____

### Comments/Notes:

- 1) The data was evaluated for precision, accuracy, representativeness, completeness, and comparability. Data usability was evaluated following the EPA Guidance on Environmental Data Verification and Data Validation (EPA QA/G-8).
- 2) Analytes were detected in the method, field, and equipment blanks, as shown in the table below. Field and equipment blanks are compared to primary samples collected on the same day. Associated detected results are considered potentially biased high.

Sample Name	Parameter	Analyte	Blank Result	RL/MDC	Units
Field Blank	Metals	Boron	0.019 J	0.020	mg/L
Equipment Blank	Metals	Boron	0.0302	0.020	mg/L
Equipment Blank	Metals	Calcium	0.064 J	0.10	mg/L
MB R3774012-1	Radium	Radium-228	0.252 J	0.232	pCi/L

- 3) A sulfate matrix spike recovery, associated with batch R308169, is below QC limits. The associated matrix spike duplicate recovery and the relative percent difference are within QC limits. Data usability is not affected.
- 4) Boron and calcium matrix spike recoveries, associated with batch 188407, are above QC limits. The associated matrix spike duplicate recoveries and the relative percent differences are within QC limits. Data usability is not affected.
- 5) Calcium matrix spike and matrix spike duplicate recoveries, associated with batch 188407, are above QC limits. The initial sample result is greater than ten times the spike amount. Data usability is not affected.

### Definitions:

COC: Chain of Custody

QC: Quality Control

LCS: Laboratory Control Sample

QL: Quantitation Limit

LCS: Laboratory Control Sample

RL: Reporting Limit

MDL: Method Detection Limit

RPD: Relative Percent Difference

MS/MSD: Matrix Spike/Matrix Spike Duplicate

SDG: Sample Delivery Group

**TABLE 1**

**Sample Collection and Analysis Summary  
SIPC CCR Groundwater Monitoring**

<i>Lab ID</i>	<i>Field Identification</i>	<i>Collection Date</i>	<i>Location</i>	<i>Matrix</i>	<i>QC Samples</i>	<i>Anions</i>	<i>Total Dissolved Solids</i>	<i>Total Metals</i>	<i>Mercury</i>	<i>Total Hardness</i>	<i>Radium-226/228</i>
22021140-001	EBG	3/7/2022	EBG	GW	-	X	X	X	X	X	X
22021140-002	EP-1	3/7/2022	EP-1	GW	-	X	X	X	X	X	X
22021140-003	EP-2	3/7/2022	EP-2	GW	-	X	X	X	X	X	X
22021140-004	EP-3	3/8/2022	EP-3	GW	-	X	X	X	X	X	X
22021140-005	EP-4	3/8/2022	EP-4	GW	-	X	X	X	X	X	X
22021140-006	EP-5	3/7/2022	EP-5	GW	-	X	X	X	X	X	X
22021140-007	EP-6	3/8/2022	EP-6	GW	-	X	X	X	X	X	X
22021140-008	EP-7	3/8/2022	EP-7	GW	-	X	X	X	X	X	X
22021140-009	Equipment Blank	3/8/2022	-	WQ	EB	X	X	X	X	X	X
22021140-010	Field Blank	3/7/2022	-	WQ	FB	X	X	X	X	X	X
22021140-011	Field Duplicate	3/7/2022	EP-2	GW	FD	X	X	X	X	X	X

**Notes:**

All analyses performed by Teklab in Collinsville, IL and PACE Mount Juliet, TN laboratories.

**Abbreviations:**

FB: Field Blank  
 FD: Field Duplicate  
 GW: Ground Water  
 WQ: Water Quality  
 QC: Quality Control

## QA LEVEL I - DATA VERIFICATION CHECKLIST

---

**Project Name:** SIPC CCR Groundwater Monitoring  
**Reviewing Company:** Golder Associates USA  
**Data Evaluator:** Victor Garcia  
**Checked by:** Danielle Sylvia Cofelice  
**Laboratory:** Teklab, Inc., Pace Analytical Services, LLC  
**Matrix:**  Water  Soil  Sed.  Waste  Other:

**Project Number:** GL21767997  
**Project Manager:** Danielle Sylvia Cofelice  
**Data Evaluation Date:** July 19, 2022  
**Review Date:** July 19, 2022  
**Lab Job #:** 22050087

**Analytical Methods (type and no.):** Total dissolved solids by SM 2540C; chloride by 4500-CL E; sulfate by SW-846 9036; fluoride by SW-846 9214; total metals by SW-846 3005A, 6010B and 6020A; mercury by SW-846 7470A; Radium226/228 by EPA 903.0/904.0

**Sample Information:** See Table 1

**Applicable Data Validation Guidance:** EPA Guidance on Environmental Data Verification and Data Validation (EPA QA/G-8)

<b>COC and Sample Receipt</b>	<b>YES</b>	<b>NO</b>	<b>NA</b>	<b>COMMENTS</b>
a) COC complete and correct?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
	(Project location, project contacts, sample IDs, sample dates, field QC samples identified, analyses identified, etc.)			
b) COC signed and dated by both field and lab staff?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
c) Field QC samples provided (note types)?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	EB, FB, FD
d) Did the cooler contents match the COC?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
e) Were samples received in good condition?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
f) Were the correct preservatives used?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
g) Was the cooler temperature within QC limits?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	

<b>Data Package Information</b>	<b>YES</b>	<b>NO</b>	<b>NA</b>	<b>COMMENTS</b>
a) Laboratory name and location documented?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
b) All samples reported in data package?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
c) Requested analytical methods used?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
d) Requested analyte list reported?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
e) Requested units reported?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
f) Solid samples reported on a dry-weight basis?	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	
g) Solid samples met %moisture criteria (>_____%)	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	
h) Were any sample dilutions noted?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
i) Results below the RL appropriately qualified?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
j) Did the laboratory define the qualifiers used?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	

<b>Laboratory Case Narrative</b>	<b>YES</b>	<b>NO</b>	<b>NA</b>	<b>COMMENTS</b>
a) Does the laboratory narrative indicate deficiencies?	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	

<b>Holding Times</b>	<b>YES</b>	<b>NO</b>	<b>NA</b>	<b>COMMENTS</b>
a) Were holding times met for sample extraction?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
b) Were holding times met for sample analysis?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	

## QA LEVEL I - DATA VERIFICATION CHECKLIST

---

<b>Blanks</b>	<b>YES</b>	<b>NO</b>	<b>NA</b>	<b>COMMENTS</b>
c) Were analytes detected in the trip blank(s)?	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	_____
d) Were analytes detected in the field blank(s)?	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	_____
e) Were analytes detected in the equipment blank(s)?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	See Note 2_____
f) Were analytes detected in the method blank(s)?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	See Note 2_____

<b>Duplicates</b>	<b>YES</b>	<b>NO</b>	<b>NA</b>	<b>COMMENTS</b>
a) Were field duplicates collected?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	_____
b) Field dup. met precision criteria (RPD 30%)?	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	See Note 3_____

<b>Overall Evaluation</b>	<b>YES</b>	<b>NO</b>	<b>NA</b>	<b>COMMENTS</b>
a) Were there any other technical problems not previously addressed?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	See Notes 4-6_____
b) Data are acceptable and usable except as noted?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	_____

### Comments/Notes:

- 1) The data was evaluated for precision, accuracy, representativeness, completeness, and comparability. Data usability was evaluated following the EPA Guidance on Environmental Data Verification and Data Validation (EPA QA/G-8).
- 2) Analytes were detected in the method, field, and equipment blanks, as shown in the table below. Field and equipment blanks are compared to primary samples collected on the same day. Associated detected results are considered potentially biased high.

Sample Name	Parameter	Analyte	Blank Result	RL/MDA	Units
Equipment Blank	Radium	Radium-228	0.657 J	0.657	pCi/L
Equipment Blank	Radium	Combined Radium	0.698 J	0.710	pCi/L
MB R3811243-1	Radium	Radium-228	0.239 J	0.334	pCi/L

- 3) Field duplicate RPDs did not meet acceptance criteria. Reporting limits were used to calculate RPDs for non-detect results. Using professional judgment, RPDs were first calculated, and analytes with RPDs above 30% were evaluated. Using professional judgement for inorganics, when the results are less than 5x the reporting limit and the absolute difference between the results is less than the reporting limit, no bias is suspected. Otherwise, the affected results are considered potentially biased.

Primary Sample Name	Parameter	Analyte	Primary Sample Result	Duplicate Sample Result	RL/MD A Primary Sample	RL/MDA Duplicate Sample	Unit	RPD (%)
EP-6	Metals	Chromium	0.0008 J	0.0021	0.0015	0.0015	mg/L	90
EP-6	Metals	Cobalt	0.0007 J	0.0010	0.0010	0.0010	mg/L	35
EP-6	Radiological	Radium-228	0.183 U	2.19	0.682	0.956	pCi/L	105
EP-6	Radiological	Combined Radium	0.295 U	2.37	0.288	0.964	pCi/L	106

- 4) Sulfate matrix spike and matrix spike duplicate recoveries, associated with batch R312712, are below QC limits. The associated relative percent difference is within QC limits. The spiked samples were not collected from the project site. Data usability is not affected.
- 5) Calcium matrix spikes recoveries, associated with batch R193106, are below QC limits. One of the calcium matrix spike duplicate recoveries is above QC limits. The associated relative percent differences are within QC limits. The spiked samples were not collected from the project site. Data usability is not affected.

## QA LEVEL I - DATA VERIFICATION CHECKLIST

---

- 6) Laboratory duplicate RPDs did not meet acceptance criteria (20%). The affected parent samples were not collected from the project side. Data usability is not affected.

Primary Sample Name	Parameter	Analyte	Primary Sample Result	Duplicate Sample Result	MDA Primary Sample	MDA Duplicate Sample	Unit	RPD (%)
L1494363-07	Radiological	Radium-228	0.770	0.197 U	0.357	0.357	pCi/L	118
L1491809-13	Radiological	Radium-226	0.203 U	0.341	0.240	0.240	pCi/L	50.7

### Definitions:

COC: Chain of Custody

QC: Quality Control

LCS: Laboratory Control Sample

QL: Quantitation Limit

LCS: Laboratory Control Sample

RL: Reporting Limit

MDL: Method Detection Limit

RPD: Relative Percent Difference

MS/MSD: Matrix Spike/Matrix Spike Duplicate

SDG: Sample Delivery Group

**TABLE 1**

**Sample Collection and Analysis Summary  
SIPC CCR Groundwater Monitoring**

<i>Lab ID</i>	<i>Field Identification</i>	<i>Collection Date</i>	<i>Location</i>	<i>Matrix</i>	<i>QC Samples</i>	<i>Anions</i>	<i>Total Dissolved Solids</i>	<i>Total Metals</i>	<i>Mercury</i>	<i>Total Hardness</i>	<i>Radium-226/228</i>
22050087-001	EBG	5/24/2022	EBG	GW	-	X	X	X	X	X	X
22050087-002	EP-1	5/24/2022	EP-1	GW	-	X	X	X	X	X	X
22050087-003	EP-2	5/24/2022	EP-2	GW	-	X	X	X	X	X	X
22050087-004	EP-3	5/25/2022	EP-3	GW	-	X	X	X	X	X	X
22050087-005	EP-4	5/25/2022	EP-4	GW	-	X	X	X	X	X	X
22050087-006	EP-5	5/24/2022	EP-5	GW	-	X	X	X	X	X	X
22050087-007	EP-6	5/24/2022	EP-6	GW	-	X	X	X	X	X	X
22050087-008	EP-7	5/25/2022	EP-7	GW	-	X	X	X	X	X	X
22050087-009	Equipment Blank	5/25/2022	-	WQ	EB	X	X	X	X	X	X
22050087-010	Field Blank	5/24/2022	-	WQ	FB	X	X	X	X	X	X
22050087-011	Field Duplicate	5/24/2022	EP-6	GW	FD	X	X	X	X	X	X

**Notes:**

All analyses performed by Teklab in Collinsville, IL and PACE Mount Juliet, TN laboratories.

**Abbreviations:**

FB: Field Blank  
FD: Field Duplicate  
GW: Ground Water  
WQ: Water Quality

## QA LEVEL I - DATA VERIFICATION CHECKLIST

---

**Project Name:** SIPC Groundwater Monitoring  
**Reviewing Company:** Golder Associates USA  
**Data Evaluator:** Candace Cocca  
**Checked by:** Danielle Sylvia Cofelice  
**Laboratory:** Teklab, Inc., Pace Analytical Services, LLC  
**Matrix:**  Water  Soil  Sed.  Waste  Other:

**Project Number:** GL21467997  
**Project Manager:** Danielle Sylvia Cofelice  
**Data Evaluation Date:** October 24, 2022  
**Review Date:** November 2, 2022  
**Lab Job #:** 22080134

**Analytical Methods (type and no.):** Total dissolved solids by SM 2540C; chloride by 4500-CL E; sulfate by SW-846 9036; fluoride by SW-846 9214; total metals by SW-846 3005A, 6010B and 6020A; mercury by SW-846 7470A; Radium226/228 by EPA 903.0/904.0

**Sample Information:** See Table 1

**Applicable Data Validation Guidance:** EPA Guidance on Environmental Data Verification and Data Validation (EPA QA/G-8)

<b>COC and Sample Receipt</b>	<b>YES</b>	<b>NO</b>	<b>NA</b>	<b>COMMENTS</b>
a) COC complete and correct?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
	(Project location, project contacts, sample IDs, sample dates, field QC samples identified, analyses identified, etc.)			
b) COC signed and dated by both field and lab staff?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
c) Field QC samples provided (note types)?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	EB, FB, FD
d) Did the cooler contents match the COC?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
e) Were samples received in good condition?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
f) Were the correct preservatives used?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
g) Was the cooler temperature within QC limits?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	

<b>Data Package Information</b>	<b>YES</b>	<b>NO</b>	<b>NA</b>	<b>COMMENTS</b>
a) Laboratory name and location documented?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
b) All samples reported in data package?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
c) Requested analytical methods used?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
d) Requested analyte list reported?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
e) Requested units reported?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
f) Solid samples reported on a dry-weight basis?	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	
g) Solid samples met %moisture criteria (>_____%)	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	
h) Were any sample dilutions noted?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
i) Results below the RL appropriately qualified?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
j) Did the laboratory define the qualifiers used?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	

<b>Laboratory Case Narrative</b>	<b>YES</b>	<b>NO</b>	<b>NA</b>	<b>COMMENTS</b>
a) Does the laboratory narrative indicate deficiencies?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	See items below _____

<b>Holding Times</b>	<b>YES</b>	<b>NO</b>	<b>NA</b>	<b>COMMENTS</b>
a) Were holding times met for sample extraction?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
b) Were holding times met for sample analysis?	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	See Note 1 _____

## QA LEVEL I - DATA VERIFICATION CHECKLIST

---

<b>Blanks</b>	<b>YES</b>	<b>NO</b>	<b>NA</b>	<b>COMMENTS</b>
a) Were analytes detected in the trip blank(s)?	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	_____
b) Were analytes detected in the field blank(s)?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	See Note 2_____
c) Were analytes detected in the equipment blank(s)?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	See Note 2_____
d) Were analytes detected in the method blank(s)?	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	_____

<b>Duplicates</b>	<b>YES</b>	<b>NO</b>	<b>NA</b>	<b>COMMENTS</b>
a) Were field duplicates collected?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	See Table 1_____
b) Field dup. met precision criteria (RPD 30%)?	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	See Note 3_____

<b>Overall Evaluation</b>	<b>YES</b>	<b>NO</b>	<b>NA</b>	<b>COMMENTS</b>
a) Were there any other technical problems not previously addressed?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	See Note 4_____
b) Data are acceptable and usable except as noted?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	_____

### Comments/Notes:

- 1) The following samples were analyzed outside of the method holding for total dissolved solids: EBG, EP-1, Field Duplicate, Equipment Blank, and Field Blank. The hold time for total dissolved solids is 7 days and these samples were analyzed 30 days outside of holding time. Initial results were deemed non-reportable by the laboratory due to technician error and these samples were reanalyzed outside of the method holding time. The results are considered to be potentially biased.
- 2) Analytes were detected in the field and equipment blanks, as shown in the table below. Field and equipment blanks are compared to primary samples collected on the same day. Associated detected results are considered potentially biased.

Sample Name	Parameter	Analyte	Blank Result	RL/MDC	Units
FB 22080134-010	Radium	Radium-226	0.0768 J	0.190	pCi/L
EB 22080134-009	Radium	Radium-228	0.407 J	0.589	pCi/L
EB 22080134-009	Radium	Radium-226	0.0821 J	0.198	pCi/L
EB 22080134-009	Radium	Combined Radium	0.490 J	0.621	pCi/L

- 3) Field duplicate RPDs did not meet acceptance criteria. Reporting limits were used to calculate RPDs for non-detect results. Using professional judgment, RPDs were first calculated, and analytes with RPDs above 30% were evaluated. Using professional judgement for inorganics, when the results are less than 5x the reporting limit and the absolute difference between the results is less than the reporting limit, no bias is suspected. Otherwise, the affected results are considered potentially biased.

Primary Sample Name	Parameter	Analyte	Primary Sample Result	Duplicate Sample Result	RL/MDA Primary Sample	RL/MDA Duplicate Sample	Unit	RPD (%)
EP-1	Metals	Thallium	0.002	0.001 J	0.002	0.002	mg/L	66.7%
EP-1	Radium	Radium-226	0.265 J	0.123 J	0.306	0.202	Pci/l	73.2%
EP-1	Mercury	Mercury	0.0002	0.00006 J	0.0002	0.0002	mg/L	107.7%

- 4) A chromium matrix spike duplicate recovery, associated with batch 196431(all samples), is above QC limits. The associated matrix spike recovery and relative percent difference is within QC limits. Data usability is not affected.

### Definitions:

## **QA LEVEL I - DATA VERIFICATION CHECKLIST**

---

COC: Chain of Custody

LCS: Laboratory Control Sample

LCS: Laboratory Control Sample

MDL: Method Detection Limit

MS/MSD: Matrix Spike/Matrix Spike Duplicate

QC: Quality Control

QL: Quantitation Limit

RL: Reporting Limit

RPD: Relative Percent Difference

SDG: Sample Delivery Group

**TABLE 1**

**Sample Collection and Analysis Summary  
SIPC CCR Groundwater Monitoring**

<b>Lab ID</b>	<b>Field Identification</b>	<b>Collection Date</b>	<b>Location</b>	<b>Matrix</b>	<b>QC Samples</b>	<b>Chloride</b>	<b>Field Parameters</b>		<b>ICP Metals</b>		<b>Mercury</b>	<b>Radium-226/228</b>	<b>Sulfate</b>	<b>TDS</b>
							<b>Fluoride</b>		<b>X</b>	<b>X</b>	<b>X</b>	<b>X</b>	<b>X</b>	<b>X</b>
22080134-001	EBG	9/6/2022	EBG	GW	-	X	X	X	X	X	X	X	X	X
22080134-002	EP-1	9/6/2022	EP-1	GW	-	X	X	X	X	X	X	X	X	X
22080134-003	EP-2	9/7/2022	EP-2	GW	-	X	X	X	X	X	X	X	X	X
22080134-004	EP-3	9/7/2022	EP-3	GW	-	X	X	X	X	X	X	X	X	X
22080134-005	EP-4	9/7/2022	EP-4	GW	-	X	X	X	X	X	X	X	X	X
22080134-006	EP-5	9/6/2022	EP-5	GW	-	X	X	X	X	X	X	X	X	X
22080134-007	EP-6	9/6/2022	EP-6	GW	-	X	X	X	X	X	X	X	X	X
22080134-008	EP-7	9/7/2022	EP-7	GW	-	X	X	X	X	X	X	X	X	X
22080134-009	Equipment Blank	9/7/2022	-	WQ	EB	X		X	X	X	X	X	X	X
22080134-010	Field Blank	9/6/2022	-	WQ	FB	X		X	X	X	X	X	X	X
22080134-011	Field Duplicate	9/6/2022	EP-1	GW	FD	X	X	X	X	X	X	X	X	X

**Notes:**

All analyses performed by Teklab in Collinsville, IL and PACE Mount Juliet, TN laboratories.

**Abbreviations:**

FB: Field Blank

FD: Field Duplicate

GW: Ground Water

WQ: Water Quality


QC: Quality Control

**APPENDIX D**

**2022 Statistical Evaluation**

## Non-Parametric Confidence Interval

Compliance Limit is not exceeded.

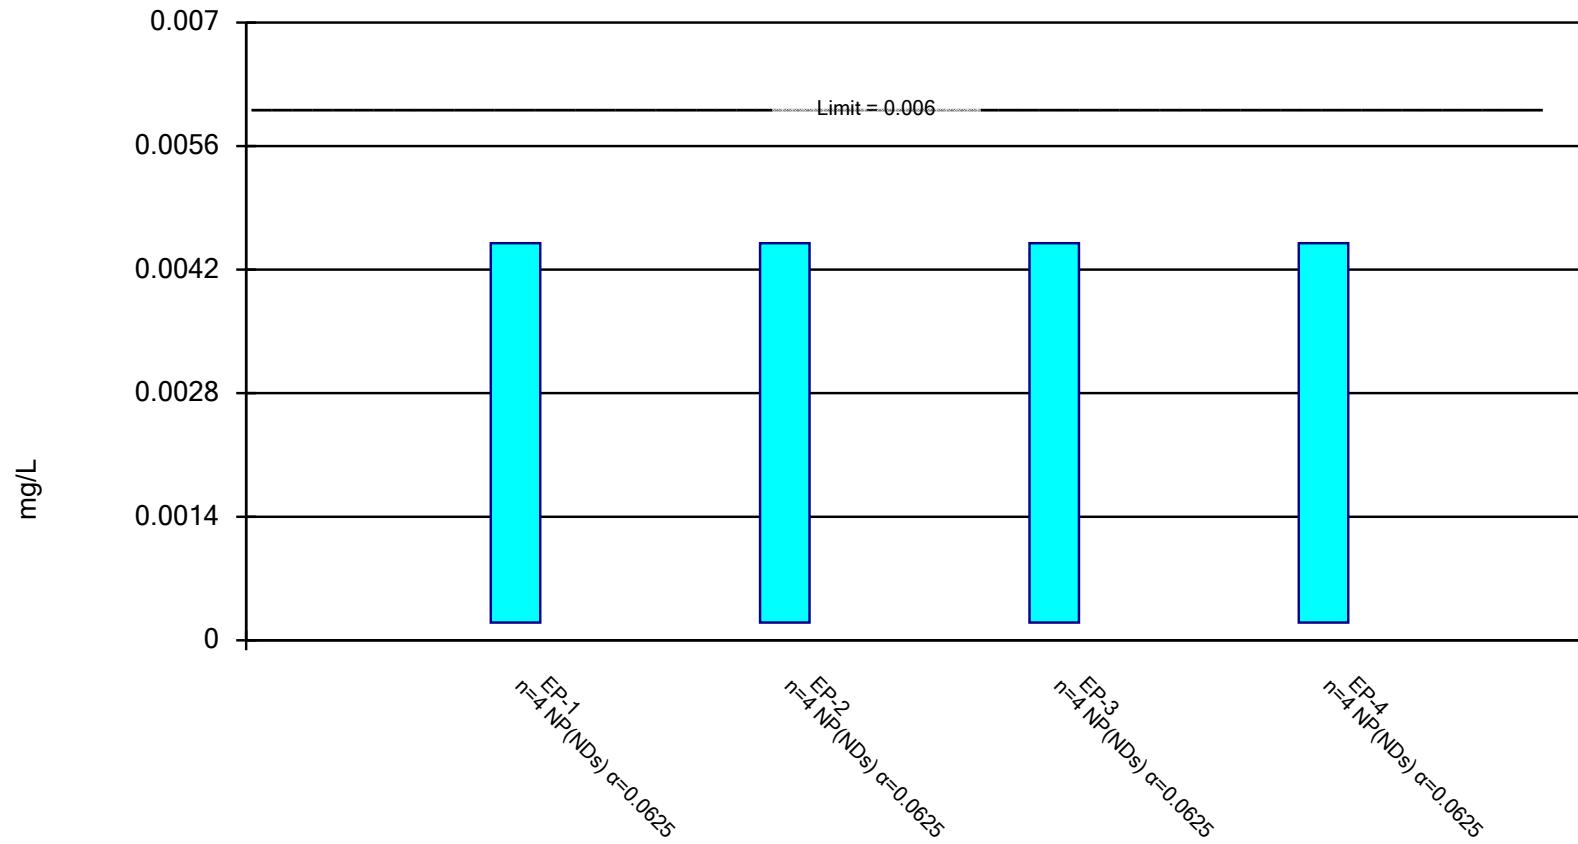


Constituent: Antimony Analysis Run 5/6/2022 2:10 PM View: EPA SSLs

Marion Power Plant Client: SIPC Data: SIPC Statistical Database

## Parametric and Non-Parametric (NP) Confidence Interval

Compliance Limit is not exceeded. Per-well alpha = 0.01 except as noted. Normality Test: Shapiro Wilk, alpha based on n.

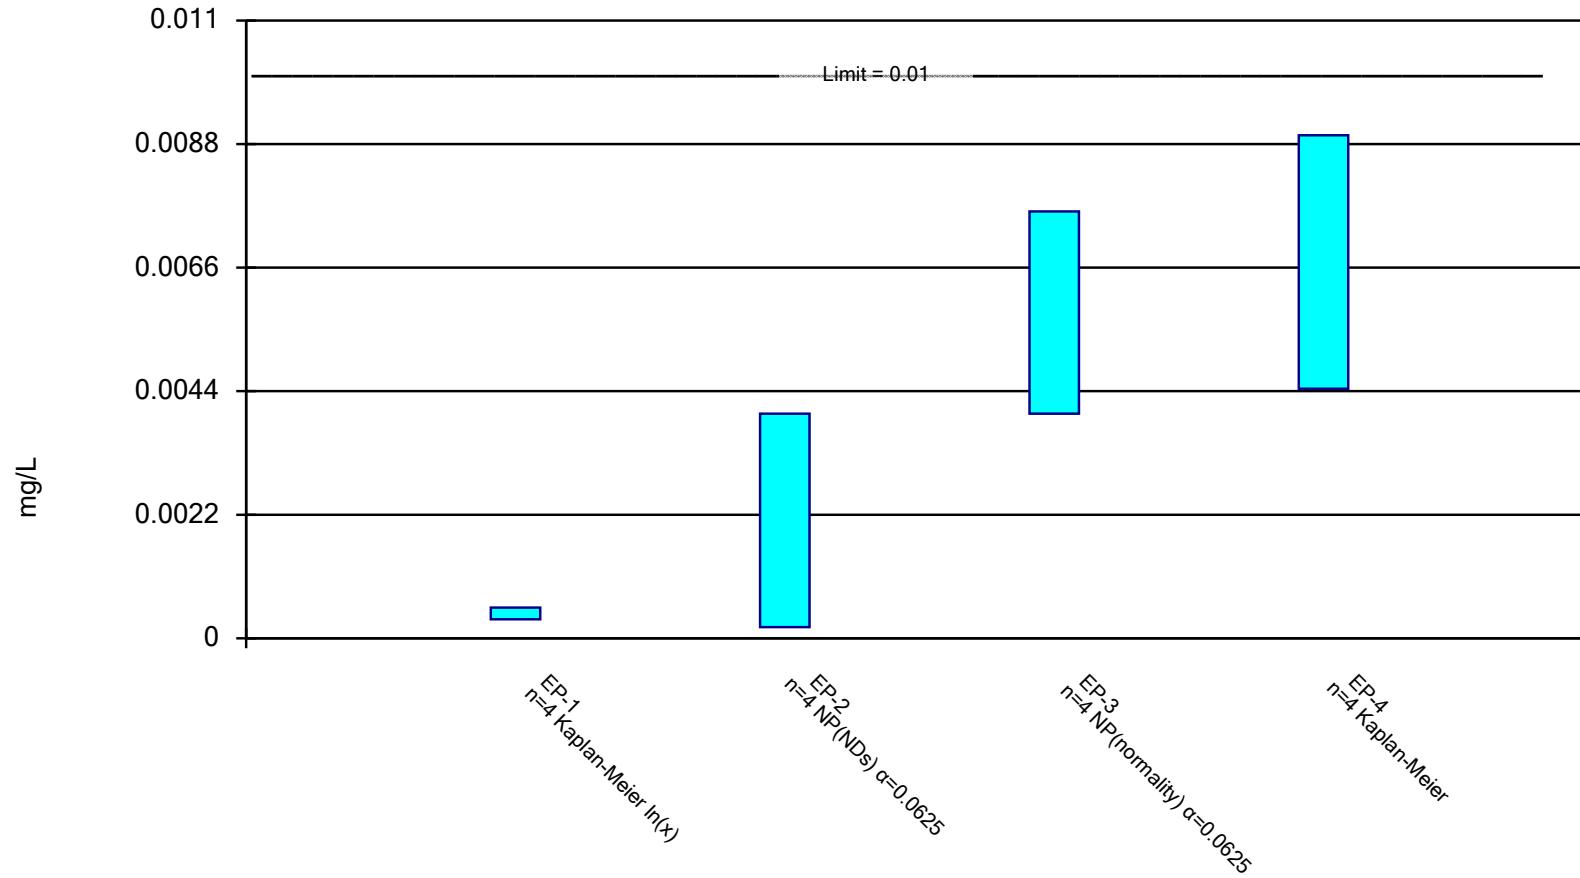


Constituent: Arsenic Analysis Run 5/6/2022 2:10 PM View: EPA SSLs

Marion Power Plant Client: SIPC Data: SIPC Statistical Database

## Parametric and Non-Parametric (NP) Confidence Interval

Compliance Limit is not exceeded. Per-well alpha = 0.01 except as noted. Normality Test: Shapiro Wilk, alpha based on n.

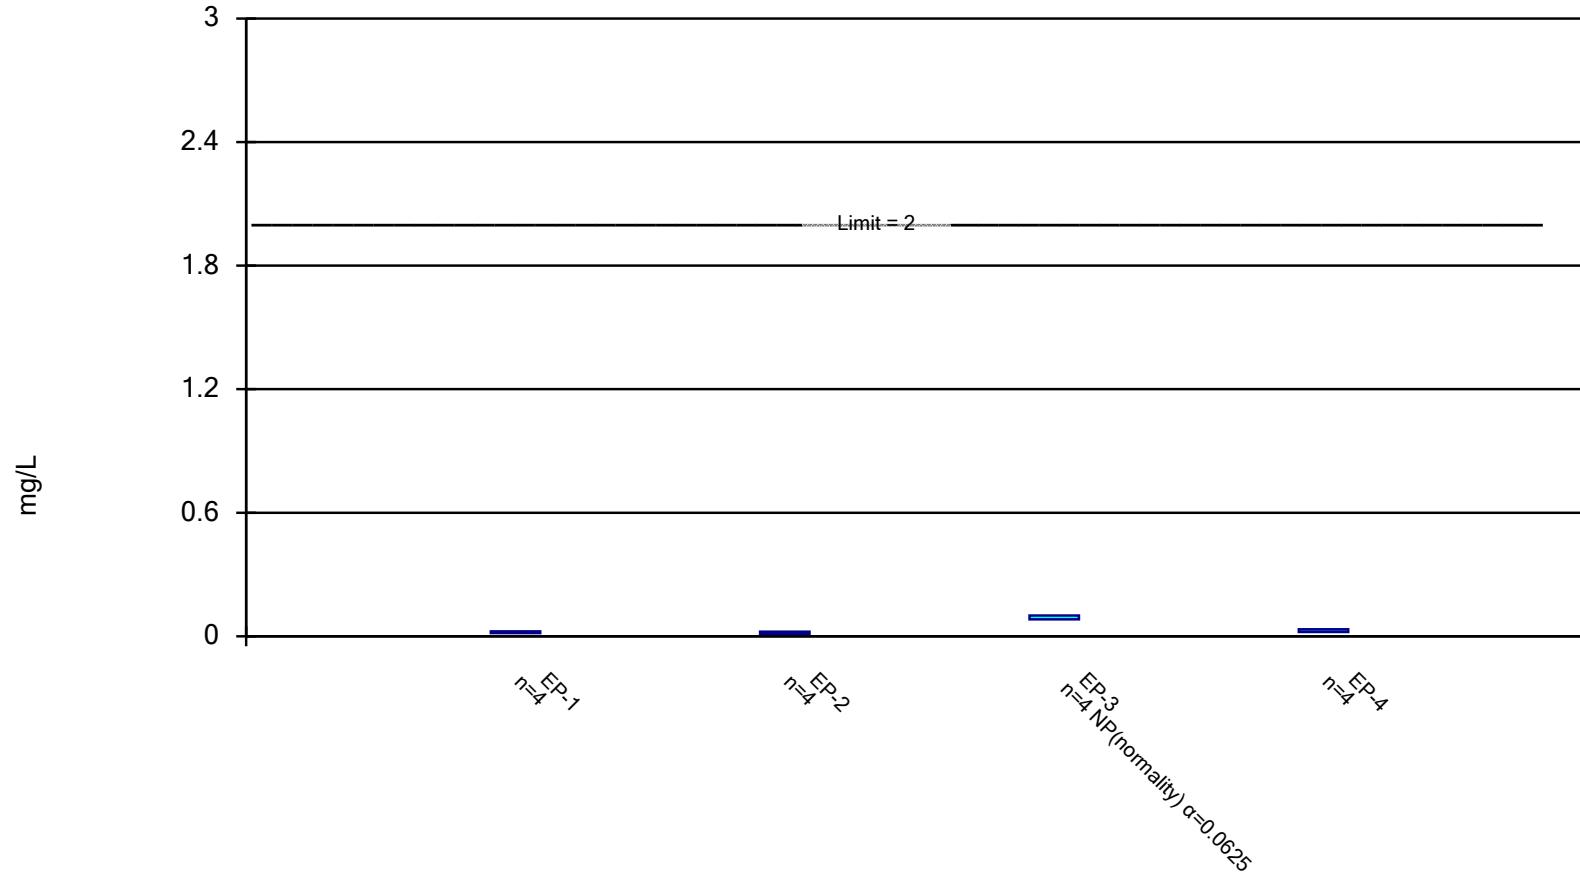


Constituent: Barium Analysis Run 5/6/2022 2:10 PM View: EPA SSLs

Marion Power Plant Client: SIPC Data: SIPC Statistical Database

## Parametric and Non-Parametric (NP) Confidence Interval

Compliance Limit is not exceeded. Per-well alpha = 0.01 except as noted. Normality Test: Shapiro Wilk, alpha based on n.

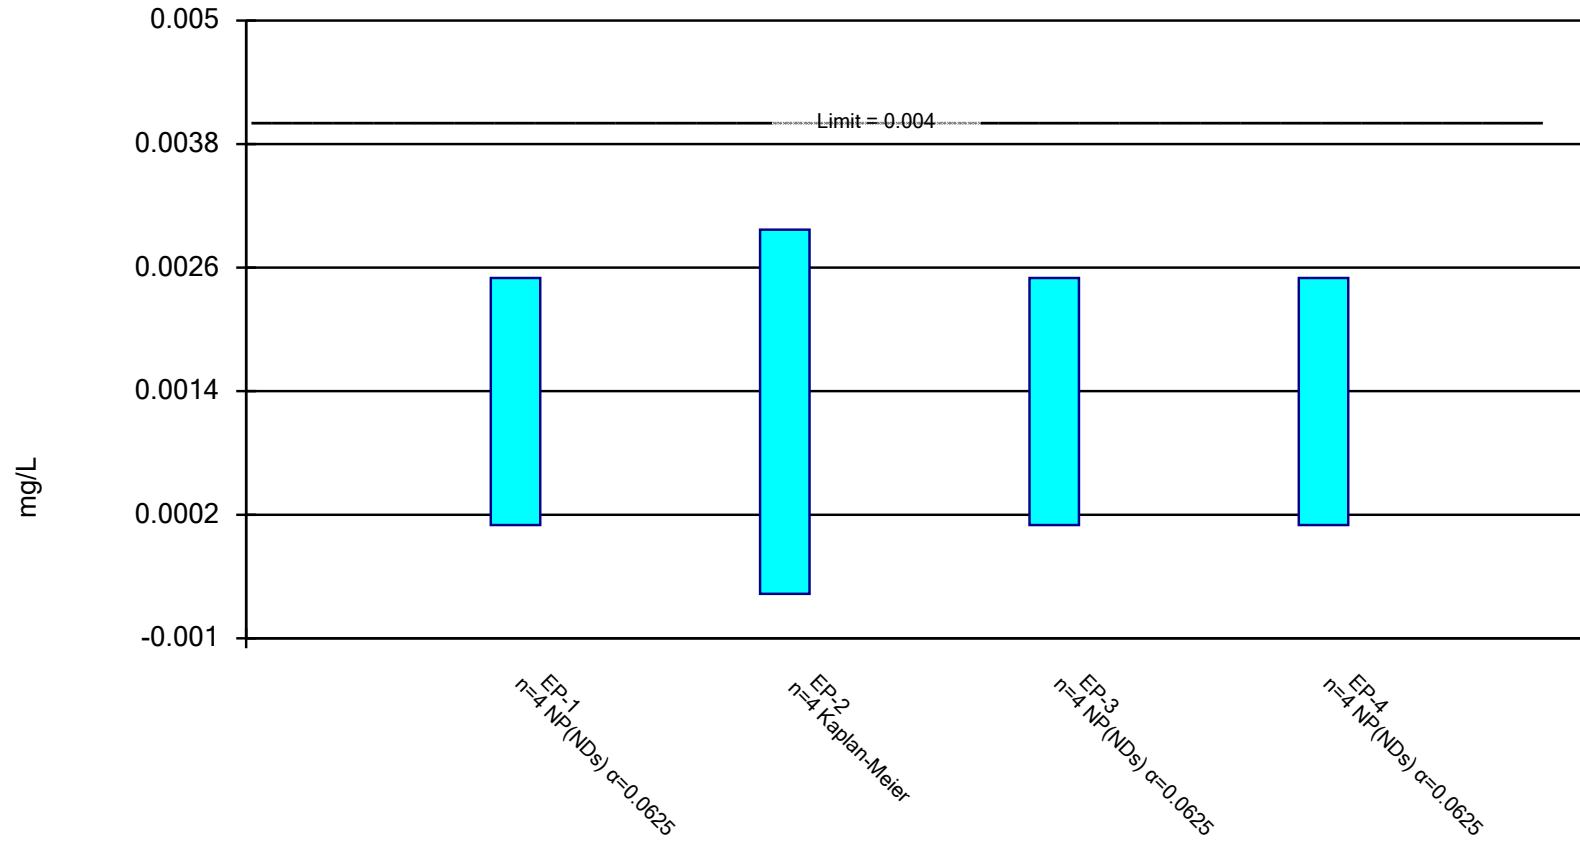


Constituent: Beryllium Analysis Run 5/6/2022 2:10 PM View: EPA SSLs

Marion Power Plant Client: SIPC Data: SIPC Statistical Database

## Parametric and Non-Parametric (NP) Confidence Interval

Compliance Limit is not exceeded. Per-well alpha = 0.01 except as noted. Normality Test: Shapiro Wilk, alpha based on n.

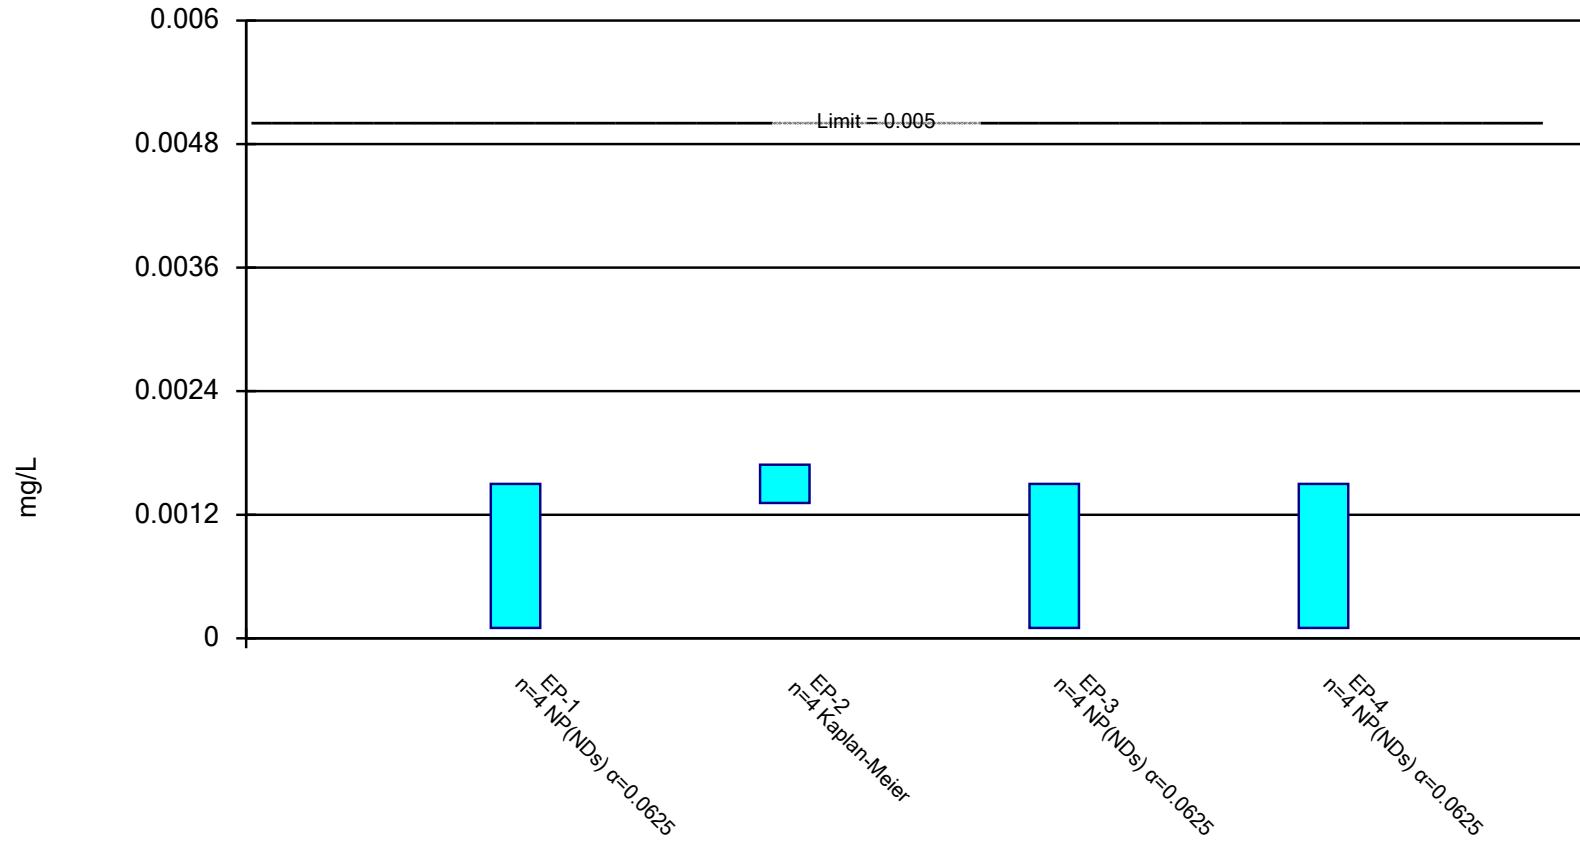


Constituent: Cadmium Analysis Run 5/6/2022 2:10 PM View: EPA SSLs

Marion Power Plant Client: SIPC Data: SIPC Statistical Database

## Non-Parametric Confidence Interval

Compliance Limit is not exceeded.

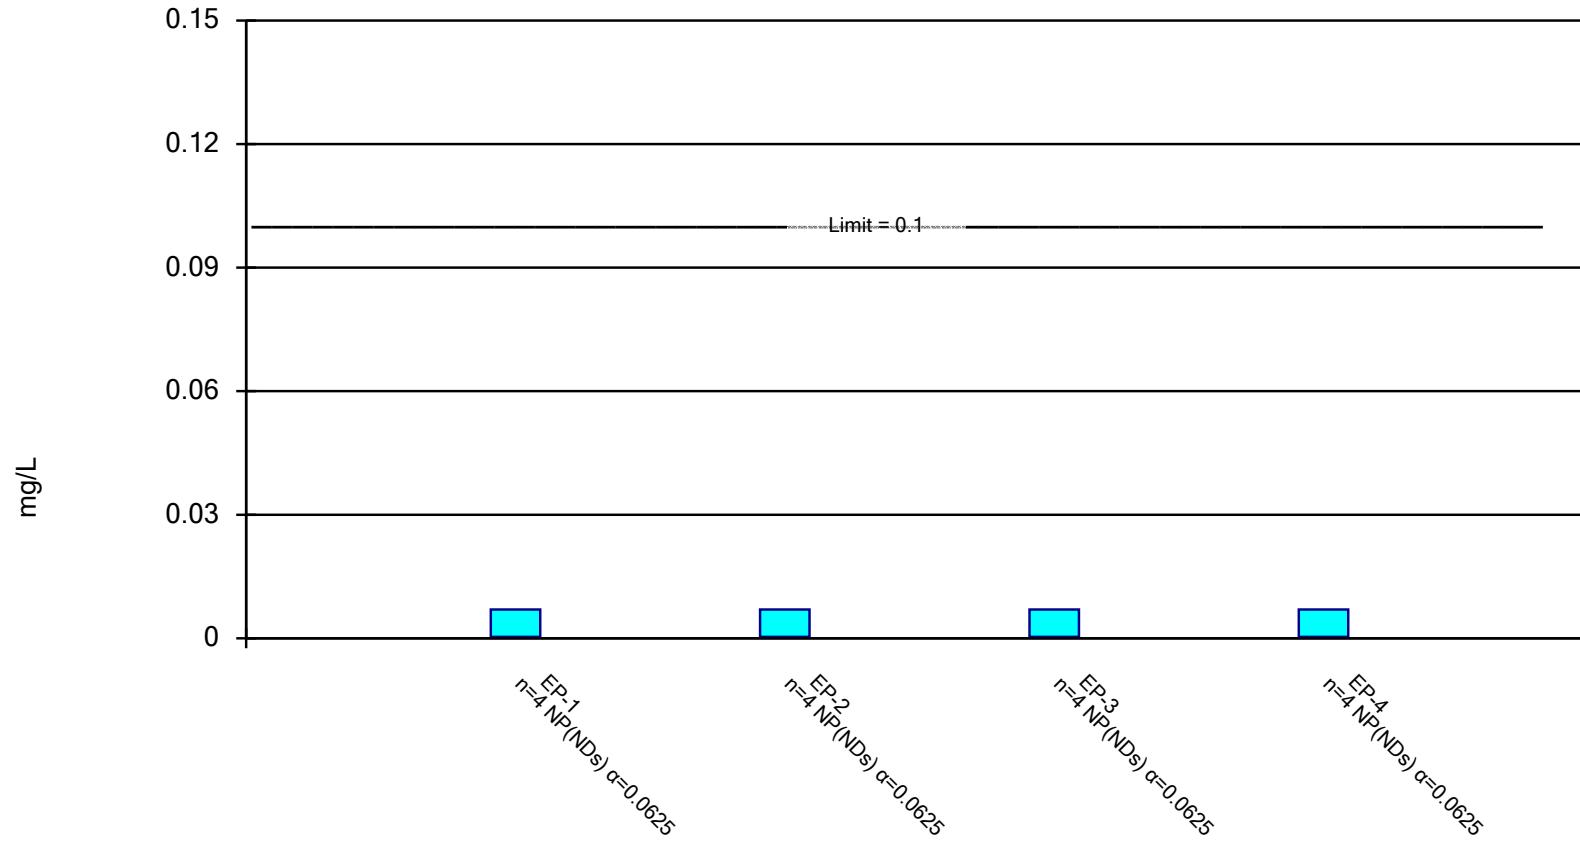


Constituent: Chromium Analysis Run 5/6/2022 2:10 PM View: EPA SSLs

Marion Power Plant Client: SIPC Data: SIPC Statistical Database

## Parametric and Non-Parametric (NP) Confidence Interval

Compliance limit is exceeded.\* Per-well alpha = 0.01 except as noted. Normality Test: Shapiro Wilk, alpha based on n.

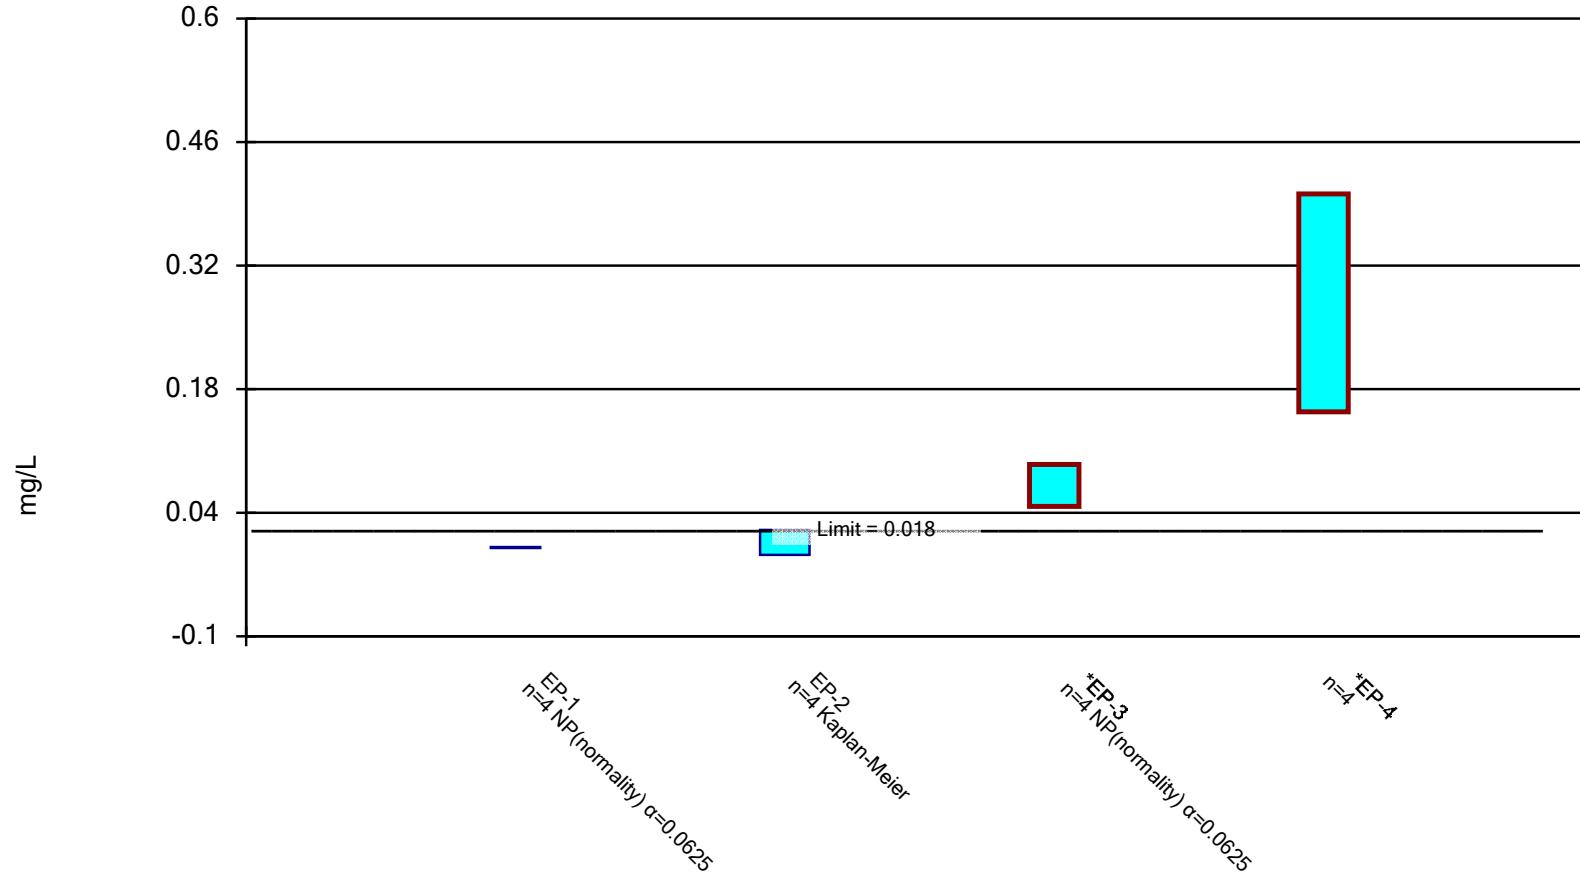


Constituent: Cobalt Analysis Run 5/6/2022 2:10 PM View: EPA SSLs

Marion Power Plant Client: SIPC Data: SIPC Statistical Database

## Parametric Confidence Interval

Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

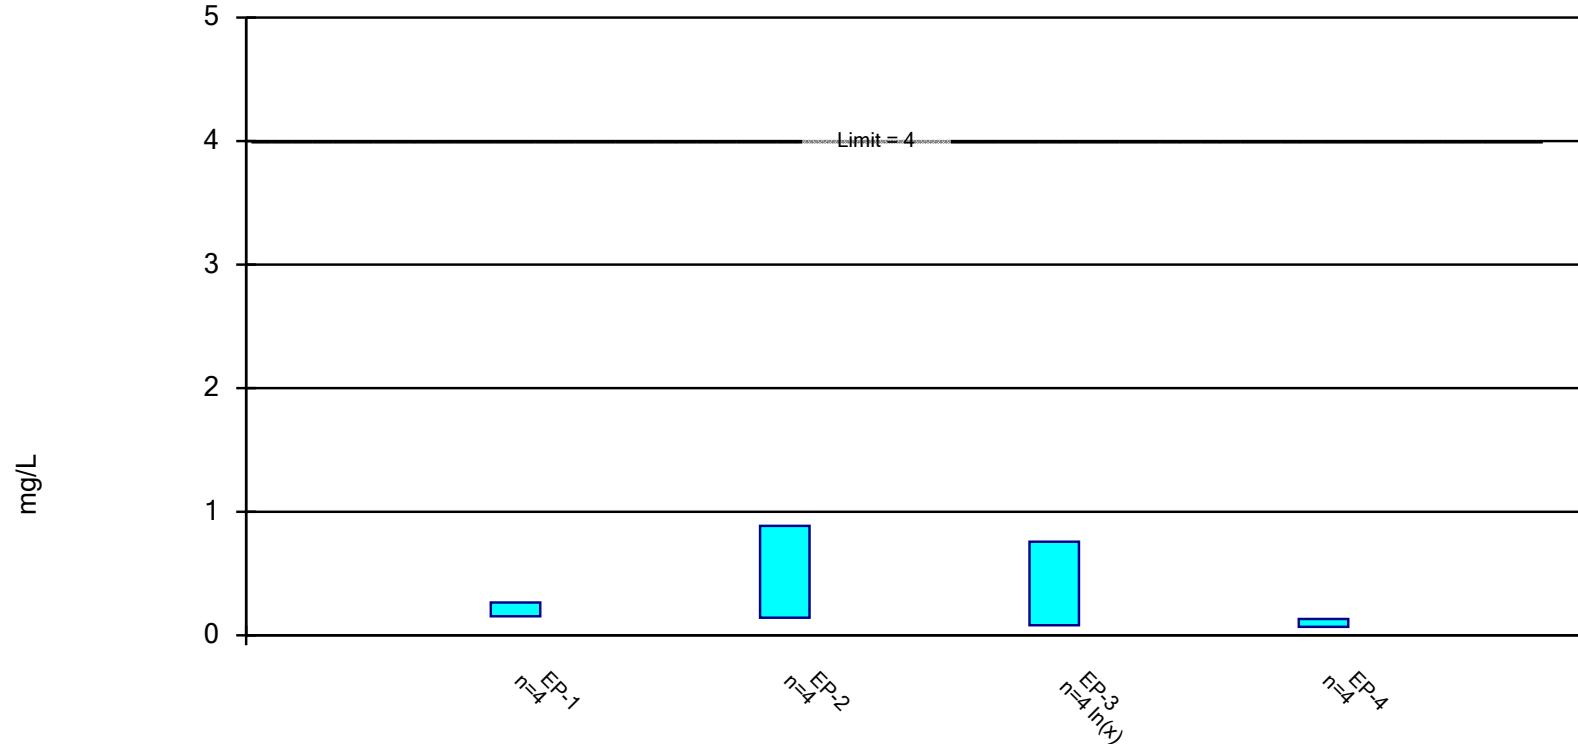


Constituent: Fluoride Analysis Run 5/6/2022 2:10 PM View: EPA SSLs

Marion Power Plant Client: SIPC Data: SIPC Statistical Database

## Parametric and Non-Parametric (NP) Confidence Interval

Compliance Limit is not exceeded. Per-well alpha = 0.01 except as noted. Normality Test: Shapiro Wilk, alpha based on n.

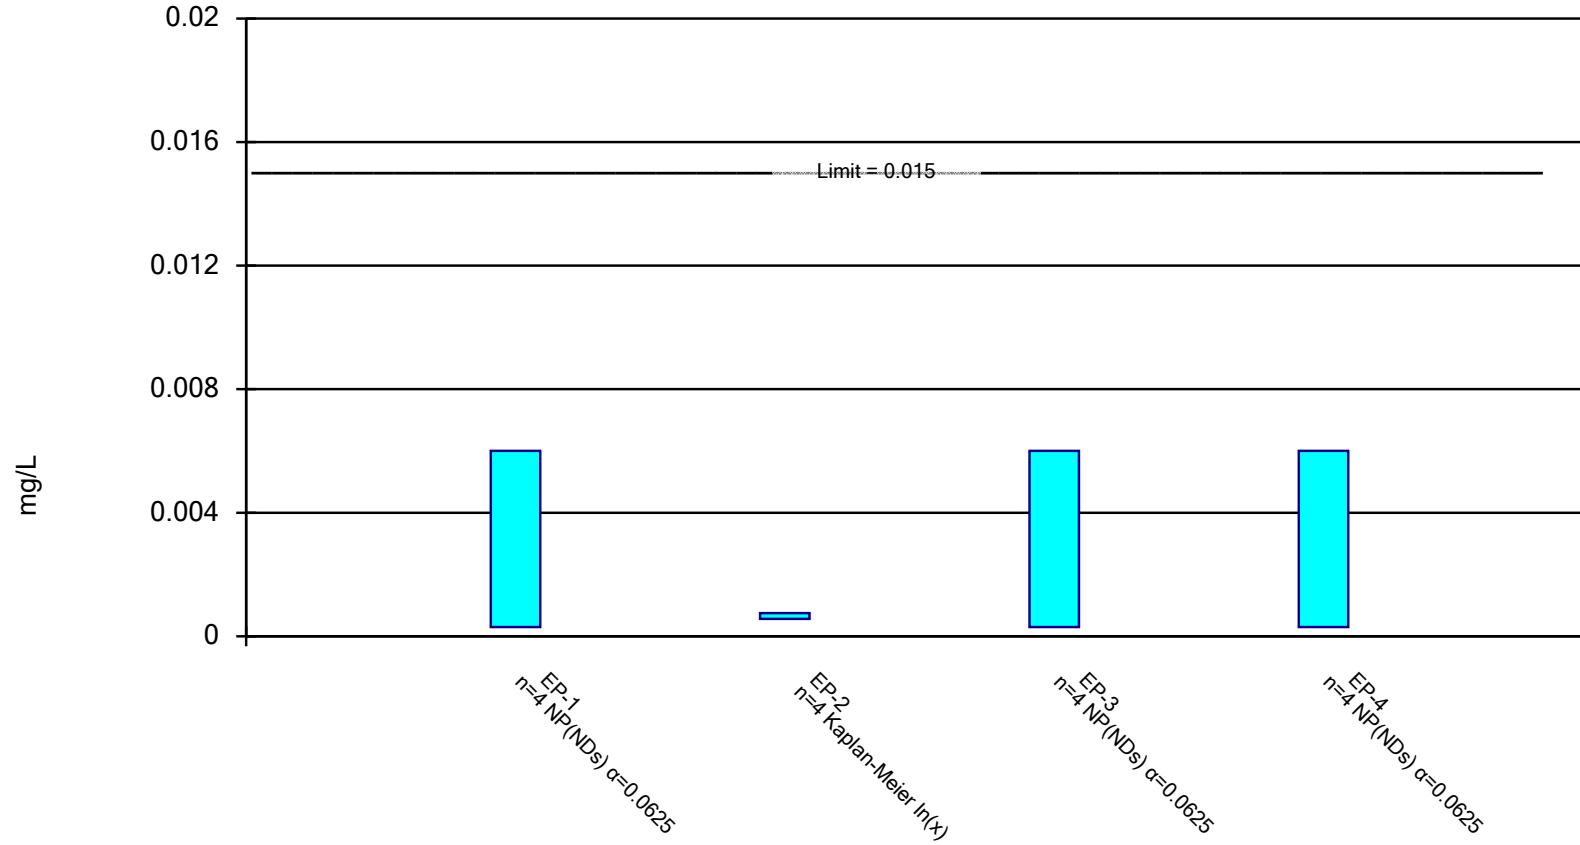


Constituent: Lead Analysis Run 5/6/2022 2:10 PM View: EPA SSLs

Marion Power Plant Client: SIPC Data: SIPC Statistical Database

## Parametric Confidence Interval

Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

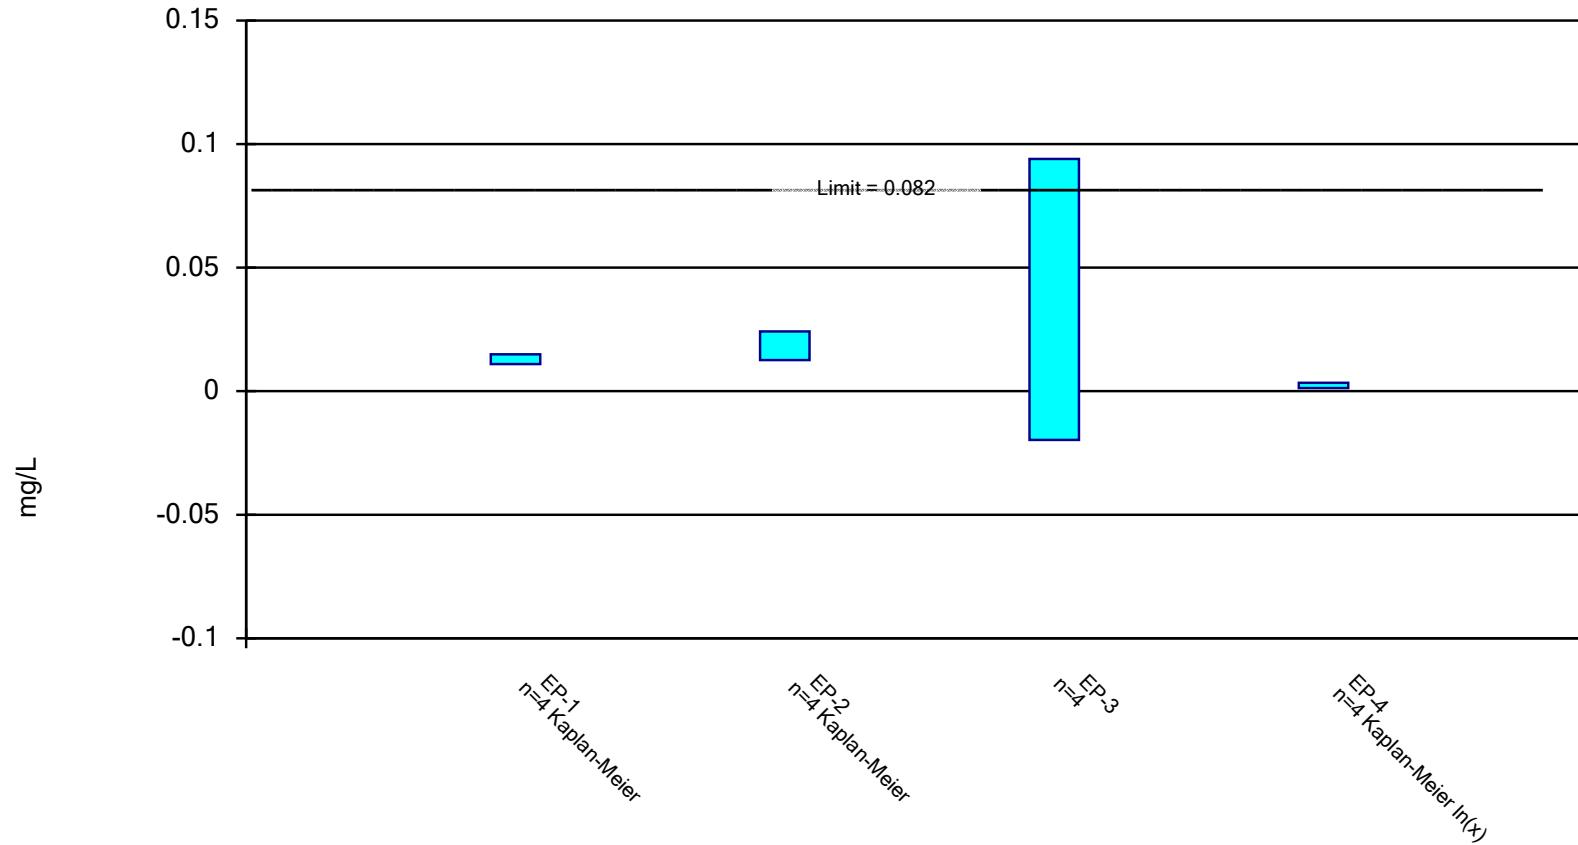


Constituent: Lithium Analysis Run 5/6/2022 2:10 PM View: EPA SSLs

Marion Power Plant Client: SIPC Data: SIPC Statistical Database

## Parametric and Non-Parametric (NP) Confidence Interval

Compliance Limit is not exceeded. Per-well alpha = 0.01 except as noted. Normality Test: Shapiro Wilk, alpha based on n.

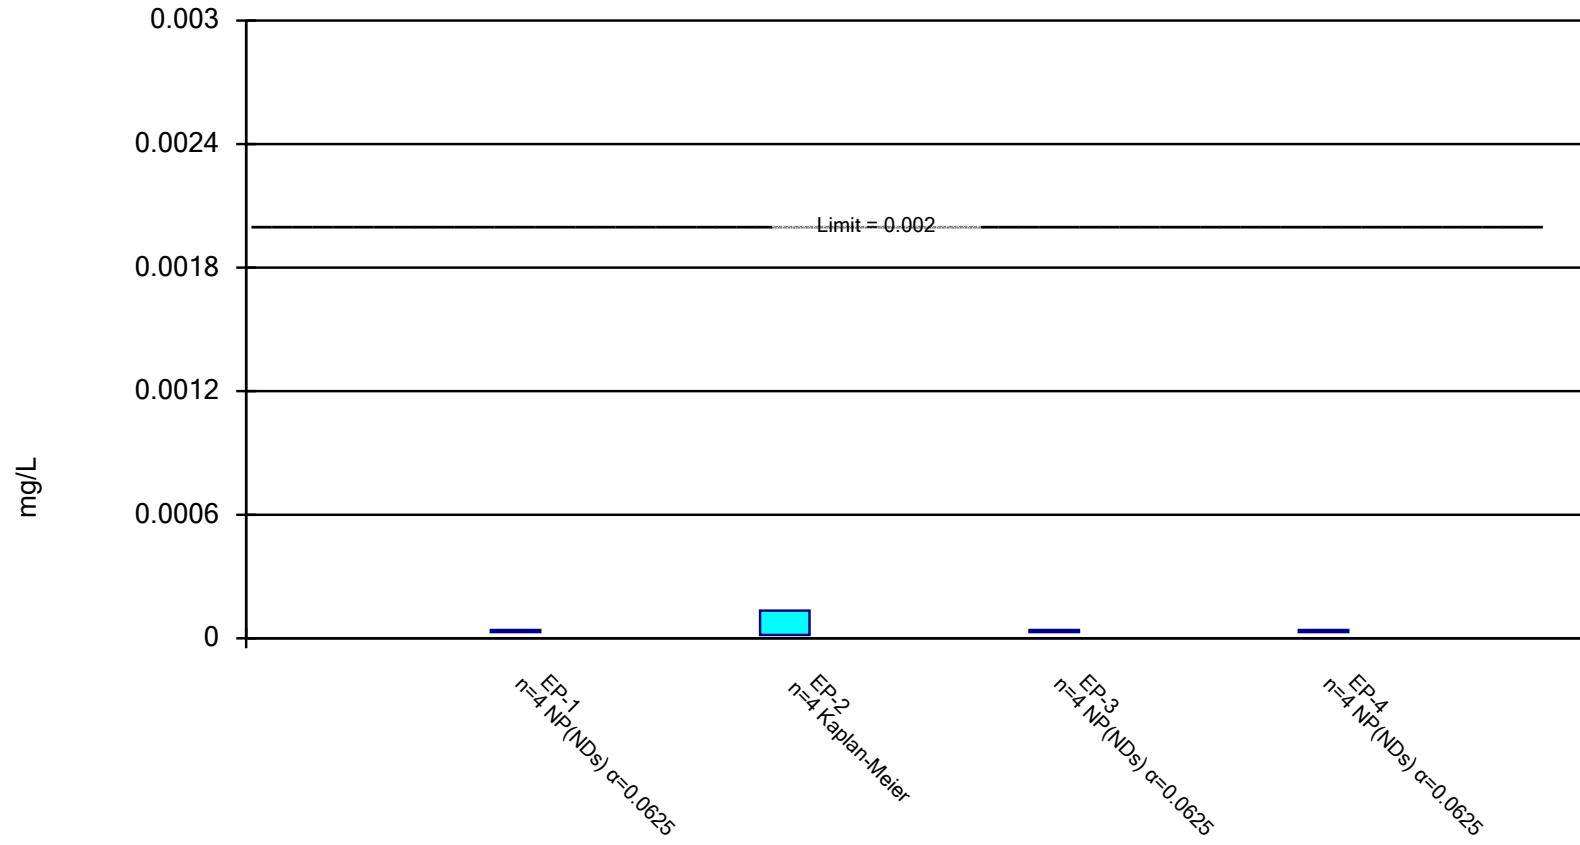


Constituent: Mercury Analysis Run 5/6/2022 2:10 PM View: EPA SSLs

Marion Power Plant Client: SIPC Data: SIPC Statistical Database

## Non-Parametric Confidence Interval

Compliance Limit is not exceeded.

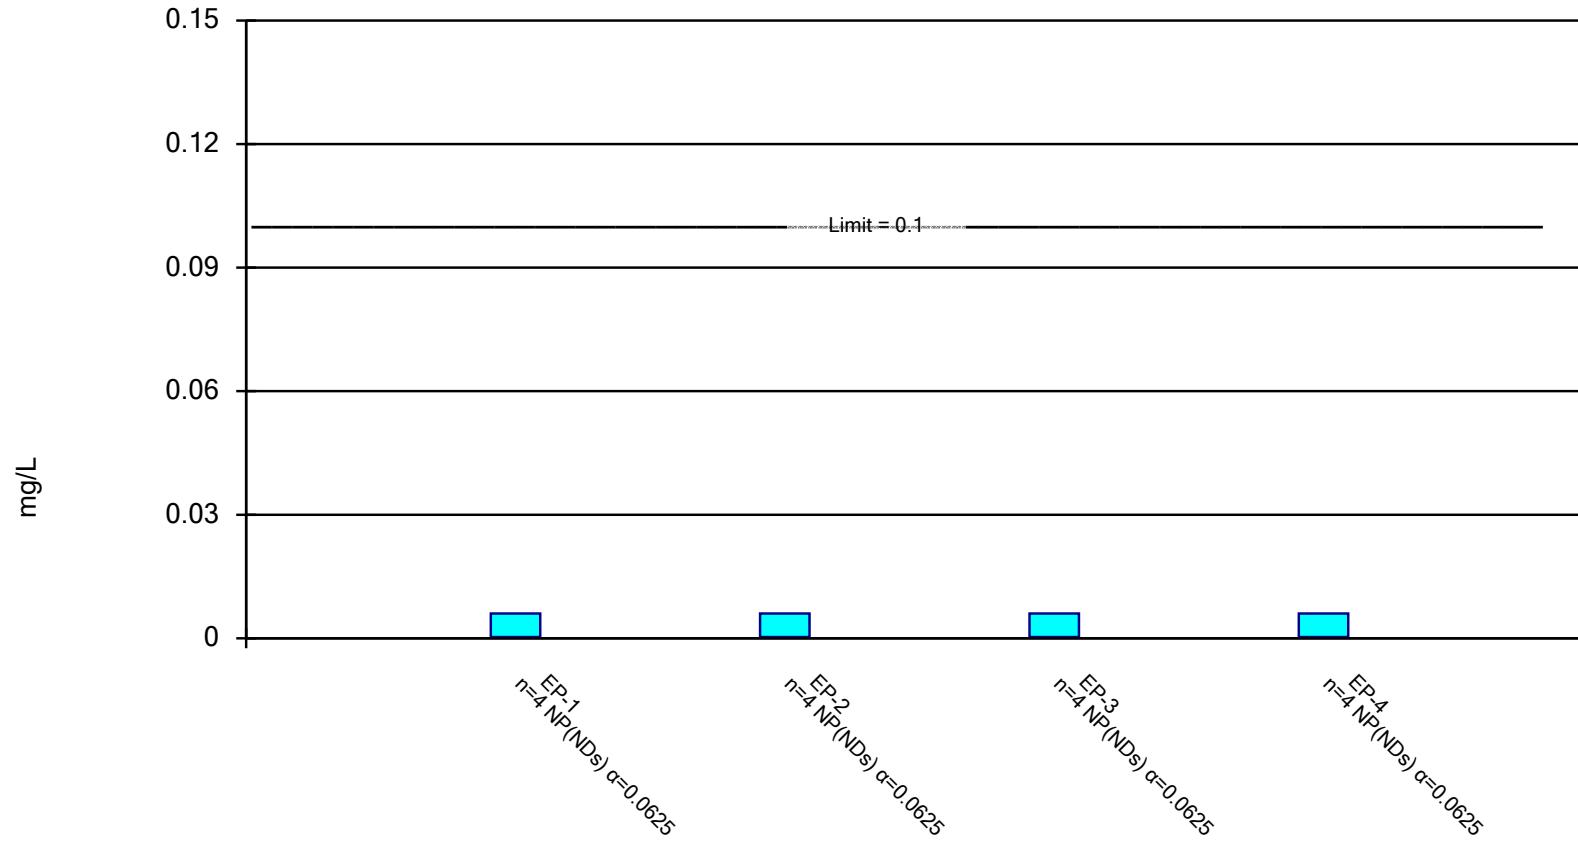


Constituent: Molybdenum Analysis Run 5/6/2022 2:10 PM View: EPA SSLs

Marion Power Plant Client: SIPC Data: SIPC Statistical Database

## Non-Parametric Confidence Interval

Compliance Limit is not exceeded.

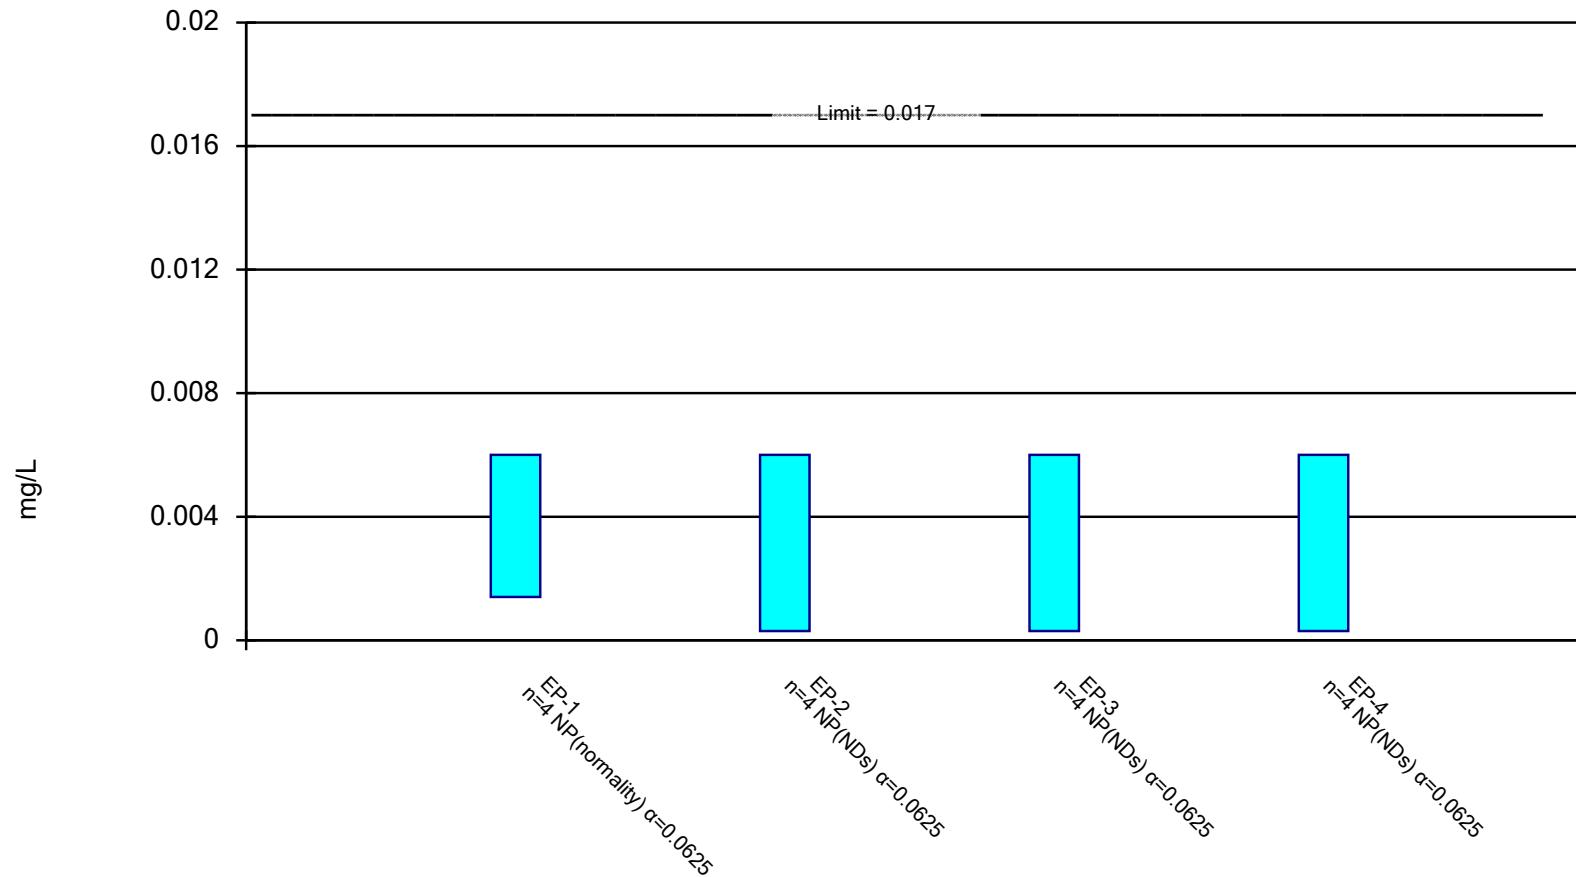


Constituent: Selenium Analysis Run 5/6/2022 2:10 PM View: EPA SSLs

Marion Power Plant Client: SIPC Data: SIPC Statistical Database

## Parametric and Non-Parametric (NP) Confidence Interval

Compliance Limit is not exceeded. Per-well alpha = 0.01 except as noted. Normality Test: Shapiro Wilk, alpha based on n.

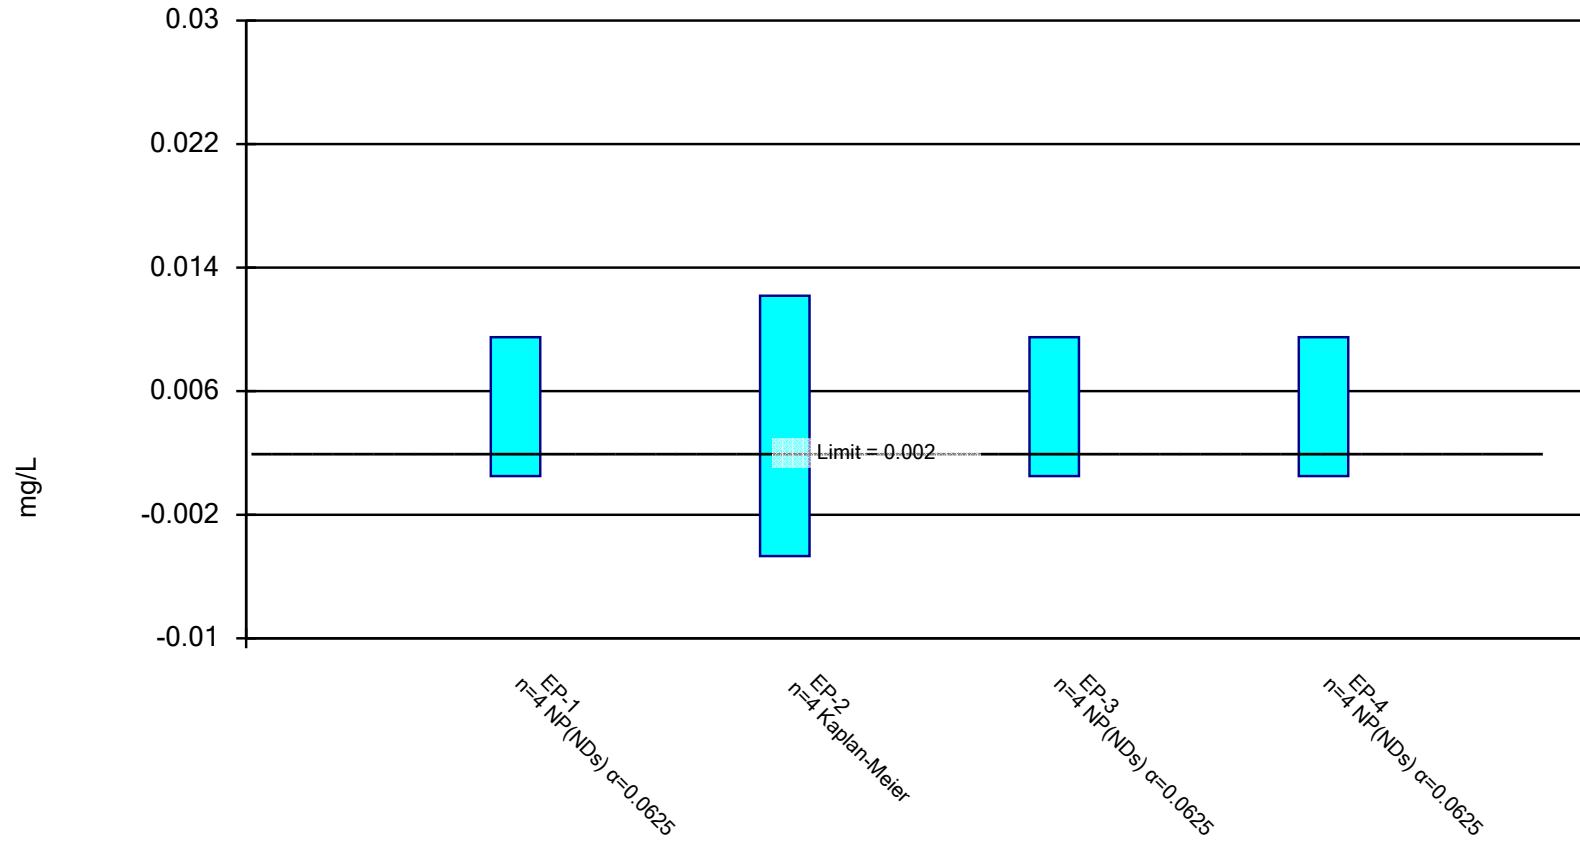


Constituent: Thallium Analysis Run 5/6/2022 2:10 PM View: EPA SSLs

Marion Power Plant Client: SIPC Data: SIPC Statistical Database

## Non-Parametric Confidence Interval

Compliance Limit is not exceeded.

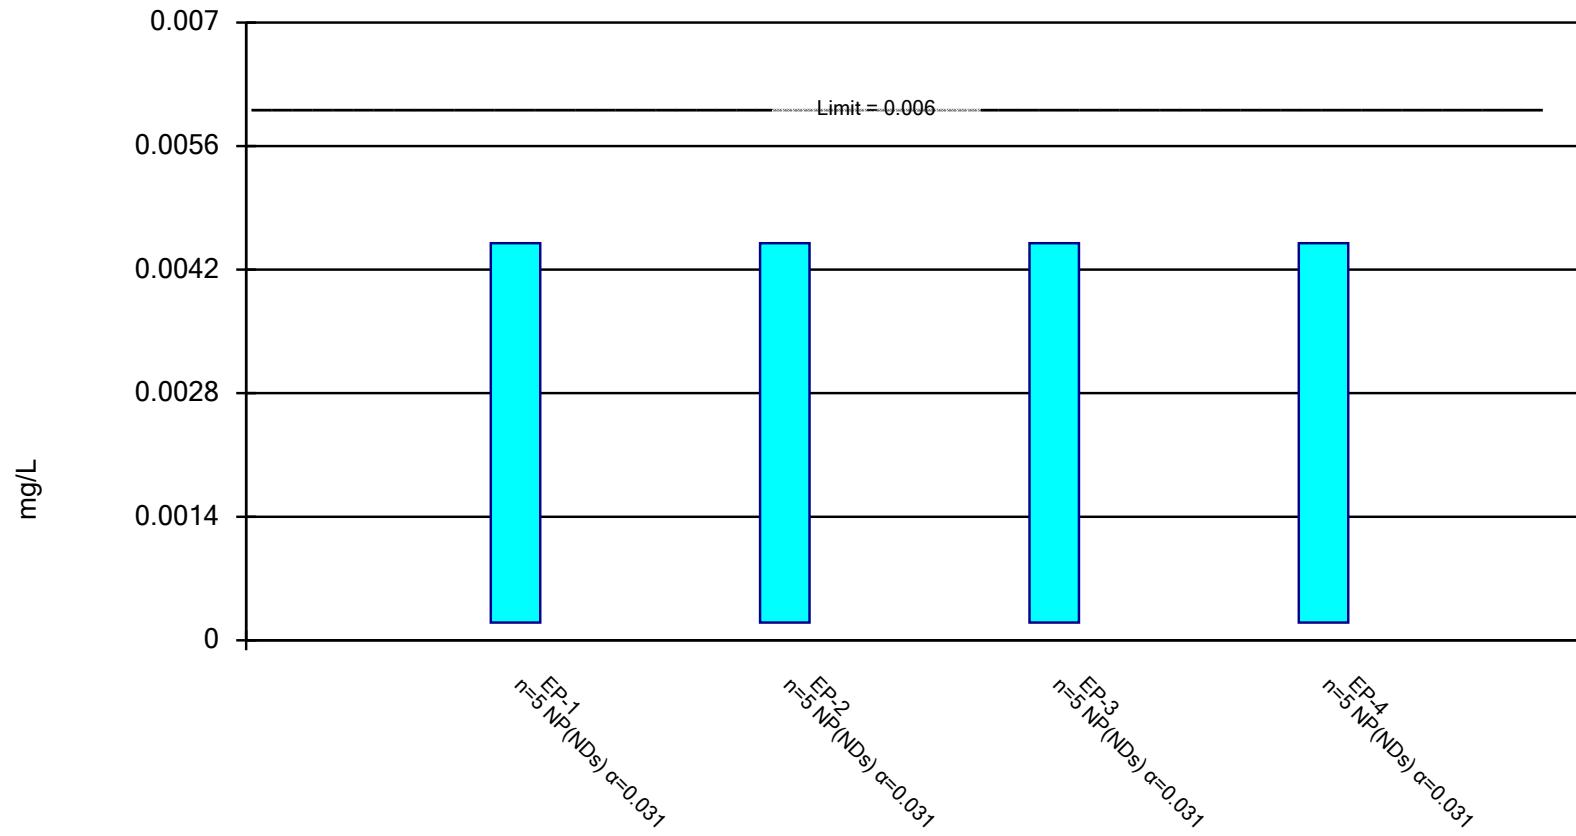


Constituent: Antimony Analysis Run 7/19/2022 11:09 AM View: EPA SSLs

Marion Power Plant Client: SIPC Data: SIPC Statistical Database

## Parametric and Non-Parametric (NP) Confidence Interval

Compliance Limit is not exceeded. Per-well alpha = 0.01 except as noted. Normality Test: Shapiro Wilk, alpha based on n.

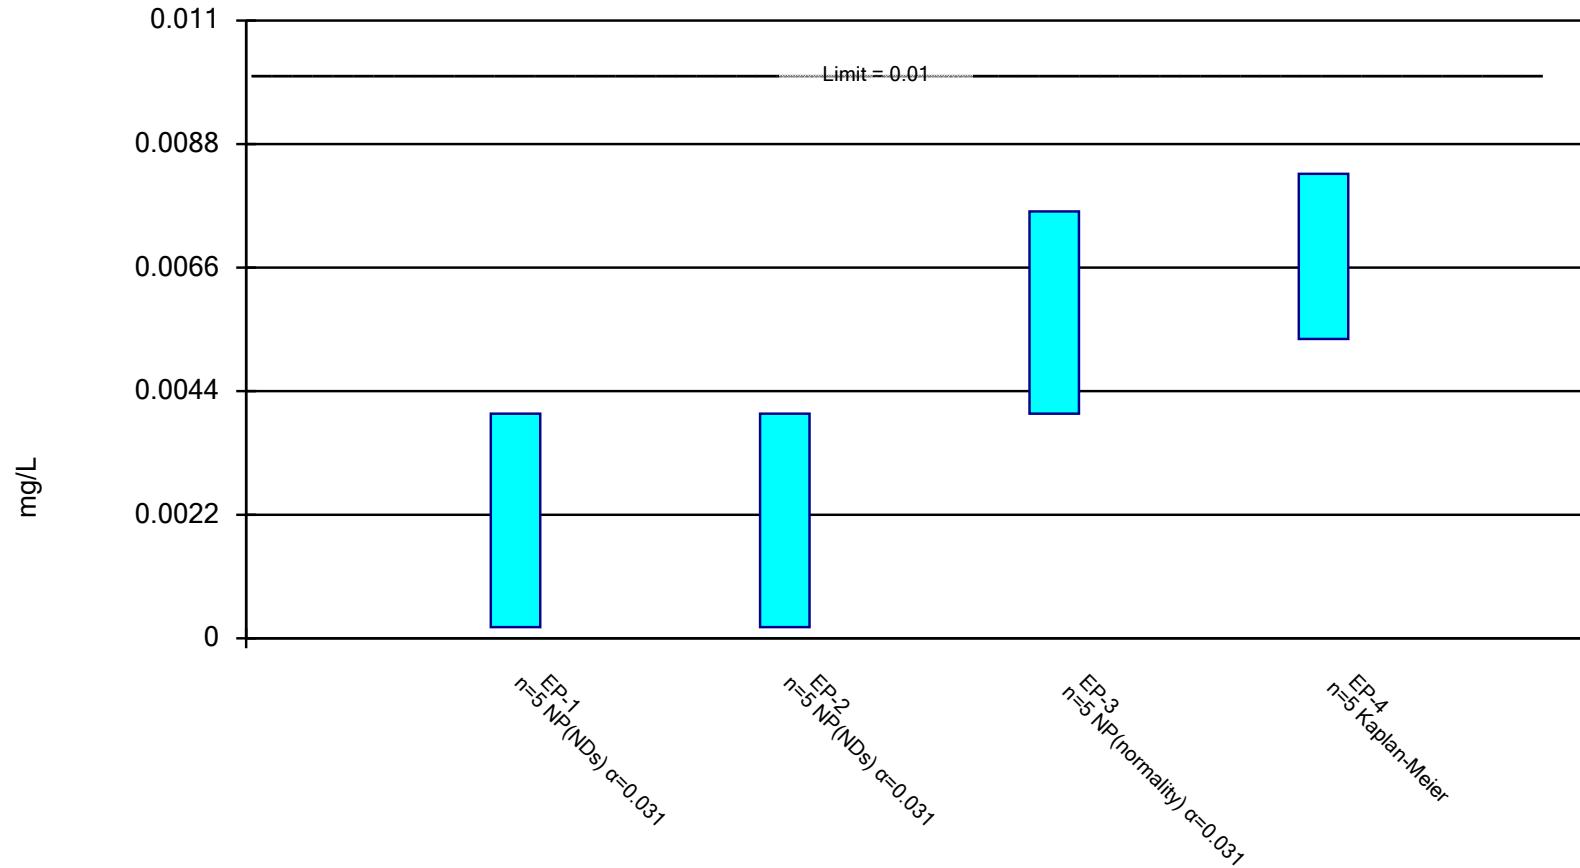


Constituent: Arsenic Analysis Run 7/19/2022 11:09 AM View: EPA SSLs

Marion Power Plant Client: SIPC Data: SIPC Statistical Database

## Parametric and Non-Parametric (NP) Confidence Interval

Compliance Limit is not exceeded. Per-well alpha = 0.01 except as noted. Normality Test: Shapiro Wilk, alpha based on n.

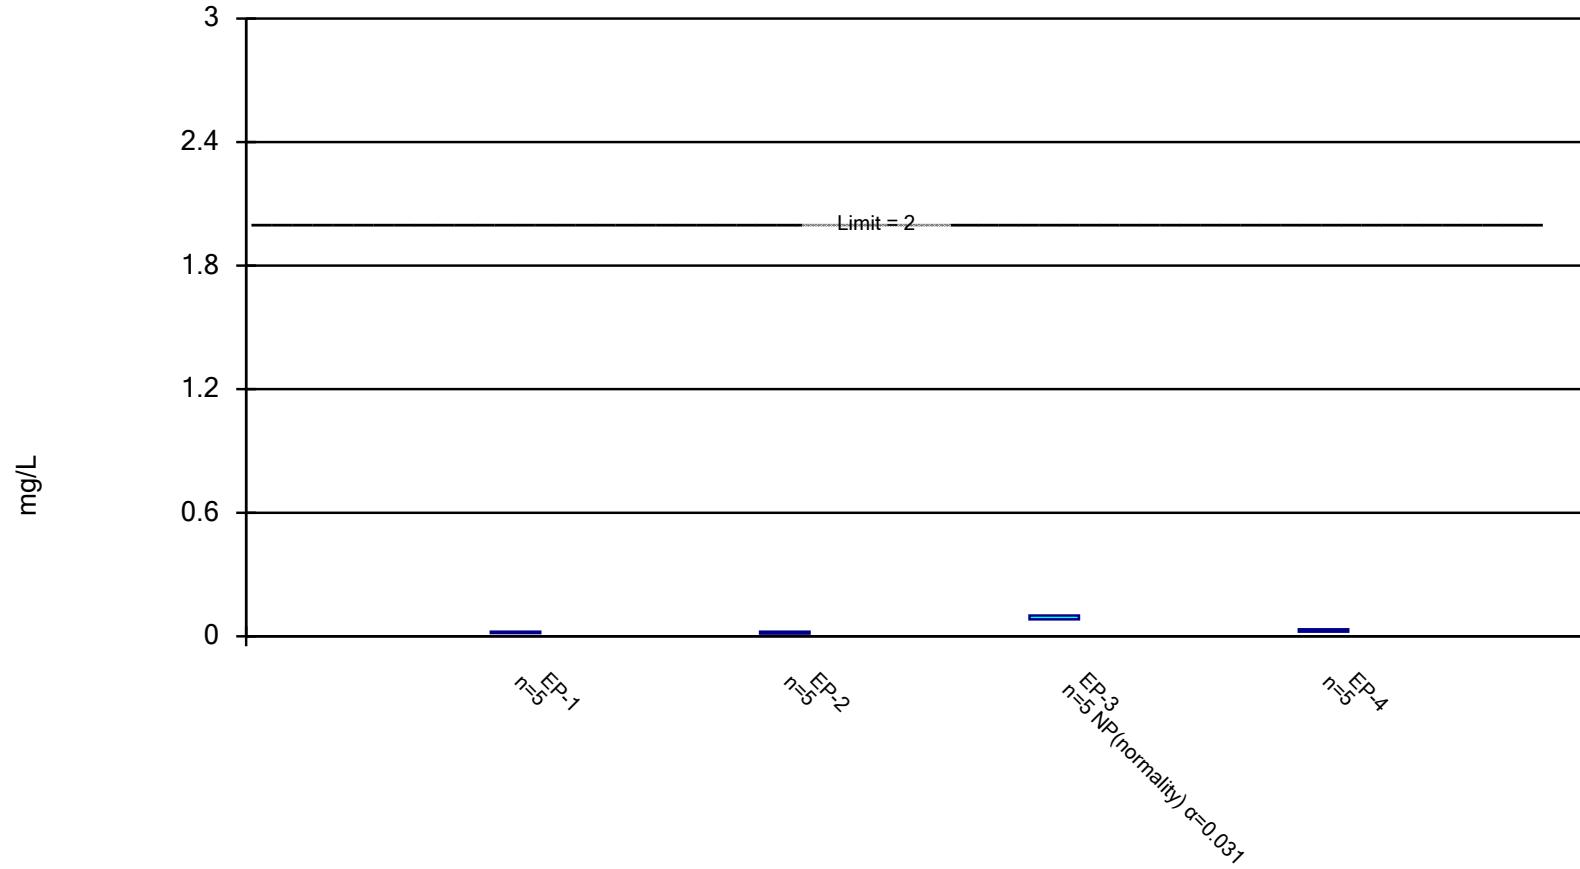


Constituent: Barium Analysis Run 7/19/2022 11:09 AM View: EPA SSLs

Marion Power Plant Client: SIPC Data: SIPC Statistical Database

## Parametric and Non-Parametric (NP) Confidence Interval

Compliance Limit is not exceeded. Per-well alpha = 0.01 except as noted. Normality Test: Shapiro Wilk, alpha based on n.

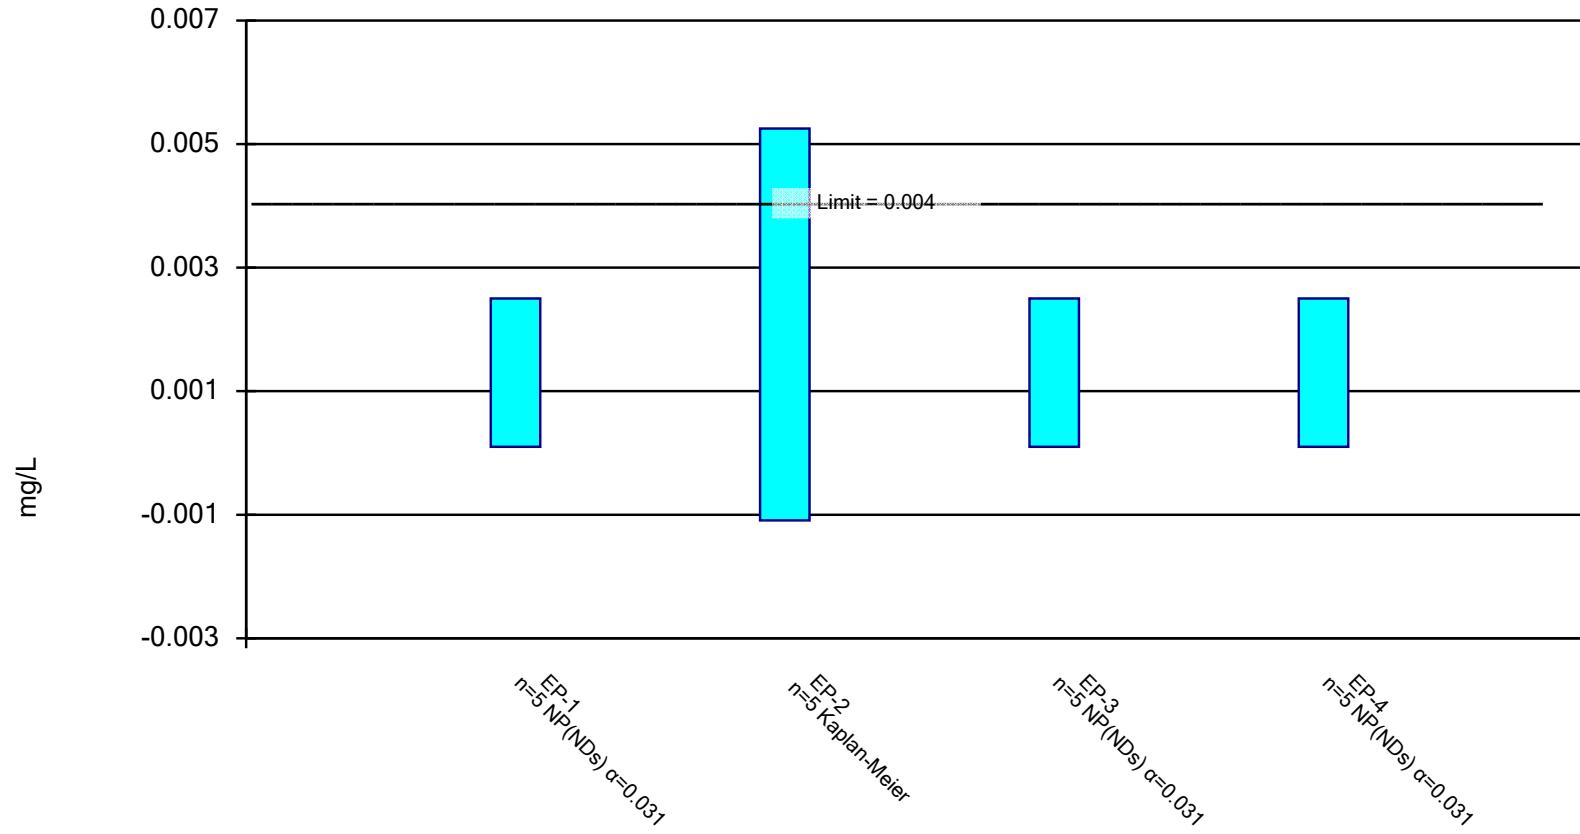


Constituent: Beryllium Analysis Run 7/19/2022 11:09 AM View: EPA SSLs

Marion Power Plant Client: SIPC Data: SIPC Statistical Database

## Non-Parametric Confidence Interval

Compliance Limit is not exceeded.

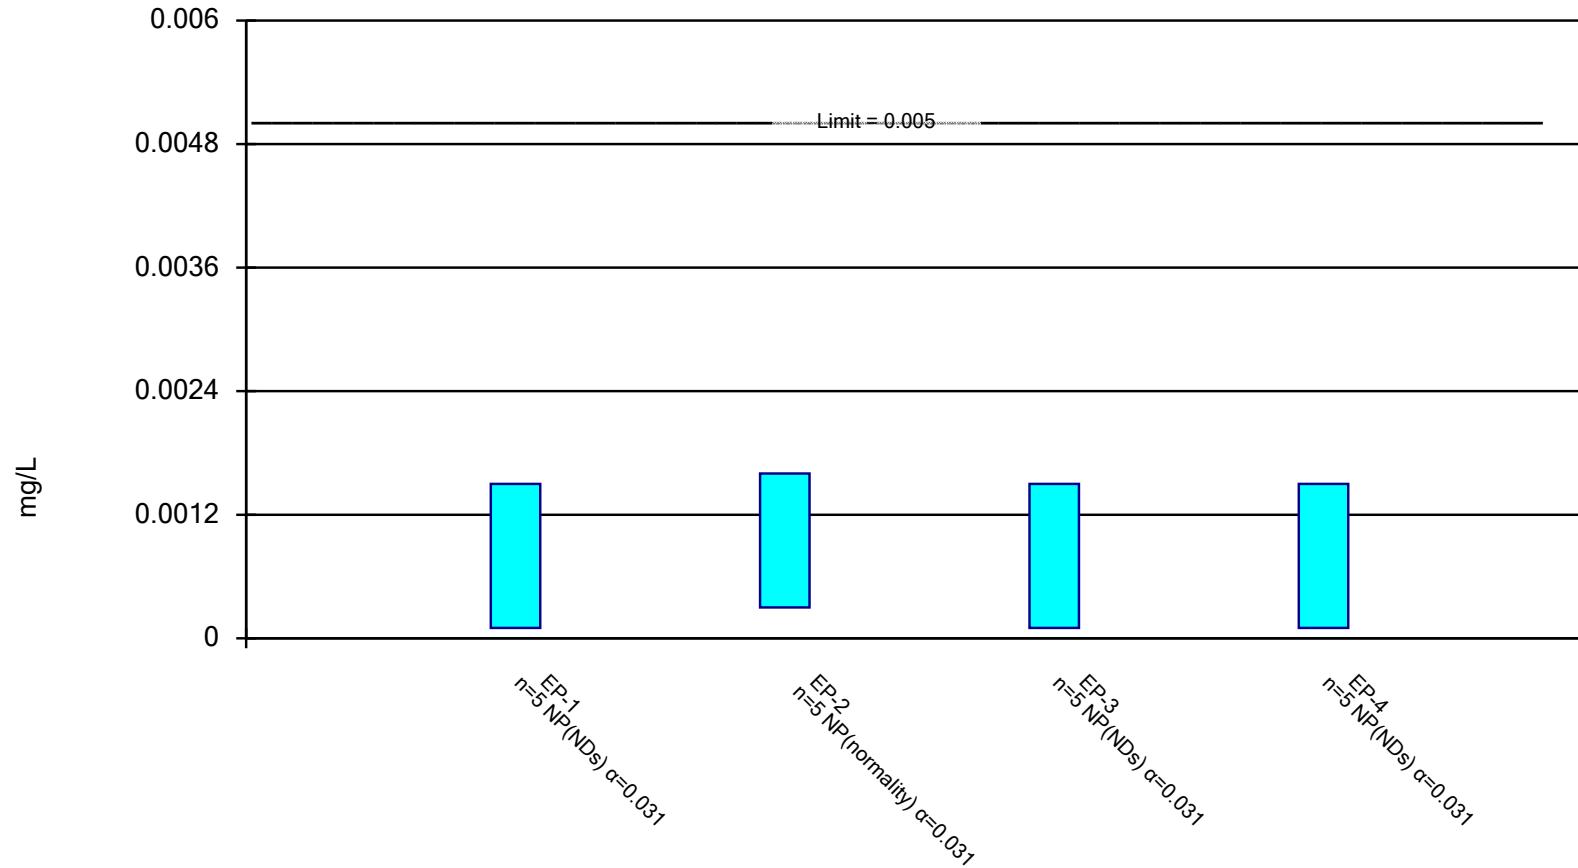


Constituent: Cadmium Analysis Run 7/19/2022 11:09 AM View: EPA SSLs

Marion Power Plant Client: SIPC Data: SIPC Statistical Database

## Non-Parametric Confidence Interval

Compliance Limit is not exceeded.

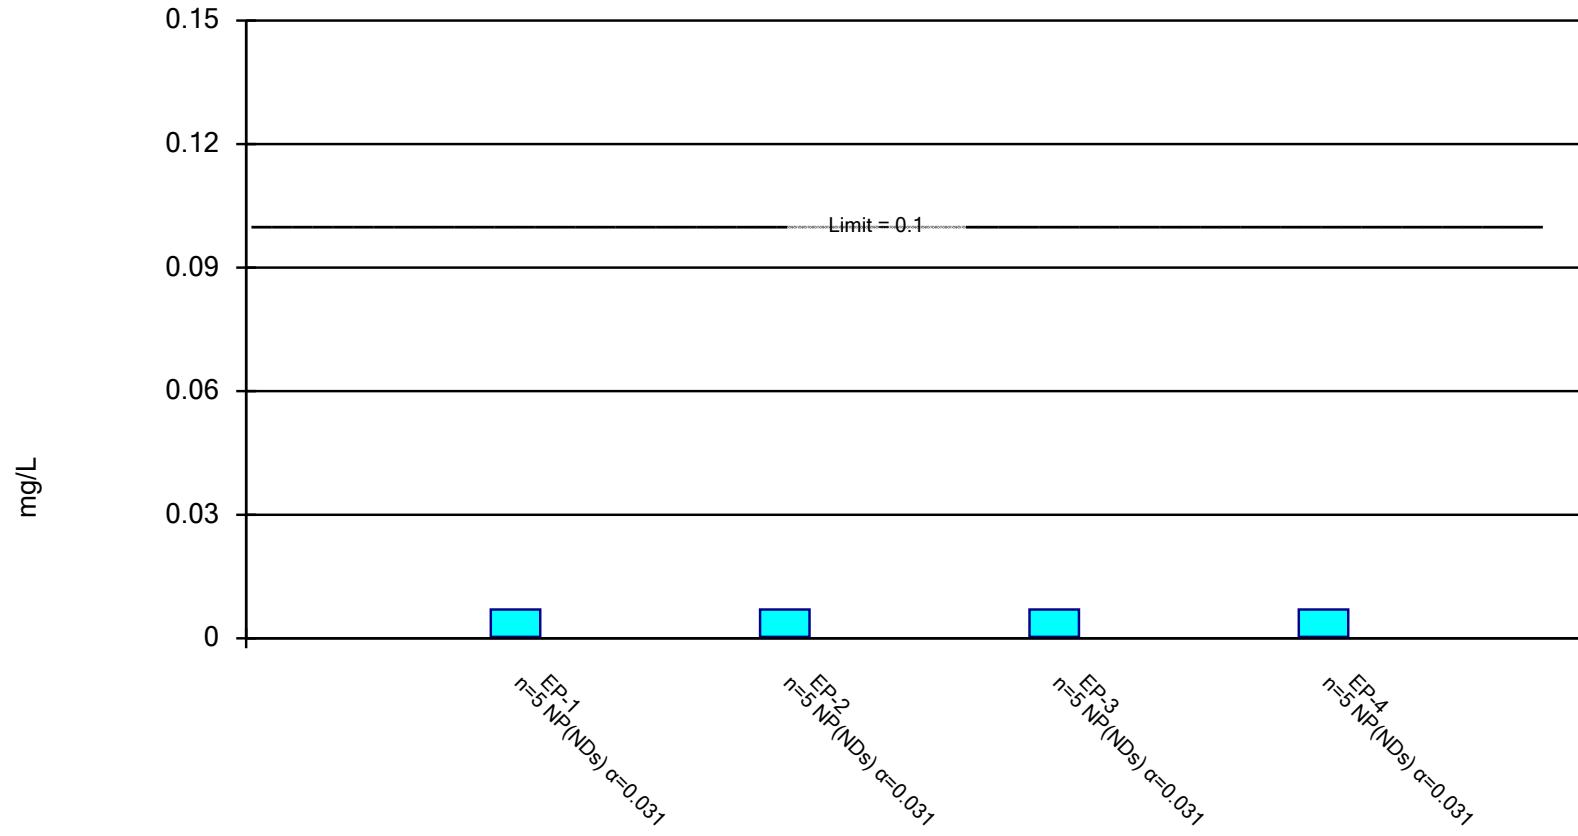


Constituent: Chromium Analysis Run 7/19/2022 11:09 AM View: EPA SSLs

Marion Power Plant Client: SIPC Data: SIPC Statistical Database

## Parametric Confidence Interval

Compliance limit is exceeded.\* Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

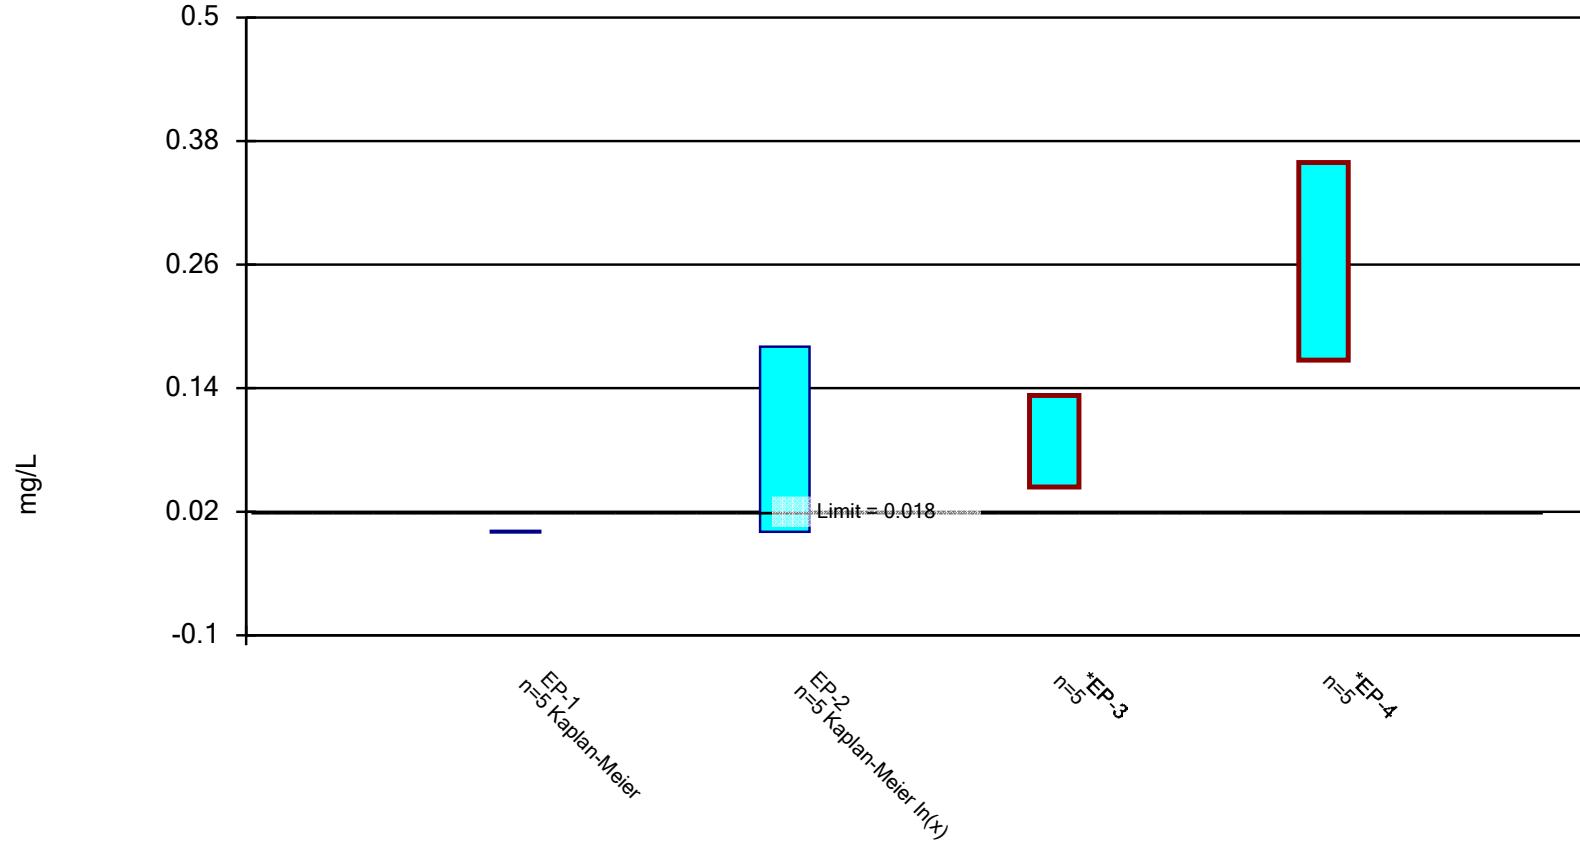


Constituent: Cobalt Analysis Run 7/19/2022 11:09 AM View: EPA SSLs

Marion Power Plant Client: SIPC Data: SIPC Statistical Database

## Parametric Confidence Interval

Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

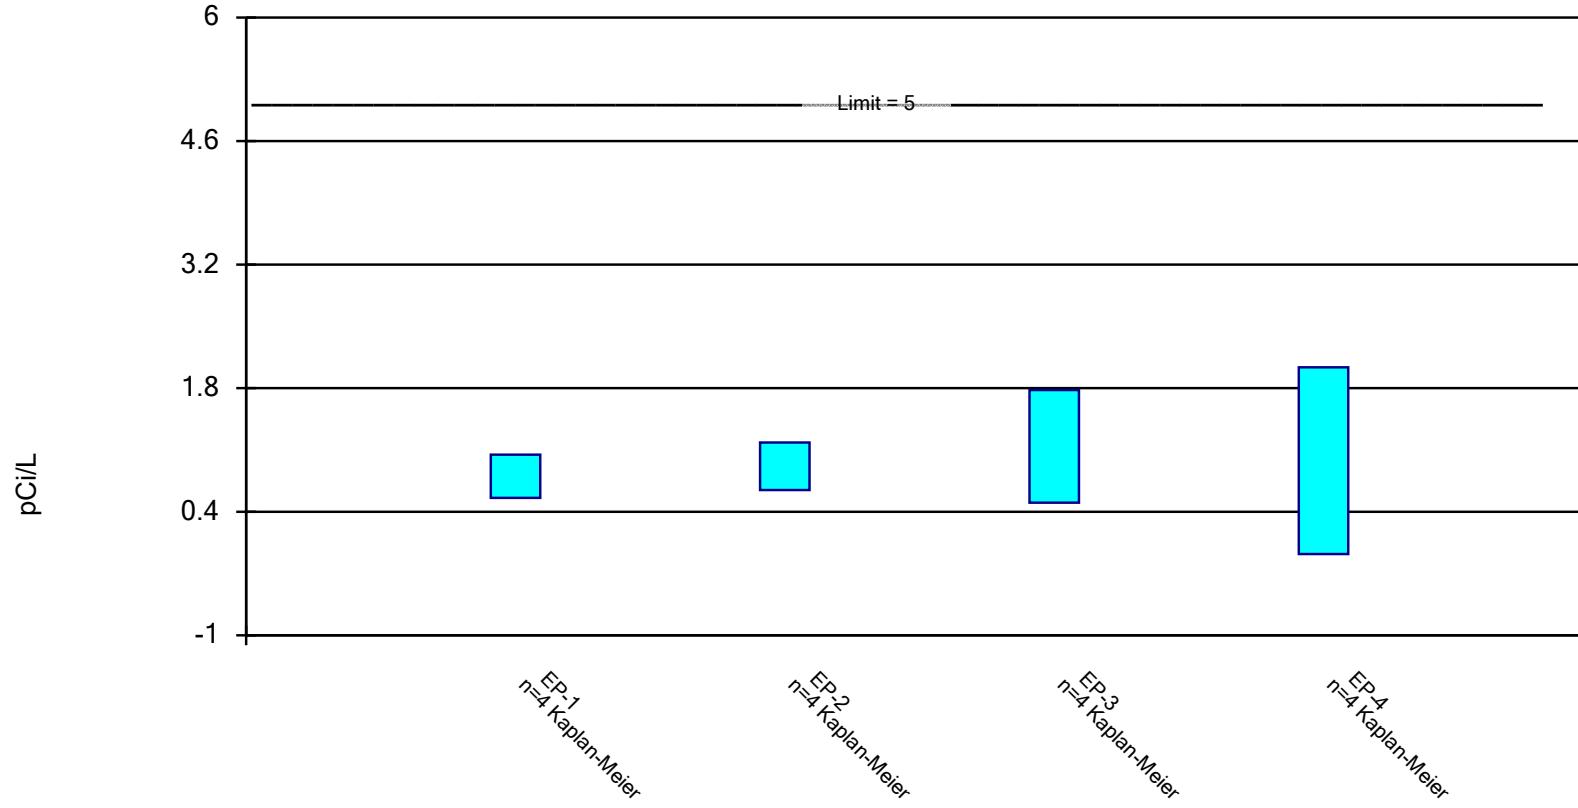


Constituent: Combined Radium Analysis Run 7/19/2022 11:09 AM View: EPA SSLs

Marion Power Plant Client: SIPC Data: SIPC Statistical Database

## Parametric and Non-Parametric (NP) Confidence Interval

Compliance Limit is not exceeded. Per-well alpha = 0.01 except as noted. Normality Test: Shapiro Wilk, alpha based on n.

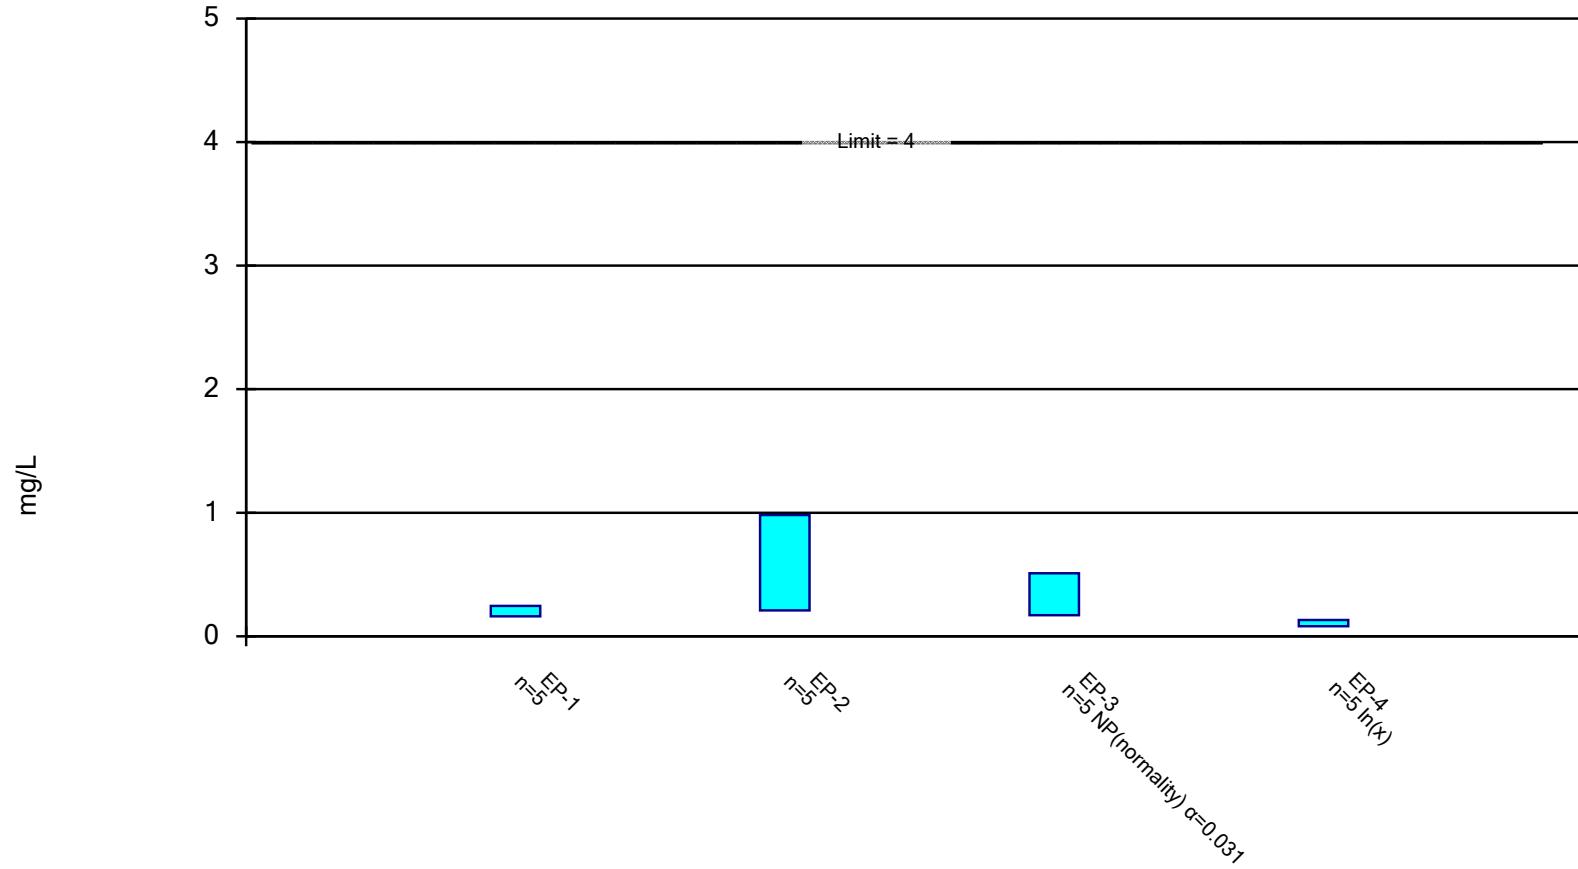


Constituent: Fluoride Analysis Run 7/19/2022 11:09 AM View: EPA SSLs

Marion Power Plant Client: SIPC Data: SIPC Statistical Database

## Non-Parametric Confidence Interval

Compliance Limit is not exceeded.

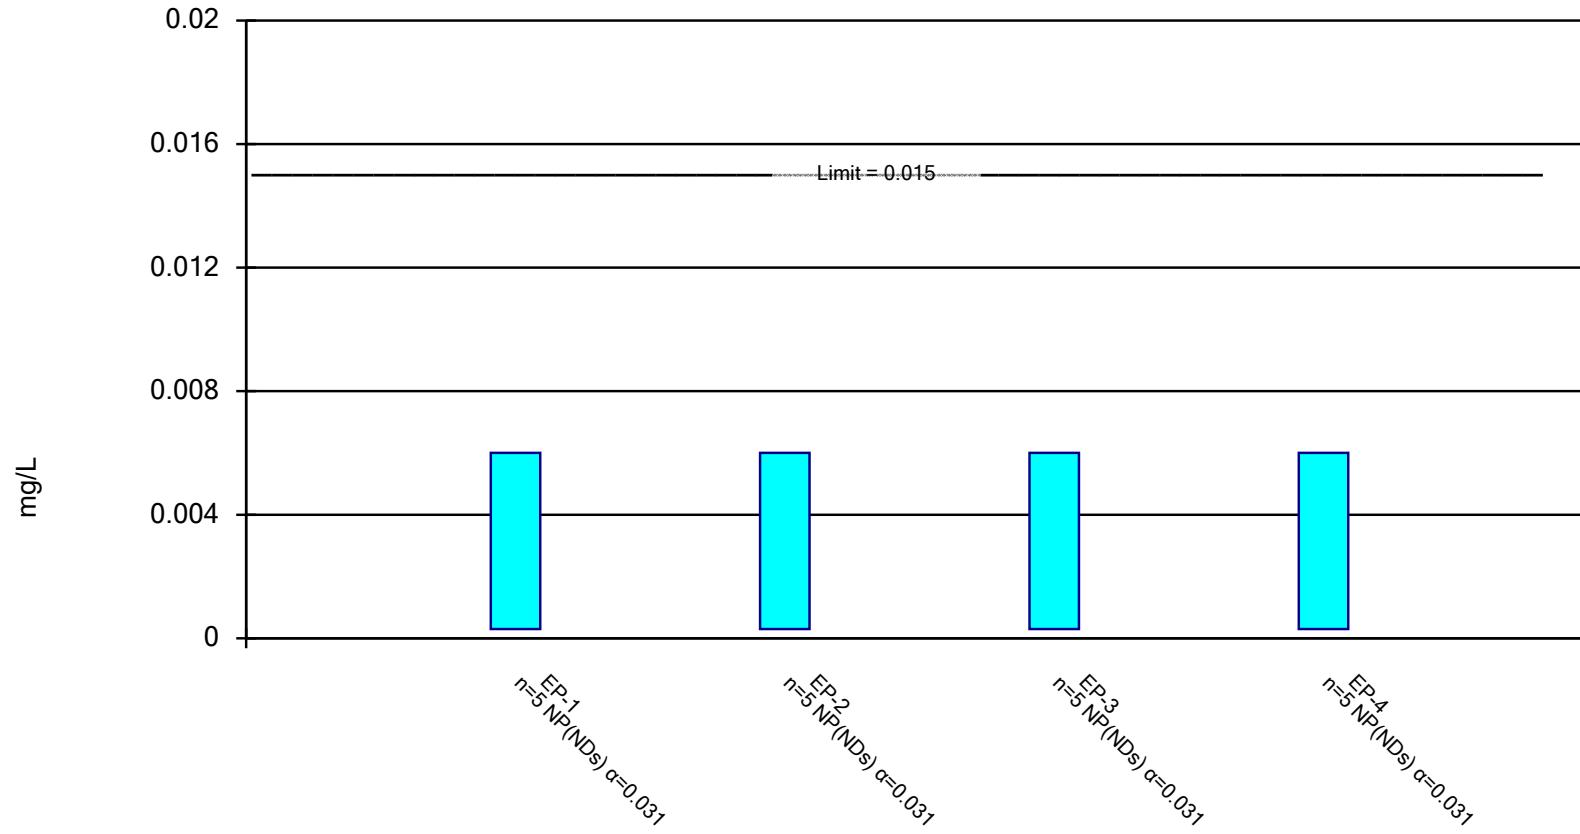


Constituent: Lead Analysis Run 7/19/2022 11:09 AM View: EPA SSLs

Marion Power Plant Client: SIPC Data: SIPC Statistical Database

## Parametric Confidence Interval

Compliance Limit is not exceeded. Per-well alpha = 0.01. Normality Test: Shapiro Wilk, alpha based on n.

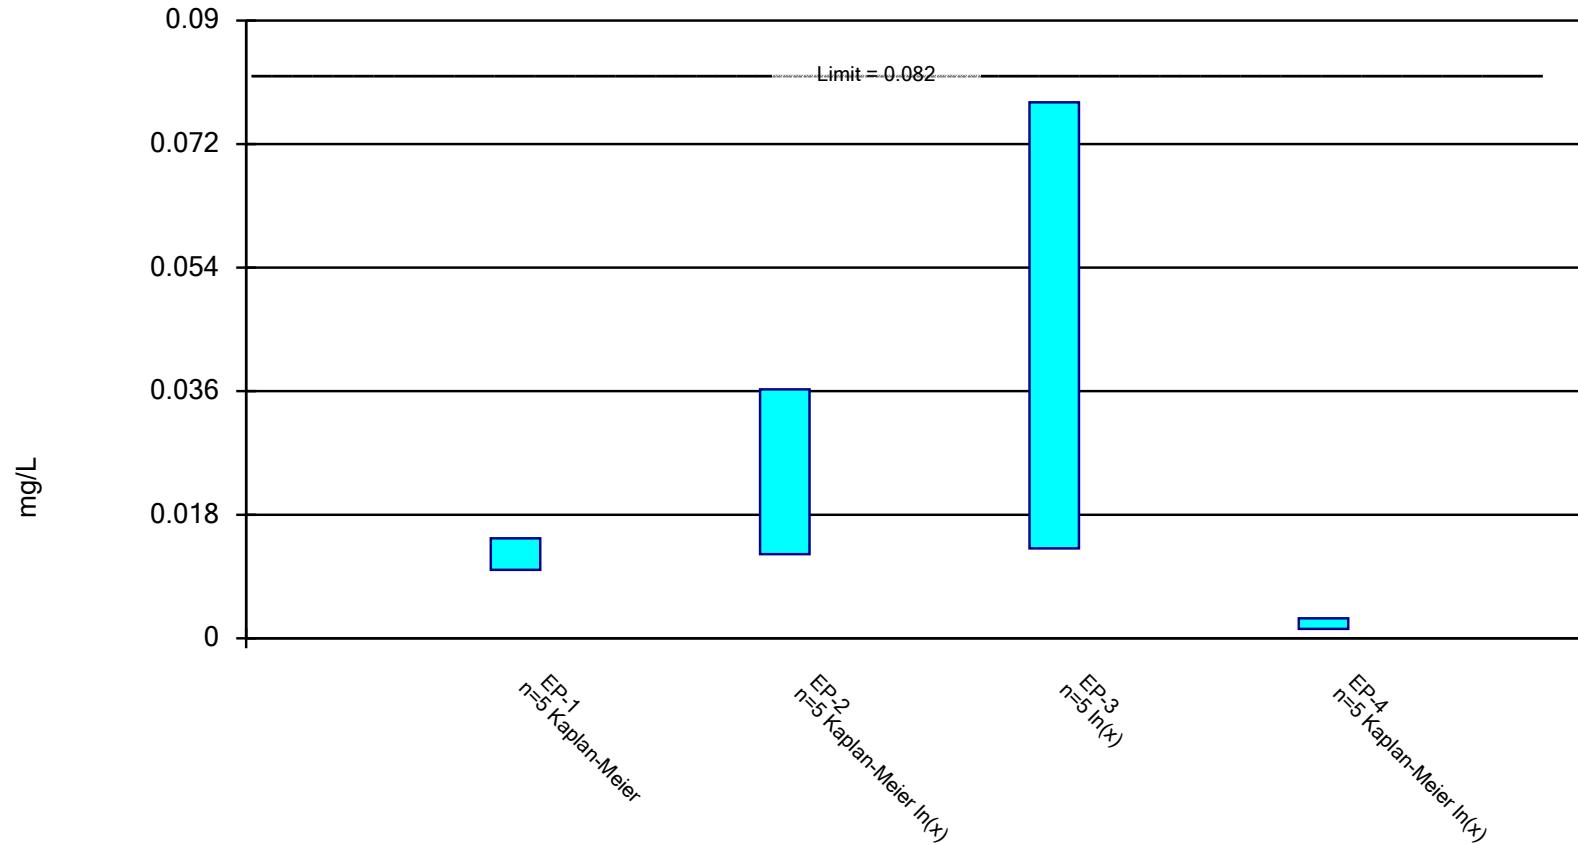


Constituent: Lithium Analysis Run 7/19/2022 11:09 AM View: EPA SSLs

Marion Power Plant Client: SIPC Data: SIPC Statistical Database

## Non-Parametric Confidence Interval

Compliance Limit is not exceeded.

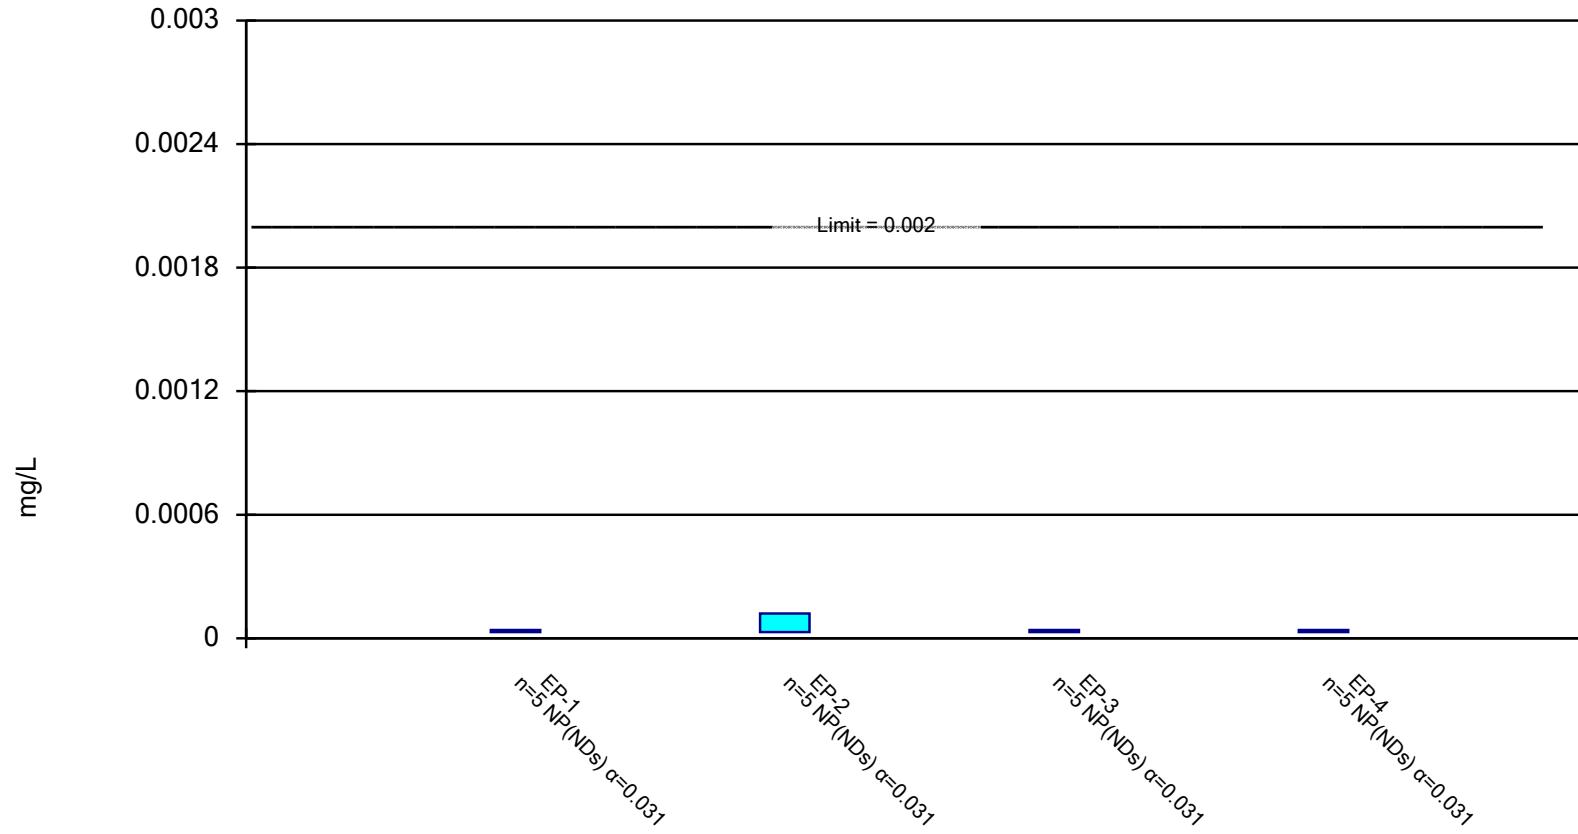


Constituent: Mercury Analysis Run 7/19/2022 11:09 AM View: EPA SSLs

Marion Power Plant Client: SIPC Data: SIPC Statistical Database

## Non-Parametric Confidence Interval

Compliance Limit is not exceeded.

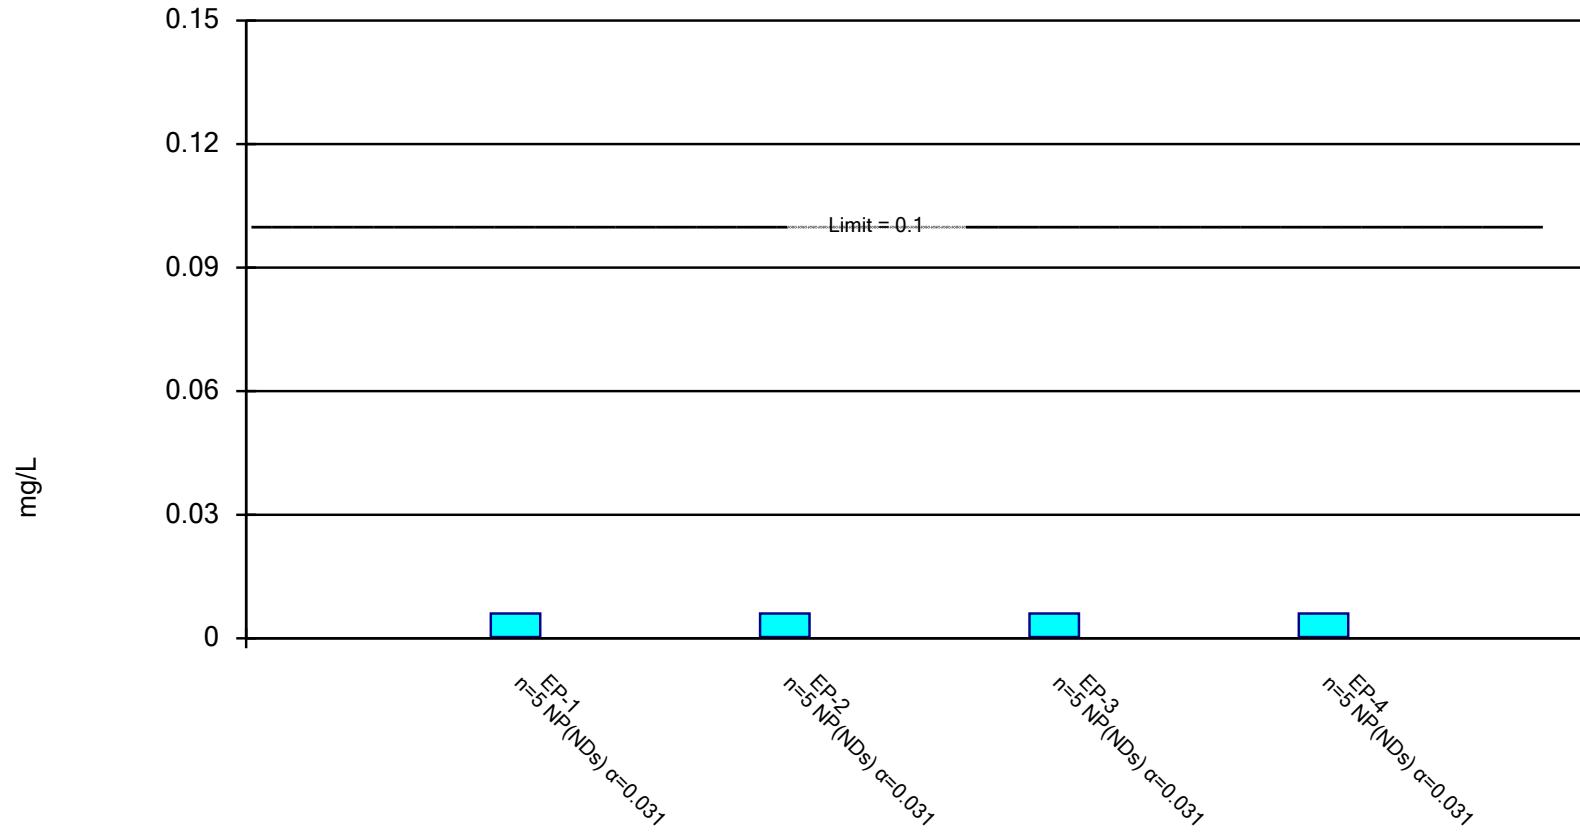


Constituent: Molybdenum Analysis Run 7/19/2022 11:09 AM View: EPA SSLs

Marion Power Plant Client: SIPC Data: SIPC Statistical Database

## Parametric and Non-Parametric (NP) Confidence Interval

Compliance Limit is not exceeded. Per-well alpha = 0.01 except as noted. Normality Test: Shapiro Wilk, alpha based on n.

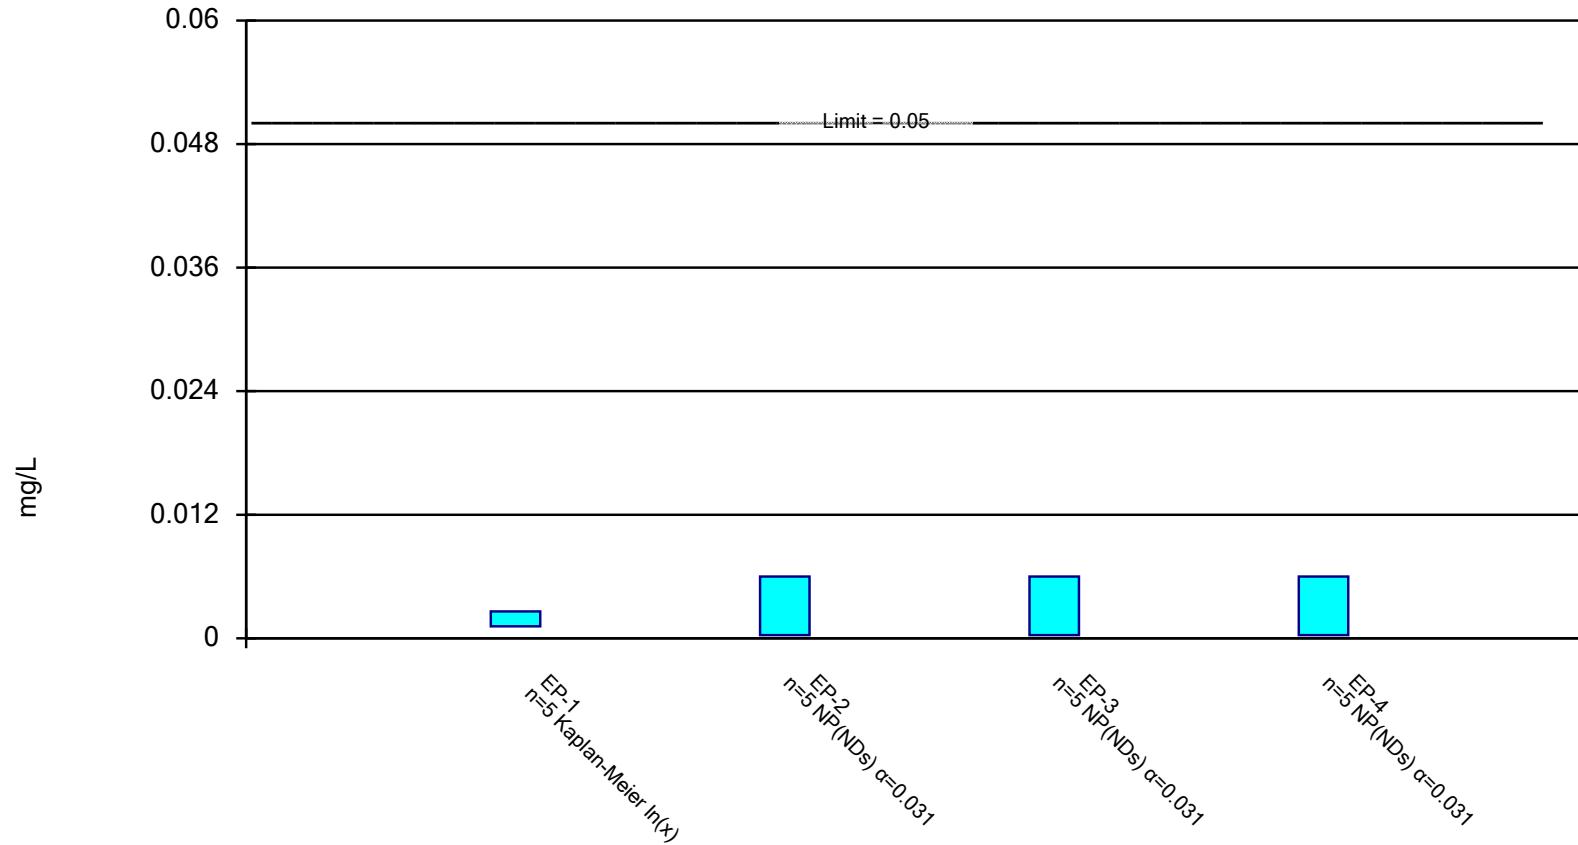


Constituent: Selenium Analysis Run 7/19/2022 11:09 AM View: EPA SSLs

Marion Power Plant Client: SIPC Data: SIPC Statistical Database

## Non-Parametric Confidence Interval

Compliance Limit is not exceeded.

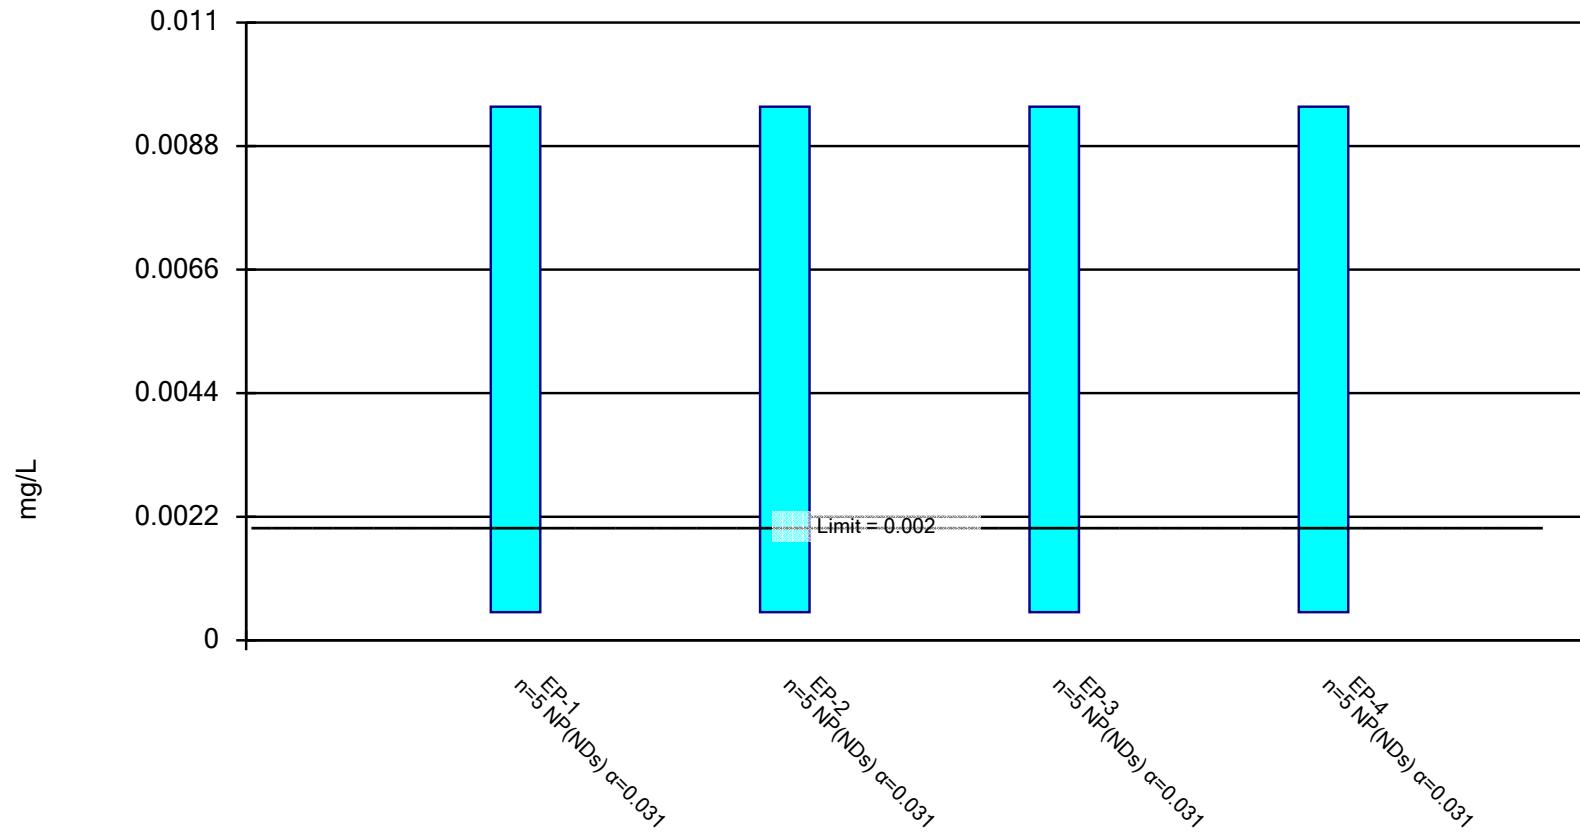


Constituent: Thallium Analysis Run 7/19/2022 11:09 AM View: EPA SSLs

Marion Power Plant Client: SIPC Data: SIPC Statistical Database

## Non-Parametric Confidence Interval

Compliance Limit is not exceeded.

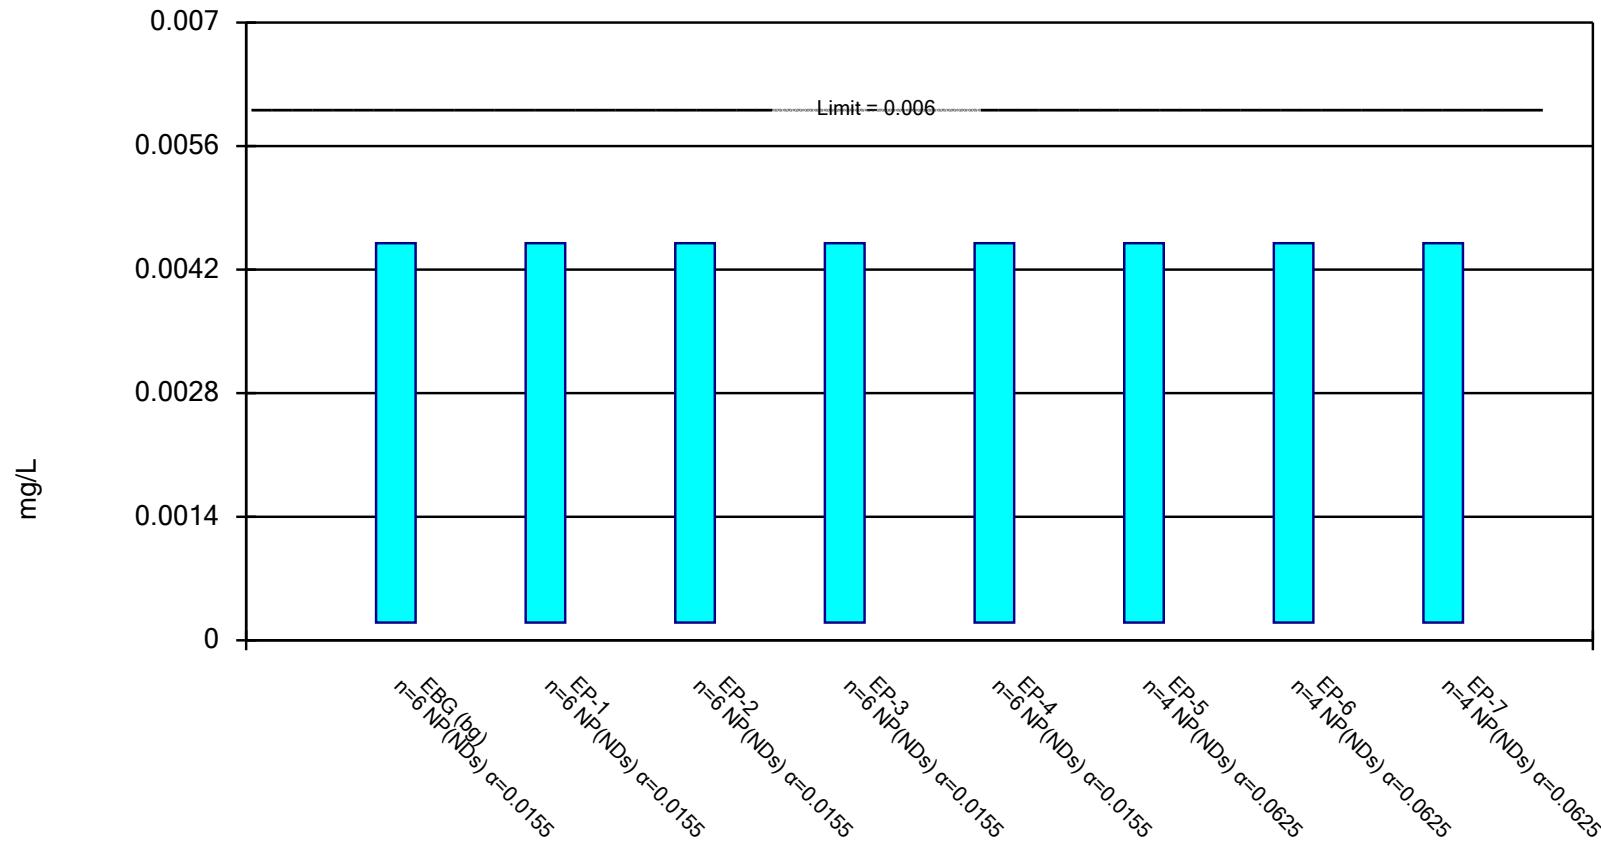


Constituent: Antimony Analysis Run 10/17/2022 1:45 PM View: EPA SSLs

Marion Power Plant Client: SIPC Data: SIPC Statistical Database

## Parametric and Non-Parametric (NP) Confidence Interval

Compliance Limit is not exceeded. Per-well alpha = 0.01 except as noted. Normality Test: Shapiro Wilk, alpha based on n.

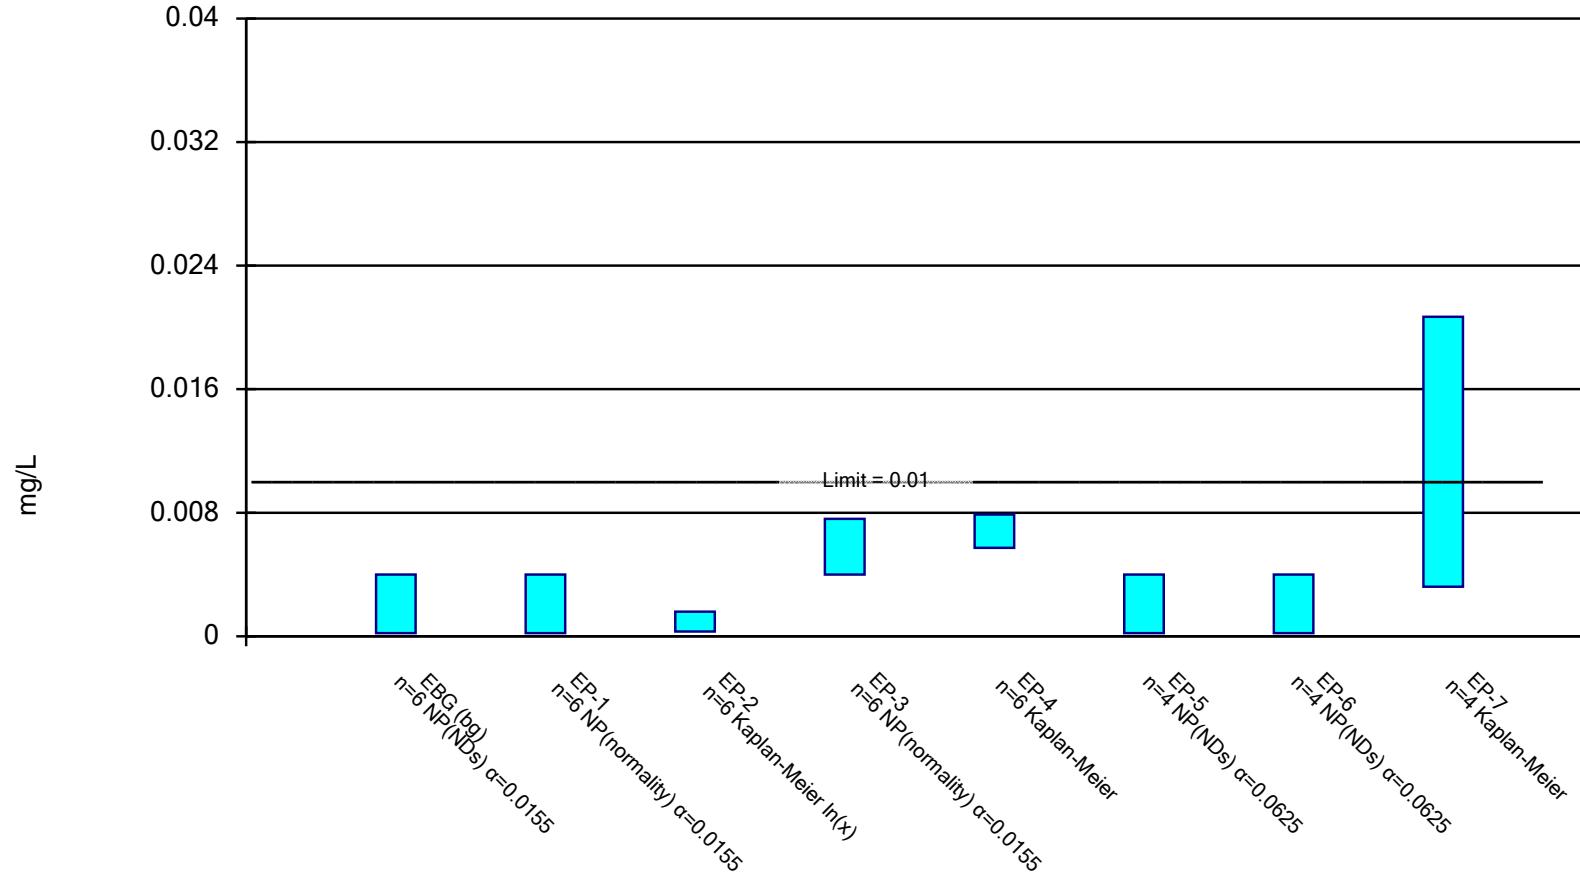


Constituent: Arsenic Analysis Run 10/17/2022 1:45 PM View: EPA SSLs

Marion Power Plant Client: SIPC Data: SIPC Statistical Database

## Parametric and Non-Parametric (NP) Confidence Interval

Compliance Limit is not exceeded. Per-well alpha = 0.01 except as noted. Normality Test: Shapiro Wilk, alpha based on n.

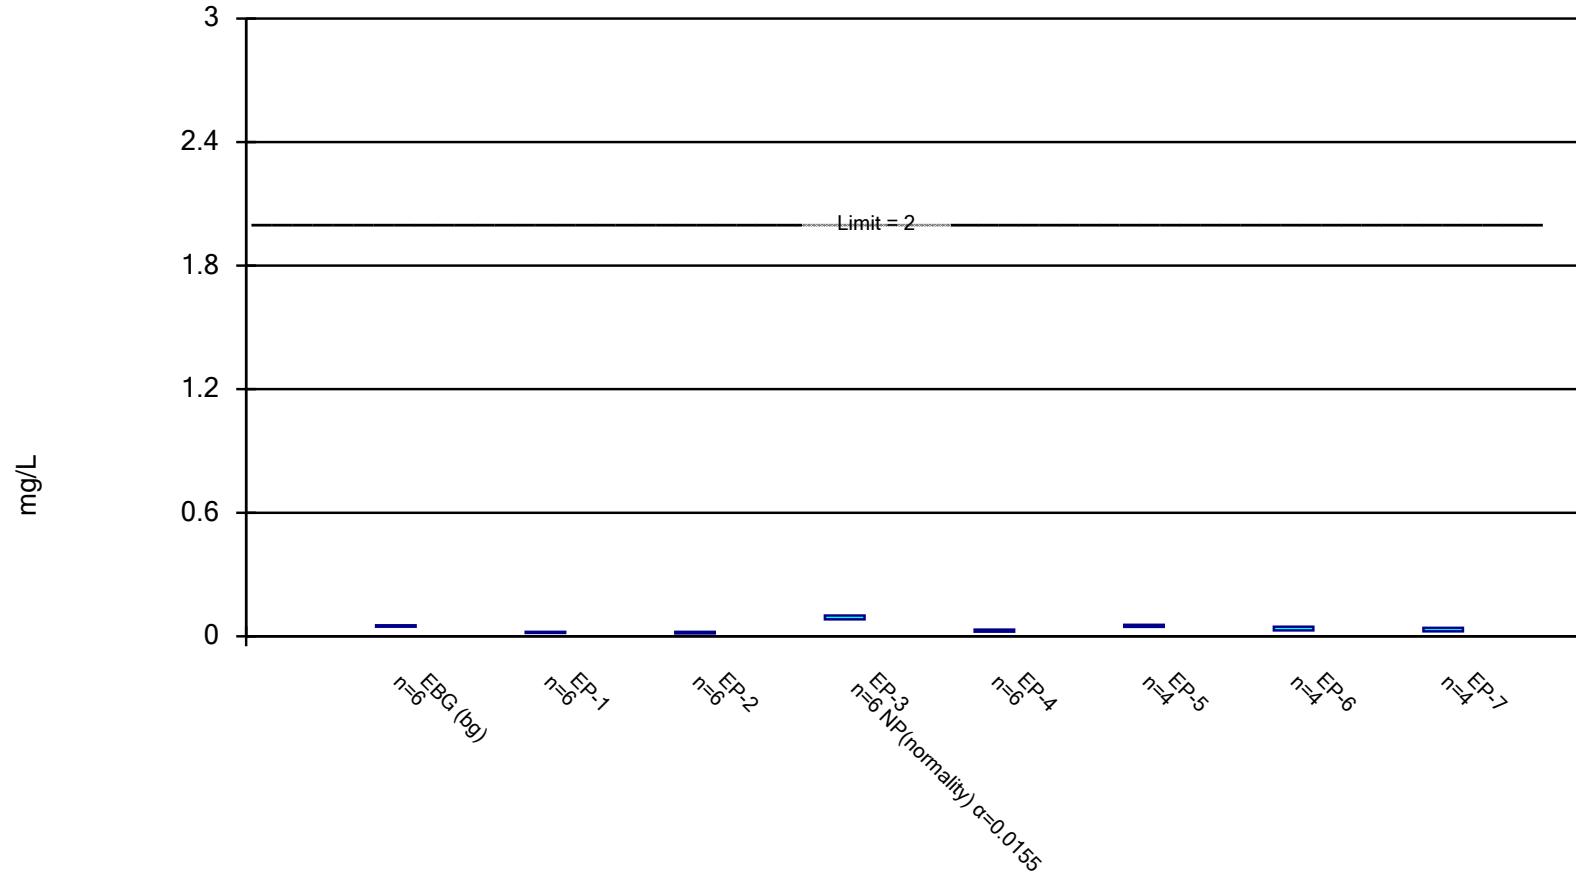


Constituent: Barium Analysis Run 10/17/2022 1:45 PM View: EPA SSLs

Marion Power Plant Client: SIPC Data: SIPC Statistical Database

## Parametric and Non-Parametric (NP) Confidence Interval

Compliance Limit is not exceeded. Per-well alpha = 0.01 except as noted. Normality Test: Shapiro Wilk, alpha based on n.

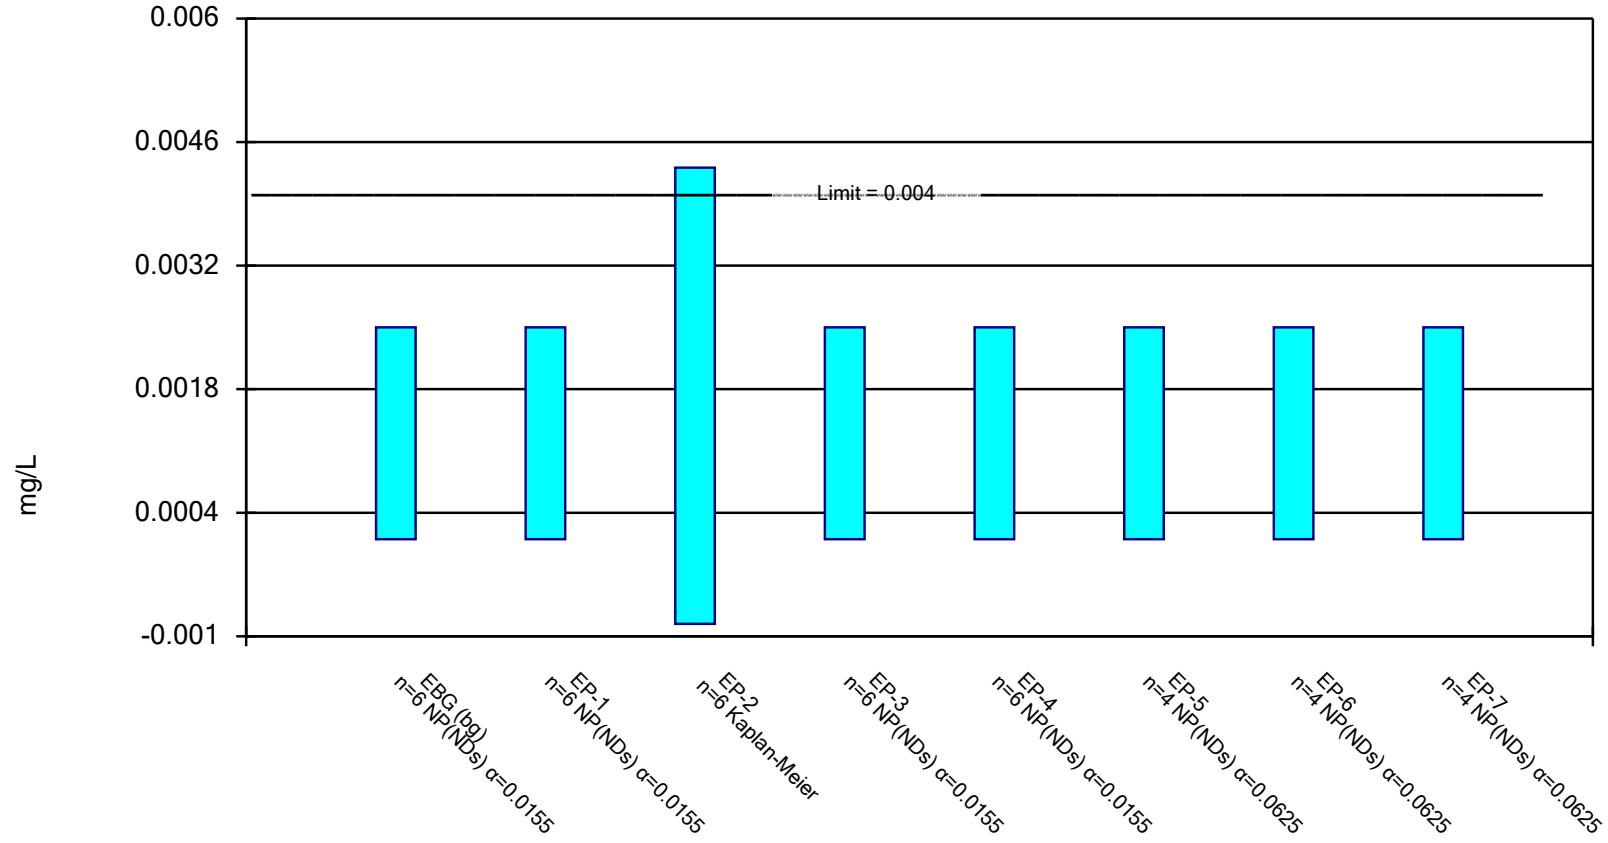


Constituent: Beryllium Analysis Run 10/17/2022 1:45 PM View: EPA SSLs

Marion Power Plant Client: SIPC Data: SIPC Statistical Database

## Non-Parametric Confidence Interval

Compliance Limit is not exceeded.

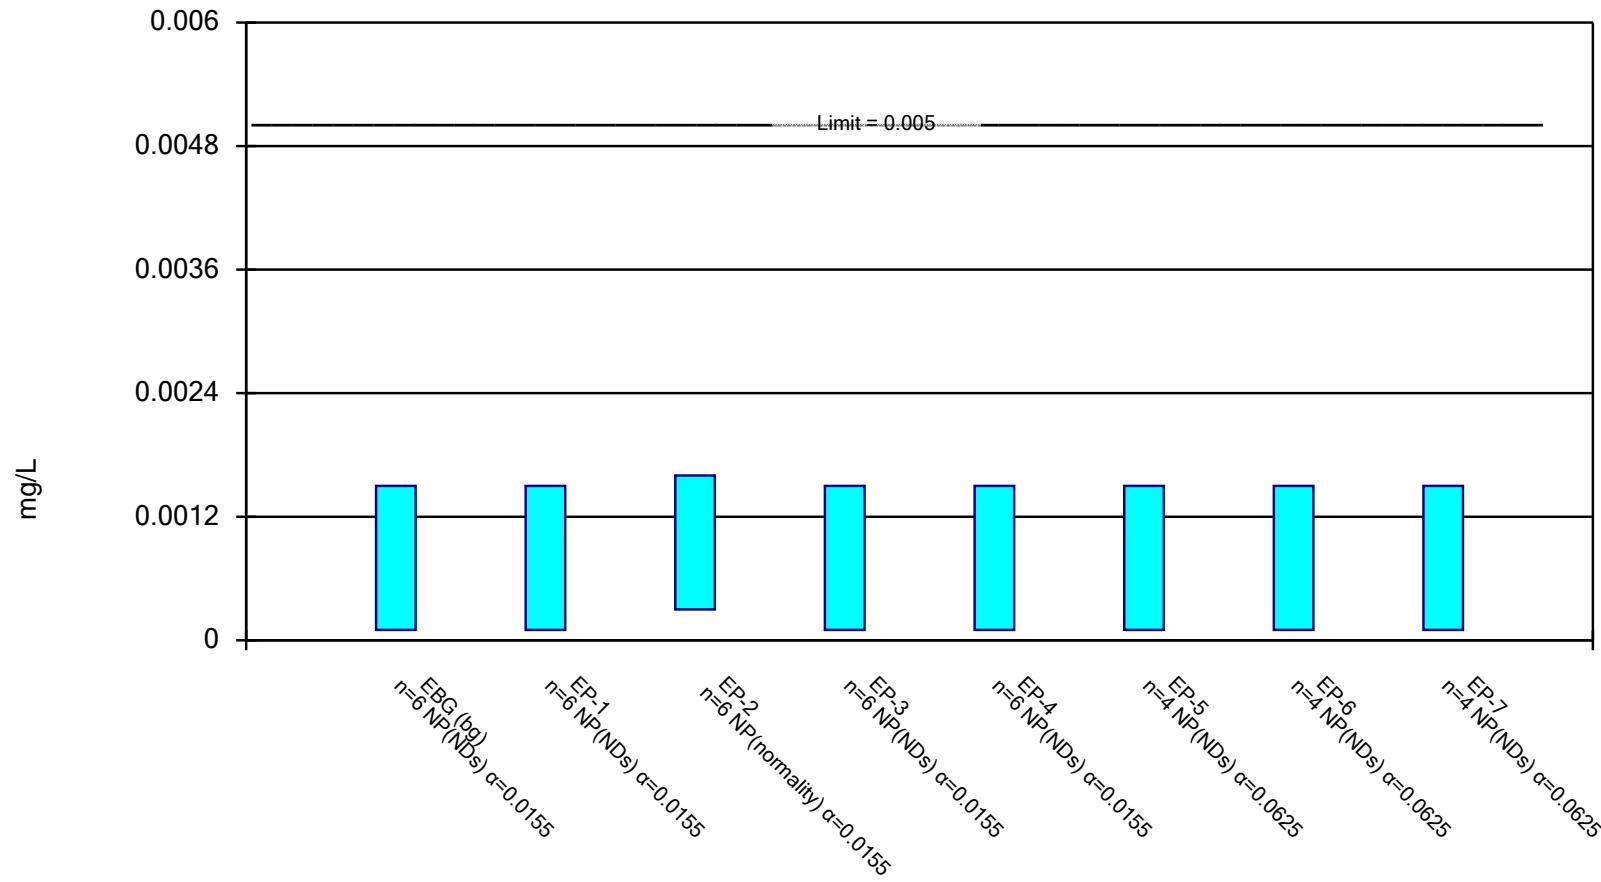


Constituent: Cadmium Analysis Run 10/17/2022 1:46 PM View: EPA SSLs

Marion Power Plant Client: SIPC Data: SIPC Statistical Database

## Parametric and Non-Parametric (NP) Confidence Interval

Compliance Limit is not exceeded. Per-well alpha = 0.01 except as noted. Normality Test: Shapiro Wilk, alpha based on n.

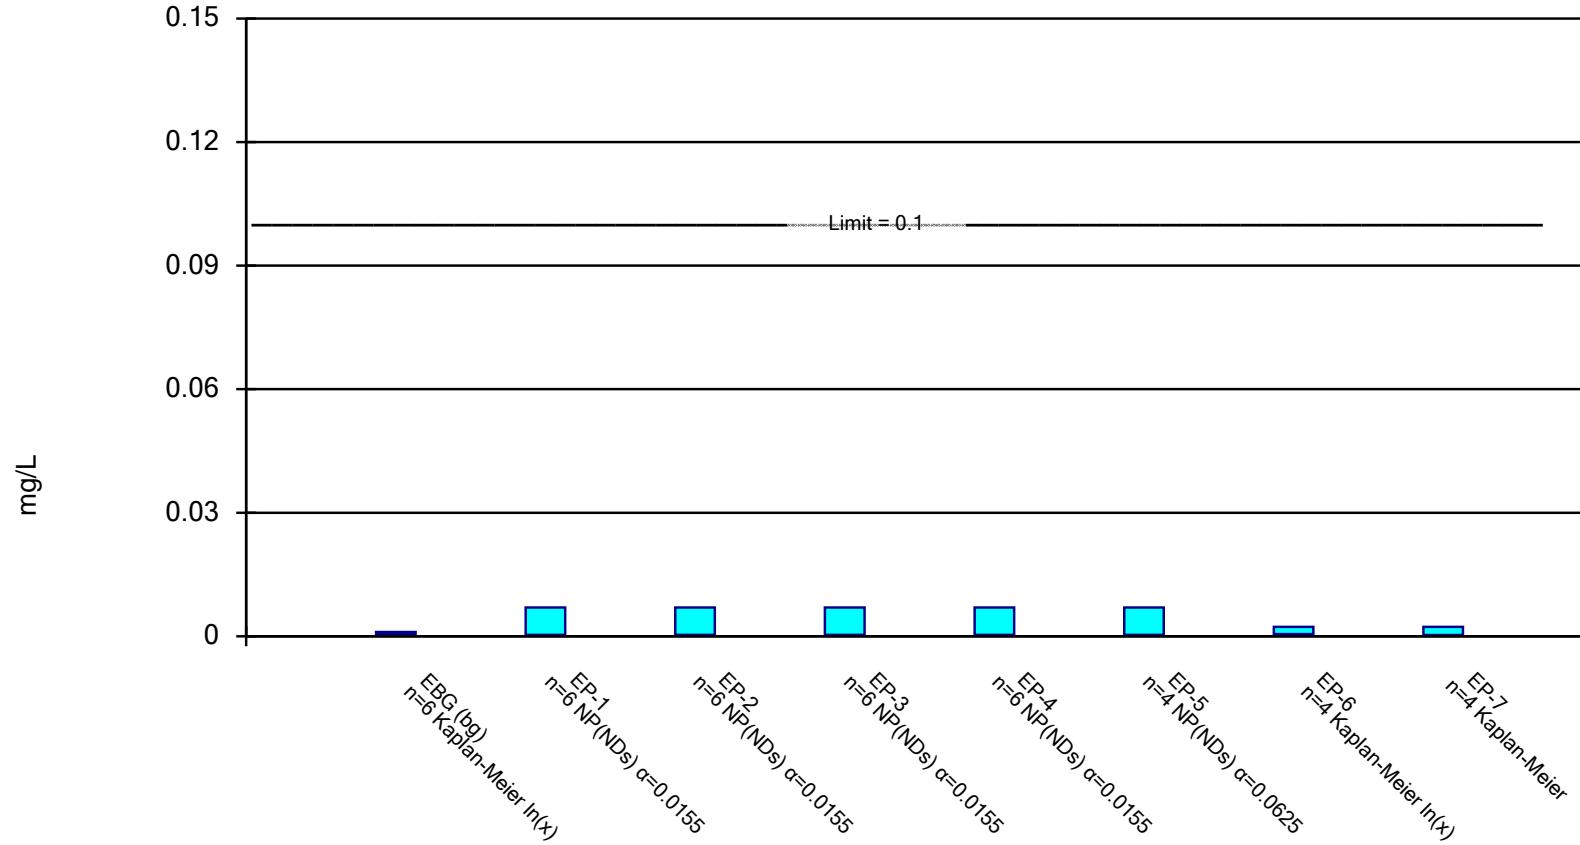


Constituent: Chromium Analysis Run 10/17/2022 1:46 PM View: EPA SSLs

Marion Power Plant Client: SIPC Data: SIPC Statistical Database

## Parametric and Non-Parametric (NP) Confidence Interval

Compliance limit is exceeded.\* Per-well alpha = 0.01 except as noted. Normality Test: Shapiro Wilk, alpha based on n.

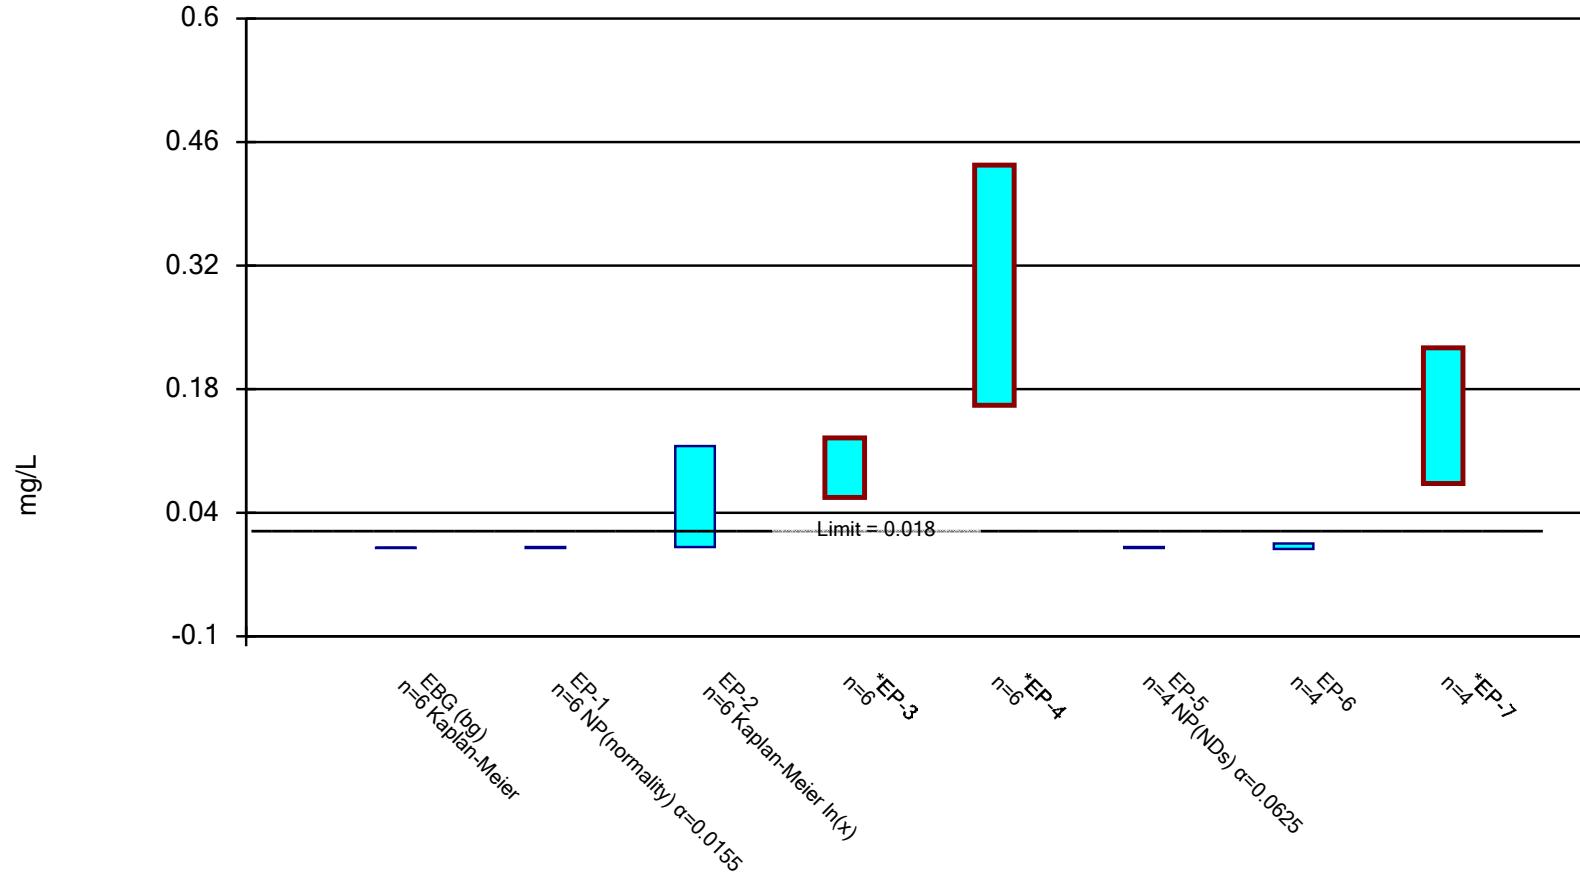


Constituent: Cobalt Analysis Run 10/17/2022 1:46 PM View: EPA SSLs

Marion Power Plant Client: SIPC Data: SIPC Statistical Database

## Parametric and Non-Parametric (NP) Confidence Interval

Compliance Limit is not exceeded. Per-well alpha = 0.01 except as noted. Normality Test: Shapiro Wilk, alpha based on n.

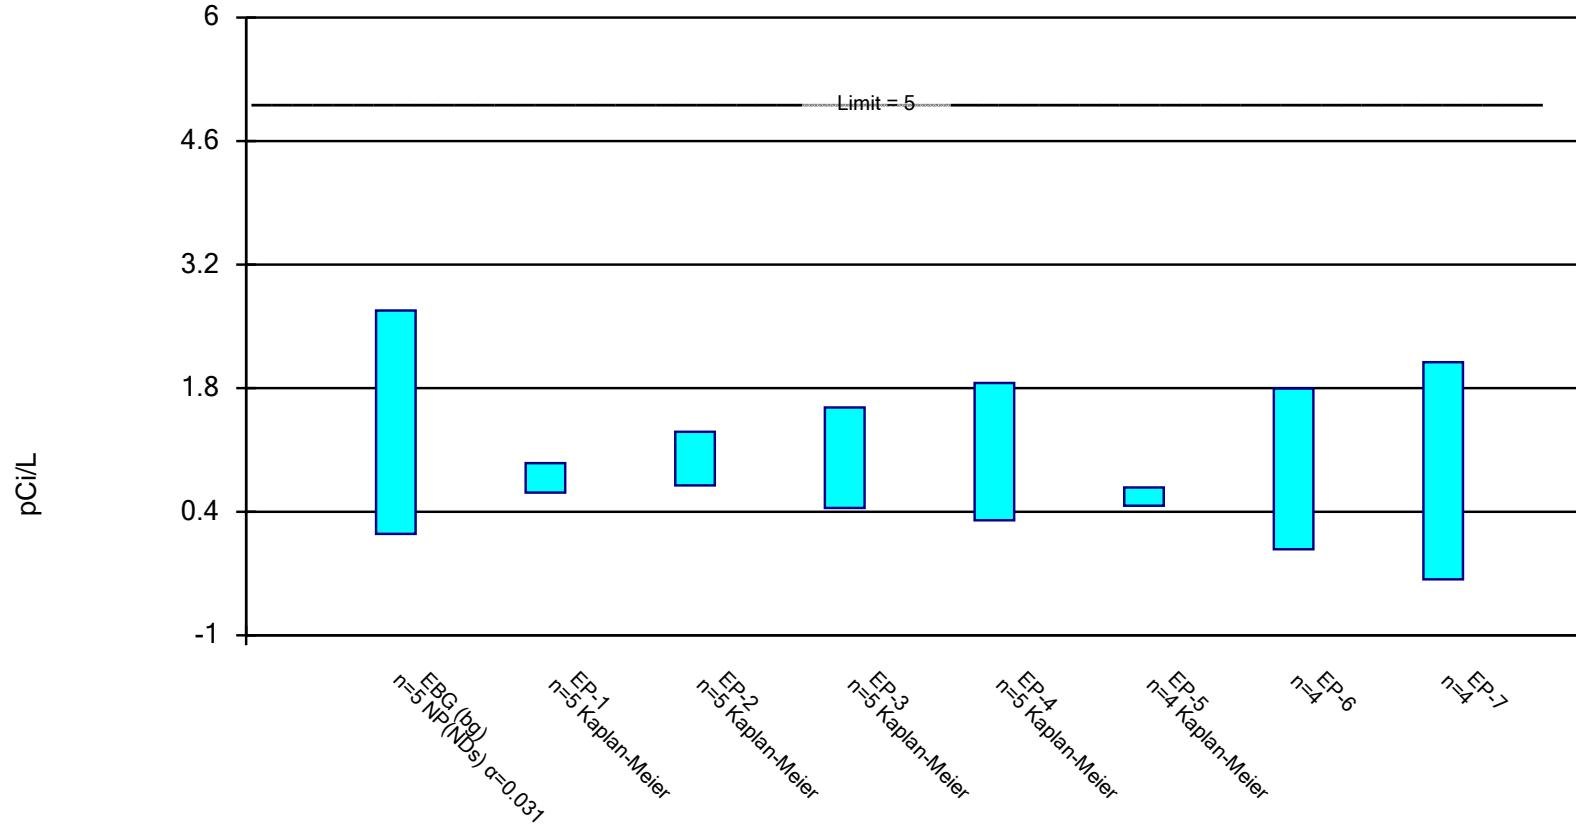


Constituent: Combined Radium Analysis Run 10/17/2022 1:46 PM View: EPA SSLs

Marion Power Plant Client: SIPC Data: SIPC Statistical Database

## Parametric and Non-Parametric (NP) Confidence Interval

Compliance Limit is not exceeded. Per-well alpha = 0.01 except as noted. Normality Test: Shapiro Wilk, alpha based on n.

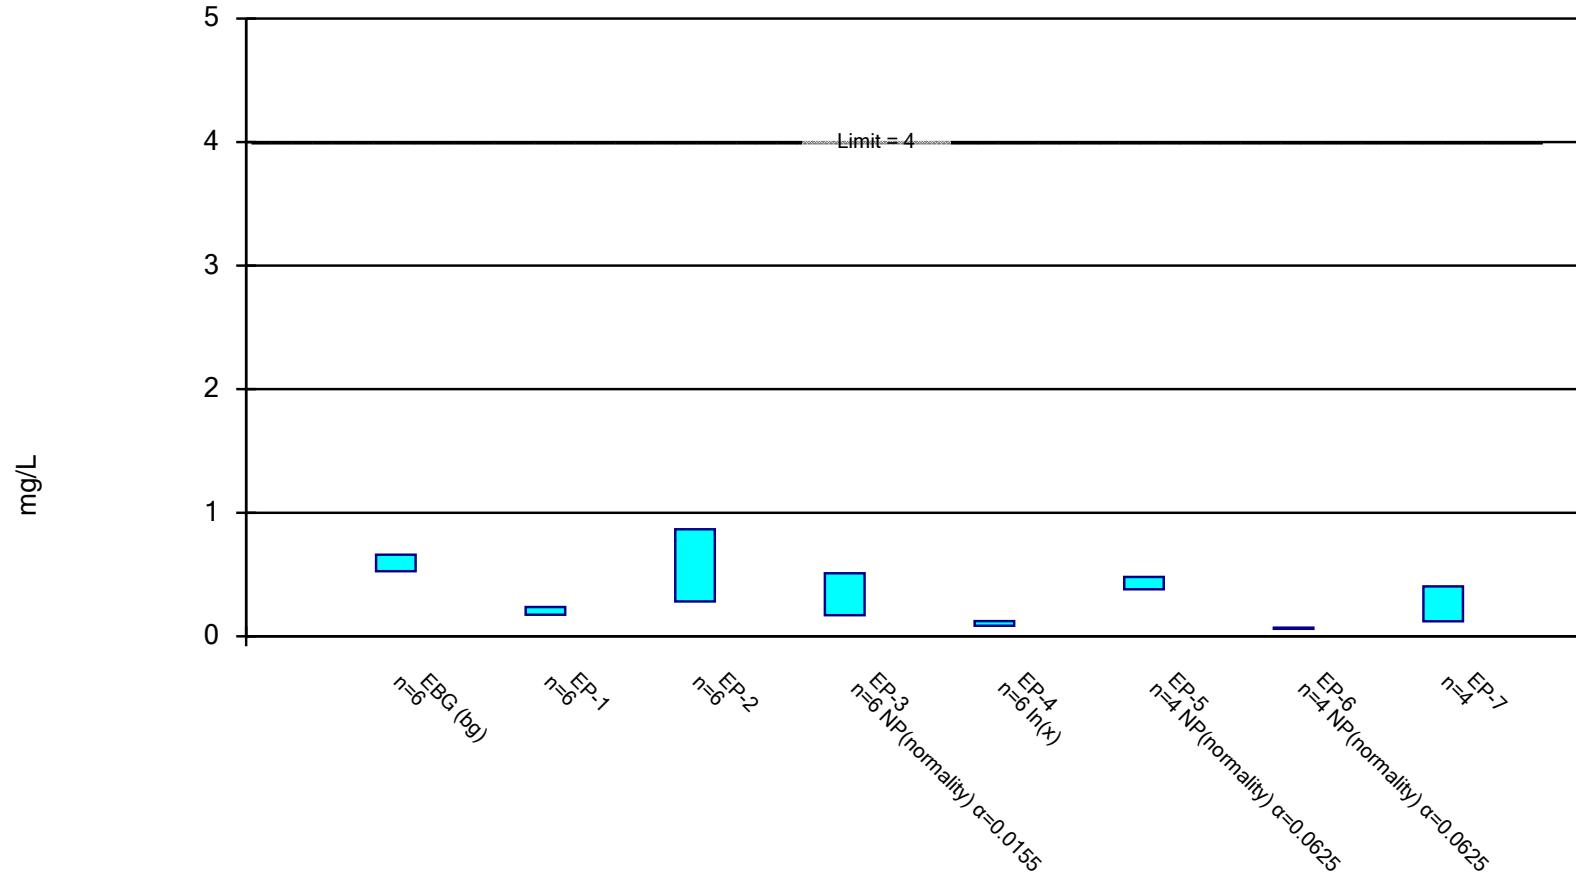


Constituent: Fluoride Analysis Run 10/17/2022 1:46 PM View: IEPA

Marion Power Plant Client: SIPC Data: SIPC Statistical Database

## Parametric and Non-Parametric (NP) Confidence Interval

Compliance Limit is not exceeded. Per-well alpha = 0.01 except as noted. Normality Test: Shapiro Wilk, alpha based on n.

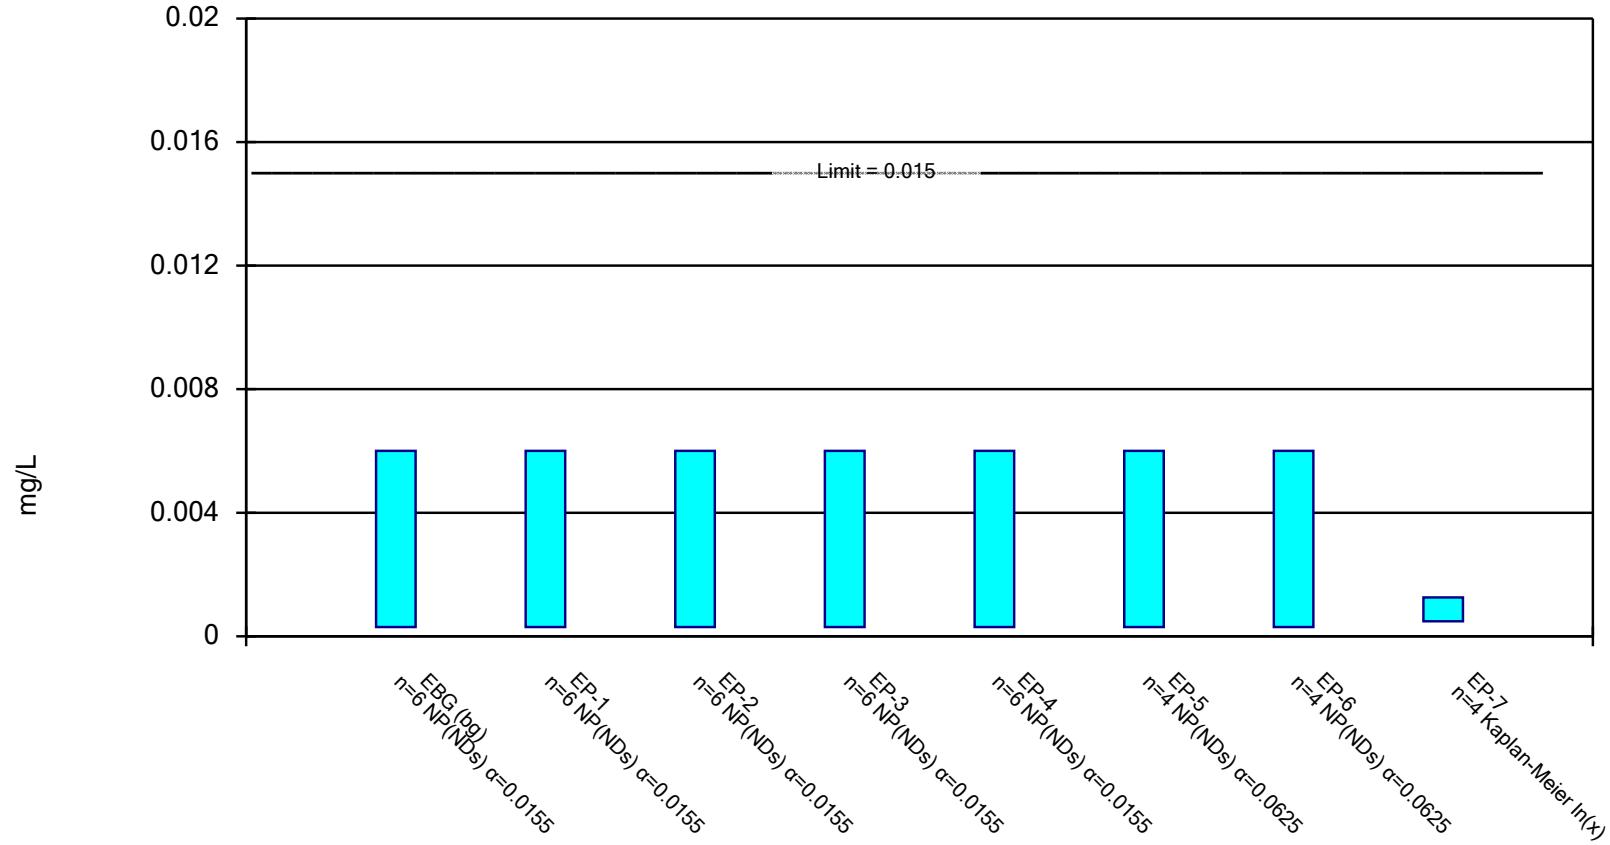


Constituent: Lead Analysis Run 10/17/2022 1:46 PM View: EPA SSLs

Marion Power Plant Client: SIPC Data: SIPC Statistical Database

## Parametric and Non-Parametric (NP) Confidence Interval

Compliance Limit is not exceeded. Per-well alpha = 0.01 except as noted. Normality Test: Shapiro Wilk, alpha based on n.

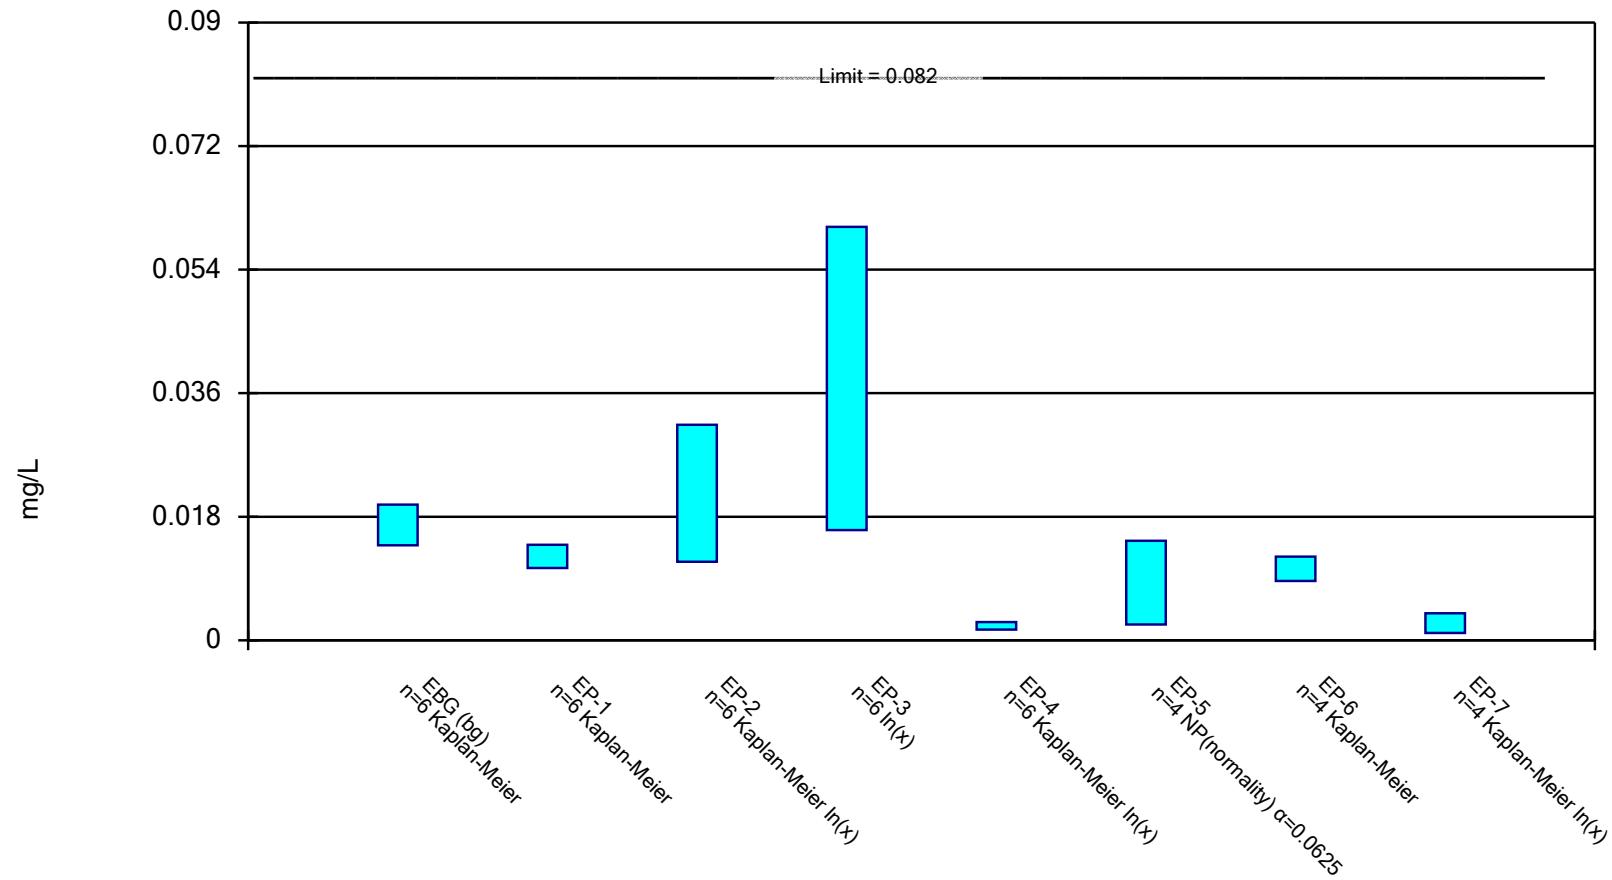


Constituent: Lithium Analysis Run 10/17/2022 1:47 PM View: EPA SSLs

Marion Power Plant Client: SIPC Data: SIPC Statistical Database

## Non-Parametric Confidence Interval

Compliance Limit is not exceeded.

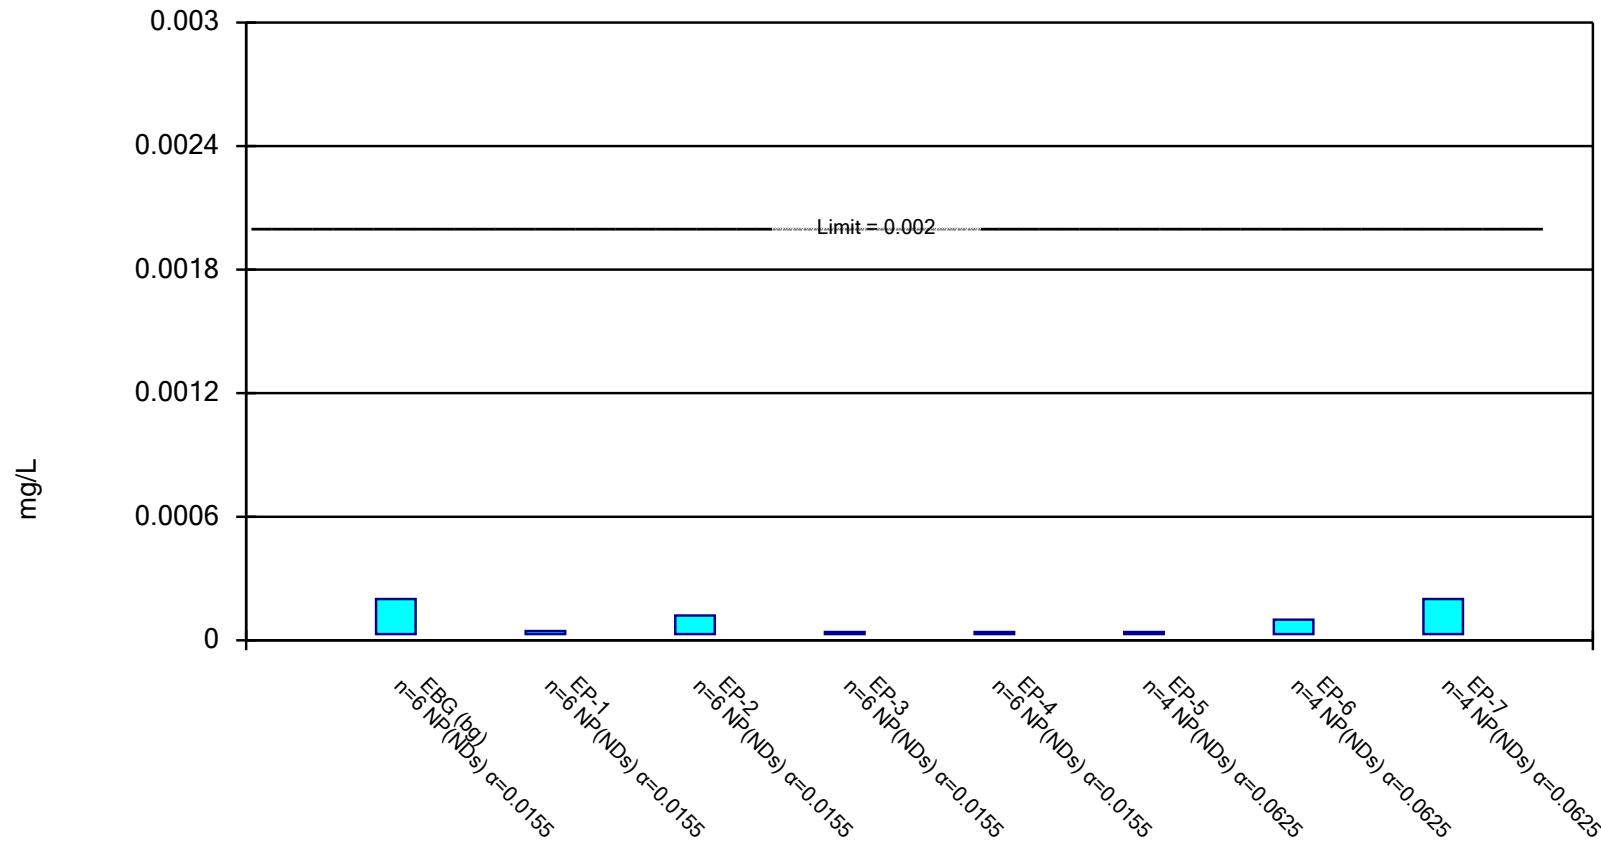


Constituent: Mercury Analysis Run 10/17/2022 1:47 PM View: EPA SSLs

Marion Power Plant Client: SIPC Data: SIPC Statistical Database

## Parametric and Non-Parametric (NP) Confidence Interval

Compliance Limit is not exceeded. Per-well alpha = 0.01 except as noted. Normality Test: Shapiro Wilk, alpha based on n.

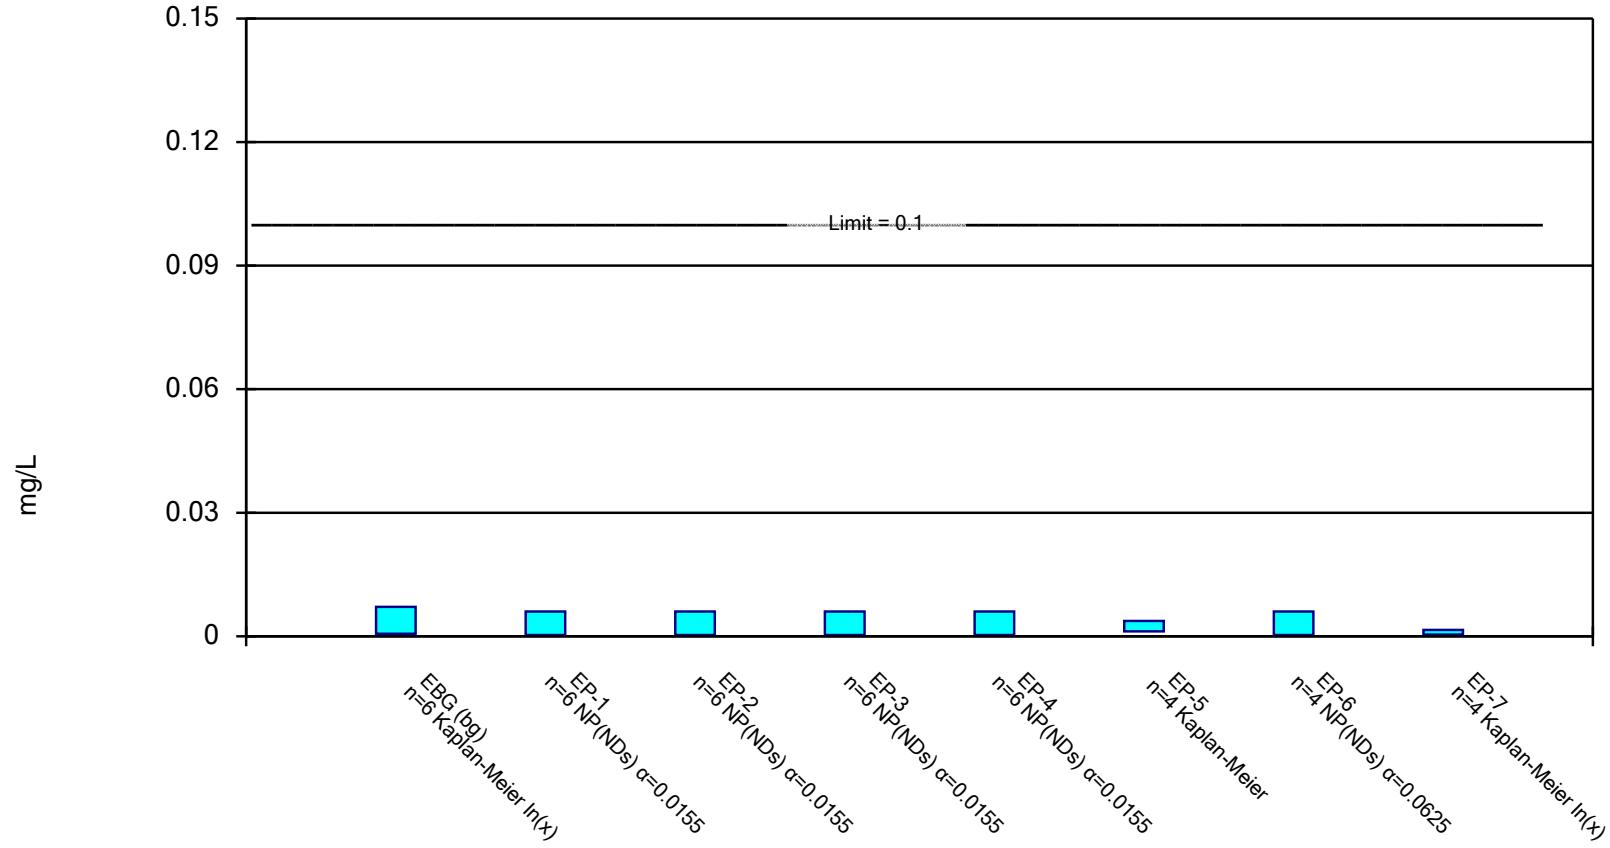


Constituent: Molybdenum Analysis Run 10/17/2022 1:47 PM View: EPA SSLs

Marion Power Plant Client: SIPC Data: SIPC Statistical Database

## Parametric and Non-Parametric (NP) Confidence Interval

Compliance Limit is not exceeded. Per-well alpha = 0.01 except as noted. Normality Test: Shapiro Wilk, alpha based on n.

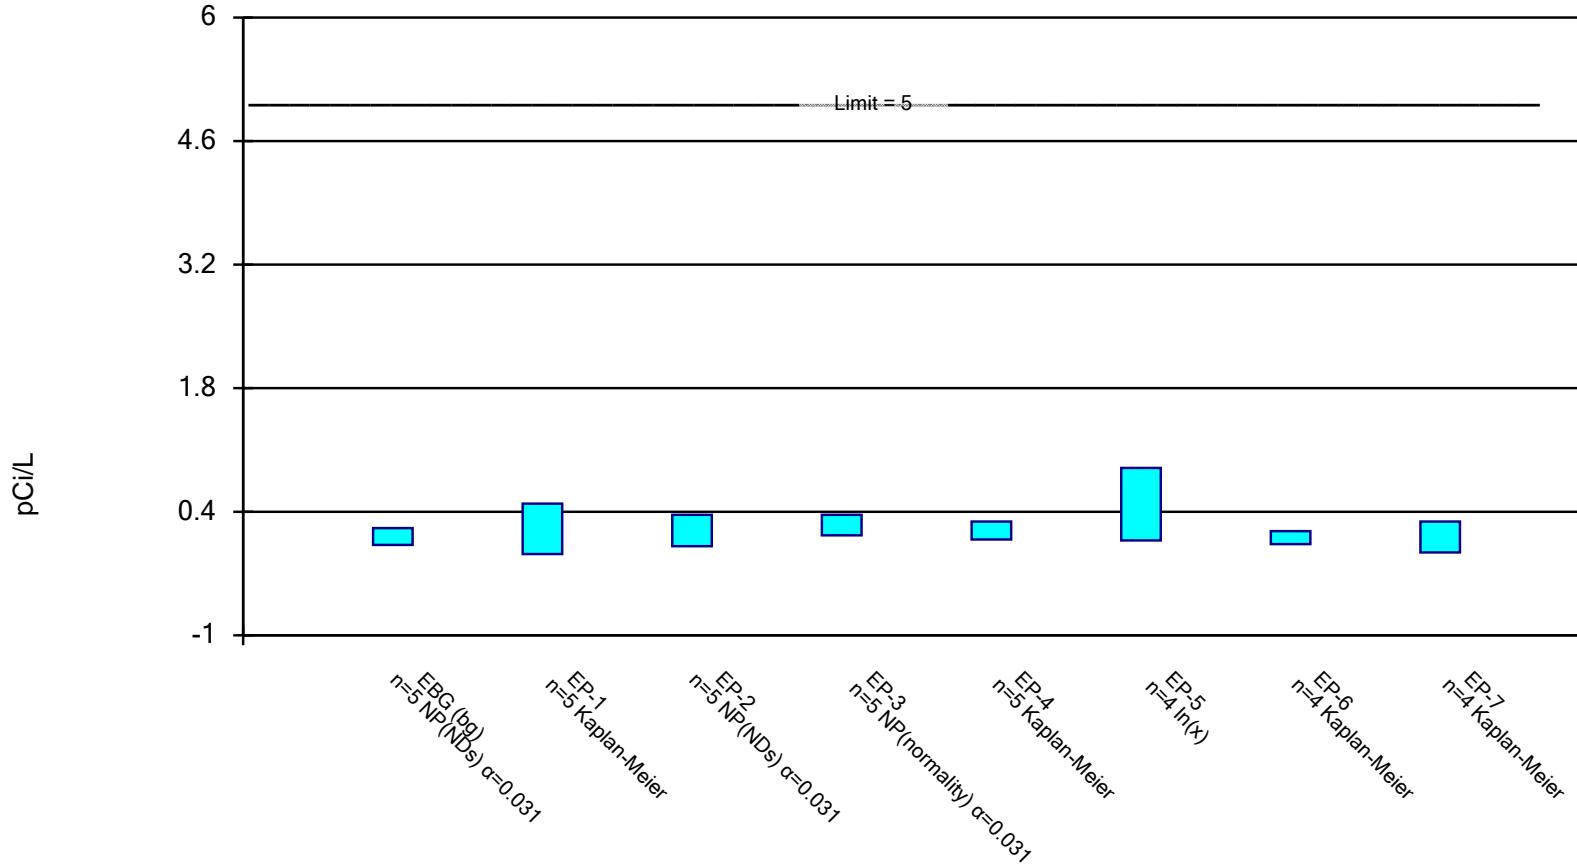


Constituent: Radium 226 Analysis Run 10/17/2022 1:47 PM View: EPA SSLs

Marion Power Plant Client: SIPC Data: SIPC Statistical Database

## Parametric and Non-Parametric (NP) Confidence Interval

Compliance Limit is not exceeded. Per-well alpha = 0.01 except as noted. Normality Test: Shapiro Wilk, alpha based on n.

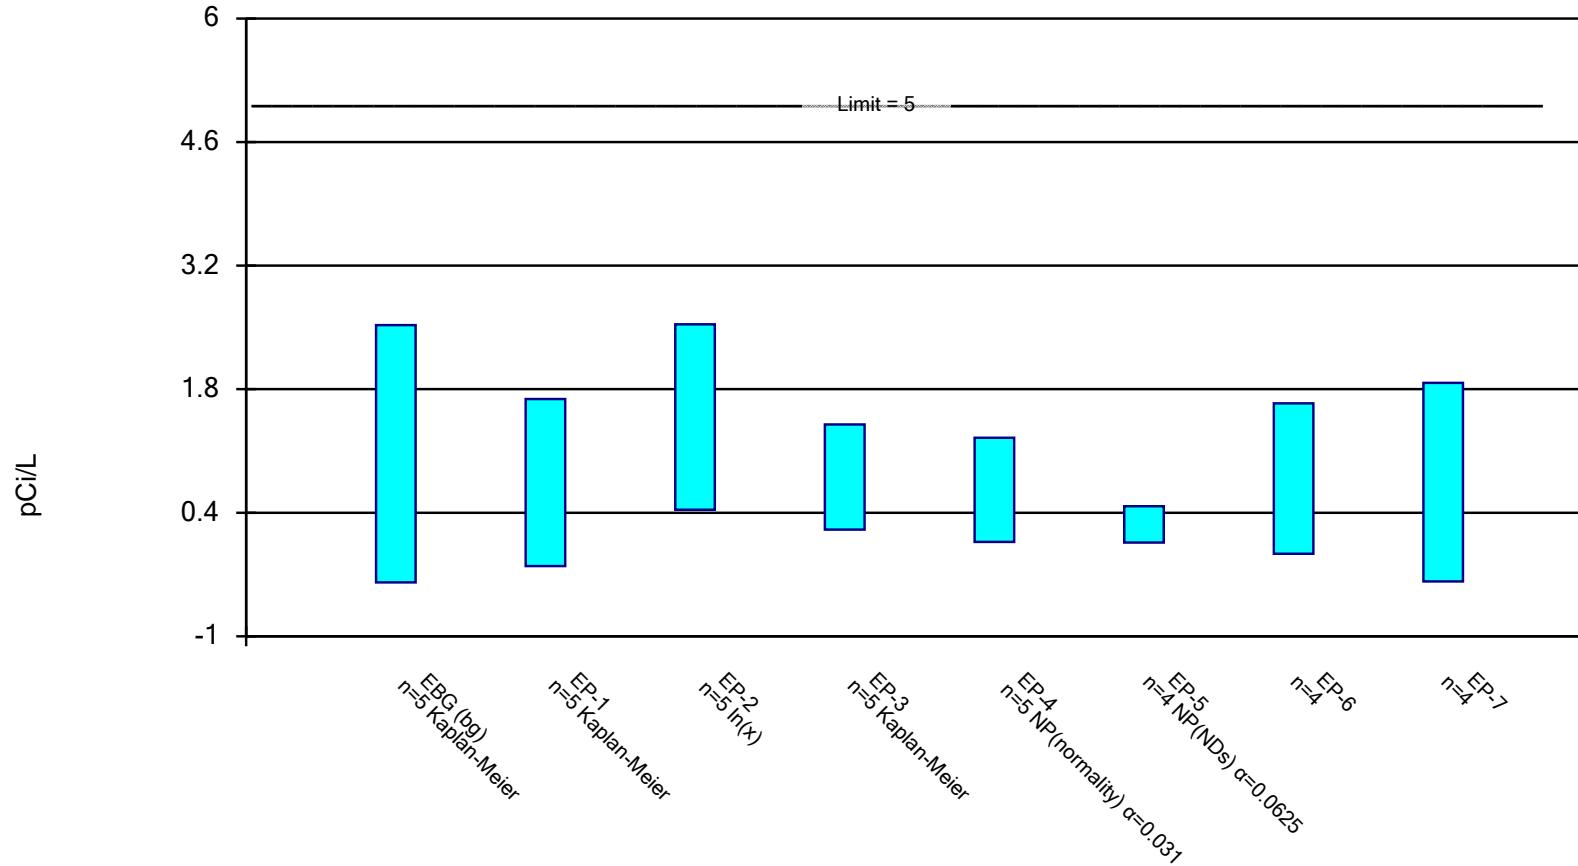


Constituent: Radium 228 Analysis Run 10/17/2022 1:47 PM View: EPA SSLs

Marion Power Plant Client: SIPC Data: SIPC Statistical Database

## Parametric and Non-Parametric (NP) Confidence Interval

Compliance Limit is not exceeded. Per-well alpha = 0.01 except as noted. Normality Test: Shapiro Wilk, alpha based on n.

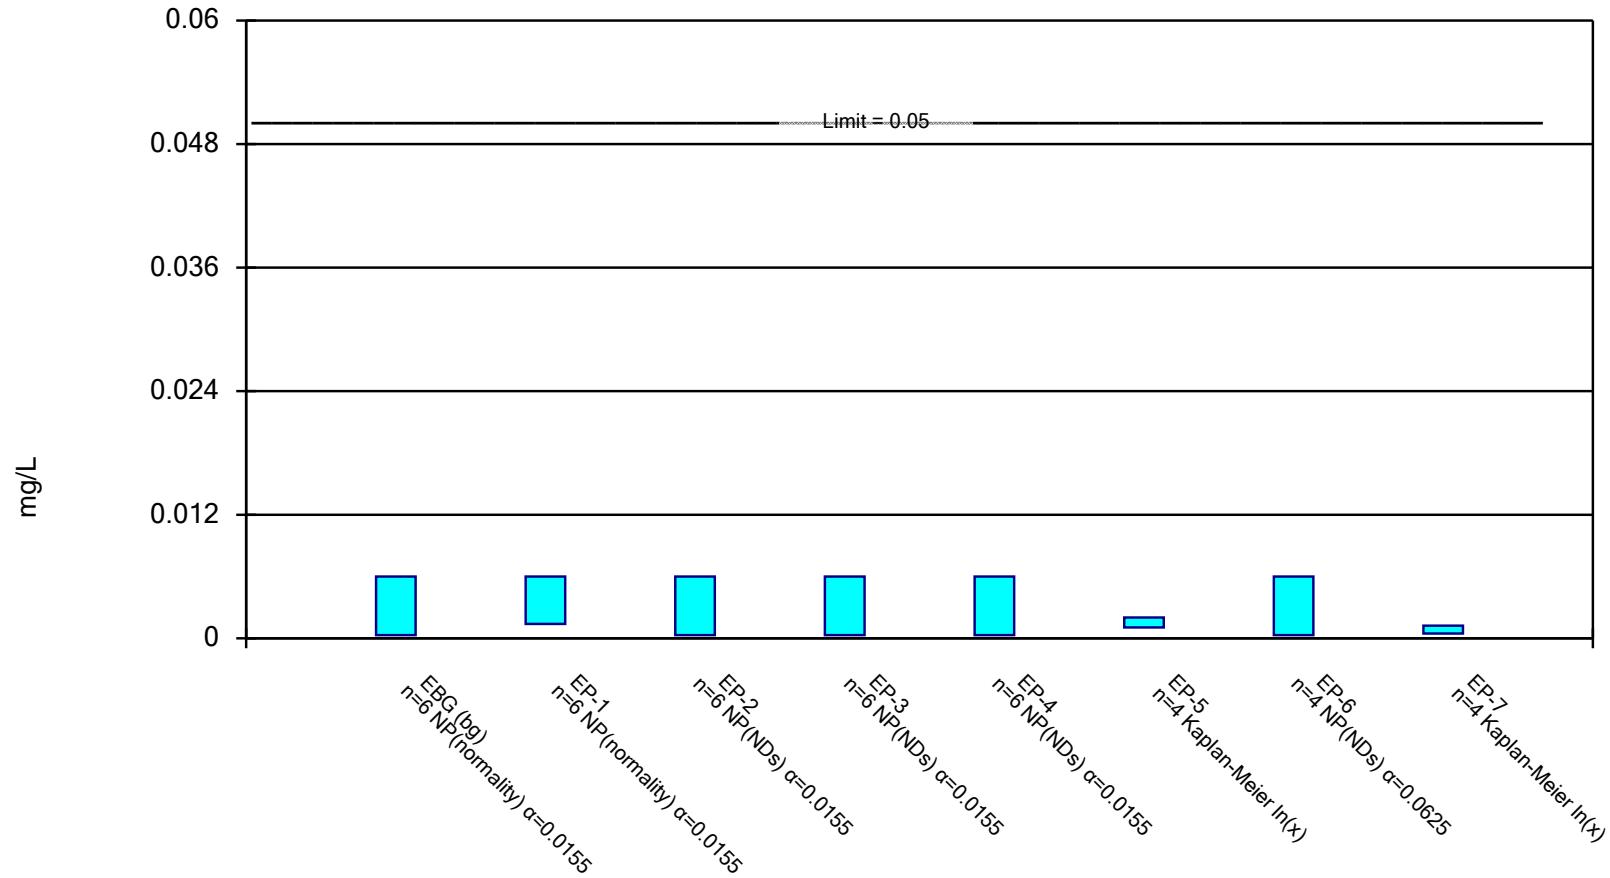


Constituent: Selenium Analysis Run 10/17/2022 1:47 PM View: EPA SSLs

Marion Power Plant Client: SIPC Data: SIPC Statistical Database

## Non-Parametric Confidence Interval

Compliance Limit is not exceeded.

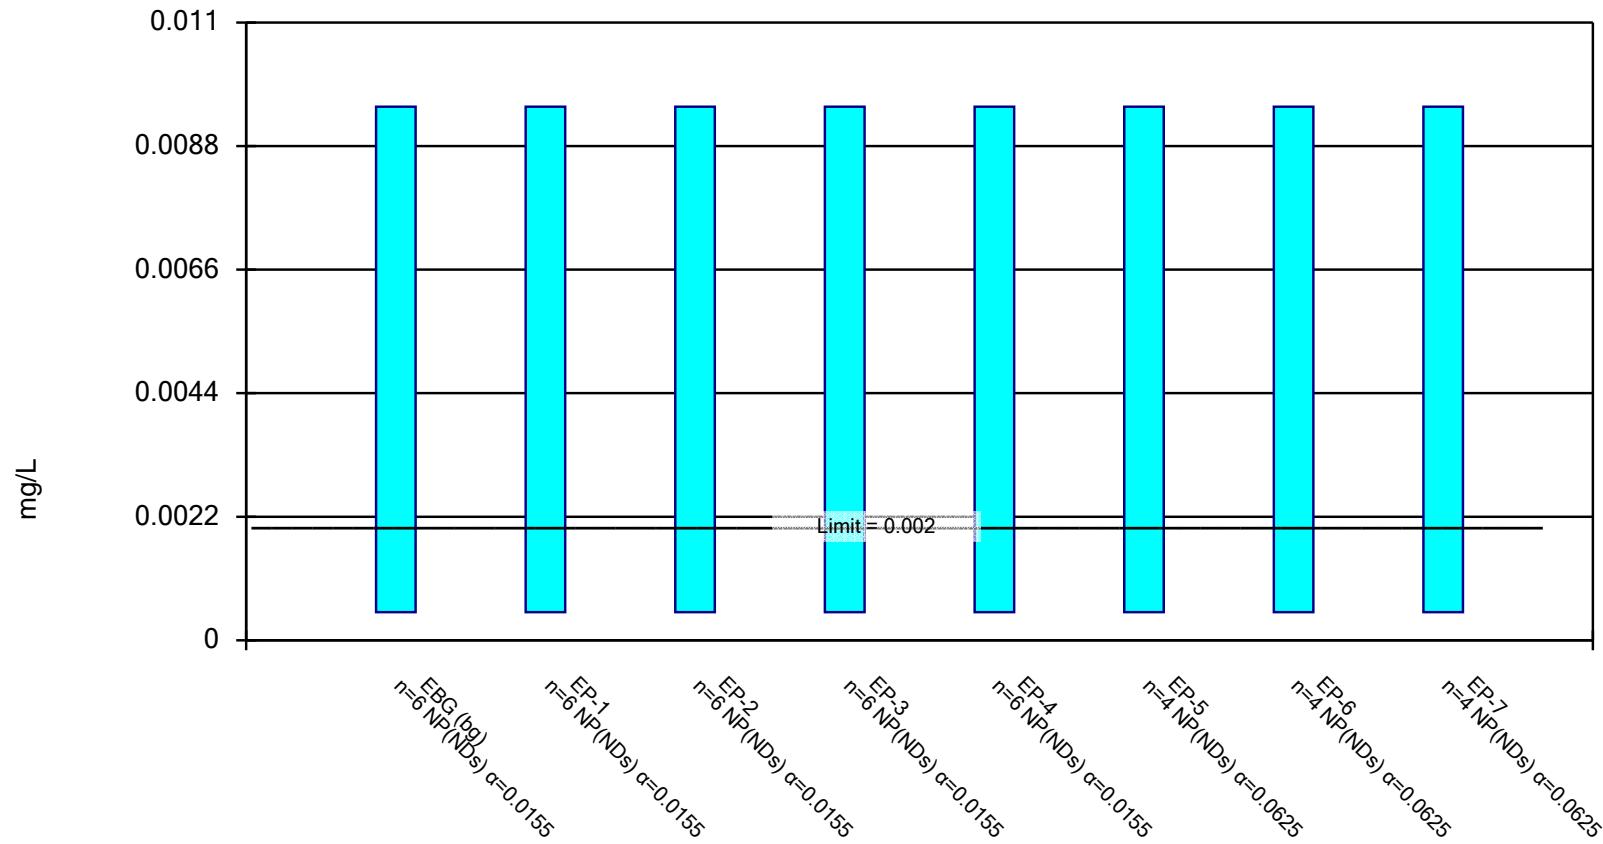

Constituent: Thallium   Analysis Run 10/17/2022 1:47 PM   View: EPA SSLs

Marion Power Plant   Client: SIPC   Data: SIPC Statistical Database