


SIPC GENERATION INTERCONNECTION PROCESS

For Generation > 40 kW connecting to 100 kV and below

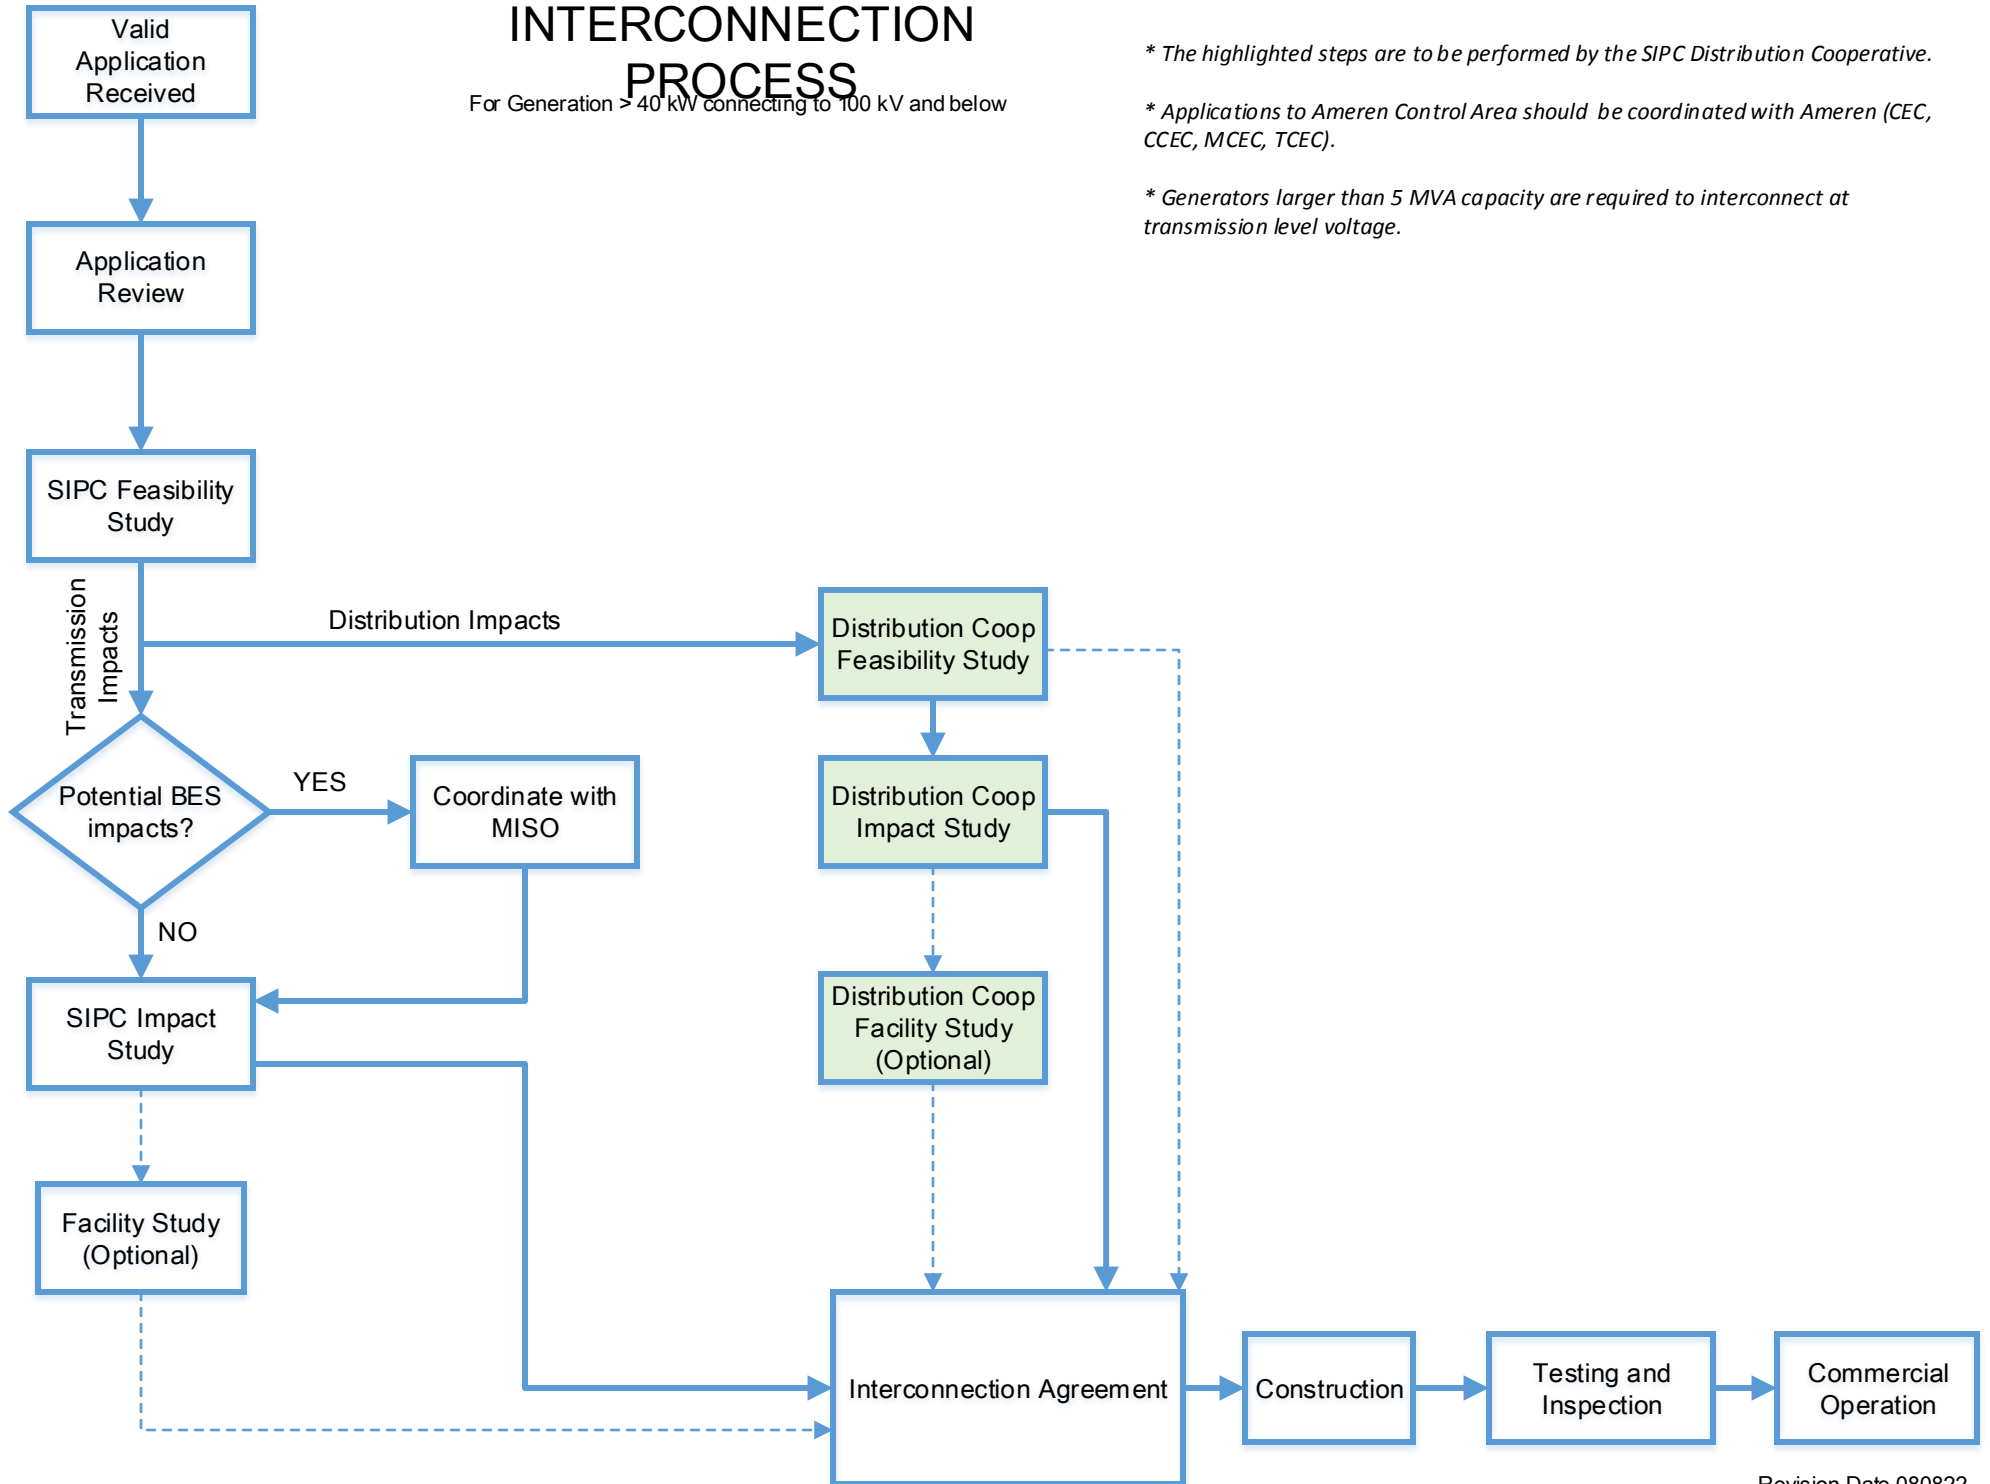

* The highlighted steps are to be performed by the SIPC Distribution Cooperative.

* Applications to Ameren Control Area should be coordinated with Ameren (CEC, CCEC, MCEC, TCEC).

* Generators larger than 5 MVA capacity are required to interconnect at transmission level voltage.